

STATE OF DELAWARE

This Copy is for information only.
You must request a CD from
DeIDOT in order to bid.



DEPARTMENT OF TRANSPORTATION

BID PROPOSAL

for

CONTRACT T201200108.01

FEDERAL AID PROJECT NO. ESTP-N026(09)

HEP, SR 72 AND OLD BALTIMORE PIKE INTERSECTION IMPROVEMENTS

NEW CASTLE COUNTY

ADVERTISEMENT DATE: April 17, 2017

COMPLETION TIME: 187 Calendar Days

SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION
DELAWARE DEPARTMENT OF TRANSPORTATION
AUGUST 2001

Bids will be received in the Bidder's Room at the Delaware Department of Transportation's Administration Building, 800 Bay Road, Dover, Delaware until 2:00 P.M. local time May 16, 2017

Contract No. T201200108.01
Federal Aid Project No. ESTP-N026(09)

HEP, SR 72 AND OLD BALTIMORE PIKE INTERSECTION IMPROVEMENTS
NEW CASTLE COUNTY

GENERAL DESCRIPTION

LOCATION

These improvements are located in New Castle County more specifically shown on the Location Map(s) of the enclosed Plans.

DESCRIPTION

This project involves intersection improvements at the intersection of SR72 and Old Baltimore Pike, including median modifications at Royal Farms entrances along SR 72 and Old Baltimore Pike. An additional left-turn lane will be constructed along eastbound Old Baltimore. The improvements consist of furnishing all labor and materials, and other incidental construction in accordance with the location, notes and details shown on the plans and as directed by the Engineer.

COMPLETION TIME

All work on this contract must be complete within 187 Calendar Days. The Contract Time includes an allowance for 23 Weather Days. It is the Department's intent to issue a Notice to Proceed such that work starts on or about June 30, 2017.

PROSPECTIVE BIDDERS NOTES:

1. BIDDERS MUST BE REGISTERED with DeIDOT and request a cd of the official plans and specifications in order to submit a bid. Contact DeIDOT at dot-ask@state.de.us, or (302) 760-2031. Bids will be received in the Bidder's Room at the Delaware Department of Transportation's Administration Building, 800 Bay Road, Dover, Delaware until 2:00 P.M. local time May 16, 2017 unless changed via addendum.
2. QUESTIONS regarding this project are to be e-mailed to dot-ask@state.de.us no less than six business days prior to the bid opening date in order to receive a response. Please include T201200108.01 in the subject line. Responses to inquiries are posted on-line at <http://www.bids.delaware.gov>.
3. THE BID PROPOSAL incorporates a cd containing **Expedite, version 5.9a** and its installation file. Bidders are to use the cd provided to enter their bid amounts into the Expedite file. The Expedite bid file must be printed and submitted in paper form along with the cd and other required documents prior to the Bid due date and time.
4. SURETY BOND - Each proposal must be accompanied by a deposit of either surety bond or security for a sum equal to at least 10% of the bid.
5. DRUG TESTING - Regulation 4104; The state Office of Management and Budget has developed regulations that require Contractors and Subcontractors to implement a program of mandatory drug testing for Employees who work on Large Public Works Contracts funded all or in part with public funds pursuant to 29 Del.C. §6908(a)(6). **Refer to the full requirements by following the below link:** <http://regulations.delaware.gov/register/september2015/final/19%20DE%20Reg%20207%2009-01-15.htm>

Please note a few of the requirements listed below;

- * At bid submission - submit with the bid a signed affidavit certifying that the Contractor has in place or will implement during the entire term of the contract a Mandatory Drug Testing Program for their Employees that complies with this regulation;
- * Upon DBE participation submission - submit a separate signed affidavit from each DBE Subcontractor certifying they have in place or will implement during the entire term of the contract a Mandatory Drug Testing Program for their Employees that complies with this regulation;
- * Two business days prior to contract execution - The awarded Contractor shall provide to DeIDOT copies of the Employee Drug Testing Program for the Contractor and each participating DBE firm;
- * Subcontractors - Contractors that employ Subcontractors on the job site may do so only after submitting a copy of the Subcontractor's Employee Drug Testing Program along with the standard required subcontractor information. A Subcontractor shall not commence work until **DeIDOT** has approved the subcontractor in writing;
- * Testing Report Forms shall be submitted to DeIDOT monthly (forms will be provided).
- * Penalties for non-compliance are specified in the regulation.

6. SUPPLEMENTAL SPECIFICATIONS to the August 2001 Standard Specifications were issued November 24, 2014 and apply to this project. They can be [viewed here](#). The *Specifications Note* document is for the use by the bidders to reference the new numbers to the past numbers used for bidding purposes on previous Department contracts.
7. **DBE PROGRAM REQUIREMENTS under 49CFR §26.53(b)(3)(i)(B) change effective January 1, 2017. Submission of DBE participation information is now required from the lowest apparent bidder no later than five (5) calendar days after bid opening (formerly 7 days).**
8. No RETAINAGE will be withheld on this contract.
9. EXTERNAL COMPLAINT PROCEDURE can be viewed on DelDOT's Website at; <http://www.deldot.gov/information/business/>, or you may request a copy by calling (302) 760-2555.
10. BREAKOUT SHEETS MUST be submitted either with your bid documents; or within seven (7) calendar days following the bid due date by the lowest apparent bidder. Refer to instructions adjacent to the Breakout Sheets in this document.
11. Road User Costs:

Road User Costs (RUC): The Contractor must maintain traffic lanes and shoulder of SR 72 and Old Baltimore Pike as specified in the contract plans.

Phases 1 and 7B – Weekend Closure of Eastern Leg of Old Baltimore Pike @ SR 72:

During Phase 1 and 7B, the eastern leg of the SR 72/Old Baltimore Pike intersection is permitted to be closed for one weekend each starting 7:00 PM Friday until 6:00 AM Monday. The Department will assess the Contractor Road User Cost for failure to have the eastern leg of the intersection fully open to traffic by 6:00 AM at the end of each weekend closure according to the below chart as follows:

Contractor Penalties for Failure to Open Eastern Leg of Intersection by Monday at 6:00 AM	
Time Road Reopened ("Verizon Time")	Road User Cost
Before 6:00 AM	No Cost
6:01 AM through 6:15 AM	\$875.00
6:16 AM through 6:30 AM	\$1,750.00
6:31 AM through 6:45 AM	\$2,625.00
6:46 AM through 7:00 AM	\$3,500.00
7:01 AM through 7:15 AM	\$4,125.00
7:16 AM through 7:30 AM	\$4,750.00
7:31 AM through 7:45 AM	\$5,375.00
7:46 AM through 8:00 AM	\$6,000.00
For every hour, or portion thereof, after 8:00 AM, \$1,500.00 will be assessed up to a maximum Day Total of \$15,000.00	

Each listed Road User Cost represents the total delay and operating cost based on average hourly traffic and the time that elapses between the above specified reopening time and the "Verizon" time that all lanes are reopened to traffic.

Examples of calculations for assessment of Road User Cost:

Failure to have all lanes of traffic open until 9:22 AM, local time:

- 6:01 AM through 8:00 AM = \$6,000.00;
- 8:01 AM through 9:00 AM = \$1,500.00;
- 9:01 AM through 9:22 AM = \$1,500.00;

A Road User Cost of \$9,000.00 will be assessed.

Phase 4 – 18-Day Closure of Western Leg of Old Baltimore Pike @ SR 72:

During Phase 4, the western leg of the SR 72/Old Baltimore Pike intersection is permitted to be closed for 18 consecutive days. The Department will assess the Contractor a Daily Road User Cost of \$73,000.00 per day for failure to have the western leg of the intersection fully open to traffic by 6:00AM on the 19th day.

12. **Additional Insurance:**

Please see Section XV. **Insurance, paragraph iii**, located on page 143 of this document. There are additional insurance requirements related to the railroad agreement.

Contract No.T201200108.01
CONSTRUCTION ITEMS UNITS OF MEASURE

English Code	English Description	Multiply By	Metric Code	Metric Description	Suggested CEC Metric Code
ACRE	Acre	0.4047	ha	Hectare	HECTARE
BAG	Bag	N/A	Bag	Bag	BAG
C.F.	Cubic Foot	0.02832	m ³	Cubic Meter	M3
C.Y.	Cubic Yard	0.7646	m ³	Cubic Meter	M3
EA-DY	Each Day	N/A	EA-DY	Each Day	EA-DY
EA-MO	Each Month	N/A	EA-MO	Each Month	EA-MO
EA/NT	Each Night	N/A	EA-NT	Each Night	EA/NT
EACH	Each	N/A	EA	Each	EACH
GAL	Gallon	3.785	L	Liter	L
HOUR	Hour	N/A	h	Hour	HOUR
INCH	Inch	25.4	mm	Millimeter	MM
L.F.	Linear Foot	0.3048	m	Linear Meter	L.M.
L.S.	Lump Sum	N/A	L.S.	Lump Sum	L.S.
LA-MI	Lane Mile	1.609	LA-km	Lane-Kilometer	LA-KM
LB	Pound	0.4536	kg	Kilogram	KG
MFBM	Thousand Feet of Board Measure	2.3597	m ³	Cubic Meter	M3
MGAL	Thousand Gallons	3.785	kL	Kiloliter	KL
MILE	Mile	1.609	km	Kilometer	KM
S.F.	Square Foot	0.0929	m ²	Square Meter	M2
S.Y.	Square Yard	0.8361	m ²	Square Meter	M2
SY-IN	Square Yard-Inch	0.8495	m ² -25 mm	Square Meter-25 Millimeter	M2-25 MM
TON	Ton	.9072	t	Metric Ton (1000kg)	TON
N.A.*	Kip	4.448	kN	Kilonewton	N.A.*
N.A.*	Thousand Pounds per Square Inch	6.895	MPa	Megapascal	N.A.*

*Not used for units of measurement for payment.

TABLE OF CONTENTS

GENERAL DESCRIPTION	<u>i</u>
LOCATION.....	<u>i</u>
DESCRIPTION.....	<u>i</u>
COMPLETION TIME.....	<u>i</u>
PROSPECTIVE BIDDERS NOTES.....	<u>i</u>
CONSTRUCTION ITEMS UNITS OF MEASURE.....	<u>iv</u>
GENERAL NOTICES	<u>1</u>
SPECIFICATIONS.....	<u>1</u>
CLARIFICATIONS.....	<u>1</u>
ATTESTING TO NON-COLLUSION.....	<u>1</u>
QUANTITIES.....	<u>1</u>
EQUALITY OF EMPLOYMENT OPPORTUNITY ON PUBLIC WORKS.....	<u>1</u>
TAX CLEARANCE.....	<u>2</u>
LICENSE.....	<u>2</u>
DIFFERING SITE CONDITIONS.....	<u>2</u>
CONFLICT WITH FEDERAL STATUTES OR REGULATIONS.....	<u>3</u>
FEDERAL LABOR AND EMPLOYMENT REQUIREMENTS.....	<u>3</u>
CONVICT PRODUCED MATERIALS:.....	<u>3</u>
TO REPORT BID RIGGING ACTIVITIES.....	<u>4</u>
NOTICE OF REQUIREMENT FOR AFFIRMATIVE ACTION.....	<u>5</u>
STANDARD FEDERAL EQUAL EMPLOYMENT OPPORTUNITY.....	<u>6</u>
TRAINING SPECIAL PROVISIONS.....	<u>9</u>
INTERMODAL SURFACE TRANSPORTATION EFFICIENCY ACT.....	<u>10</u>
DISADVANTAGED BUSINESS ENTERPRISE (DBE) PROGRAM SPECIFICATION.....	<u>10</u>
CRITICAL DBE REQUIREMENTS.....	<u>12</u>
GUIDANCE FOR GOOD FAITH EFFORT.....	<u>13</u>
REQUIRED CONTRACT PROVISIONS - FEDERAL-AID CONSTRUCTION CONTRACTS	<u>15</u>
I. GENERAL.....	<u>15</u>
II. NONDISCRIMINATION.....	<u>15</u>
III. NONSEGREGATED FACILITIES.....	<u>19</u>
IV. DAVIS-BACON AND RELATED ACT PROVISIONS.....	<u>19</u>
V. CONTRACT WORK HOURS AND SAFETY STANDARDS ACT.....	<u>24</u>
VI. SUBLETTING OR ASSIGNING THE CONTRACT.....	<u>24</u>
VII. SAFETY: ACCIDENT PREVENTION.....	<u>25</u>
VIII. FALSE STATEMENTS CONCERNING HIGHWAY PROJECTS.....	<u>26</u>
IX. IMPLEMENTATION OF CLEAN AIR & WATER POLLUTION CONTROL ACT.....	<u>26</u>
X. CERTIFICATION REGARDING DEBARMENT, SUSPENSION, INELIGIBILITY.....	<u>26</u>
XI. CERTIFICATION REGARDING USE OF CONTRACT FUNDS FOR LOBBYING....	<u>29</u>
CARGO PREFERENCE ACT (NEW).....	<u>30</u>
BUY AMERICA (NEW).....	<u>30</u>
APPENDICES TO THE TITLE VI ASSURANCE.....	<u>32</u>
PREVAILING WAGES	<u>34</u>
PREVAILING WAGE REQUIREMENTS.....	<u>34</u>
APPLICABILITY OF DAVIS-BACON LABOR STANDARD PROVISIONS TO FLAG....	<u>38</u>
ALL AGENCY MEMORANDUM NO. 130.....	<u>38</u>
SUPPLEMENTAL SPECIFICATIONS	<u>40</u>
SPECIAL PROVISIONS	<u>41</u>
CONSTRUCTION ITEM NUMBERS.....	<u>42</u>
401502 - ASPHALT CEMENT COST ADJUSTMENT.....	<u>43</u>
202573 - TEST HOLES.....	<u>44</u>
302514 - MILLED HOT-MIX BASE COURSE.....	<u>45</u>
401699 - QUALITY CONTROL/QUALITY ASSURANCE OF BITUMINOUS CONCRETE.....	<u>47</u>
401752 - SAFETY EDGE FOR ROADWAY PAVEMENT.....	<u>59</u>
401816 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE B, 160 GYRATIONS, PG 76-..	<u>60</u>
401819 - BITUMINOUS CONCRETE, SUPERPAVE, BITUMINOUS CONCRETE BASE..	<u>60</u>

401821 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 64-..	<u>60</u>
401822 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE B, 160 GYRATIONS, PG 64-..	<u>60</u>
401823 - BITUMINOUS CONCRETE, SUPERPAVE, BITUMINOUS CONCRETE BASE ..	<u>60</u>
401824 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG-64 ..	<u>60</u>
401833 -BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 76-22,.	<u>60</u>
614508 - WATER MAIN AND ACCESSORIES.	<u>71</u>
705505 - RESET STONE/BRICK SIDEWALK AND/OR STONE/BRICK ROADWAY.	<u>75</u>
705528 - TEMPORARY CURB RAMP.....	<u>76</u>
705530 – TRIANGULAR CHANNELIZING ISLANDS.	<u>77</u>
710501 - CONVERTING EXISTING CATCH BASIN TO MANHOLE.	<u>79</u>
710506 - ADJUST AND REPAIR EXISTING SANITARY MANHOLE.....	<u>80</u>
743552 – PEDESTRIAN CHANNELIZING BARRICADE SYSTEM.....	<u>81</u>
744524 - CONDUIT JUNCTION WELL, TYPE 5, PRECAST CONCRETE.....	<u>82</u>
744530 - CONDUIT JUNCTION WELL, TYPE 11, PRECAST CONCRETE/POLYMER LID.	<u>82</u>
744531 - CONDUIT JUNCTION WELL, TYPE 14, PRECAST CONCRETE/POLYMER LID.	<u>82</u>
744544 – ADJUST OR REPAIR EXISTING CONDUIT JUNCTION WELL.	<u>85</u>
745602 - FURNISH & INSTALL UP TO 4” SCHEDULE 80 HDPE CONDUIT (BORE). . . .	<u>86</u>
745603 - FURNISH & INSTALL UP TO 4” SCHEDULE 80 PVC CONDUIT (OPEN CUT). .	<u>86</u>
745604 - FURNISH & INSTALL UP TO 4” SCHEDULE 80 PVC CONDUIT (TRENCH). . .	<u>86</u>
745606 - FURNISH & INSTALL UP TO 4” GALVANIZED STEEL CONDUIT (TRENCH). .	<u>86</u>
746517 - ALUMINUM LIGHTING STANDARD WITH SINGLE DAVIT ARM, 30' POLE..	<u>90</u>
746558 - POLE BASE, TYPE 3C.....	<u>95</u>
746614 - POLE BASE EXTENSION.....	<u>96</u>
746849 - POLE BASE, TYPE 3B.....	<u>97</u>
746850 - POLE BASE, TYPE 4A.	<u>97</u>
746852 - POLE BASE, TYPE 6	<u>97</u>
746907 - FURNISH & INSTALL 1-CONDUCTOR #2 AWG STRANDED COPPER.....	<u>99</u>
746909 - FURNISH & INSTALL 1-CONDUCTOR #6 AWG STRANDED COPPER.....	<u>99</u>
746914 - FURNISH & INSTALL #6 BARE STRANDED COPPER GROUND.	<u>99</u>
746924 - FURNISH & INSTALL LOOP WIRE 1-CONDUCTOR #14 AWG ENCASED IN.	<u>103</u>
746925 – FURNISH & INSTALL EMBEDDED METERED SERVICE PEDESTAL	<u>105</u>
747513 - LIGHTING CONTROL AND DISTRIBUTION ENCLOSURE (120/240 100 AMP.	<u>106</u>
747515 - CABINET BASE TYPE M.	<u>108</u>
747516 - CABINET BASE TYPE P.....	<u>108</u>
747517 - CABINET BASE TYPE R.	<u>108</u>
748548 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/.	<u>109</u>
748530 - REMOVAL OF PAVEMENT STRIPING.	<u>118</u>
748553 - PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT	<u>119</u>
749687 - INSTALLATION OR REMOVAL OF TRAFFIC SIGN ON SINGLE SIGN.	<u>123</u>
749688 - INSTALLATION OF 4” DIAMETER HOLE, LESS THAN OR EQUAL TO 6” IN .	<u>124</u>
749690 - INSTALLATION OR REMOVAL OF TRAFFIC SIGN ON MULTIPLE SIGN . . .	<u>125</u>
763501 - CONSTRUCTION ENGINEERING.....	<u>126</u>
763502 - MAINTENANCE OF RAILROAD TRAFFIC	<u>133</u>
907510 - COMPOST FILTER LOG.....	<u>147</u>
UTILITY STATEMENT.....	<u>149</u>
RIGHT OF WAY CERTIFICATE.....	<u>157</u>
ENVIRONMENTAL STATEMENT.....	<u>158</u>
RAILROAD STATEMENT.....	<u>160</u>
BID PROPOSAL FORMS.....	<u>161</u>
BREAKOUT SHEET.....	<u>174</u>
DRUG TESTING AFFIDAVIT.....	<u>177</u>
CERTIFICATION.....	<u>178</u>
BID BOND.....	<u>180</u>

GENERAL NOTICES

SPECIFICATIONS:

The specifications entitled "Delaware Standard Specifications for Road and Bridge Construction, August, 2001", hereinafter referred to as the Standard Specifications; Supplemental Standard Specifications; the Special Provisions; notes on the Plans; this Bid Proposal; and any addenda thereto, shall govern the work to be performed under this contract.

CLARIFICATIONS:

Under any Section or Item included in the Contract, the Contractor shall be aware that when requirements, responsibilities, and furnishing of materials are outlined in the details and notes on the Plans and in the paragraphs preceding the "Basis of Payment" paragraph in the Standard Specifications or Special Provisions, no interpretation shall be made that such stipulations are excluded because reiteration is not made in the "Basis of Payment" paragraph.

ATTESTING TO NON-COLLUSION:

The Department requires as a condition precedent to acceptance of bids a sworn statement executed by, or on behalf of, the person, firm, association, or corporation to whom such contract is to be awarded, certifying that such person, firm, association, or corporation has not, either directly or indirectly, entered into any agreement, participated in any collusion, or otherwise taken any action in restraint of free competitive bidding in connection with such contract. The form for this sworn statement is included in the proposal and must be properly executed in order to have the bid considered.

QUANTITIES:

The quantities shown are for comparison of bids only. The Department may increase or decrease any quantity or quantities without penalty or change in the bid price.

EQUALITY OF EMPLOYMENT OPPORTUNITY ON PUBLIC WORKS:

Delaware Code, Title 29, Chapter 69, Section 6962, Paragraph (d), Subsection (7) states;

- a. As a condition of the awarding of any contract for public works financed in whole or in part by State appropriation, such contracts shall include the following provisions:

During the performance of this contract, the contractor agrees as follows:

1. The contractor will not discriminate against any employee or applicant for employment because of race, creed, color, sex, sexual orientation, gender identity or national origin. The contractor will take positive steps to ensure that applicants are employed and that employees are treated during employment without regard to their race, creed, color, sex, sexual orientation, gender identity or national origin. Such action shall include, but not be limited to, the following: employment, upgrading, demotion or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship. The contractor agrees to post in conspicuous places available to employees and applicants for employment notices to be provided by the contracting agency setting forth this nondiscrimination clause.
2. The contractor will, in all solicitations or advertisements for employees placed by or on behalf of the contractor, state that all qualified applicants will receive consideration for employment without regard to race, creed, color, sex, sexual orientation, gender identity or national origin.
3. The contractor will ensure employees receive equal pay for equal work, without regard to sex. Employee pay differential is acceptable if pursuant to a seniority system, a merit system, a system which measures earnings by quantity or quality of production, or if the differential is based on any other factor other than sex.

TAX CLEARANCE:

As payments to each vendor or contractor aggregate \$2,000, the Division of Accounting will report such vendor or contractor to the Division of Revenue, who will then check the vendor or contractor's compliance with tax requirements and take such further action as may be necessary to insure compliance.

LICENSE:

A person desiring to engage in business in this State as a contractor shall obtain a license upon making application to the Division of Revenue. Proof of said license compliance to be made prior to, or in conjunction with, the execution of a contract to which he has been named.

SUBCONTRACTOR LICENSE: 29 DEL. C. §6967:

(c) Any contractor that enters a public works contract must provide to the agency to which it is contracting, within 30 days of entering such public works contract, copies of all occupational and business licenses of subcontractors and/or independent contractors that will perform work for such public works contract. However, if a subcontractor or independent contractor is hired or contracted more than 20 days after the contractor entered the public works contract the occupational or business license of such subcontractor or independent contractor shall be provided to the agency within 10 days of being contracted or hired.

DIFFERING SITE CONDITIONS,

SUSPENSIONS OF WORK and SIGNIFICANT CHANGES IN THE CHARACTER OF WORK:

Differing site conditions: During the progress of the work, if subsurface or latent physical conditions are encountered at the site differing materially from those indicated in the contract or if unknown physical conditions of an unusual nature, differing materially from those ordinarily encountered and generally recognized as inherent in the work provided for in the contract are encountered at the site, the party discovering such conditions shall promptly notify the other party in writing of the specific differing conditions before they are disturbed and before the affected work is performed.

Upon written notification, the engineer will investigate the conditions, and if he/she determines that the conditions materially differ and cause an increase or decrease in the cost or time required for the performance of any work under the contract, an adjustment, excluding loss of anticipated profits, will be made and the contract modified in writing accordingly. The engineer will notify the contractor of his/her determination whether or not an adjustment of the contract is warranted.

No contract adjustment which results in a benefit to the contractor will be allowed unless the contractor has provided the required written notice. No contract adjustment will be allowed under their clause for any effects caused on unchanged work.

Suspensions of work ordered by the engineer: If the performance of all or any portion of the work is suspended or delayed by the engineer in writing for an unreasonable period of time (not originally anticipated, customary or inherent to the construction industry) and the contractor believes that additional compensation and/or contract time is due as a result of such suspension or delay, the contractor shall submit to the engineer in writing a request for adjustment within 7 calendar days of receipt of the notice to resume work. The request shall set forth the reasons and support for such adjustment.

Upon receipt, the engineer will evaluate the contractor's request. If the engineer agrees that the cost and/or time required for the performance of the contract has increased as a result of such suspension and the suspension was caused by conditions beyond the control of and not the fault of the contractor, its suppliers, or subcontractors at any approved tier, and not caused by weather, the engineer will make an adjustment (excluding profit) and modify the contract in writing accordingly. The engineer will notify the contractor of his/her determination whether or not an adjustment of the contract is warranted.

No contract adjustment will be allowed unless the contractor has submitted the request for adjustment within the time prescribed. No contract adjustment will be allowed under this clause to the extent that performance would have been suspended or delayed by any other cause, or for which an adjustment is provided for or excluded under any other term or condition of this contract.

Significant changes in the character of work: The engineer reserves the right to make, in writing, at any time during the work, such changes in quantities and such alterations in the work as are necessary to satisfactorily complete the project. Such changes in quantities and alterations shall not invalidate the contract nor release the surety, and the contractor agrees to perform the work as altered.

If the alterations or changes in quantities significantly change the character of the work under the contract, whether or not changed by any such different quantities or alterations, an adjustment, excluding loss of anticipated profits, will be made to the contract. The basis for the adjustment shall be agreed upon prior to the performance of the work. If a basis cannot be agreed upon, then an adjustment will be made either for or against the contractor in such amount as the engineer may determine to be fair and equitable.

The term "significant change" shall be construed to apply only to the following circumstances:

- (A) When the character of the work as altered differs materially in kind or nature from that involved or included in the original proposed construction or
- (B) When a major item of work, as defined elsewhere in the contract, is increased in excess of 125 percent or decreased below 75 percent of the original contract quantity. Any allowance for an increase in quantity shall apply only to that portion in excess of 125 percent of original contract item quantity, or in case of a decrease below 75 percent, to the actual amount of work performed.

CONFLICT WITH FEDERAL STATUTES OR REGULATIONS:

Delaware Code, Title 29, Chapter 69, Section 6904, Paragraph (a):

"If any provision of this subchapter conflicts or is inconsistent with any statute, rule or regulation of the federal government applicable to a project or activity, the cost of which is to be paid or reimbursed in whole or in part by the federal government, and due to such conflict or inconsistency the availability of federal funds may be jeopardized, such provision shall not apply to such project or activity."

FEDERAL LABOR AND EMPLOYMENT REQUIREMENTS

Federal Regulation 23 CFR § 635.117(b) Labor and employment, states:

"No procedures or requirement shall be imposed by any State which will operate to discriminate against the employment of labor from any other State, possession or territory of the United States, in the construction of a Federal-aid project."

CONVICT PRODUCED MATERIALS:

- (a) Materials produced after July 1, 1991, by convict labor may only be incorporated in a Federal-aid highway construction project if such materials have been:
 - (1) Produced by convicts who are on parole, supervised release, or probation from a prison or
 - (2) Produced in a qualified prison facility and the cumulative annual production amount of such materials for use in Federal-aid highway construction does not exceed the amount of such materials produced in such facility for use in Federal-aid highway construction during the 12-month period ending July 1, 1987.
- (b) Qualified prison facility means any prison facility in which convicts, during the 12-month period ending July 1, 1987, produced materials for use in Federal-aid highway construction projects.

TO REPORT BID RIGGING ACTIVITIES:

The U. S. Department of Transportation (DOT) operates the below toll-free "hotline" Monday through Friday, 8:00 a.m. to 5:00 p.m. eastern time. Anyone with knowledge of possible bid rigging, bidder collusion, or other fraudulent activities should use the "hotline" to report such activities.

The "hotline" is part of the DOT's continuing effort to identify and investigate highway construction contract fraud and abuse and is operated under the direction of the DOT Inspector General. All information will be treated confidentially and caller anonymity will be respected.

TO REPORT BID RIGGING ACTIVITIES
CALL 1-800-424-9071

NOTICE OF REQUIREMENT FOR AFFIRMATIVE ACTION
TO ENSURE EQUAL EMPLOYMENT OPPORTUNITY
(EXECUTIVE ORDER 11246)

1. The Offeror's or Bidder's attention is called to the "Equal Opportunity Clause" and the "Standard Federal Equal Employment Specifications" set forth herein.
2. The goals and timetables for minority and female participation, expressed in percentage terms for the Contractor's aggregate work force in each trade on all construction work in the covered area, are as follows:

Goals for Minority Participation In
Each Trade

12.3% (New Castle County)
14.5% (Kent & Sussex Counties)

Goals for Female Participation In
Each Trade

6.9% (Entire State)

These goals are applicable to all the Contractor's construction work (whether or not it is Federal or federally assisted) performed in the covered area. If the contractor performs construction work in a geographical area located outside of the covered area, it shall apply the goals established for such geographical area where the work is actually performed. With regard to this second area, the contractor also is subject to the goals for both its federally involved and non-federally involved construction.

The Contractor's compliance with the Executive Order and the regulations in CFR Part 60-4 shall be based on its implementation of the Equal Opportunity Clause, specific affirmative action obligations required by the specifications set forth in 41 CFR 60-4.3(a), and its efforts to meet the goals. The hours of minority and female employment and training must be substantially uniform throughout the length of the contract, and in each trade, and the contractor shall make a good faith effort to employ minorities and women evenly on each of its projects. The transfer of minority or female employees or trainees from Contractor to Contractor or from project to project for the sole purpose of meeting the Contractor's goals shall be a violation of the contract, the Executive Order, and the regulations in 41 CFR Part 60-4. Compliance with the goals will be measured against the total work hours performed.

3. The Contractor shall provide written notification to the Director of the Office of Federal Contract Compliance Programs within 10 working days of award of any construction subcontract in excess of \$10,000 at any tier for construction work under the contract resulting from this solicitation. The notification shall list the name, address, and telephone number of the subcontractor; employer identification number of the subcontractor; estimated dollar amount of the subcontract; estimated starting and completion dates of the subcontract; and the geographical area in which the subcontract is to be performed.
4. As used in this Notice, and in the contract resulting from this solicitation, the "covered area" is NEW CASTLE County.

REV. 11-3-80

STANDARD FEDERAL EQUAL EMPLOYMENT OPPORTUNITY
CONSTRUCTION CONTRACT SPECIFICATIONS (EXECUTIVE ORDER 11246)

1. As used in these specifications:
 - a. "Covered area" means the geographical area described in the solicitation from which this contract resulted;
 - b. "Director" means Director, Office of Federal Contract Compliance Programs, United States Department of Labor, or any person to whom the Director delegates authority;
 - c. "Employer identification number" means the Federal Social Security number used on the Employer's Quarterly Federal Tax Return, U.S. Treasury Department Form 941.
 - d. "Minority" includes:
 - i. Black (all persons having origins in any of the Black African racial groups not of Hispanic origin);
 - ii. Hispanic (all persons of Mexican, Puerto Rican, Cuban, Central or South American or other Spanish Culture or origin, regardless of race);
 - iii. Asian and Pacific Islander (all persons having origins in any of the original peoples of the Far East, Southeast Asia, the Indian Subcontinent, or the Pacific Islands); and
 - iv. American Indian or Alaskan Native (all persons having origins in any of the original peoples of North America and maintaining identifiable tribal affiliations through membership and participation or community identification).
2. Whenever the Contractor, or any Subcontractor at any tier, subcontracts a portion of the work involving any construction trade, it shall physically include in each subcontract in excess of \$10,000 the provisions of these specifications and the Notice which contains the applicable goals for minority and female participation and which is set forth in the solicitations from which this contract resulted.
3. If the Contractor is participating (pursuant to 41 CFR 60-4.5) in a Hometown Plan approved by the U.S. Department of Labor in the covered area either individually or through an association, its affirmative action obligations on all work in the Plan area (including goals and timetables) shall be in accordance with that Plan for those trades which have unions participating in the Plan. Contractors must be able to demonstrate their participation in and compliance with the provisions of any such Hometown Plan. Each Contractor or Subcontractor participating in an approved Plan is individually required to comply with its obligations under the EEO clause, and to make a good faith effort to achieve each goal under the Plan in each trade in which it has employees. The overall good faith performance by other Contractors or Subcontractors toward a goal in an approved plan does not excuse any covered Contractor's or Subcontractor's failure to take good faith efforts to achieve the Plan goals and timetables.
4. The Contractor shall implement the specific affirmative action standards provided in paragraphs 7a through 7p of these specifications. The goals set forth in the solicitation from which this contract resulted are expressed as percentages of the total hours of employment and training of minority and female utilization the Contractor should reasonably be able to achieve in each construction trade in which it has employees in the covered area. Covered Construction contractors performing construction work in geographical areas where they do not have a Federal or federally assisted construction contract shall apply the minority and female goals established for the geographical area where the work is being performed. Goals are published periodically in the Federal Register in notice form, and such notices may be obtained from any Office of Federal Contract Compliance Program Office or from the Federal procurement contracting offices. The Contractor is expected to make substantially uniform progress in meeting its goals in each craft during the period specified.
5. Neither the provisions of any collective bargaining agreement, nor the failure by a union with whom the Contractor has a collective bargaining agreement, to refer either minorities or women shall excuse the Contractor's obligations under these specifications, Executive Order 11246, or the regulations promulgated pursuant thereto.
6. In order for the nonworking training hours of apprentices and trainees to be counted in meeting the goals, such apprentices and trainees must be employed by the Contractor during the training period, and the Contractor must have made a commitment to employ the apprentices and trainees at the completion of their training, subject to the availability of employment opportunities. Trainees must be trained pursuant to training programs approved by the U.S. Department of Labor.

7. The Contractor shall take specific affirmative actions to ensure equal employment opportunity. The evaluation of the Contractor's compliance with these specifications shall be based upon its effort to achieve maximum results from its actions. The Contractor shall document these efforts fully, and shall implement affirmative action steps at least as extensive as the following:
 - a. Ensure and maintain a working environment free of harassment, intimidation, and coercion at all sites, and in all facilities at which the Contractor's employees are assigned to work. The Contractor, where possible, will assign two or more women to each construction project. The Contractor shall specifically ensure that all foremen, superintendents, and other on-site supervisory personnel are aware of and carry out the Contractor's obligation to maintain such a working environment, with specific attention to minority or female individuals working at such sites or in such facilities.
 - b. Establish and maintain a current list of minority and female recruitment sources, provide written notification to minority and female recruitment sources and to community organizations when the Contractor or its unions have employment opportunities available, and maintain a record of the organizations' responses.
 - c. Maintain a current file of the names, addresses and telephone numbers of each minority and female off-the-street applicant and minority or female referral from a union, a recruitment source or community organization and of what action was taken with respect to each such individual. If such individual was sent to the union hiring hall for referral and was not referred back to the Contractor by the union or, if referred, not employed by the Contractor, this shall be documented in the file with the reason therefor, along with whatever additional actions the Contractor may have taken.
 - d. Provide immediate written notification to the Director when the union or unions with which the Contractor has a collective bargaining agreement has not referred to the Contractor a minority person or woman sent by the Contractor, or when the Contractor has other information that the union referral process has impeded the Contractor's efforts to meet its obligations.
 - e. Develop on-the-job training opportunities and/or participate in training programs for the area which expressly include minorities and women, including upgrading programs and apprenticeship and trainee programs relevant to the Contractor's employment needs, especially those programs funded or approved by the Department of Labor. The Contractor shall provide notice of these programs to the sources compiled under 7b above.
 - f. Disseminate the Contractor's EEO policy by providing notice of the policy to unions and training programs and requesting their cooperation in assisting the Contractor in meeting its EEO obligations; by including it in any policy manual and collective bargaining agreement; by publicizing it in the company newspaper, annual report, etc.; by specific review of the policy with all management personnel and with all minority and female employees at least once a year; and by posting the company EEO policy on bulletin boards accessible to all employees at each location where construction work is performed.
 - g. Review, at least annually, the company's EEO policy and affirmative action obligations under these specifications with all employees having any responsibility for hiring, assignment, layoff, termination or other employment decisions including specific review of these items with on-site supervisory personnel such as Superintendents, General Foreman, etc., prior to the initiation of construction work at any job site. A written record shall be made and maintained identifying the time and place of these meetings, persons attending, subject matter discussed, and disposition of the subject matter.
 - h. Disseminate the Contractor's EEO policy externally by including it in any advertising in the news media, specifically including minority and female news media, and providing written notification to and discussing the Contractor's EEO policy with other Contractors and Subcontractors with whom the Contractor does or anticipates doing business.
 - i. Direct its recruitment efforts, both oral and written, to minority, female and community organizations, to schools with minority and female students and to minority and female recruitment and training organizations serving the Contractor's recruitment area and employment needs. Not later than one month prior to the date for the acceptance of applications for apprenticeship or other training by any recruitment source, the Contractor shall send written notification to organizations such as the above, describing the openings, screening procedures, and tests to be used in the selection process.
 - j. Encourage present minority and female employees to recruit other minority persons and women and, where reasonable, provide after school, summer and vacation employment to minority and female youth both on the site and in other areas of a Contractor's work force.
 - k. Validate all tests and other selection requirements where there is an obligation to do so under 41 CFR Part 60-3.

- l. Conduct, at least annually, an inventory and evaluation at least of all minority and female personnel for promotional opportunities and encourage these employees to seek or to prepare for, through appropriate training, etc., such opportunities.
 - m. Ensure that seniority practices, job classifications, work assignments and other personnel practices, do not have a discriminatory effect by continually monitoring all personnel and employment related activities to ensure that the EEO policy and the Contractor's obligations under these specifications are being carried out.
 - n. Ensure that all facilities and company activities are nonsegregated except that separate or single-user toilet and necessary changing facilities shall be provided to assure privacy between the sexes.
 - o. Document and maintain a record of all solicitations of offers for subcontractors from minority and female construction contractors and suppliers, including circulation of solicitations to minority and female contractor associations and other business associations.
 - p. Conduct a review, at least annually, of all supervisors' adherence to and performance under the Contractor's EEO policies and affirmative action obligations.
8. Contractors are encouraged to participate in voluntary associations which assist in fulfilling one or more of their affirmative action obligations (7a through p). The efforts of a contractor association, joint contractor-union, contractor-community, or other similar group of which the Contractor is a member and participant, may be asserted as fulfilling any one or more of its obligations under 7a through p of these Specifications provided that the Contractor actively participates in the group, makes every effort to assure that the group has a positive impact on the employment of minorities and women in the industry, ensures that the concrete benefits of the program are reflected in the Contractor's minority and female work force participating, makes a good faith effort to meet its individual goals and timetables, and can provide access to documentation which demonstrates the effectiveness of actions taken on behalf of the Contractor. The obligation to comply, however, is the Contractor's and failure of such a group to fulfill an obligation shall not be a defense for the Contractor's noncompliance.
 9. A single goal for minorities and a separate single goal for women have been established. The Contractor, however, is required to provide equal employment opportunity and to take affirmative action for all minority groups, both male and female, and all women, both minority and non-minority. Consequently, the Contractor may be in violation of the Executive Order if a particular group is employed in a substantially disparate manner (for example, even though the Contractor has achieved its goals for women generally, the Contractor may be in violation of the Executive Order if a specific minority group of women is under utilized).
 10. The Contractor shall not use the goals and timetables or affirmative action standards to discriminate against any person because of race, color, religion, sex, or national origin.
 11. The Contractor shall not enter into any Subcontract with any person or firm debarred from Government contracts pursuant to Executive Order 11246.
 12. The Contractor shall carry out such sanctions and penalties for violation of these specifications and of the Equal Opportunity Clause, including suspension, termination and cancellation of existing subcontracts as may be imposed or ordered pursuant to Executive Order 11246, as amended, and its implementing regulations, by the Order of Federal Contract Compliance Programs. Any Contractor who fails to carry out such sanctions and penalties shall be in violation of these specifications and Executive Order 11246, as amended.
 13. The Contractor, in fulfilling its obligations under these specifications, shall implement specific affirmative action steps, at least as extensive as those standards prescribed in paragraph 7 of these specifications, so as to achieve maximum results from its efforts to ensure equal employment opportunity. If the Contractor fails to comply with the requirements of the Executive Order, the implementing regulations, or these specifications, the Director shall proceed in accordance with 41 CFR 60-4.8.
 14. The Contractor shall designate a responsible official to monitor all employment-related activity to ensure that the company EEO policy is being carried out, to submit reports relating to the provisions hereof as may be required by the Government, and to keep records. Records shall at least include for each employee the name, address, telephone numbers, construction trade, union affiliation if any, employee identification number when assigned, social security number, race, sex, status (e.g., mechanic, apprentice, trainee, helper, or laborer), dates of changes in status, hours worked per week in the indicated trade, rate

of pay, and locations at which the work was performed. Records shall be maintained in an easily understandable and retrievable form; however, to the degree that existing records satisfy this requirement, contractors shall not be required to maintain separate records.

15. Nothing herein provided shall be construed as a limitation upon the application of other laws which establish different standards of compliance or upon the application of requirements for the hiring of local or other area residents (e.g., those under the Public Works Employment Act of 1977 and the Community Development Block Grant Program).

* * * * *

TRAINING SPECIAL PROVISIONS

This Training Special Provision supersedes subparagraph 7b of the Special Provision entitled "Specific Equal Employment Opportunity Responsibilities", (Attachment 1), and is in implementation of 23 U.S.C. 140(a). As part of the contractor's equal employment opportunity affirmative action program, training shall be provided as follows:

The contractor shall provide on-the-job training aimed at developing full journeyman in the type of trade or job classification involved.

The number of trainees to be trained under the special provision will be **0**. In the event the contractor subcontracts a portion of the contract work, he shall determine how many, if any, of the trainees are to be trained by the subcontractor, provided however, that the contractor shall retain the primary responsibility for meeting the training requirements imposed by this special provision. The contractor shall also insure that this Training Special Provision is made applicable to such subcontract. Where feasible, 25 percent of apprentices or trainees in each occupation shall be in their first year apprenticeship or training.

The number of trainees shall be distributed among the work classification on the basis of the contractor's needs and the availability of journeymen in the various classifications within a reasonable area of recruitment. Prior to commencing construction, the contractor shall submit to the Department of Highways and Transportation for approval the number of trainees to be trained in each selected classification and training program to be used. Furthermore, the contractor shall specify the starting time for training in each of the classifications. The contractor will be credited for each trainee employed by him on the contract work who is currently enrolled or becomes enrolled in an approved program and will be reimbursed for such trainees as provided hereinafter.

Training and upgrading of minorities and women toward journeyman status is a primary objective of this Training Special Provision. Accordingly, the contractor shall make every effort to enroll minority trainees and women (e.g., by conducting systematic and direct recruitment through public and private sources likely to yield minority and women trainees) to the extent that such persons are available within a reasonable area of recruitment. The contractor will be responsible for demonstrating the steps that he has taken in pursuance thereof, prior to a determination as to whether the contractor is in compliance with this Training Special Provision. This training commitment is not intended, and not be used, to discriminate against any applicant for training, whether a member of a minority group or not.

No employee shall be employed as a trainee in any classification in which he has successfully completed a training course leading to journeyman status or in which he has been employed as a journeyman. The contractor should satisfy this requirement by including appropriate questions in the employee application or by other suitable means. Regardless of the method used the contractor's records should document the findings in each case.

The minimum length and type of training for each classification will be as established in the training program selected by the contractor and approved by the Department of Highways and Transportation and the Federal Highway Administration. The Department of Highways and Transportation and the Federal Highway Administration shall approve a program if it is reasonably calculated to meet the equal employment opportunity obligations of the contractor and to qualify the average trainee for journeyman status in the classification concerned by the end of the training period. Furthermore, apprenticeship programs registered with the U.S. Department of Labor, Bureau of Apprenticeship and Training, or with a State apprenticeship agency recognized by the Bureau and training programs approved but not necessarily sponsored by the U.S. Department of Labor, Manpower Administration, Bureau of Apprenticeship and Training shall also be considered acceptable provided it is being administered in a manner consistent with the equal employment

obligations of Federal-aid highway construction contracts. Approval or acceptance of a training program shall be obtained from the State prior to commencing work the classification covered by the program. It is the intention of these provisions that the training is to be provided in the construction crafts rather than clerk-typists or secretarial-type positions. Training is permissible in lower level management positions such as office engineers, estimators, timekeepers, etc., where the training is oriented toward construction applications. Training in the laborer classification may be permitted provided that significant and meaningful training is provided and approved by the division office. Some off-site training is permissible as long as the training is an integral part of an approved training program and does not comprise a significant part of the overall training.

Except as otherwise noted below, the contractor will be reimbursed 80 cents per hour of training given an employee on this contract in accordance with an approved training program. As approved by the engineer, reimbursement will be made for training persons in excess of the number specified herein. This reimbursement will be made even though the contractor receives additional training program funds from other sources, provided such other sources does not specifically prohibit the contractor from receiving other reimbursement. Reimbursement for off-site training indicated above may only be made to the contractor where he does one or more of the following and the trainees are concurrently employed on a Federal-aid project; contributes to the cost of the training; provides the instruction of the trainee; or pays the trainee's wages during the off-site training period.

No payment shall be made to the contractor if either the failure to provide the required training, or the failure to hire the trainees as a journeyman, is caused by the contractor and evidences a lack of good faith on the part of the contractor in meeting the requirements of this Training Special Provision. It is normally expected that a trainee will begin his training on the project as soon as feasible after start of work utilizing the skill involved and remain on the project as long as training opportunities exist in his work classification or until he has completed his training program. It is not required that all trainees be on board for the entire length of the contract. A contractor will have fulfilled his responsibilities under this Training Special Provision if he has provided acceptable training to the number of trainees specified. The number trained shall be determined on the basis of the total number enrolled on the contract for a significant period.

Trainees will be paid a least 60 percent of the appropriate minimum journeymen's rate specified in the contract for the first half of the of the training period, 75 percent for the third quarter of the training period, and 90 percent for the last quarter of the training period, unless apprentices or trainees is an approved existing program are enrolled as trainees on this project. In fact case, the appropriate rates approved by the Department of Labor or Transportation in connection with the existing program shall apply to all trainees being trained for the same classification who are covered by this Training Special Provisions.

The contractor shall furnish the trainee a copy of the program he will follow in providing the training.

The contractor shall provide each trainee with a certification showing the type and length of training satisfactorily completed.

The contractor will provide for the maintenance of records and furnish periodic reports documenting his performance under this Training Special Provision.

* * * * *

INTERMODAL SURFACE TRANSPORTATION EFFICIENCY ACT
& TRANSPORTATION EQUITY ACT

Recipients of Federal-aid highway funds authorized under Titles I (other than Part B) and V of the Intermodal Surface Transportation Efficiency Act of 1991 (ISTEA), or Titles I, III, and V of the Transportation Equity Act for the 21st Century (TEA-21) are required to comply with the regulations of 49 Code of Federal Regulations (CFR) Part 26 - Participation by Disadvantaged Business Enterprises in Department of Transportation Financial Assistance Programs.

DISADVANTAGED BUSINESS ENTERPRISE (DBE) PROGRAM SPECIFICATION

The U.S. Department of Transportation (DOT) requires that the Delaware Department of Transportation continue the established Disadvantaged Business Enterprise (DBE) Program for participation in U.S. DOT programs and that the program follow the final rules as stated in 49 CFR Part 26 and the Department's approved DBE Program plan.

The following definitions apply to this subpart:

Disadvantaged Business Enterprise or DBE means a for-profit small business concern (1) that is at least 51 percent owned by one or more individuals who are both socially and economically disadvantaged or, in the case of a corporation, in which 51 percent of the stock is owned by one or more such individuals; and, (2) whose management and daily business operations are controlled by one or more of the socially and economically disadvantaged individuals who own it.

DOT-assisted contract means any contract between a recipient and a contractor (at any tier) funded in whole or in part with DOT financial assistance, including letters of credit or loan guarantees, except a contract solely for the purchase of land.

Good Faith Efforts means efforts to achieve a DBE goal or other requirement of this part which, by their scope, intensity, and appropriateness to the objective, can reasonably be expected to fulfill the program requirement.

Joint Venture means an association of a DBE firm and one or more other firms to carry out a single, for-profit business enterprise, for which the parties combine their property, capital, efforts, skills and knowledge, and in which the DBE is responsible for a distinct, clearly defined portion of the work of the contract and whose share in the capital contribution, control, management, risks, and profits of the joint venture are commensurate with its ownership interest.

Race-conscious measure or program is one that is focused specifically on assisting only DBEs, including women-owned DBEs.

Race-neutral measure or program is one that is, or can be, used to assist all small businesses. For the purposes of this part, race-neutral includes gender neutrality.

Small Business concern means, with respect to firms seeking to participate as DBEs in DOT-assisted contracts, a small business concern as defined pursuant to section 3 of the Small Business Act and Small Business Administration regulations implementing it (13 CFR part 121) that also does not exceed the cap on average annual gross receipts specified in 49 CFR §26.65(b).

Socially and economically disadvantaged individuals means any individual who is a citizen (or lawfully admitted permanent resident) of the United States and who is - (1) any individual who a recipient finds to be a socially and economically disadvantaged individual on a case-by-case basis; (2) any individual in the following groups, members of which are rebuttably presumed to be socially and economically disadvantaged:

- (i) Black Americans which includes persons having origins in any of the Black racial groups of Africa;
- (ii) Hispanic Americans which includes persons of Mexican, Puerto Rican, Cuban, Dominican, Central or South American, or other Spanish or Portuguese culture or origin, regardless of race;
- (iii) Native Americans which includes persons who are American Indians, Eskimos, Aluets, or Native Hawaiians;
- (iv) Asian-Pacific Americans which includes persons whose origins are from Japan, China, Taiwan, Korea, Burma (Myanmar), Vietnam, Laos, Cambodia (Kampuchea), Thailand, Malaysia, Indonesia, the Philippines, Brunei, Samoa, Guam, the U.S. Trust Territories of the Pacific Islands (Republic of Palau), the Commonwealth of the Northern Marianas Islands, Macao, Fiji, Tonga, Kiribati, Juvalu, Nauru, Federated States of Micronesia, or Hong Kong;
- (v) Subcontinent Asian Americans which includes persons whose origins are from India, Pakistan, Bangladesh, Bhutan, the Maldives Islands, Nepal or Sri Lanka;
- (vi) Women;
- (vii) Any additional groups whose members are designated as socially and economically disadvantaged by the SBA, at such time as the SBA designation becomes effective.

DelDOT will establish specific goals for each particular DOT-assisted project which will be expressed as a percentage of the total dollar amount of contract bid. The specific contract goals for this contract are:

Disadvantaged Business Enterprise 15 % Percent

DelDOT continues to reserve the right to approve DBE subcontractors and all substitutions of DBE subcontractors prior to award and during the time of the contract.

Bidders are required to submit with their bids the completed DBE Program Assurance portion of the Certification document which will state the bidders intent of meeting the goals established for this contract; or in the instance where a contractor cannot meet the assigned DBE Goals for this contract, he/she shall at the time of bid submit documentation required to verify that he/she has made a Good Faith Effort to meet the DBE Goals. Guidance for submitting a Good Faith Effort is identified in the next section and in the DBE Program Plan. Further, the apparent low bidder must submit to DelDOT within five (5) calendar days after

the bid opening, executed originals of each and every DBE subcontract to satisfy contract goals consistent with the DBE Program Assurance submitted as part of the bid package.

No contract work shall be performed by a DBE subcontractor until the executed DBE subcontract is approved in writing by DelDOT and the Department has issued the required Notice to Proceed. Any DBE subcontract relating to work to be performed pursuant to this contract, which is submitted to DelDOT for approval, must contain all DBE subcontractor information, the requirements contained in this contract, and must be fully executed by the contractor and DBE subcontractor.

Each contract between the prime contractor and each DBE subcontractor shall at the minimum include the following:

1. All pertinent provisions and requirements of the prime contract.
2. Description of the work to be performed by the DBE subcontractor.
3. The dollar value of each item of work to be completed by the DBE subcontractor and the bid price of each item of work to be completed by the DBE subcontractor.

* * * * *

CRITICAL DBE REQUIREMENTS

A bid may be held to be non-responsive and not considered if the required DBE information is not provided. In addition, the bidder may lose its bidding capability on Department projects and such other sanctions as the Department may impose. It is critical that the bidder understands:

1. In the event that the bidder cannot meet the DBE goal as set forth in this specification, he/she shall at the time of bid submit to the Department that percentage of the DBE Goal that will be met, if any, on the written and notarized assurance made a part of this contract. The contractor shall also at the time of bid submit all documentation that the contractor wishes to have the Department consider in determining that the contractor made a Good Faith Effort to meet contract DBE Goals. The Department will not accept Good Faith Effort documentation other than on the scheduled date and time of the bid opening. However, the Department may ask for clarification of information submitted should the need arise.
2. A bid which does not contain either a completely executed DBE Program Assurance and/or Good Faith Effort documentation, where appropriate, shall be declared non-responsive and shall not be considered by the Department.
3. Failure of the apparent low bidder to present originals of all DBE subcontracts to substantiate the volume of work to be performed by DBE's as indicated in the bid within five (5) calendar days after the bid opening shall create a rebuttable presumption that the bid is not responsive.
4. Bidders are advised that failure to meet DBE Goals during the term of the contract may subject them to Department sanctions as identified in the DBE Program Plan.
5. In the execution of this contract, the successful bidder agrees to comply with the following contract clauses:

Prompt Payment: The prime contractor/consultant receiving payments shall, within 30 days of receipt of any payment, file a statement with the Department on a form to be determined by the Department that all subcontractors furnishing labor or material have been paid the full sum due them at the stage of the contract, except any funds withheld under the terms of the contract as required by Chapter 8, Title 17 of the Delaware Code, annotated and as amended. Any delay or postponement of payment from the above referenced time frame may occur only for good cause following written approval of DelDOT. This clause applies to both DBE and non-DBE subcontractors.

Retainage: The prime contractor agrees to return retainage to each subcontractor within 15 calendar days after the subcontractor's work is satisfactorily completed. Any delay or postponement of payment from the above referenced time frame may occur only for good cause following written approval of DelDOT. This clause covers both DBE and non-DBE subcontractors. As guidance, once a subcontractor has satisfactorily completed the physical work, and has given to the prime contractor a certified statement that all laborers, lower tier contractors, and materialmen who have furnished labor and materials to the subcontractor have been paid all monies due them, the prime contractor shall return retainage to the subcontractor within 15 calendar days.

6. In the execution of this contract, the successful bidder agrees to comply with the following contract assurance and will include this same language in each subcontractor contract:

"The contractor or subcontractor shall not discriminate on the basis of race, color, national origin, or sex in the performance of this contract. The contractor shall carry out applicable requirements of 49 CFR Part 26 in the award and administration of DOT-assisted contracts. Failure by the contractor to carry out these requirements is a material breach of this contract, which may result in the termination of this contract or such remedy as the recipient deems appropriate." 49 CFR Section 26.13

7. In addition to this specification, bidders must comply with all provisions of the rules and regulations adopted by the U.S. Department of Transportation for DBE participation in U.S. DOT and DelDOT Programs (49 CFR Part 26) and the Delaware Department of Transportation Disadvantaged Business Enterprise Program Plan; each of which is hereby incorporated and made part of this specification. Bidders are also reminded that they must be responsible and responsive bidders in all other aspects aside from the DBE Program in order to be awarded the contract.
8. In accordance with 49 CFR 26.53(f)(1), DelDOT requires that a prime contractor not terminate a DBE subcontractor without prior written consent from the DelDOT Civil Rights Office. This includes, but is not limited to, instances in which a prime contractor seeks to perform work originally designated for a DBE subcontractor with its own forces or those of an affiliate, a non-DBE firm, or with another DBE firm.

* * * * *

GUIDANCE FOR GOOD FAITH EFFORT

When the DBE Goals established for a contract by DelDOT are not met, the contractor shall demonstrate good faith efforts to meet the DBE contract goals. The contractor shall demonstrate that the efforts made were those that a contractor actively and aggressively seeking to meet the goals established by DelDOT would make, given all relevant circumstances. Evidence of this good faith effort will be submitted with the bid at the time of the bid opening.

The contractor is expected to demonstrate good faith efforts by actively and aggressively seeking out DBE participation in the project to the maximum extent, given all relevant circumstances. Following are the kinds of efforts that may be taken but are not deemed to be exclusive or exhaustive and DelDOT will consider other factors and types of efforts that may be relevant:

1. Efforts made to select portions of the work proposed to be performed by DBEs in order to increase the likelihood of achieving the stated goal. Selection of portions of work are required to at least equal the goal for DBE utilization specified in this contract.
2. Written notification at least ten (10) calendar days prior to the opening of a bid soliciting DBE interest in participating in the contract as a subcontractor or supplier and for specific items of work.
3. Efforts made to obtain and negotiate with DBE firms for specific items of work:
 - a. Description of the means by which firms were solicited (i.e. by telephone, e-mail, written notice, advertisement).
 - b. The names, addresses, telephone numbers of DBE's contacted, the dates of initial contact; and whether initial solicitations of interest were followed-up by contacting the DBEs to determine with certainty whether the DBEs were interested.
 - c. A description of the information provided to DBE firms regarding the plans, specifications and estimated quantities for portions of the work to be performed.
 - d. A statement of why additional agreements with DBE's were not reached in order to meet the projected goal.
 - e. Listing of each DBE contacted but not contracted and the reasons for not entering a contract.
4. Efforts made to assist DBEs that need assistance in obtaining bonding, insurance, or lines of credit required by the contractor.
5. Reasons why certified DBEs are not available or not interested.
6. Efforts to effectively use the services of available disadvantaged community organizations; disadvantaged contractor's groups; local, state and federal DBE assistance offices; and other organizations that provide assistance in recruitment and placement of DBEs.

The following are examples of actions that may not be used as justification by the contractor for failure to meet DBE contract goals:

1. Failure to contract with a DBE solely because the DBE was unable to provide performance and/or payment bonds.
2. Rejection of a DBE bid or quotation based on price alone.

3. Rejection of a DBE because of its union or non-union status.
4. Failure to contract with a DBE because the contractor normally would perform all or most of the work in the contract.

Administrative reconsideration:

Within five (5) days of being informed by DelDOT that it is not responsive because it has not documented sufficient good faith efforts, a bidder may request administrative reconsideration. Bidder should make this request in writing to the following reconsideration official: Director of Administration, DelDOT, P. O. Box 778, Dover, Delaware 19903. The reconsideration official will not have played any role in the original determination that the bidder did not document sufficient good faith efforts.

As part of this reconsideration, the bidder will have the opportunity to provide written documentation or argument concerning the issue of whether it met the goal or made adequate good faith efforts to do so. The bidder will have the opportunity to meet in person with the reconsideration official, explaining the basis for finding that the bidder did or did not meet the goal or make adequate good faith efforts to do so. The final decision made by the reconsideration official will be communicated to the bidder in writing. The result of the reconsideration process is not administratively appealable to the U.S. Department of Transportation.

* * * * *

REQUIRED CONTRACT PROVISIONS - FEDERAL-AID CONSTRUCTION CONTRACTS
(Exclusive of Appalachian Contracts)

FHWA-1273 -- Revised May 1, 2012 <http://www.fhwa.dot.gov/programadmin/contracts/1273/1273.docx>

- I. General
- II. Nondiscrimination
- III. Nonsegregated Facilities
- IV. Davis-Bacon and Related Act Provisions
- V. Contract Work Hours and Safety Standards Act Provisions
- VI. Subletting or Assigning the Contract
- VII. Safety: Accident Prevention
- VIII. False Statements Concerning Highway Projects
- IX. Implementation of Clean Air Act and Federal Water Pollution Control Act
- X. Compliance with Governmentwide Suspension and Debarment Requirements
- XI. Certification Regarding Use of Contract Funds for Lobbying

I. GENERAL

1. Form FHWA-1273 must be physically incorporated in each construction contract funded under Title 23 (excluding emergency contracts solely intended for debris removal). The contractor (or subcontractor) must insert this form in each subcontract and further require its inclusion in all lower tier subcontracts (excluding purchase orders, rental agreements and other agreements for supplies or services).

The applicable requirements of Form FHWA-1273 are incorporated by reference for work done under any purchase order, rental agreement or agreement for other services. The prime contractor shall be responsible for compliance by any subcontractor, lower-tier subcontractor or service provider.

Form FHWA-1273 must be included in all Federal-aid design-build contracts, in all subcontracts and in lower tier subcontracts (excluding subcontracts for design services, purchase orders, rental agreements and other agreements for supplies or services). The design-builder shall be responsible for compliance by any subcontractor, lower-tier subcontractor or service provider.

Contracting agencies may reference Form FHWA-1273 in bid proposal or request for proposal documents, however, the Form FHWA-1273 must be physically incorporated (not referenced) in all contracts, subcontracts and lower-tier subcontracts (excluding purchase orders, rental agreements and other agreements for supplies or services related to a construction contract).

2. Subject to the applicability criteria noted in the following sections, these contract provisions shall apply to all work performed on the contract by the contractor's own organization and with the assistance of workers under the contractor's immediate superintendence and to all work performed on the contract by piecework, station work, or by subcontract.
3. A breach of any of the stipulations contained in these Required Contract Provisions may be sufficient grounds for withholding of progress payments, withholding of final payment, termination of the contract, suspension / debarment or any other action determined to be appropriate by the contracting agency and FHWA.
4. Selection of Labor: During the performance of this contract, the contractor shall not use convict labor for any purpose within the limits of a construction project on a Federal-aid highway unless it is labor performed by convicts who are on parole, supervised release, or probation. The term Federal-aid highway does not include roadways functionally classified as local roads or rural minor collectors.

II. NONDISCRIMINATION

The provisions of this section related to 23 CFR Part 230 are applicable to all Federal-aid construction contracts and to all related construction subcontracts of \$10,000 or more. The provisions of 23 CFR Part 230 are not applicable to material supply, engineering, or architectural service contracts.

In addition, the contractor and all subcontractors must comply with the following policies: Executive Order 11246, 41 CFR 60, 29 CFR 1625-1627, Title 23 USC Section 140, the Rehabilitation Act of 1973, as amended (29 USC 794), Title VI of the Civil Rights Act of 1964, as amended, and related regulations including 49 CFR Parts 21, 26 and 27; and 23 CFR Parts 200, 230, and 633.

The contractor and all subcontractors must comply with: the requirements of the Equal Opportunity Clause in 41 CFR 60-1.4(b) and, for all construction contracts exceeding \$10,000, the Standard Federal Equal Employment Opportunity Construction Contract Specifications in 41 CFR 60-4.3.

Note: The U.S. Department of Labor has exclusive authority to determine compliance with Executive Order 11246 and the policies of the Secretary of Labor including 41 CFR 60, and 29 CFR 1625-1627. The contracting agency and the FHWA have the authority and the responsibility to ensure compliance with Title 23 USC Section 140, the Rehabilitation Act of 1973, as amended (29 USC 794), and Title VI of the Civil Rights Act of 1964, as amended, and related regulations including 49 CFR Parts 21, 26 and 27; and 23 CFR Parts 200, 230, and 633.

The following provision is adopted from 23 CFR 230, Appendix A, with appropriate revisions to conform to the U.S. Department of Labor (US DOL) and FHWA requirements.

1. Equal Employment Opportunity: Equal employment opportunity (EEO) requirements not to discriminate and to take affirmative action to assure equal opportunity as set forth under laws, executive orders, rules, regulations (28 CFR 35, 29 CFR 1630, 29 CFR 1625-1627, 41 CFR 60 and 49 CFR 27) and orders of the Secretary of Labor as modified by the provisions prescribed herein, and imposed pursuant to 23 U.S.C. 140 shall constitute the EEO and specific affirmative action standards for the contractor's project activities under this contract. The provisions of the Americans with Disabilities Act of 1990 (42 U.S.C. 12101 et seq.) set forth under 28 CFR 35 and 29 CFR 1630 are incorporated by reference in this contract. In the execution of this contract, the contractor agrees to comply with the following minimum specific requirement activities of EEO:
 - a. The contractor will work with the contracting agency and the Federal Government to ensure that it has made every good faith effort to provide equal opportunity with respect to all of its terms and conditions of employment and in their review of activities under the contract.
 - b. The contractor will accept as its operating policy the following statement:
"It is the policy of this Company to assure that applicants are employed, and that employees are treated during employment, without regard to their race, religion, sex, color, national origin, age or disability. Such action shall include: employment, upgrading, demotion, or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship, pre-apprenticeship, and/or on-the-job training."
2. EEO Officer: The contractor will designate and make known to the contracting officers an EEO Officer who will have the responsibility for and must be capable of effectively administering and promoting an active EEO program and who must be assigned adequate authority and responsibility to do so.
3. Dissemination of Policy: All members of the contractor's staff who are authorized to hire, supervise, promote, and discharge employees, or who recommend such action, or who are substantially involved in such action, will be made fully cognizant of, and will implement, the contractor's EEO policy and contractual responsibilities to provide EEO in each grade and classification of employment. To ensure that the above agreement will be met, the following actions will be taken as a minimum:
 - a. Periodic meetings of supervisory and personnel office employees will be conducted before the start of work and then not less often than once every six months, at which time the contractor's EEO policy and its implementation will be reviewed and explained. The meetings will be conducted by the EEO Officer.
 - b. All new supervisory or personnel office employees will be given a thorough indoctrination by the EEO Officer, covering all major aspects of the contractor's EEO obligations within thirty days following their reporting for duty with the contractor.
 - c. All personnel who are engaged in direct recruitment for the project will be instructed by the EEO Officer in the contractor's procedures for locating and hiring minorities and women.

- d. Notices and posters setting forth the contractor's EEO policy will be placed in areas readily accessible to employees, applicants for employment and potential employees.
 - e. The contractor's EEO policy and the procedures to implement such policy will be brought to the attention of employees by means of meetings, employee handbooks, or other appropriate means.
4. Recruitment: When advertising for employees, the contractor will include in all advertisements for employees the notation: "An Equal Opportunity Employer." All such advertisements will be placed in publications having a large circulation among minorities and women in the area from which the project work force would normally be derived.
- a. The contractor will, unless precluded by a valid bargaining agreement, conduct systematic and direct recruitment through public and private employee referral sources likely to yield qualified minorities and women. To meet this requirement, the contractor will identify sources of potential minority group employees, and establish with such identified sources procedures whereby minority and women applicants may be referred to the contractor for employment consideration.
 - b. In the event the contractor has a valid bargaining agreement providing for exclusive hiring hall referrals, the contractor is expected to observe the provisions of that agreement to the extent that the system meets the contractor's compliance with EEO contract provisions. Where implementation of such an agreement has the effect of discriminating against minorities or women, or obligates the contractor to do the same, such implementation violates Federal nondiscrimination provisions.
 - c. The contractor will encourage its present employees to refer minorities and women as applicants for employment. Information and procedures with regard to referring such applicants will be discussed with employees.
5. Personnel Actions: Wages, working conditions, and employee benefits shall be established and administered, and personnel actions of every type, including hiring, upgrading, promotion, transfer, demotion, layoff, and termination, shall be taken without regard to race, color, religion, sex, national origin, age or disability. The following procedures shall be followed:
- a. The contractor will conduct periodic inspections of project sites to insure that working conditions and employee facilities do not indicate discriminatory treatment of project site personnel.
 - b. The contractor will periodically evaluate the spread of wages paid within each classification to determine any evidence of discriminatory wage practices.
 - c. The contractor will periodically review selected personnel actions in depth to determine whether there is evidence of discrimination. Where evidence is found, the contractor will promptly take corrective action. If the review indicates that the discrimination may extend beyond the actions reviewed, such corrective action shall include all affected persons.
 - d. The contractor will promptly investigate all complaints of alleged discrimination made to the contractor in connection with its obligations under this contract, will attempt to resolve such complaints, and will take appropriate corrective action within a reasonable time. If the investigation indicates that the discrimination may affect persons other than the complainant, such corrective action shall include such other persons. Upon completion of each investigation, the contractor will inform every complainant of all of their avenues of appeal.
6. Training and Promotion:
- a. The contractor will assist in locating, qualifying, and increasing the skills of minorities and women who are applicants for employment or current employees. Such efforts should be aimed at developing full journey level status employees in the type of trade or job classification involved.
 - b. Consistent with the contractor's work force requirements and as permissible under Federal and State regulations, the contractor shall make full use of training programs, i.e., apprenticeship, and on-the-job training programs for the geographical area of contract performance. In the event a special provision for training is provided under this contract, this subparagraph will be superseded as indicated in the special provision. The contracting agency may reserve training positions for persons who receive welfare assistance in accordance with 23 U.S.C. 140(a).

- c. The contractor will advise employees and applicants for employment of available training programs and entrance requirements for each.
 - d. The contractor will periodically review the training and promotion potential of employees who are minorities and women and will encourage eligible employees to apply for such training and promotion.
7. Unions: If the contractor relies in whole or in part upon unions as a source of employees, the contractor will use good faith efforts to obtain the cooperation of such unions to increase opportunities for minorities and women. Actions by the contractor, either directly or through a contractor's association acting as agent, will include the procedures set forth below:
- a. The contractor will use good faith efforts to develop, in cooperation with the unions, joint training programs aimed toward qualifying more minorities and women for membership in the unions and increasing the skills of minorities and women so that they may qualify for higher paying employment.
 - b. The contractor will use good faith efforts to incorporate an EEO clause into each union agreement to the end that such union will be contractually bound to refer applicants without regard to their race, color, religion, sex, national origin, age or disability.
 - c. The contractor is to obtain information as to the referral practices and policies of the labor union except that to the extent such information is within the exclusive possession of the labor union and such labor union refuses to furnish such information to the contractor, the contractor shall so certify to the contracting agency and shall set forth what efforts have been made to obtain such information.
 - d. In the event the union is unable to provide the contractor with a reasonable flow of referrals within the time limit set forth in the collective bargaining agreement, the contractor will, through independent recruitment efforts, fill the employment vacancies without regard to race, color, religion, sex, national origin, age or disability; making full efforts to obtain qualified and/or qualifiable minorities and women. The failure of a union to provide sufficient referrals (even though it is obligated to provide exclusive referrals under the terms of a collective bargaining agreement) does not relieve the contractor from the requirements of this paragraph. In the event the union referral practice prevents the contractor from meeting the obligations pursuant to Executive Order 11246, as amended, and these special provisions, such contractor shall immediately notify the contracting agency.
8. Reasonable Accommodation for Applicants / Employees with Disabilities: The contractor must be familiar with the requirements for and comply with the Americans with Disabilities Act and all rules and regulations established there under. Employers must provide reasonable accommodation in all employment activities unless to do so would cause an undue hardship.
9. Selection of Subcontractors, Procurement of Materials and Leasing of Equipment: The contractor shall not discriminate on the grounds of race, color, religion, sex, national origin, age or disability in the selection and retention of subcontractors, including procurement of materials and leases of equipment. The contractor shall take all necessary and reasonable steps to ensure nondiscrimination in the administration of this contract.
- a. The contractor shall notify all potential subcontractors and suppliers and lessors of their EEO obligations under this contract.
 - b. The contractor will use good faith efforts to ensure subcontractor compliance with their EEO obligations.
10. Assurance Required by 49 CFR 26.13(b):
- a. The requirements of 49 CFR Part 26 and the State DOT's U.S. DOT-approved DBE program are incorporated by reference.
 - b. The contractor or subcontractor shall not discriminate on the basis of race, color, national origin, or sex in the performance of this contract. The contractor shall carry out applicable requirements of 49 CFR Part 26 in the award and administration of DOT-assisted contracts. Failure by the contractor to carry out these requirements is a material breach of this contract, which may result in the termination of this contract or such other remedy as the contracting agency deems appropriate.

11. Records and Reports: The contractor shall keep such records as necessary to document compliance with the EEO requirements. Such records shall be retained for a period of three years following the date of the final payment to the contractor for all contract work and shall be available at reasonable times and places for inspection by authorized representatives of the contracting agency and the FHWA.
 - a. The records kept by the contractor shall document the following:
 - (1) The number and work hours of minority and non-minority group members and women employed in each work classification on the project;
 - (2) The progress and efforts being made in cooperation with unions, when applicable, to increase employment opportunities for minorities and women; and
 - (3) The progress and efforts being made in locating, hiring, training, qualifying, and upgrading minorities and women;
 - b. The contractors and subcontractors will submit an annual report to the contracting agency each July for the duration of the project, indicating the number of minority, women, and non-minority group employees currently engaged in each work classification required by the contract work. This information is to be reported on [Form FHWA-1391](#). The staffing data should represent the project work force on board in all or any part of the last payroll period preceding the end of July. If on-the-job training is being required by special provision, the contractor will be required to collect and report training data. The employment data should reflect the work force on board during all or any part of the last payroll period preceding the end of July.

III. NONSEGREGATED FACILITIES

This provision is applicable to all Federal-aid construction contracts and to all related construction subcontracts of \$10,000 or more.

The contractor must ensure that facilities provided for employees are provided in such a manner that segregation on the basis of race, color, religion, sex, or national origin cannot result. The contractor may neither require such segregated use by written or oral policies nor tolerate such use by employee custom. The contractor's obligation extends further to ensure that its employees are not assigned to perform their services at any location, under the contractor's control, where the facilities are segregated. The term "facilities" includes waiting rooms, work areas, restaurants and other eating areas, time clocks, restrooms, washrooms, locker rooms, and other storage or dressing areas, parking lots, drinking fountains, recreation or entertainment areas, transportation, and housing provided for employees. The contractor shall provide separate or single-user restrooms and necessary dressing or sleeping areas to assure privacy between sexes.

IV. DAVIS-BACON AND RELATED ACT PROVISIONS

This section is applicable to all Federal-aid construction projects exceeding \$2,000 and to all related subcontracts and lower-tier subcontracts (regardless of subcontract size). The requirements apply to all projects located within the right-of-way of a roadway that is functionally classified as Federal-aid highway. This excludes roadways functionally classified as local roads or rural minor collectors, which are exempt. Contracting agencies may elect to apply these requirements to other projects.

The following provisions are from the U.S. Department of Labor regulations in 29 CFR 5.5 "Contract provisions and related matters" with minor revisions to conform to the FHWA-1273 format and FHWA program requirements.

1. Minimum wages

- a. All laborers and mechanics employed or working upon the site of the work, will be paid unconditionally and not less often than once a week, and without subsequent deduction or rebate on any account (except such payroll deductions as are permitted by regulations issued by the Secretary of Labor under the Copeland Act (29 CFR part 3)), the full amount of wages and bona fide fringe benefits (or cash equivalents thereof) due at time of payment computed at rates not less than those contained in the wage determination of the Secretary of Labor which is attached hereto and made a part hereof, regardless of any contractual relationship which may be alleged to exist between the contractor and such laborers and mechanics.

Contributions made or costs reasonably anticipated for bona fide fringe benefits under section 1(b)(2) of the Davis-Bacon Act on behalf of laborers or mechanics are considered wages paid to such laborers or mechanics, subject to the provisions of paragraph 1.d. of this section; also, regular contributions made or costs incurred for more than a weekly period (but not less often than quarterly) under plans, funds, or programs which cover the particular weekly period, are deemed to be constructively made or incurred during such weekly period. Such laborers and mechanics shall be paid the appropriate wage rate and fringe benefits on the wage determination for the classification of work actually performed, without regard to skill, except as provided in 29 CFR 5.5(a)(4). Laborers or mechanics performing work in more than one classification may be compensated at the rate specified for each classification for the time actually worked therein: Provided, That the employer's payroll records accurately set forth the time spent in each classification in which work is performed. The wage determination (including any additional classification and wage rates conformed under paragraph 1.b. of this section) and the Davis-Bacon poster (WH-1321) shall be posted at all times by the contractor and its subcontractors at the site of the work in a prominent and accessible place where it can be easily seen by the workers.

- b. (1) The contracting officer shall require that any class of laborers or mechanics, including helpers, which is not listed in the wage determination and which is to be employed under the contract shall be classified in conformance with the wage determination. The contracting officer shall approve an additional classification and wage rate and fringe benefits therefore only when the following criteria have been met:
- (i) The work to be performed by the classification requested is not performed by a classification in the wage determination; and
 - (ii) The classification is utilized in the area by the construction industry; and
 - (iii) The proposed wage rate, including any bona fide fringe benefits, bears a reasonable relationship to the wage rates contained in the wage determination.
- (2) If the contractor and the laborers and mechanics to be employed in the classification (if known), or their representatives, and the contracting officer agree on the classification and wage rate (including the amount designated for fringe benefits where appropriate), a report of the action taken shall be sent by the contracting officer to the Administrator of the Wage and Hour Division, Employment Standards Administration, U.S. Department of Labor, Washington, DC 20210. The Administrator, or an authorized representative, will approve, modify, or disapprove every additional classification action within 30 days of receipt and so advise the contracting officer or will notify the contracting officer within the 30-day period that additional time is necessary.
- (3) In the event the contractor, the laborers or mechanics to be employed in the classification or their representatives, and the contracting officer do not agree on the proposed classification and wage rate (including the amount designated for fringe benefits, where appropriate), the contracting officer shall refer the questions, including the views of all interested parties and the recommendation of the contracting officer, to the Wage and Hour Administrator for determination. The Wage and Hour Administrator, or an authorized representative, will issue a determination within 30 days of receipt and so advise the contracting officer or will notify the contracting officer within the 30-day period that additional time is necessary.
- (4) The wage rate (including fringe benefits where appropriate) determined pursuant to paragraphs 1.b.(2) or 1.b.(3) of this section, shall be paid to all workers performing work in the classification under this contract from the first day on which work is performed in the classification.
- c. Whenever the minimum wage rate prescribed in the contract for a class of laborers or mechanics includes a fringe benefit which is not expressed as an hourly rate, the contractor shall either pay the benefit as stated in the wage determination or shall pay another bona fide fringe benefit or an hourly cash equivalent thereof.
- d. If the contractor does not make payments to a trustee or other third person, the contractor may consider as part of the wages of any laborer or mechanic the amount of any costs reasonably anticipated in providing bona fide fringe benefits under a plan or program, Provided, That the Secretary of Labor has found, upon the written request of the contractor, that the applicable standards of the Davis-Bacon Act have been met. The Secretary of Labor may require the contractor to set aside in a separate account assets for the meeting of obligations under the plan or program.

2. Withholding

The contracting agency shall upon its own action or upon written request of an authorized representative of the Department of Labor, withhold or cause to be withheld from the contractor under this contract, or any other Federal contract with the same prime contractor, or any other federally-assisted contract subject to Davis-Bacon prevailing wage requirements, which is held by the same prime contractor, so much of the accrued payments or advances as may be considered necessary to pay laborers and mechanics, including apprentices, trainees, and helpers, employed by the contractor or any subcontractor the full amount of wages required by the contract. In the event of failure to pay any laborer or mechanic, including any apprentice, trainee, or helper, employed or working on the site of the work, all or part of the wages required by the contract, the contracting agency may, after written notice to the contractor, take such action as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds until such violations have ceased.

3. Payrolls and basic records

a. Payrolls and basic records relating thereto shall be maintained by the contractor during the course of the work and preserved for a period of three years thereafter for all laborers and mechanics working at the site of the work. Such records shall contain the name, address, and social security number of each such worker, his or her correct classification, hourly rates of wages paid (including rates of contributions or costs anticipated for bona fide fringe benefits or cash equivalents thereof of the types described in section 1(b)(2)(B) of the Davis-Bacon Act), daily and weekly number of hours worked, deductions made and actual wages paid. Whenever the Secretary of Labor has found under 29 CFR 5.5(a)(1)(iv) that the wages of any laborer or mechanic include the amount of any costs reasonably anticipated in providing benefits under a plan or program described in section 1(b)(2)(B) of the Davis-Bacon Act, the contractor shall maintain records which show that the commitment to provide such benefits is enforceable, that the plan or program is financially responsible, and that the plan or program has been communicated in writing to the laborers or mechanics affected, and records which show the costs anticipated or the actual cost incurred in providing such benefits. Contractors employing apprentices or trainees under approved programs shall maintain written evidence of the registration of apprenticeship programs and certification of trainee programs, the registration of the apprentices and trainees, and the ratios and wage rates prescribed in the applicable programs.

b. (1) The contractor shall submit weekly for each week in which any contract work is performed a copy of all payrolls to the contracting agency. The payrolls submitted shall set out accurately and completely all of the information required to be maintained under 29 CFR 5.5(a)(3)(i), except that full social security numbers and home addresses shall not be included on weekly transmittals. Instead the payrolls shall only need to include an individually identifying number for each employee (e.g. , the last four digits of the employee's social security number). The required weekly payroll information may be submitted in any form desired. Optional Form WH-347 is available for this purpose from the Wage and Hour Division Web site at <http://www.dol.gov/esa/whd/forms/wh347instr.htm> or its successor site. The prime contractor is responsible for the submission of copies of payrolls by all subcontractors. Contractors and subcontractors shall maintain the full social security number and current address of each covered worker, and shall provide them upon request to the contracting agency for transmission to the State DOT, the FHWA or the Wage and Hour Division of the Department of Labor for purposes of an investigation or audit of compliance with prevailing wage requirements. It is not a violation of this section for a prime contractor to require a subcontractor to provide addresses and social security numbers to the prime contractor for its own records, without weekly submission to the contracting agency.

(2) Each payroll submitted shall be accompanied by a "Statement of Compliance," signed by the contractor or subcontractor or his or her agent who pays or supervises the payment of the persons employed under the contract and shall certify the following:

- (i) That the payroll for the payroll period contains the information required to be provided under §5.5 (a)(3)(ii) of Regulations, 29 CFR part 5, the appropriate information is being maintained under §5.5 (a)(3)(i) of Regulations, 29 CFR part 5, and that such information is correct and complete;
- (ii) That each laborer or mechanic (including each helper, apprentice, and trainee) employed on the contract during the payroll period has been paid the full weekly wages earned, without

rebate, either directly or indirectly, and that no deductions have been made either directly or indirectly from the full wages earned, other than permissible deductions as set forth in Regulations, 29 CFR part 3;

(iii) That each laborer or mechanic has been paid not less than the applicable wage rates and fringe benefits or cash equivalents for the classification of work performed, as specified in the applicable wage determination incorporated into the contract.

(3) The weekly submission of a properly executed certification set forth on the reverse side of Optional Form WH-347 shall satisfy the requirement for submission of the "Statement of Compliance" required by paragraph 3.b.(2) of this section.

(4) The falsification of any of the above certifications may subject the contractor or subcontractor to civil or criminal prosecution under section 1001 of title 18 and section 231 of title 31 of the United States Code.

c. The contractor or subcontractor shall make the records required under paragraph 3.a. of this section available for inspection, copying, or transcription by authorized representatives of the contracting agency, the State DOT, the FHWA, or the Department of Labor, and shall permit such representatives to interview employees during working hours on the job. If the contractor or subcontractor fails to submit the required records or to make them available, the FHWA may, after written notice to the contractor, the contracting agency or the State DOT, take such action as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds. Furthermore, failure to submit the required records upon request or to make such records available may be grounds for debarment action pursuant to 29 CFR 5.12.

4. Apprentices and trainees

a. Apprentices (programs of the USDOL).

Apprentices will be permitted to work at less than the predetermined rate for the work they performed when they are employed pursuant to and individually registered in a bona fide apprenticeship program registered with the U.S. Department of Labor, Employment and Training Administration, Office of Apprenticeship Training, Employer and Labor Services, or with a State Apprenticeship Agency recognized by the Office, or if a person is employed in his or her first 90 days of probationary employment as an apprentice in such an apprenticeship program, who is not individually registered in the program, but who has been certified by the Office of Apprenticeship Training, Employer and Labor Services or a State Apprenticeship Agency (where appropriate) to be eligible for probationary employment as an apprentice.

The allowable ratio of apprentices to journeymen on the job site in any craft classification shall not be greater than the ratio permitted to the contractor as to the entire work force under the registered program. Any worker listed on a payroll at an apprentice wage rate, who is not registered or otherwise employed as stated above, shall be paid not less than the applicable wage rate on the wage determination for the classification of work actually performed. In addition, any apprentice performing work on the job site in excess of the ratio permitted under the registered program shall be paid not less than the applicable wage rate on the wage determination for the work actually performed. Where a contractor is performing construction on a project in a locality other than that in which its program is registered, the ratios and wage rates (expressed in percentages of the journeyman's hourly rate) specified in the contractor's or subcontractor's registered program shall be observed.

Every apprentice must be paid at not less than the rate specified in the registered program for the apprentice's level of progress, expressed as a percentage of the journeymen hourly rate specified in the applicable wage determination. Apprentices shall be paid fringe benefits in accordance with the provisions of the apprenticeship program. If the apprenticeship program does not specify fringe benefits, apprentices must be paid the full amount of fringe benefits listed on the wage determination for the applicable classification. If the Administrator determines that a different practice prevails for the applicable apprentice classification, fringes shall be paid in accordance with that determination. In the event the Office of Apprenticeship Training, Employer and Labor Services, or a State Apprenticeship Agency recognized by the Office, withdraws approval of an apprenticeship program, the contractor will no longer be permitted to utilize apprentices at less than the applicable predetermined rate for the work performed until an acceptable program is approved.

b. Trainees (programs of the USDOL).

Except as provided in 29 CFR 5.16, trainees will not be permitted to work at less than the predetermined rate for the work performed unless they are employed pursuant to and individually registered in a program which has received prior approval, evidenced by formal certification by the U.S. Department of Labor, Employment and Training Administration.

The ratio of trainees to journeymen on the job site shall not be greater than permitted under the plan approved by the Employment and Training Administration.

Every trainee must be paid at not less than the rate specified in the approved program for the trainee's level of progress, expressed as a percentage of the journeyman hourly rate specified in the applicable wage determination. Trainees shall be paid fringe benefits in accordance with the provisions of the trainee program. If the trainee program does not mention fringe benefits, trainees shall be paid the full amount of fringe benefits listed on the wage determination unless the Administrator of the Wage and Hour Division determines that there is an apprenticeship program associated with the corresponding journeyman wage rate on the wage determination which provides for less than full fringe benefits for apprentices. Any employee listed on the payroll at a trainee rate who is not registered and participating in a training plan approved by the Employment and Training Administration shall be paid not less than the applicable wage rate on the wage determination for the classification of work actually performed. In addition, any trainee performing work on the job site in excess of the ratio permitted under the registered program shall be paid not less than the applicable wage rate on the wage determination for the work actually performed.

In the event the Employment and Training Administration withdraws approval of a training program, the contractor will no longer be permitted to utilize trainees at less than the applicable predetermined rate for the work performed until an acceptable program is approved.

- c. Equal employment opportunity. The utilization of apprentices, trainees and journeymen under this part shall be in conformity with the equal employment opportunity requirements of Executive Order 11246, as amended, and 29 CFR part 30.
- d. Apprentices and Trainees (programs of the U.S. DOT).
Apprentices and trainees working under apprenticeship and skill training programs which have been certified by the Secretary of Transportation as promoting EEO in connection with Federal-aid highway construction programs are not subject to the requirements of paragraph 4 of this Section IV. The straight time hourly wage rates for apprentices and trainees under such programs will be established by the particular programs. The ratio of apprentices and trainees to journeymen shall not be greater than permitted by the terms of the particular program.
5. Compliance with Copeland Act requirements. The contractor shall comply with the requirements of 29 CFR part 3, which are incorporated by reference in this contract.
6. Subcontracts. The contractor or subcontractor shall insert Form FHWA-1273 in any subcontracts and also require the subcontractors to include Form FHWA-1273 in any lower tier subcontracts. The prime contractor shall be responsible for the compliance by any subcontractor or lower tier subcontractor with all the contract clauses in 29 CFR 5.5.
7. Contract termination: debarment. A breach of the contract clauses in 29 CFR 5.5 may be grounds for termination of the contract, and for debarment as a contractor and a subcontractor as provided in 29 CFR 5.12.
8. Compliance with Davis-Bacon and Related Act requirements. All rulings and interpretations of the Davis-Bacon and Related Acts contained in 29 CFR parts 1, 3, and 5 are herein incorporated by reference in this contract.
9. Disputes concerning labor standards. Disputes arising out of the labor standards provisions of this contract shall not be subject to the general disputes clause of this contract. Such disputes shall be resolved in accordance with the procedures of the Department of Labor set forth in 29 CFR parts 5, 6, and 7. Disputes within the meaning of this clause include disputes between the contractor (or any of its subcontractors) and the contracting agency, the U.S. Department of Labor, or the employees or their representatives.

10. Certification of eligibility.

- a. By entering into this contract, the contractor certifies that neither it (nor he or she) nor any person or firm who has an interest in the contractor's firm is a person or firm ineligible to be awarded Government contracts by virtue of section 3(a) of the Davis-Bacon Act or 29 CFR 5.12(a)(1).
- b. No part of this contract shall be subcontracted to any person or firm ineligible for award of a Government contract by virtue of section 3(a) of the Davis-Bacon Act or 29 CFR 5.12(a)(1).
- c. The penalty for making false statements is prescribed in the U.S. Criminal Code, 18 U.S.C. 1001.

V. CONTRACT WORK HOURS AND SAFETY STANDARDS ACT

The following clauses apply to any Federal-aid construction contract in an amount in excess of \$100,000 and subject to the overtime provisions of the Contract Work Hours and Safety Standards Act. These clauses shall be inserted in addition to the clauses required by 29 CFR 5.5(a) or 29 CFR 4.6. As used in this paragraph, the terms laborers and mechanics include watchmen and guards.

1. Overtime requirements. No contractor or subcontractor contracting for any part of the contract work which may require or involve the employment of laborers or mechanics shall require or permit any such laborer or mechanic in any workweek in which he or she is employed on such work to work in excess of forty hours in such workweek unless such laborer or mechanic receives compensation at a rate not less than one and one-half times the basic rate of pay for all hours worked in excess of forty hours in such workweek.
2. Violation; liability for unpaid wages; liquidated damages. In the event of any violation of the clause set forth in paragraph (1.) of this section, the contractor and any subcontractor responsible therefor shall be liable for the unpaid wages. In addition, such contractor and subcontractor shall be liable to the United States (in the case of work done under contract for the District of Columbia or a territory, to such District or to such territory), for liquidated damages. Such liquidated damages shall be computed with respect to each individual laborer or mechanic, including watchmen and guards, employed in violation of the clause set forth in paragraph (1.) of this section, in the sum of \$10 for each calendar day on which such individual was required or permitted to work in excess of the standard workweek of forty hours without payment of the overtime wages required by the clause set forth in paragraph (1.) of this section.
3. Withholding for unpaid wages and liquidated damages. The FHWA or the contracting agency shall upon its own action or upon written request of an authorized representative of the Department of Labor withhold or cause to be withheld, from any moneys payable on account of work performed by the contractor or subcontractor under any such contract or any other Federal contract with the same prime contractor, or any other federally-assisted contract subject to the Contract Work Hours and Safety Standards Act, which is held by the same prime contractor, such sums as may be determined to be necessary to satisfy any liabilities of such contractor or subcontractor for unpaid wages and liquidated damages as provided in the clause set forth in paragraph (2.) of this section.
4. Subcontracts. The contractor or subcontractor shall insert in any subcontracts the clauses set forth in paragraph (1.) through (4.) of this section and also a clause requiring the subcontractors to include these clauses in any lower tier subcontracts. The prime contractor shall be responsible for compliance by any subcontractor or lower tier subcontractor with the clauses set forth in paragraphs (1.) through (4.) of this section.

VI. SUBLETTING OR ASSIGNING THE CONTRACT

This provision is applicable to all Federal-aid construction contracts on the National Highway System.

1. The contractor shall perform with its own organization contract work amounting to not less than 30 percent (or a greater percentage if specified elsewhere in the contract) of the total original contract price, excluding any specialty items designated by the contracting agency. Specialty items may be performed by subcontract and the amount of any such specialty items performed may be deducted from the total original contract price before computing the amount of work required to be performed by the contractor's own organization (23 CFR 635.116).

- a. The term “perform work with its own organization” refers to workers employed or leased by the prime contractor, and equipment owned or rented by the prime contractor, with or without operators. Such term does not include employees or equipment of a subcontractor or lower tier subcontractor, agents of the prime contractor, or any other assignees. The term may include payments for the costs of hiring leased employees from an employee leasing firm meeting all relevant Federal and State regulatory requirements. Leased employees may only be included in this term if the prime contractor meets all of the following conditions:
 - (1) the prime contractor maintains control over the supervision of the day-to-day activities of the leased employees;
 - (2) the prime contractor remains responsible for the quality of the work of the leased employees;
 - (3) the prime contractor retains all power to accept or exclude individual employees from work on the project; and
 - (4) the prime contractor remains ultimately responsible for the payment of predetermined minimum wages, the submission of payrolls, statements of compliance and all other Federal regulatory requirements.
 - b. "Specialty Items" shall be construed to be limited to work that requires highly specialized knowledge, abilities, or equipment not ordinarily available in the type of contracting organizations qualified and expected to bid or propose on the contract as a whole and in general are to be limited to minor components of the overall contract.
2. The contract amount upon which the requirements set forth in paragraph (1) of Section VI is computed includes the cost of material and manufactured products which are to be purchased or produced by the contractor under the contract provisions.
 3. The contractor shall furnish (a) a competent superintendent or supervisor who is employed by the firm, has full authority to direct performance of the work in accordance with the contract requirements, and is in charge of all construction operations (regardless of who performs the work) and (b) such other of its own organizational resources (supervision, management, and engineering services) as the contracting officer determines is necessary to assure the performance of the contract.
 4. No portion of the contract shall be sublet, assigned or otherwise disposed of except with the written consent of the contracting officer, or authorized representative, and such consent when given shall not be construed to relieve the contractor of any responsibility for the fulfillment of the contract. Written consent will be given only after the contracting agency has assured that each subcontract is evidenced in writing and that it contains all pertinent provisions and requirements of the prime contract.
 5. The 30% self-performance requirement of paragraph (1) is not applicable to design-build contracts; however, contracting agencies may establish their own self-performance requirements.

VII. SAFETY: ACCIDENT PREVENTION

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts.

1. In the performance of this contract the contractor shall comply with all applicable Federal, State, and local laws governing safety, health, and sanitation (23 CFR 635). The contractor shall provide all safeguards, safety devices and protective equipment and take any other needed actions as it determines, or as the contracting officer may determine, to be reasonably necessary to protect the life and health of employees on the job and the safety of the public and to protect property in connection with the performance of the work covered by the contract.
2. It is a condition of this contract, and shall be made a condition of each subcontract, which the contractor enters into pursuant to this contract, that the contractor and any subcontractor shall not permit any employee, in performance of the contract, to work in surroundings or under conditions which are unsanitary, hazardous or dangerous to his/her health or safety, as determined under construction safety and health standards (29 CFR 1926) promulgated by the Secretary of Labor, in accordance with Section 107 of the Contract Work Hours and Safety Standards Act (40 U.S.C. 3704).

3. Pursuant to 29 CFR 1926.3, it is a condition of this contract that the Secretary of Labor or authorized representative thereof, shall have right of entry to any site of contract performance to inspect or investigate the matter of compliance with the construction safety and health standards and to carry out the duties of the Secretary under Section 107 of the Contract Work Hours and Safety Standards Act (40 U.S.C.3704).

VIII. FALSE STATEMENTS CONCERNING HIGHWAY PROJECTS

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts.

In order to assure high quality and durable construction in conformity with approved plans and specifications and a high degree of reliability on statements and representations made by engineers, contractors, suppliers, and workers on Federal-aid highway projects, it is essential that all persons concerned with the project perform their functions as carefully, thoroughly, and honestly as possible. Willful falsification, distortion, or misrepresentation with respect to any facts related to the project is a violation of Federal law. To prevent any misunderstanding regarding the seriousness of these and similar acts, Form FHWA-1022 shall be posted on each Federal-aid highway project (23 CFR 635) in one or more places where it is readily available to all persons concerned with the project:

18 U.S.C. 1020 reads as follows:

"Whoever, being an officer, agent, or employee of the United States, or of any State or Territory, or whoever, whether a person, association, firm, or corporation, knowingly makes any false statement, false representation, or false report as to the character, quality, quantity, or cost of the material used or to be used, or the quantity or quality of the work performed or to be performed, or the cost thereof in connection with the submission of plans, maps, specifications, contracts, or costs of construction on any highway or related project submitted for approval to the Secretary of Transportation; or

Whoever knowingly makes any false statement, false representation, false report or false claim with respect to the character, quality, quantity, or cost of any work performed or to be performed, or materials furnished or to be furnished, in connection with the construction of any highway or related project approved by the Secretary of Transportation; or

Whoever knowingly makes any false statement or false representation as to material fact in any statement, certificate, or report submitted pursuant to provisions of the Federal-aid Roads Act approved July 1, 1916, (39 Stat. 355), as amended and supplemented;

Shall be fined under this title or imprisoned not more than 5 years or both."

IX. IMPLEMENTATION OF CLEAN AIR ACT AND FEDERAL WATER POLLUTION CONTROL ACT

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts.

By submission of this bid/proposal or the execution of this contract, or subcontract, as appropriate, the bidder, proposer, Federal-aid construction contractor, or subcontractor, as appropriate, will be deemed to have stipulated as follows:

1. That any person who is or will be utilized in the performance of this contract is not prohibited from receiving an award due to a violation of Section 508 of the Clean Water Act or Section 306 of the Clean Air Act.
2. That the contractor agrees to include or cause to be included the requirements of paragraph (1) of this Section X in every subcontract, and further agrees to take such action as the contracting agency may direct as a means of enforcing such requirements.

X. CERTIFICATION REGARDING DEBARMENT, SUSPENSION, INELIGIBILITY AND VOLUNTARY EXCLUSION

This provision is applicable to all Federal-aid construction contracts, design-build contracts, subcontracts, lower-tier subcontracts, purchase orders, lease agreements, consultant contracts or any other covered transaction requiring FHWA approval or that is estimated to cost \$25,000 or more – as defined in 2 CFR Parts 180 and 1200.

1. Instructions for Certification – First Tier Participants:

- a. By signing and submitting this proposal, the prospective first tier participant is providing the certification set out below.
- b. The inability of a person to provide the certification set out below will not necessarily result in denial of participation in this covered transaction. The prospective first tier participant shall submit an explanation of why it cannot provide the certification set out below. The certification or explanation will be considered in connection with the department or agency's determination whether to enter into this transaction. However, failure of the prospective first tier participant to furnish a certification or an explanation shall disqualify such a person from participation in this transaction.
- c. The certification in this clause is a material representation of fact upon which reliance was placed when the contracting agency determined to enter into this transaction. If it is later determined that the prospective participant knowingly rendered an erroneous certification, in addition to other remedies available to the Federal Government, the contracting agency may terminate this transaction for cause of default.
- d. The prospective first tier participant shall provide immediate written notice to the contracting agency to whom this proposal is submitted if any time the prospective first tier participant learns that its certification was erroneous when submitted or has become erroneous by reason of changed circumstances.
- e. The terms "covered transaction," "debarred," "suspended," "ineligible," "participant," "person," "principal," and "voluntarily excluded," as used in this clause, are defined in 2 CFR Parts 180 and 1200. "First Tier Covered Transactions" refers to any covered transaction between a grantee or subgrantee of Federal funds and a participant (such as the prime or general contract). "Lower Tier Covered Transactions" refers to any covered transaction under a First Tier Covered Transaction (such as subcontracts). "First Tier Participant" refers to the participant who has entered into a covered transaction with a grantee or subgrantee of Federal funds (such as the prime or general contractor). "Lower Tier Participant" refers any participant who has entered into a covered transaction with a First Tier Participant or other Lower Tier Participants (such as subcontractors and suppliers).
- f. The prospective first tier participant agrees by submitting this proposal that, should the proposed covered transaction be entered into, it shall not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from participation in this covered transaction, unless authorized by the department or agency entering into this transaction.
- g. The prospective first tier participant further agrees by submitting this proposal that it will include the clause titled "Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion-Lower Tier Covered Transactions," provided by the department or contracting agency, entering into this covered transaction, without modification, in all lower tier covered transactions and in all solicitations for lower tier covered transactions exceeding the \$25,000 threshold.
- h. A participant in a covered transaction may rely upon a certification of a prospective participant in a lower tier covered transaction that is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless it knows that the certification is erroneous. A participant is responsible for ensuring that its principals are not suspended, debarred, or otherwise ineligible to participate in covered transactions. To verify the eligibility of its principals, as well as the eligibility of any lower tier prospective participants, each participant may, but is not required to, check the Excluded Parties List System website (<https://www.epls.gov/>), which is compiled by the General Services Administration.
- i. Nothing contained in the foregoing shall be construed to require the establishment of a system of records in order to render in good faith the certification required by this clause. The knowledge and information of the prospective participant is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.
- j. Except for transactions authorized under paragraph (f) of these instructions, if a participant in a covered transaction knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily excluded from participation in this transaction, in addition to other remedies available to the Federal Government, the department or agency may terminate this transaction for cause or default.

* * * * *

2. Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion – First Tier Participants:

- a. The prospective first tier participant certifies to the best of its knowledge and belief, that it and its principals:
 - (1) Are not presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from participating in covered transactions by any Federal department or agency;
 - (2) Have not within a three-year period preceding this proposal been convicted of or had a civil judgment rendered against them for commission of fraud or a criminal offense in connection with obtaining, attempting to obtain, or performing a public (Federal, State or local) transaction or contract under a public transaction; violation of Federal or State antitrust statutes or commission of embezzlement, theft, forgery, bribery, falsification or destruction of records, making false statements, or receiving stolen property;
 - (3) Are not presently indicted for or otherwise criminally or civilly charged by a governmental entity (Federal, State or local) with commission of any of the offenses enumerated in paragraph (a)(2) of this certification; and
 - (4) Have not within a three-year period preceding this application/proposal had one or more public transactions (Federal, State or local) terminated for cause or default.
- b. Where the prospective participant is unable to certify to any of the statements in this certification, such prospective participant shall attach an explanation to this proposal.

2. Instructions for Certification - Lower Tier Participants:

(Applicable to all subcontracts, purchase orders and other lower tier transactions requiring prior FHWA approval or estimated to cost \$25,000 or more - 2 CFR Parts 180 and 1200)

- a. By signing and submitting this proposal, the prospective lower tier is providing the certification set out below.
- b. The certification in this clause is a material representation of fact upon which reliance was placed when this transaction was entered into. If it is later determined that the prospective lower tier participant knowingly rendered an erroneous certification, in addition to other remedies available to the Federal Government, the department, or agency with which this transaction originated may pursue available remedies, including suspension and/or debarment.
- c. The prospective lower tier participant shall provide immediate written notice to the person to which this proposal is submitted if at any time the prospective lower tier participant learns that its certification was erroneous by reason of changed circumstances.
- d. The terms "covered transaction," "debarred," "suspended," "ineligible," "participant," "person," "principal," and "voluntarily excluded," as used in this clause, are defined in 2 CFR Parts 180 and 1200. You may contact the person to which this proposal is submitted for assistance in obtaining a copy of those regulations. "First Tier Covered Transactions" refers to any covered transaction between a grantee or subgrantee of Federal funds and a participant (such as the prime or general contract). "Lower Tier Covered Transactions" refers to any covered transaction under a First Tier Covered Transaction (such as subcontracts). "First Tier Participant" refers to the participant who has entered into a covered transaction with a grantee or subgrantee of Federal funds (such as the prime or general contractor). "Lower Tier Participant" refers any participant who has entered into a covered transaction with a First Tier Participant or other Lower Tier Participants (such as subcontractors and suppliers).
- e. The prospective lower tier participant agrees by submitting this proposal that, should the proposed covered transaction be entered into, it shall not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from participation in this covered transaction, unless authorized by the department or agency with which this transaction originated.

- f. The prospective lower tier participant further agrees by submitting this proposal that it will include this clause titled "Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion-Lower Tier Covered Transaction," without modification, in all lower tier covered transactions and in all solicitations for lower tier covered transactions exceeding the \$25,000 threshold.
- g. A participant in a covered transaction may rely upon a certification of a prospective participant in a lower tier covered transaction that is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless it knows that the certification is erroneous. A participant is responsible for ensuring that its principals are not suspended, debarred, or otherwise ineligible to participate in covered transactions. To verify the eligibility of its principals, as well as the eligibility of any lower tier prospective participants, each participant may, but is not required to, check the Excluded Parties List System website (<https://www.epls.gov/>), which is compiled by the General Services Administration.
- h. Nothing contained in the foregoing shall be construed to require establishment of a system of records in order to render in good faith the certification required by this clause. The knowledge and information of participant is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.
- i. Except for transactions authorized under paragraph e of these instructions, if a participant in a covered transaction knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily excluded from participation in this transaction, in addition to other remedies available to the Federal Government, the department or agency with which this transaction originated may pursue available remedies, including suspension and/or debarment.

* * * * *

Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion--Lower Tier Participants:

- 1. The prospective lower tier participant certifies, by submission of this proposal, that neither it nor its principals is presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from participating in covered transactions by any Federal department or agency.
- 2. Where the prospective lower tier participant is unable to certify to any of the statements in this certification, such prospective participant shall attach an explanation to this proposal.

* * * * *

XI. CERTIFICATION REGARDING USE OF CONTRACT FUNDS FOR LOBBYING

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts which exceed \$100,000 (49 CFR 20).

- 1. The prospective participant certifies, by signing and submitting this bid or proposal, to the best of his or her knowledge and belief, that:
 - a. No Federal appropriated funds have been paid or will be paid, by or on behalf of the undersigned, to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with the awarding of any Federal contract, the making of any Federal grant, the making of any Federal loan, the entering into of any cooperative agreement, and the extension, continuation, renewal, amendment, or modification of any Federal contract, grant, loan, or cooperative agreement.
 - b. If any funds other than Federal appropriated funds have been paid or will be paid to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with this Federal contract, grant, loan, or cooperative agreement, the undersigned shall complete and submit Standard Form-LLL, "Disclosure Form to Report Lobbying," in accordance with its instructions.
- 2. This certification is a material representation of fact upon which reliance was placed when this transaction was made or entered into. Submission of this certification is a prerequisite for making or entering into this transaction imposed by 31 U.S.C. 1352. Any person who fails to file the required certification shall be subject to a civil penalty of not less than \$10,000 and not more than \$100,000 for each such failure.

3. The prospective participant also agrees by submitting its bid or proposal that the participant shall require that the language of this certification be included in all lower tier subcontracts, which exceed \$100,000 and that all such recipients shall certify and disclose accordingly.

* * * * *

CARGO PREFERENCE ACT (NEW)

Requirements in the Federal-aid Highway Program

(a) Agreement Clauses. "Use of United States-flag vessels:

(1) Pursuant to Pub. L. 664 (43 U.S.C. 1241(b)) at least 50 percent of any equipment, materials or commodities procured, contracted for or otherwise obtained with funds granted, guaranteed, loaned, or advanced by the U.S. Government under this agreement, and which may be transported by ocean vessel, shall be transported on privately owned United States-flag commercial vessels, if available.

(2) Within 20 days following the date of loading for shipments originating within the United States or within 30 working days following the date of loading for shipments originating outside the United States, a legible copy of a rated, 'on-board' commercial ocean bill-of-lading in English for each shipment of cargo described in paragraph (a)(1) of this section shall be furnished to both the Contracting Officer (through the prime contractor in the case of subcontractor bills-of-lading) and to the Division of National Cargo, Office of Market Development, Maritime Administration, Washington, DC 20590.

(b) Contractor and Subcontractor Clauses. "Use of United States-flag vessels: The contractor agrees—

(1) To utilize privately owned United States-flag commercial vessels to ship at least 50 percent of the gross tonnage (computed separately for dry bulk carriers, dry cargo liners, and tankers) involved, whenever shipping any equipment, material, or commodities pursuant to this contract, to the extent such vessels are available at fair and reasonable rates for United States-flag commercial vessels.

(2) To furnish within 20 days following the date of loading for shipments originating within the United States or within 30 working days following the date of loading for shipments originating outside the United States, a legible copy of a rated, 'on-board' commercial ocean bill-of-lading in English for each shipment of cargo described in paragraph (b) (1) of this section to both the Contracting Officer (through the prime contractor in the case of subcontractor bills-of-lading) and to the Division of National Cargo, Office of Market Development, Maritime Administration, Washington, DC 20590.

(3) To insert the substance of the provisions of this clause in all subcontracts issued pursuant to this contract.

NOTE:

This requirement applies to material or equipment that is acquired for a specific Federal-aid highway project. It is not applicable to goods or materials that come into inventories independent of an FHWA funded-contract.

* * * * *

BUY AMERICA (NEW)

Requirements in the Federal-aid Highway Program

By signing and submitting this proposal, the bidder certifies that:

In accordance with 23 U.S.C, 313 and 23 CFR 635.410, all iron and steel materials permanently incorporated into this project will be produced in the United States and that all manufacturing processes involving these materials will occur in the U.S, except that a minimal amount of foreign steel or iron materials may be used, provided the cost of the foreign materials does not exceed 0.1 percent of the total Contract cost or \$2,500.00, whichever is greater. If such minimal amount of foreign steel is used, the Contractor shall maintain a record of the costs to ensure that the allowable limit is not exceeded. This documentation shall be presented to the Department upon request.

At the Department's request, I/we will provide manufacturer's/supplier's documentation verifying domestic origin as defined in the Specifications. All Materials accepted on the basis of such Certificate of Compliance may be sampled by the Department and tested at any time. Use of Material on the basis of Certificate of Compliance shall not relieve the Contractor of responsibility for incorporating Material in the Project conforming to the requirements of the Contract. Any Material not conforming to such requirements will be subject to rejection whether in place or not. The Department reserves the right to refuse to permit the use of Material on the basis of Certificate of Compliance.

* * * * *

APPENDICES TO THE TITLE VI ASSURANCE

APPENDIX A

During the performance of this contract, the contractor, for itself, its assignees, and successors in interest (hereinafter referred to as the "contractor") agrees as follows:

1. **Compliance with Regulations:** The contractor (hereinafter includes consultants) will comply with the Acts and the Regulations relative to Non-discrimination in Federally-assisted programs of the U.S. Department of Transportation, (Federal Highway Administration (FHWA), or Federal Transit Authority (FTA)), as they may be amended from time to time, which are herein incorporated by reference and made a part of this contract.
2. **Non-discrimination:** The contractor, with regard to the work performed by it during the contract, will not discriminate on the grounds of race, color, or national origin in the selection and retention of subcontractors, including procurements of materials and leases of equipment. The contractor will not participate directly or indirectly in the discrimination prohibited by the Acts and the Regulations, including employment practices when the contract covers any activity, project, or program set forth in Appendix B of 49 CFR Part 21.
3. **Solicitations for Subcontracts, Including Procurements of Materials and Equipment:** In all solicitations, either by competitive bidding, or negotiation made by the contractor for work to be performed under a subcontract, including procurements of materials, or leases of equipment, each potential subcontractor or supplier will be notified by the contractor of the contractor's obligations under this contract and the Acts and the Regulations relative to Non-discrimination on the grounds of race, color, or national origin.
4. **Information and Reports:** The contractor will provide all information and reports required by the Acts and the Regulations, and will permit access to its books, records, accounts, other sources of information, and its facilities as may be determined by the Recipient or the Federal Highway Administration (FHWA), or Federal Transit Authority (FTA) to be pertinent to ascertain compliance with such Acts, Regulations, and instructions. Where any information required of a contractor is in the exclusive possession of another who fails or refuses to furnish the information, the contractor will so certify to the Recipient or the Federal Highway Administration (FHWA), or Federal Transit Authority (FTA), as appropriate, and will set forth what efforts it has made to obtain the information.
5. **Sanctions for Noncompliance:** In the event of a contractor's noncompliance with the Non-discrimination provisions of this contract, the Recipient will impose such contract sanctions as it or the Federal Highway Administration (FHWA), or Federal Transit Authority (FTA) may determine to be appropriate, including, but not limited to:
 - withholding payments to the contractor under the contract until the contractor complies;
 - and/or cancelling, terminating, or suspending a contract, in whole or in part.
6. **Incorporation of Provisions:** The contractor will include the provisions of paragraphs one through five in every subcontract, including procurements of materials and leases of equipment, unless exempt by the Acts and the Regulations . The contractor will take action with respect to any subcontract or procurement as the Recipient or the Federal Highway Administration (FHWA), or Federal Transit Authority (FTA) may direct as a means of enforcing such provisions including sanctions for noncompliance. Provided, that if the contractor becomes involved in, or is threatened with litigation by a subcontractor, or supplier because of such direction, the contractor may request the Recipient to enter into any litigation to protect the interests of the Recipient. In addition, the contractor may request the United States to enter into the litigation to protect the interests of the United States.

APPENDIX E

During the performance of this contract, the contractor or consultant, for itself, its assignees, and successors in interest (hereinafter referred to as the "contractor") agrees to comply with the following nondiscrimination statutes and authorities; including but not limited to:

Pertinent Non-Discrimination Authorities:

Title VI of the Civil Rights Act of 1964 (42 U.S.C. § 2000d et seq., 78 stat. 252), (prohibits discrimination on the basis of race, color, national origin); and 49 CFR Part 21.

The Uniform Relocation Assistance and Real Property Acquisition Policies Act of 1970,(42 U.S.C. § 460 D), (prohibits unfair treatment of persons displaced or whose property has been acquired because of Federal or Federal-aid programs and projects);

Federal-Aid Highway Act of 1973, (23 U.S.C. § 324 et seq.), (prohibits discrimination on the basis of sex);

Section 504 of the Rehabilitation Act of 1973, (29 U.S.C. § 794 et seq.), as amended, (prohibits discrimination on the basis of disability); and 49 CFR Part27;

The Age Discrimination Act of 1975, as amended, (42 U.S.C. § 6101 et seq.), (prohibits discrimination on the basis of age);

Airport and Airway Improvement Act of 1982,(49 USC §471, Section 47123), as amended, (prohibits discrimination based on race, creed, color, national origin, or sex);

The Civil Rights Restoration Act of 1987,(PL 100-209), (Broadened the scope, coverage and applicability of Title VI of the Civil Rights Act of 1964,The AgeDiscrimination Act of 1975and Section 504 of the Rehabilitation Act of 1973,by expanding the defrnition of the terms "programs or activities" to include all of the programs or activities of the Federal-aid recipients, sub-recipients and contractors, whether such programs or activities are Federally funded or not);

Titles II and III of the Americans with Disabilities Act, which prohibit discrimination on the basis of disability in the operation of public entities, public and private transportation systems, places of public accommodation, and certain testing entities (42 U.S.C. §§ 12131 - 12189) as implemented by Department of Transportation regulations at 49 C.F.R. parts 37 and 38;

The Federal Aviation Administration's Non-discrimination statute (49 U.S.C. S 41123) (prohibits discrimination on the basis of race, color, national origin, and sex);

Executive Order 12898, Federal Actions to Address Environmental Justice in Minority Populations and Low-Income Populations, which ensures nondiscrimination against minority populations by discouraging programs; policies, and activities with disproportionately high and adverse human health or environmental effects on minority and low-income populations;

Executive Order 13166, Improving Access to Services for Persons with Limited English Proficiency, and resulting agency guidance, national origin discrimination includes discrimination because of limited English proficiency (LEP). To ensure compliance with Title VI, you must take reasonable steps to ensure that LEP persons have meaningful access to your programs (70 Fed. Reg. at 74087 to 74100);

Title IX of the Education Amendments of 1972, as amended, which prohibits you from discriminating because of sex in education programs or activities (20 U.S.C. 1681 et seq).

* * * * *

PREVAILING WAGES

Included in this proposal are the minimum wages to be paid various classes of laborers and mechanics as determined by the Department of Labor of the State of Delaware in accordance with Title 29 Del.C. §6960, relating to wages and the regulations implementing that Section.

REQUIREMENT BY DEPARTMENT OF LABOR FOR SWORN PAYROLL INFORMATION

Title 29 Del.C. §6960 stipulates;

(b) Every contract based upon these specifications shall contain a stipulation that the employer shall pay all mechanics and laborers employed directly upon the site of the work, unconditionally and not less often than once a week and without subsequent deduction or rebate on any account, the full amounts accrued at time of payment, computed at wage rates not less than those stated in the specifications, regardless of any contractual relationship which may be alleged to exist between the employer and such laborers and mechanics. The specifications shall further stipulate that the scale of wages to be paid shall be posted by the employer in a prominent and easily accessible place at the site of the work, and that there may be withheld from the employer so much of accrued payments as may be considered necessary by the Department of Labor to pay to laborers and mechanics employed by the employer the difference between the rates of wages required by the contract to be paid laborers and mechanics on the work and rates of wages received by such laborers and mechanics to be remitted to the Department of Labor for distribution upon resolution of any claims.

(c) Every contract based upon these specifications shall contain a stipulation that sworn payroll information, as required by the Department of Labor, be furnished weekly. The Department of Labor shall keep and maintain the sworn payroll information for a period of 6 months from the last day of the work week covered by the payroll.

Bidders are specifically directed to note the Department of Labor's prevailing wage regulations implementing §6960 relating to the effective date of the wage rates, at Part VI., Section C., which in relevant part states:

"Public agencies (covered by the provisions of 29 Del.C. §6960) are required to use the rates which are in effect on the date of the publication of specifications for a given project. In the event that a contract is not executed within one hundred twenty (120) days from the date the specifications were published, the rates in effect at the time of the execution of the contract shall be the applicable rates for the project."

PREVAILING WAGE REQUIREMENTS

It is DelDOT's understanding that the Davis-Bacon Act is not a preemptive statute in the broad sense, and does not preempt or displace State of Delaware prevailing wage requirements.

When a contract for a project contains both Federal Davis-Bacon and State of Delaware prevailing wage standards because of concurrent Federal and State coverage, the employer's minimum wage obligations are determined by whichever standards are higher.

STATE OF DELAWARE
DEPARTMENT OF LABOR
DIVISION OF INDUSTRIAL AFFAIRS
OFFICE OF LABOR LAW ENFORCEMENT
PHONE: (302) 451-3423


Mailing Address:
225 CORPORATE BOULEVARD
SUITE 104
NEWARK, DE 19702

Located at:
225 CORPORATE BOULEVARD
SUITE 104
NEWARK, DE 19702

PREVAILING WAGES FOR HIGHWAY CONSTRUCTION EFFECTIVE MARCH 15, 2017

CLASSIFICATION	NEW CASTLE	KENT	SUSSEX
BRICKLAYERS	51.99	51.99	15.17
CARPENTERS	53.48	53.81	42.77
CEMENT FINISHERS	33.91	34.12	27.13
ELECTRICAL LINE WORKERS	23.52	45.39	22.22
ELECTRICIANS	66.85	66.85	66.85
IRON WORKERS	62.35	24.95	26.50
LABORERS	43.30	39.85	39.12
MILLWRIGHTS	16.84	16.34	14.11
PAINTERS	67.07	67.07	67.07
PILEDRIVERS	69.44	24.83	28.17
POWER EQUIPMENT OPERATORS	42.91	41.41	37.92
SHEET METAL WORKERS	23.79	21.23	19.23
TRUCK DRIVERS	35.73	29.51	35.95

CERTIFIED: 3/28/17

BY: 

ADMINISTRATOR, OFFICE OF LABOR LAW ENFORCEMENT

NOTE: THESE RATES ARE PROMULGATED AND ENFORCED PURSUANT TO THE PREVAILING WAGE REGULATIONS ADOPTED BY THE DEPARTMENT OF LABOR ON APRIL 3, 1992.

CLASSIFICATIONS OF WORKERS ARE DETERMINED BY THE DEPARTMENT OF LABOR. FOR ASSISTANCE IN CLASSIFYING WORKERS, OR FOR A COPY OF THE REGULATIONS OR CLASSIFICATIONS, PHONE (302) 451-3423.

NON-REGISTERED APPRENTICES MUST BE PAID THE MECHANIC'S RATE.

PROJECT: T201200108.01 SR72 and Old Baltimore Pike Intersection Improvements, New Castle County

Note: Executive Order (EO) 13706, Establishing Paid Sick Leave for Federal Contractors applies to all contracts subject to the Davis-Bacon Act for which the contract is awarded (and any sollicitation was issued) on or after January 1, 2017. If this contract is covered by the EO, the contractor must provide employees with 1 hour of paid sick leave for every 30 hours they work, up to 56 hours of paid sick leave each year. Employees must be permitted to use paid sick leave for their own illness, injury or other health-related needs, including preventive care; to assist a family member (or person who is like family to the employee) who is ill, injured, or has other health-related needs, including preventive care; or for reasons resulting from, or to assist a family member (or person who is like family to the employee) who is a victim of, domestic violence, sexual assault, or stalking. Additional information on contractor requirements and worker protections under the EO is available at www.dol.gov/whd/govcontracts.

Unlisted classifications needed for work not included within the scope of the classifications listed may be added after award only as provided in the labor standards contract clauses (29 CFR 5.5(a) (1) (ii)).

The body of each wage determination lists the classification and wage rates that have been found to be prevailing for the cited type(s) of construction in the area covered by the wage determination. The classifications are listed in alphabetical order of “identifiers” that indicate whether the particular rate is a union rate (current union negotiated rate for local), a survey rate (weighted average rate) or a union average rate (weighted union average rate).

Union Rate Identifiers

A four letter classification abbreviation identifier enclosed in dotted lines beginning with characters other than “SU” or “UAVG” denotes that the union classification and rate were prevailing for that classification in the survey. Example: PLUM0198-005 07/01/2014. PLUM is an abbreviation identifier of the union which prevailed in the survey for this classification, which in this example would be Plumbers. 0198 indicates the local union number or district council number where applicable, i.e., Plumbers Local 0198. The next number, 005 in the example, is an internal number used in processing the wage determination. 07/01/2014 is the effective date of the most current negotiated rate, which in this example is July 1, 2014.

Union prevailing wage rates are updated to reflect all rate changes in the collective bargaining agreement (CBA) governing this classification and rate.

Survey Rate Identifiers

Classifications listed under an “SU” identifier indicated that no one rate prevailed for this classification in the survey and the published rate is derived by computing a weighted average rate based on all the rates reported in the survey for that classification. As this weighted average rate includes all rates reported in the survey, it may include both union and non-union rates. Example: SULA2012-007 5/13/2014. SU indicates the rates are survey rates based on a weighted average calculation of rates and are not majority rates. LA indicates the State of Louisiana. 2012 is the year of survey on which these classifications and rates are based. The next number, 007 in the example, is an internal number used in producing the wage determination. 5/13/2014 indicates the survey completion date for the classifications and rates under that identifier.

Survey wage rates are not updated and remain in effect until a new survey is conducted.

Union Average Rate Identifiers

Classification(s) listed under the UAVG identifier indicate that no single majority rate prevailed for those classifications; however, 100% of the data reported for the classifications was union data. EXAMPLE: UAVG-OH-0010 08/29/2014. UAVG indicates that the rate is a weighted union average rate. OH indicates the state. The next number, 0010 in the example, is an internal number used in producing the wage determination. 08/29/2014 indicates the survey completion date for the classifications and rates under that identifier.

A UAVG rate will be updated once a year, usually in January of each year, to reflect a weighted average of the current negotiated/CBA rate of the union locals from which the rate is based.

WAGE DETERMINATION APPEALS PROCESS

1.) Has there been an initial decision in the matter? This can be:

- * an existing published wage determination
- * a survey underlying a wage determination
- * a Wage and Hour Division letter setting forth a position on a wage determination matter
- * a conformance (additional classification and rate) ruling

On survey related matters, initial contact, including requests for summaries of surveys, should be with the Wage and Hour Regional Office for the area in which the survey was conducted because those Regional Offices have responsibility for the Davis-Bacon survey program. If the response from this initial contact is not satisfactory, then the process described in 2.) and 3.) should be followed.

With regard to any other matter not yet ripe for the formal process described here, initial contact should be with the Branch of Construction Wage Determinations. Write to:

Branch of Construction Wage Determinations
Wage and Hour Division
U.S. Department of Labor
200 Constitution Avenue, N. W.
Washington, D. C. 20210

2.) If the answer to the question in 1.) is yes, then an interested party (those affected by the action) can request review and reconsideration from the Wage and Hour Administrator (See 29 CFR Part 1.8 and 29 CFR Part 7). Write to:

Wage and Hour Administrator
U.S. Department of Labor
200 Constitution Avenue, N. W.
Washington, D. C. 20210

The request should be accompanied by a full statement of the interested party's position and by any information (wage payment data, project description, area practice material, etc.) that the requestor considers relevant to the issue.

3.) If the decision of the Administrator is not favorable, an interested party may appeal directly to the Administrative Review Board (formerly the Wage Appeals Board). Write to:

Administrative Review Board
U. S. Department of Labor
200 Constitution Avenue, N. W.
Washington, D. C. 20210

4.) All decisions by the Administrative Review Board are final.

END OF GENERAL DECISION

APPLICABILITY OF DAVIS-BACON LABOR STANDARD PROVISIONS TO FLAGGERS

The U.S. Department of Labor has established that the duties of flaggers working on contracts covered by the Davis-Bacon Act, are manual and physical in nature. Accordingly, all employees performing the work of flaggers on Davis-Bacon covered contracts shall be entitled to receive applicable prevailing wage rates.

* * * * *

ALL AGENCY MEMORANDUM NO. 130
U.S. DEPARTMENT OF LABOR
EMPLOYMENT STANDARDS ADMINISTRATION
WAGE AND HOUR DIVISION
WASHINGTON, DC 20210

GUIDELINES

HIGHWAY CONSTRUCTION

Highway projects include the construction, alteration, or repair of roads, streets, highways, runways, taxiways, alleys, trails, paths, parking areas, and other similar projects not incidental to building or heavy construction.

EXAMPLES: Alleys, Base Courses, Bituminous treatments, Bridle Paths, Concrete pavement, Curbs, Excavation and embankment (for road construction), Fencing (highway), Grade crossing elimination (overpasses and underpasses), Guard rails on highway, Highway signs, Highway bridges (overpasses, underpasses, grade separation), Medians, Parking lots, Parkways, Resurfacing streets and highways, Roadbeds, Roadways, Runways, Shoulders, Stabilizing courses, Storm sewers incidental to road construction, Street paving, Surface courses, Taxiways, and Trails.

ANY QUESTIONS REGARDING THE APPLICATION OF THE GUIDELINES ABOVE TO A PARTICULAR PROJECT OR ANY DISPUTES REGARDING THE APPLICATION OF THE WAGE SCHEDULES ARE TO BE REFERRED TO THE WAGE AND HOUR DIVISION, U.S. DEPARTMENT OF LABOR FOR RESOLUTION, AND THE INSTRUCTIONS OF THE WAGE AND HOUR DIVISION ARE TO BE OBSERVED IN ALL INSTANCES.

*ALL AGENCY MEMORANDUM NO. 130
U.S. DEPARTMENT OF LABOR
EMPLOYMENT STANDARDS ADMINISTRATION
WAGE AND HOUR DIVISION
WASHINGTON, DC 20210

**SUPPLEMENTAL SPECIFICATIONS
TO THE
AUGUST 2001
STANDARD SPECIFICATIONS**

**EFFECTIVE AS OF THE ADVERTISEMENT
DATE OF THIS PROPOSAL
AND INCLUDED BY REFERENCE**

**The Supplemental Specifications can be viewed and printed from
the Department's Website.**

To access the Website;

- in your internet browser, enter; <http://www.deldot.gov>
- on the left side of the page under 'INFORMATION', Click; 'Publications'
- scroll down under 'MANUALS' and Click; "Standard Specifications 2001"

The full Website Link is;

http://www.deldot.gov/information/pubs_forms/manuals/standard_specifications/index.shtml

Printed copies of the Supplemental Specifications are available upon request. A printed copy of the above referenced Supplemental Specifications will be included in the final contract documents upon award.

The Contractor shall make himself aware of these revisions and corrections (Supplemental Specifications), and apply them to the applicable item(s) of this contract.

SPECIAL PROVISIONS

CONSTRUCTION ITEM NUMBERS

All construction pay items are assigned a six (6) digit number, shown as Item Number on the Plans and/or in the Special Provisions, and shall be interpreted in accordance with the following:

Standard Item Number:

The first three digits of the construction item numbers indicates the Section number as described in the Standard Specifications, and all applicable requirements of the Section shall remain effective unless otherwise modified by the Special Provisions. The last three digits of the construction item identifies the item by sequential number under that Section. Sequential numbers for all items covered under Standard Specifications range from 000 to 499. A comprehensive list of construction item numbers begins on page 421 of the Standard Specifications. Additions to this list will be made as required.

Special Provisions Item Number:

The first three digits of the construction items, covered under Special Provisions, indicates the applicable Section number of the Standard Specifications, and shall be governed fully by the requirements of the Special Provisions. The last three digit of the items covered under Special Provisions identifies the item by sequential number. Sequential numbers for Special Provision items, range from 500 to 999.

Examples

Standard Item Number - 20200 Excavation and Embankment

202 Indicates Section Number

000 Indicates Sequential Number

Special Provision Item Number - 202500 Grading and Reshaping Roadway

202 Indicates Section Number

500 Indicates Sequential Number

NOTE:

PLEASE NOTE revised Supplemental Specifications to the August 2001 Standard Specifications were issued November 24, 2014 and apply to this project. They can be [viewed here](#) and at www.deldot.gov.

SPECIFICATIONS: The Department is currently updating the August 2001 Specifications for Road and Bridge Construction. Through this update, some Divisions were renumbered and some new ones were created and added. The *Specifications Note* document is for the use by the bidders to reference the new numbers to the past numbers used for bidding purposes on previous Department contracts.

401502 - ASPHALT CEMENT COST ADJUSTMENT

For Sections 304, 401, 402, 403, 404, and 405, payments to the Contractor shall be adjusted to reflect increases or decreases in the Delaware Posted Asphalt Cement Price when compared to the Project Asphalt Cement Base Price, as defined in these Special Provisions.

The Delaware Posted Asphalt Cement Price will be issued monthly by the Department and will be the industry posted price for Asphalt Cement, F.O.B. Philadelphia, Pennsylvania. The link for the posting is http://www.deldot.gov/information/business/bids/asphalt_cement_english.shtml.

The Project Asphalt Cement Base Price will be the Delaware Posted Asphalt Cement Price in effect on the date of advertisement.

All deviations of the Delaware Posted Asphalt Cement Price from the Project Asphalt Cement Base Price are eligible for cost adjustment. No minimum increases or decreases or corresponding percentages are required to qualify for cost adjustment.

Actual quantity of asphalt cement qualifying for any Asphalt Cement Cost Adjustment will be computed using the weight of eligible asphalt that is shown on the QA/QC pay sheets as a percentage for the delivered material.

If the mix was not inspected and no QA/QC pay sheet was generated, then the asphalt percentage will be obtained from the job mix formula for that mix ID.

The asphalt percentage eligible for cost adjustment shall only be the virgin asphalt cement added to the mix.

There shall be no separate payment per ton cost of asphalt cement. That cost shall be included in the various unit prices bid per ton for those bid items that contain asphalt cement (mentioned above).

The Asphalt cement cost adjustment will be calculated on grade PG 64-22 asphalt regardless of the actual grade of asphalt used. The Project Asphalt Cement Base Price per ton for the project will be the Delaware Posted Asphalt Cement Price in effect on the date of project advertisement.

If the Contractor exceeds the authorized allotted completion time, the price of asphalt cement on the last authorized allotted work day, shall be the prices used for cost adjustment during the time liquidated damages are assessed. However, if the industry posted price for asphalt cement goes down, the asphalt-cement cost shall be adjusted downward accordingly.

NOTE:

Application of Asphalt Cement Cost Adjustment requirements as indicated above shall apply only to those contracts involving items related to bituminous base and pavements, and with bitumen, having a total of 1,000 tons or more of hot-mix bid quantity in case of Sections 401, 402 and 403; and 15,000 gallons or more in case of Sections 304, 404 and 405.

5/05/15

202573 - TEST HOLES

Description:

This work consists of excavation of test holes to locate existing subsurface structures and utilities, prior to the start of adjacent construction activities, that may be affected by or interfere with the proposed construction at the locations shown on the plans or at locations directed by the Engineer. This work also consists of excavating test holes at proposed construction locations where excavation may impact existing facilities, known or unknown, at the construction location.

Construction Methods:

When facilities and utility lines must be discovered or exposed and identified at specified locations, the contractor shall use minimally intrusive excavation techniques, acceptable to DelDOT, that ensure the safety of the excavation, the integrity of the facility / utility line to be located, and that of other facilities which may be encountered during test hole excavation.

Excavation shall be by means of air-assisted vacuum excavation equipment manufactured specifically for the purpose.

Clear the test hole area of surface debris.

In paved areas, neatly cut and remove existing pavement, which cut shall not exceed 225 square inches (0.15 square meters) unless otherwise approved.

Excavate the test hole by the method(s) acceptable to DelDOT and noted above. The nominal diameter of the test hole shall not exceed 15 inches (375 mm) unless otherwise approved.

Where facilities are discovered or located, expose the facility / utility only to the extent required for identification and data collection purposes.

Avoid damage to lines, wrappings, coatings, cathodic protection or other protective coverings and features.

Hand-dig as needed to supplement mechanical excavation and to ensure safety.

Test hole locations may be revised, as directed or approved by the engineer, in the field as necessary to positively expose the utility or to determine the absence of facilities within the area impacted by the proposed construction. Store excavated material for re-use or disposal, as appropriate.

Replace bedding material around exposed utility lines in accordance with owner's specifications or as otherwise directed or approved. Backfill and compact the excavation in lifts no greater than six inches using excavated material with appropriate moisture/density control.

If test holes are excavated within paved areas that will be exposed to traffic, provide pavement restoration within the limits of the original cut using materials, compaction, and pavement thickness matching the excavated pavement material and thicknesses.

Method of Measurement:

The quantity of test holes will be measured by the number of EACH excavated.

Basis of Payment:

The quantity of test holes will be paid for at the Contract price per EACH. Price and payment will constitute full compensation for performing all the work described in these Special Provisions, as noted on the Plans, and/or as directed by the Engineer, and includes, excavation, backfill, backfilling, pavement restoration, disposal and removal, away from the site of the unsuitable materials, for all labor, tools, equipment, and incidentals necessary to complete the item.

302514 - MILLED HOT-MIX BASE COURSE

Description:

It is the intent of this Special Provision to qualify the use of milled hot-mix asphalt pavement material in lieu of graded aggregate as a base course. All requirements of Section 302 shall remain in effect except as modified below:

Materials:

The material used to construct milled hot-mix asphalt pavement base courses shall be uniformly graded with a maximum size of 1 1/2" (38 mm).

Subgrade Preparation:

The subgrade shall be properly constructed in accordance with Subsection 202.06. No base course material shall be placed until the subgrade has been approved by the Engineer.

Placement:

- a. *Equipment.* The milled material shall be spread uniformly by an approved spreading machine or box in such a manner that no segregation occurs. A conventional motor grader will not be approved for placement of milled material on mainline roadway sections.

Where it is not possible to use a spreading machine or box in patching or other tight areas, other approved methods can be used only in such manner that no segregation occurs. Compaction shall be uniformly attained by approved rollers or compactors. No milled materials shall be placed until approved equipment is on the Project site and is operational.

- b. *Spreading and Compacting.* Milled material shall be placed in successive layers. Each layer shall be placed in a level, uniform cross-section not to exceed 12" (300 mm) in depth, loose measurement, unless otherwise approved by the Engineer. The milled material shall be deposited and spread parallel to the centerline and the layer shall extend to the full width as shown on the Plans. The milled material shall be handled so that no segregation of fine or coarse particles occurs. No more than 1,000' (300 m) of material, as measured along the roadway centerline, shall be spread in advance of compaction operations. Each layer shall be properly compacted as specified, before starting the next layer.

Compaction or rolling shall be performed parallel to the roadway centerline starting at the edges and progressing toward the center. It shall continue until each layer is thoroughly and uniformly compacted to the full width as shown on the Plans. The milled material shall be compacted by the following method: a sheepsfoot roller (minimal 50 ton static roller) shall make the required number of passes on the base material to achieve the target density followed by a back-drag by either a bulldozer or a motor grader. After the pavement base material has been placed, a 15 ton/1800 vpm (minimum) vibratory steel wheel roller shall compact the base material. Compaction will be measured per subsection *Performance* below. In small areas where the above noted equipment cannot be used, the contractor must request approval from the Department to place the millings with other equipment. The Department reserves the right to reject or approve the areas for placement of millings as determined by the Engineer.

After compaction, all voids in the surface of each layer will be filled with millings and compacted (with the vibratory steel wheel roller) until the layer of base material is well bonded and firm, as determined by the Engineer. In no case shall vehicles be allowed to travel in a single track or to form ruts in the base course. If any sharp irregularities are formed in the subgrade or base course material, the affected area shall be scarified to a depth of 6" (150 mm) and compacted to conform to the requirements of Section 202 or this Section.

- c. *Performance.* Compaction of milled hot-mix asphalt pavement base courses will be monitored by measuring the in-place density using a nuclear density gauge and comparing it to a control strip target density. The mean base compaction shall be at least 98% of the control strip target density and sufficiently uniform that individual test results are at least 96% of the control strip target density, the base course represented by the test will be considered defective and the Contractor shall further

compact the area. After further compaction, the original test site and one other randomly selected site within the area will be tested. The average of two test results will be included in the mean density for that day's placement.

To determine the control strip target density, a control strip with a minimum length of 300' (90 m) shall be constructed at the beginning of work on each pavement base. Each control strip is to remain in place and become a section of the completed roadway. A control strip shall have an area of at least 400 yd² (325 m²). For small areas, the Contractor may request to have a test strip waived. This request shall be submitted to the Engineer for review.

Upon completion of the rolling, the mean density of the control strip will be determined by averaging the results of ten nuclear density tests taken at randomly selected sites within the control strip. The mean density of the control strip shall be the target density for the remainder of the pavement base course which it represents. Compaction shall be expressed as a percentage of the target density.

The finished surface of the graded aggregate base course shall not vary from that required on the Plans by more than 1/2" (13 mm) when tested with a 10' (3.048 m) straightedge applied to the surface parallel to the centerline of the pavement and when tested with a template cut to the cross-section of the pavement. The actual thickness of the graded aggregate base course shall not be more than 1/2" (13 mm) less than the thickness shown on Plans. Those portions of completed base course not meeting these performance requirements shall be completely removed and replaced with proper material placed in accordance with this Section.

A straightedge meeting the approval of the Engineer shall be supplied by the Contractor at each placement operation. The straightedge shall be constructed of rigid materials that resist warping and bending.

Method of Measurement:

The quantity of milled hot-mix base course will be measured by the cubic yard (cubic meter) and will be paid for under Item 302007 - Graded Aggregate Base Course. The volume of cubic yards (cubic meters) will be measured as the number of square yards (square meters) of surface area of milled hot-mix base course, placed and accepted, multiplied by the depths shown on the Plans. If the depth of milled hot-mix base course, placed and accepted, is greater than the depth shown on the Plans, the Plan depth will be used to measure the quantity of payment.

If the limits of measurement for pay quantities for milled hot-mix base course are designated on the Plans, the quantity of milled hot-mix base course measured for payment will be the number of square yards (square meters) of surface area multiplied by the depth placed within the payment lines and grades shown on the Plans. If the limits are not designated on the Plans, or have been changed by the Engineer, in-place dimensions of the accepted milled hot-mix base course will be established. The computation of quantity will be made from cross-sections taken after the completion of work under this Section.

Materials placed beyond the designated lines and grades as shown on the Plans or beyond the limits established by the Engineer will not be measured for payment. There will be no separate payment made for filling voids with millings as required under Placement subsection (b) *Spreading and Compaction*.

Basis of Payment:

Millings used for Base Course will be paid at the unit bid price for Item 302007 - Graded Aggregate Base Course, Type B. All costs to bring the millings into compliance with the requirements of 302514 are incidental to Item 302007. No payment will be made under this item 302514. Price and payment will constitute full compensation for hauling, stockpiling (includes any double handling of material), preparing the subgrade, placing and compacting the materials, and for all labor, equipment, tools and incidental required to complete the work.

No additional compensation will be made to the Contractor to crush, screen or otherwise modify the milled hot-mix base course to meet the necessary gradation. No payment will be made for materials placed beyond the designated lines and grades as shown on the Plans or beyond the limits established by the Engineer.

10/31/05

401699 - QUALITY CONTROL/QUALITY ASSURANCE OF BITUMINOUS CONCRETE

.01 Description

This item shall govern the Quality Assurance Testing for supplying bituminous asphalt plant materials and constructing bituminous asphalt pavements and the calculation for incentives and disincentives for materials and construction. The Engineer will evaluate all materials and construction for acceptance. The procedures for acceptance are described in this Section. Include the costs for all materials, labor, equipment, tools, and incidentals necessary to meet the requirements of this specification in the bid price per ton for the bituminous asphalt. Payment to the Contractor for the bituminous asphalt item(s) will be based on the Contract price per ton and the pay adjustments described in this specification.

.02 Bituminous Concrete Production – Quality Acceptance

(a) Material Production - Tests and Evaluations.

All acceptance tests shall be performed by qualified technicians at qualified laboratories following AASHTO or DelDOT procedures, and shall be evaluated using Quality Level Analysis. The Engineer will conduct acceptance tests. The Engineer will directly base acceptance on the acceptance test results, the asphalt cement quality, the Contractor's QC Plan work, and the comparisons of the acceptance test results to the QC test results. The Engineer may elect to utilize test results of the Contractor in some situations toward judging acceptance.

Supply and capture samples, as directed by the Engineer under the purview of the Engineer from delivery trucks before the trucks leave the production plant. Hand samples to the Engineer to be marked accordingly. The sample shall represent the material produced by the Contractor, and shall be of sufficient size to allow the Engineer to complete all required acceptance tests. The Engineer will direct the Contractor when to capture these samples, on a statistically random, unbiased basis, established before production begins each day based upon the anticipated production tonnage. The captured sample shall be from the Engineer specified delivery truck. The Contractor may visually inspect the specified delivery load during sampling and elect to reject the load. If the contractor elects to reject the specified delivery truck, each subsequent load will be inspected until a visually acceptable load is produced for acceptance testing. All visually rejected loads shall not be sent to a Department project.

The first sample of the production day will be randomly generated by the Engineer between loads 0 and 12 (0-250 tons). Subsequent samples will be randomly generated by the Engineer on 500-ton sub-lots for the production day. Samples not retrieved in accordance with the Contractor's QC plan will be deemed unacceptable and may be a basis for rejection of material produced. Parallel tests or dispute resolution tests will only be performed on material captured at the same time and location as the acceptance test sample. Parallel test samples or Dispute Resolution samples will be created by splitting a large sample or obtaining multiple samples that equally represent the material. The Engineer will perform all splitting and handling of material after it is obtained by the Contractor.

The Contractor may retain dispute resolution samples or perform parallel tests with the Engineer on any acceptance sample. The Engineer will evaluate and accept the material on a lot basis. All the material within a lot shall have the same JMF (mixture ID). The lot size shall be targeted for 2000 tons or a maximum period of three days, whichever is reached first. If the 2000th ton target lot size is achieved during a production day, the lot size shall extend to the end of that production day. The Contractor may interrupt the production of one JMF in order to produce different material; this type of interruption will not alter the determination of the size or limits of material represented by a lot. The Engineer will evaluate each lot on a subplot basis. The size for each subplot shall be 100 to 500 tons and testing for the sub lots will be completed on a daily basis. For each subplot, the Engineer will evaluate one sample.

The target size of sub-lots within each lot, except for the first sample of the production day, is equal-sized 500 ton sub lots and will be based upon anticipated production, however, more or fewer sublots, with differing sizes, may result due to the production schedule and conditions. If the actual production is less than anticipated, and it's determined a sample will not be obtained (based upon the anticipated tonnage), a new sample location will be determined on a statistically random, unbiased basis based upon the new actual production. If the actual production is going to be 50 tons or greater over the anticipated sub lot production, a new sample location will be determined on a statistically random, unbiased basis based upon the new actual

production. The Engineer will combine the evaluation and test results for all of the applicable sublots in order to evaluate each individual lot.

If the Engineer is present, and the quantity exceeds 25 tons, a statistically random sample will be used for analysis. When the anticipated production is less than 100 tons and greater than 25 tons, and the Engineer is not present, the contractor shall randomly select a sample using the Engineer's random location program. The captured sample shall be placed in a suitable box, marked to the attention of the Engineer, and submitted to the Engineer for testing. A box sample shall also be obtained by the contractor at the same time and will be used as the Dispute Resolution sample if requested by the Engineer. The Contractor shall also obtain one liquid asphalt sample (1 pint) per grade of asphalt used per day and properly label it with all pertinent information.

The Engineer will conduct the following tests in order to characterize the material for the pavement compaction quality and to judge acceptance and the pay adjustment for the material:

- AASHTO T312 - Preparing and Determining the Density of Hot Mix Asphalt (HMA) Specimens by Means of the Superpave Gyrotory Compactor
- AASHTO T166, Method C (Rapid Method) - Bulk Specific Gravity of Compacted Hot Mix Asphalt (HMA) Using Saturated Surface Dry Specimens
- AASHTO T308 - Determining the Asphalt Binder Content of Hot Mix Asphalt (HMA) by the Ignition Method
- AASHTO T30 - Mechanical Analysis of Extracted Aggregate
- AASHTO T209 - Theoretical Maximum Specific Gravity and Density of Hot Mix Asphalt (HMA)
- ASTM D7227 - Standard Practice for Rapid Drying of Compacted Asphalt Specimens using Vacuum Drying Apparatus

(b) Pavement Construction - Tests and Evaluations.

The Engineer will directly base acceptance on the compaction acceptance test results, and on the inspection of the construction, the Contractor's QC Plan work, ride smoothness as referenced in the contract documents, lift thickness as referenced in the contract documents, joint quality as referenced in the contract documents, surface texture as referenced in the contract documents, and possibly the comparisons of the acceptance test results to the independent test results. For the compaction acceptance testing, the Engineer will sample the work on a statistically random basis, and will test and evaluate the work based on daily production.

Notify the Engineer of any locations within that road segment that may not be suitable to achieve minimum (93%) compaction due to existing conditions prior to paving the road segment. Schedule and hold a meeting in the field with the Engineer in order to discuss all areas that may potentially be applicable to Table 5a before paving starts. Areas that will be considered for Table 5a will be investigated in accordance to the method described in Appendix B. If this meeting is not held prior to paving, no areas will be considered for Table 5a. Areas of allowable exemptions that will not be cored include the following: partial-depth patch areas, driveway entrances, paving locations of less than 100 tons, areas around manholes and driveway entrances, and areas of paving that are under 400 feet in continuous total length and/or 5 feet in width.

The exempt areas around manholes will be a maximum of 4 feet transversely on either side from the center of the manhole, and 20 feet longitudinally on either side from the center of the manhole. The exempt areas around driveway entrances shall be the entire width of the driveway, and 3 feet from the edge of the longitudinal joint next to the driveway. Areas of exemption that will be cored for informational purposes only include: areas where the mat thickness is less than three times the nominal maximum aggregate size as directed by the Engineer, violations of Section 401.08 in the Standard Specifications as directed by the Engineer, and areas shown to contain questionable subgrade properties as proven by substantial yielding under a fully legally loaded truck. Failure to obtain core samples in these areas will result in zero payment for compaction regardless of the exempt status.

The Engineer will evaluate and accept the compaction work on a daily basis. Payment for the compaction will be calculated by using the material production lots as referenced in **.02 Acceptance Plan (a) Material Production - B Tests and Evaluation** and analyzing the compaction results over the individual days covered in the material production lot. The compaction results will be combined with the material results to obtain a payment for this item.

The minimum size of a compaction lot shall be 100 tons. If the compaction lot is between 101 and 1000 tons, the Engineer shall randomly determine four compaction acceptance test locations. If the compaction lot is between 1001 and 1500 tons, the Engineer shall randomly determine six compaction acceptance test locations. If the compaction lot is between 1501 and 2000 tons, the Engineer shall randomly determine eight compaction acceptance test locations. If the compaction lot is greater than 2000 tons, the Engineer shall randomly determine two compaction acceptance test locations per 500 tons.

If a randomly selected area falls within an Engineer approved exemption area, the Engineer will select one more randomly generated location to be tested per the requirements of this Specification. If that cannot be accomplished, or if an entire location has been declared exempt, the compaction testing shall be performed as per these Specifications but a note will be added to the results that the location was an Engineer approved exempt location.

Testing locations will be a minimum of 1.0 feet from the newly placed longitudinal joint and 50 feet from a new transverse joint.

Cut one six (6) inch diameter core through the full lift depth at the exact location marked by the Engineer. Cores submitted that are not from the location designated by the Engineer will not be tested and will be paid at zero pay.

Notify the Engineer prior to starting paving operations with approximate tonnage to be placed. The Contractor is then responsible for notifying the appropriate Engineer test personnel within 12 hours of material placement. The Engineer will mark core locations within 24 hours of notification. After determination of locations, the Contractor shall complete testing within two operational days of the locations being marked. If the cores are not cut within two operational days, the area in question will be paid at zero pay for compaction testing.

Provide any traffic control required for the structural number investigation, sampling, and testing work at no additional cost to the Department.

Commence coring of the pavement after the pavement has cooled to a temperature of 140°F or less. Cut each core with care in order to prevent damaging the core. Damaged cores will not be tested. Label each core with contract number, date of construction, and number XX of XX upon removal from the roadway. Place cores in a 6-inch diameter plastic concrete cylinder mold or approved substitute for protection. Separate cores in the same cylinder mold with paper. Attach a completed QC test record for the represented area with the corresponding cores. The Engineer will also complete a test record for areas tested for the QA report and provide to Materials & Research. Deliver the cores to the Engineer for testing, processing, and report distribution at the end of each production day.

Repair core holes per Appendix A, Repairing Core Holes in Bituminous Asphalt Pavements. Core holes shall be filled immediately. Failure to repair core holes at the time of coring will result in zero pay for compaction testing for the area in question.

The Engineer will conduct the following tests on the applicable portion of the cores in order to evaluate their quality:

- AASHTO T166, Method C (Rapid Method) – Bulk Specific Gravity of Compacted Hot Mix Asphalt (HMA) Using Saturated Surface Dry Specimens
- AASHTO T209 - Theoretical Maximum Specific Gravity and Density of Hot Mix Asphalt
- ASTM D7227 - Standard Practice for Rapid Drying of Compacted Asphalt Specimens using Vacuum Drying Apparatus

The Engineer will use the average of the last five test values of the same JMF (mixture ID) material at the production plant in order to calculate the average theoretical maximum specific gravity of the cores. The average will be based on the production days test results and as many test results needed from previous days production to have an average of five samples. If there are less than five values available, the Engineer will use the JMF design value in addition to the available values to calculate the average theoretical maximum specific gravity.

.03 Payment and Pay Adjustment Factors.

The Engineer will determine pay adjustments for the bituminous asphalt item(s) in accordance with this specification. The Engineer will determine a pay adjustment factor for the material produced and a pay adjustment factor for the pavement construction. Pay adjustments for material and construction will be calculated independently. When the pay adjustment calculation for either material or construction falls to zero payment per tables 4, 5, or 5a, the maximum pay adjustment for the other factor will not exceed 100.

Pay Adjustment factors will only be calculated on in place material. Removed material will not be used in payment adjustment calculations.

Material Production Pay Adjustments will be calculated based upon 70% of the contract unit price and calculated according to section .03(a) of this specification. Pavement construction Pay Adjustments will be calculated based upon 30% of the contract unit price and calculated according to section .03(b) of this specification.

(a) Material Production - Pay Adjustment.

Calculate the material pay adjustment by evaluating the production material based on the following parameters:

Table 2 - Material Parameter Weight Factors		
Material Parameter	Single Test Tolerance (+/-)	Weight Factor
Asphalt Content	0.4	0.30
#8 Sieve (>=19.0 mm)	7.0	0.30
#8 Sieve (<=12.5 mm)	5.0	0.30
#200 Sieve (0.075mm Sieve)	2.0	0.30
Air Voids (4.0% Target)	2.0	0.10

Using the JMF target value, the single test tolerance (from Table 2), and the test values, the Engineer will use the following steps to determine the material pay adjustment factor for each lot of material:

1. For each parameter, calculate the mean value and the standard deviation of the test values for the lot to the nearest 0.1 unit.
2. For each parameter, calculate the Upper Quality Index (QU):

$$QU = ((JMF \text{ target}) + (\text{single test tolerance}) - (\text{mean value})) / (\text{standard deviation}).$$
3. For each parameter, calculate the Lower Quality Index (QL):

$$QL = ((\text{mean value}) - (JMF \text{ target}) + (\text{single test tolerance})) / (\text{standard deviation}).$$
4. For each parameter, locate the values for the Upper Payment Limit (PU) and the Lower Payment Limit (PL) from Table 3 - Quality Level Analysis by the Standard Deviation Method. (Use the column for “n” representing the number of sublots in the lot. Use the closest value on the table when the exact value is not listed).
5. Calculate the PWL for each parameter from the values located in the previous step:

$$PWL = PU + PL - 100.$$
6. Calculate each parameter’s contribution to the payment adjustment by multiplying its PWL by the weight factor shown in Table 2 for that parameter.
7. Add the calculated adjustments of all the parameters together to determine the Composite PWL for the lot.
8. From Table 4, locate the value of the Pay Adjustment Factor corresponding to the calculated PWL. When all properties of a single test are within the single test tolerance of Table 2, Pay Adjustment factors shall be determined by Column B. When any property of a single test is outside of the Single Test Tolerance parameters defined in Table 2, the Material Pay Adjustment factor shall be determined by Column C

9. For each lot, determine the final material price adjustment:

Final Material Pay Adjustment =
 (Lot Quantity) x (Item Bid Price) x (Pay Adjustment Factor) x 70%. This final pay calculation will be paid to the cent.

In lieu of being assessed a pay adjustment penalty, the Contractor may choose to remove and replace the material at no additional cost to the Department. When the PWL of any material parameter in Table 2 is below 60, the Engineer may require the removal and replacement of the material at no additional cost to the Department. Test results on removed material shall not be used in calculation of future PWL calculations for Mixture ID. The test results from the Engineer on production that is less than 100 tons will be combined with the two most recently completed Engineer tests with the same Mixture ID to calculate payment for the lot encompassing the single test. If that cannot be accomplished, the approved JMF will be used to calculate payment for the lot encompassing the single test. Payment for previously closed lots will not be affected by the analysis.

When a sample is outside of the allowable single test tolerance for any Materials criteria in Table 2, that sample will be isolated. For payment purposes, the test result of the out of acceptable tolerance sample will be combined with the two previous acceptable samples of the same JMF and analyzed per this specification. The material that is considered out of the acceptable tolerance will only include the material within the represented sub-lot (i.e., a maximum of 500 tons). If the previous acceptable test result is from the previous production day, only the material produced on the second production day will be considered out of tolerance. All future sub lots will not include the isolated test. The pay factors for the out of tolerance sample lot will be calculated using column C of table 4.

If, during production, a QA sample test result does not meet the acceptable tolerances and the Contractors QC sample duplicates the QA sample test result, the Contractor can make an appropriate change to the mixture (within the JMF boundaries), and request to have that sample further isolated. After the Contractor has made appropriate changes, the Contractor will visually inspect each produced load. The first visually acceptable load will be sampled and tested. If that sample test result shows compliance with the specifications, the material that is considered out of the acceptable tolerance will include the material from the previous acceptable test result to the third load after the initially sampled and tested sample. If the sample does not meet the specification requirements, the Engineer will no longer accept material. Production may resume when changes have been made and an acceptable sample and test result is obtained.

Table 3 - Quality Level Analysis by the Standard Deviation Method							
PU or PL	QU and QL for "n" Samples						
	n = 3	n = 4	n = 5	n = 6	n = 7	n = 8	n = 9
100	1.16	1.50	1.79	2.03	2.23	2.39	2.53
99	-	1.47	1.67	1.80	1.89	1.95	2.00
98	1.15	1.44	1.60	1.70	1.76	1.81	1.84
97	-	1.41	1.54	1.62	1.67	1.70	1.72
96	1.14	1.38	1.49	1.55	1.59	1.61	1.63
95	-	1.35	1.44	1.49	1.52	1.54	1.55
94	1.13	1.32	1.39	1.43	1.46	1.47	1.48
93	-	1.29	1.35	1.38	1.40	1.41	1.42
92	1.12	1.26	1.31	1.33	1.35	1.36	1.36
91	1.11	1.23	1.27	1.29	1.30	1.30	1.31
90	1.10	1.20	1.23	1.24	1.25	1.25	1.26
89	1.09	1.17	1.19	1.20	1.20	1.21	1.21
88	1.07	1.14	1.15	1.16	1.16	1.16	1.17
87	1.06	1.11	1.12	1.12	1.12	1.12	1.12
86	1.04	1.08	1.08	1.08	1.08	1.08	1.08
85	1.03	1.05	1.05	1.04	1.04	1.04	1.04
84	1.01	1.02	1.01	1.01	1.00	1.00	1.00

83	1.00	0.99	0.98	0.97	0.97	0.96	0.96
82	0.97	0.96	0.95	0.94	0.93	0.93	0.93
81	0.96	0.93	0.91	0.90	0.90	0.89	0.89
80	0.93	0.90	0.88	0.87	0.86	0.86	0.86
79	0.91	0.87	0.85	0.84	0.83	0.82	0.82
78	0.89	0.84	0.82	0.80	0.80	0.79	0.79
77	0.87	0.81	0.78	0.77	0.76	0.76	0.76
76	0.84	0.78	0.75	0.74	0.73	0.73	0.72
75	0.82	0.75	0.72	0.71	0.70	0.70	0.69
74	0.79	0.72	0.69	0.68	0.67	0.66	0.66
73	0.75	0.69	0.66	0.65	0.64	0.63	0.63
72	0.74	0.66	0.63	0.62	0.61	0.60	0.60
71	0.71	0.63	0.60	0.59	0.58	0.57	0.57
70	0.68	0.60	0.57	0.56	0.55	0.55	0.54
69	0.65	0.57	0.54	0.53	0.52	0.52	0.51
68	0.62	0.54	0.51	0.50	0.49	0.49	0.48
67	0.59	0.51	0.47	0.47	0.46	0.46	0.46
66	0.56	0.48	0.45	0.44	0.44	0.43	0.43
65	0.52	0.45	0.43	0.41	0.41	0.40	0.40
64	0.49	0.42	0.40	0.39	0.38	0.38	0.37
63	0.46	0.39	0.37	0.36	0.35	0.35	0.35
62	0.43	0.36	0.34	0.33	0.32	0.32	0.32

Table 3 - Quality Level Analysis by the Standard Deviation Method							
PU or PL	QU and QL for "n" Samples						
	n = 3	n = 4	n = 5	n = 6	n = 7	n = 8	n = 9
61	0.39	0.33	0.31	0.30	0.30	0.29	0.29
60	0.36	0.30	0.28	0.27	0.27	0.27	0.26
59	0.32	0.27	0.25	0.25	0.24	0.24	0.24

Table 4 - PWL Pay Adjustment Factors		
PWL	Pay Adjustment Factor (%) Column B	Pay Adjustment Factor (%) Column C
100	+5	0
99	+4	-1
98	+3	-2
97	+2	-3
96	+1	-4
95	0	-5
94	-1	-6
93	-2	-7

92	-3	-8
91	-4	-9
PWL<91	PWL - 100	PWL - 100

(b) Pavement Construction - Pay Adjustments.

The Engineer will determine the pavement construction pay adjustment by evaluating the construction of the pavement, based on the following parameter:

- Degree of compaction of the in-place material

Using the test values for the cores, the Engineer will use the following steps to determine the pavement construction pay adjustment for each lot of work.

1. Calculate the core bulk specific gravity values from the subplot tests values, to the nearest 0.001 unit. Obtain the Theoretical maximum Specific Gravity values from the corresponding laboratory subplot tests.
2. Calculate the Degree of Compaction:

$$\text{Degree of Compaction} = \frac{((\text{Core Bulk Specific Gravity}) / (\text{Theoretical Maximum Specific Gravity})) \times 100\%}{\text{recorded to the nearest } 0.1\%}$$
3. The average compaction for the sublots shall be averaged together for the compaction level of the lot. The lots compaction test level shall be averaged and recorded to the nearest whole percent.
4. Locate the value of the Payment Adjustment Factor corresponding to the calculated degree of compaction from Table 5 or Table 5a.
5. Determine the pavement construction price adjustment by using the following formula:

$$\text{Construction Pay adjustment} = (\text{Lot Quantity}) \times (\text{Bid Price}) \times (\text{Pay Adjustment Factor}) \times 30\%$$

Table 5: Compaction Price Adjustment Highway Locations		
Degree of Compaction (%)	Range	Pay Adjustment Factor (%)
>= 97.0	>= 96.75	-100*
96.5	96.26 – 96.74	-5
96.0	95.75 – 96.25	-3
95.5	95.26 – 95.74	-2
95.0	94.75 – 95.25	0
94.5	94.26 – 94.74	0
94.0	93.75 – 94.25	1
93.5	93.26 – 93.74	3
93.0	92.75 – 93.25	5
92.5	92.26 – 92.74	3
92.0	91.75 – 92.25	0
91.5	91.26 – 91.74	0
91.0	90.75 – 91.25	-5

90.5	90.26 – 90.74	-15
90.0	89.75 – 90.25	-20
89.5	89.26 – 89.74	-25
89.0	88.75 – 89.25	-30
88.5	88.26 – 88.74	-50
=<88.0	=<88.25	-100*

* or remove and replace it at Engineer's discretion

Table 5A: Compaction Price Adjustment Other¹ Locations		
Degree of Compaction	Range	Pay Adjustment Factor (%)
>= 97.0	>= 96.75	-100*
96.5	96.26 – 96.74	-5
96.0	95.75 – 96.25	-3
95.5	95.26 – 95.74	-2
95.0	94.75 – 95.25	0
94.5	94.26 – 94.74	0
94.0	93.75 – 94.25	0
93.5	93.26 – 93.74	1
93.0	92.75 – 93.25	3
92.5	92.26 – 92.74	1
92.0	91.75 – 92.25	0
91.5	91.26 – 91.74	0
91.0	90.75 – 91.25	0
90.5	90.26 – 90.74	0
90.0	89.75 – 90.25	0
89.5	89.26 – 89.74	0
89.0	88.75 – 89.25	-1
88.5	88.26 – 88.74	-3
88.0	87.75 – 88.25	-5
87.5	87.26 – 87.74	-10
87.0	86.75 – 87.25	-15
86.5	86.26 – 86.74	-20
86.0	85.75 – 86.25	-25
85.5	85.26 – 85.74	-30
85.0	84.75 – 85.25	-40

84.5	84.26 – 84.74	-50
=< 84.0	=<84.25	-100*

* or remove and replace at Engineer's discretion

¹ This chart is to be used for areas where the structural value of the area to be paved is less than 1.75 as determined by the Engineer. See Appendix B - Method for Obtaining Cores for Determination of Roadway Structure. This chart is applicable to rehabilitation work only; full depth construction will not be considered for Table 5a.

.04 Dispute Resolution.

Disputes or questions about any test result shall be brought to the attention of the Contractor and the Engineer within two operational days of reported test results. The following dispute resolution procedures will be used. The Engineer and the Contractor will review the sample quality, the test method, the laboratory equipment, and the laboratory technician. If these factors are not the cause of the dispute, a third party dispute resolution will be used.

Third party resolution testing can be performed at either another Contractor’s laboratory, the Engineer’s laboratory, or an independent accredited laboratory. Unless otherwise mutually agreed upon by DAPA and the Engineer, the Engineer’s qualified laboratory in Dover and qualified personnel shall conduct the necessary testing for third party Dispute Resolution after the Engineer has provided reasonable notice to allow the Contractor to witness this testing.

When disputes over production testing occur, the samples used for Dispute Resolution testing will be those samples the properly captured, labeled, and stored, as described in the second paragraph of the section of these specifications titled **.02 Acceptance Plan, (a) Material Production - Tests and Evaluations**. If no samples are available, the original testing results will be used for payment calculations. Dispute Resolution samples for air void content will be heated by a microwave oven.

If there is a discrepancy between the Engineer’s acceptance test result and the Contractor’s test result, the Contractor may ask for the Dispute Resolution sample to be tested. The Contractor may request up to two dispute resolution samples be tested per calendar year without charge. Any additional Dispute Resolution samples run at the Contractors request where the results substantiate the acceptance test result will be assessed a fee of \$125. Any additional Dispute Resolution samples that substantiate the Contractors test result will not be assessed the fee.

When disputes over compaction core test results occur, the Engineer’s acceptance core will be used for the dispute resolution sample. The Contractor will be advised on when the testing will occur as referenced above to witness the testing. The results of the dispute resolution testing shall replace all of the applicable disputed test results for payment purposes.

Appendix A - Repairing Core Holes in Bituminous Asphalt Pavement

Description.

This appendix describes the procedure required to repair core holes in a bituminous concrete pavement.

Materials and Equipment.

The following material shall be available to complete this work:

- Patch Material - DelDOT approved High Performance Cold Patch material shall be used.

The following equipment shall be available to complete this work:

- Sponge or other absorbent material - Used to extract water from the hole.
- Compaction Hammer - mechanical (electrical, pneumatic, or gasoline driven) tamping device with a flat, circular tamping face smaller than 6 inches in diameter.

Construction Method.

After core removal from the hole, remove all excess water from within the hole, and prevent water from re-entering the hole.

Place the patch material in lifts no greater than 3 inches and compact with mechanical tamping device. If the hole is deeper than 3 inches, use two lifts of approximately equal depths so that optimum compaction is achieved. Make sure that the patch surface matches the grade of the existing roadway. Make every effort to achieve the greatest possible compaction

Performance Requirements.

The Engineer will judge the patch on the following basis:

- The patch shall be well compacted
- The patch surface shall match the grade of the surrounding roadway surface.

Basis of Payment.

No measurement or payment will be made for the patching work. The Contractor must gain the Engineer's acceptance of the patching work before the Engineer will accept the material represented by the core.

Appendix B - Method for Obtaining Cores for Determination of Roadway Structure

The Contractor is responsible for obtaining cores in areas that they propose are eligible for compaction price adjustments according to Table 5a in this specification. Table 5a is not applicable for new full-depth pavement box construction. Cores submitted for this process shall be obtained according to the following process.

1. Contact Materials & Research (M&R) personnel to determine if information about the area is already available. If M&R has already obtained cores in the location that is being investigated, the contractor may opt to use the laboratory information for the investigation and not core the area on their own.
2. If M&R does not have information concerning the section of the roadway, the contractor needs to contact M&R to arrange for verification of coring operations. Arrangements shall be made to allow for an individual from M&R to be on the site when the cores are obtained. Cores will be turned over to M&R for evaluation.
3. The Contractor is responsible for providing all traffic control and repairing core holes in accordance to 401699 Appendix A - Repairing Core Holes in Bituminous Asphalt Pavements.
4. Cores are to be taken throughout the entire project for the area in question. Cores will be spaced, from the start of the project in increments determined based on field and project specifics. Cores will be evenly distributed throughout the project location. The cores will be taken in the center of the lane in question.
5. Additional cores may be taken at other locations, if surface conditions indicate that there may be a substantial difference in the underlying section. The location of these cores should be documented and submitted to M&R.
6. Cores shall be full depth and include underlying materials. If there is a stone base included in the pavement section, at a minimum 1 core must have information concerning the thickness of the base. This is determined by augering to the subgrade surface.
7. The calculations used to determine the structural capacity of the roadway is as follows. If the contractor finds, upon starting the coring process, that the areas are of greater thickness than applicable to Table 5a, they may terminate the coring process on their own and retract the request.

Structural Number Calculations

Each pavement box material is assigned a structural coefficient based upon AASHTO design guides. The structural coefficient is used to determine the total strength of the pavement section. Materials used in older pavement sections are assigned lower structural coefficients to compensate for aging of the materials. The coefficients used to determine the structural number of an existing pavement are:

Existing Material	Structural Coefficient
HMA	0.32
Asphalt Treated Base	0.26
Soil Cement	0.16
Surface Treatment (Tar & Chip)	0.10
GABC	0.14
Concrete	0 - 0.7*

* The Structural Coefficient of Concrete is dependent upon the condition of the concrete. Compressive strengths & ASR analysis are used to determine condition - contact the Engineer if this situation arises.

Newly placed materials use a different set of structural coefficients. They are as follows:

New Material	Structural Coefficient
HMA	0.40
Asphalt Treated Base (BCBC)	0.32
Soil Cement	0.20
GABC	0.14

Example:

Location includes placement of a 1.25" Type C overlay on 2.25" Type B. Existing roadway is cored and is shown to consist of 2" HMA on 7" GABC.

Calculation:

For the Type B lift the calculation would be:

$$\begin{array}{rcl}
 \text{Existing HMA} & 2 * 0.32 & = & 0.64 \\
 \text{GABC} & 7 * 0.14 & = & \underline{0.98} \\
 & & & 1.62
 \end{array}$$

For the Type C lift the calculation would be:

$$\begin{array}{rcl}
 \text{Newly Placed B} & 2.25 * 0.4 & = & 0.90 \\
 \text{Existing HMA} & 2 * 0.32 & = & 0.64 \\
 \text{GABC} & 7 * 0.14 & = & \underline{0.98} \\
 & & & 2.52
 \end{array}$$

401752 – SAFETY EDGE FOR ROADWAY PAVEMENT

Description:

This work consists of the construction of safety edge(s) along bituminous concrete pavement or P.C.C. pavement in accordance with the details and notes on the Plans and as directed by the Engineer.

Construction Methods:

The safety edge shall not be constructed adjacent to curb or in front of guardrail sections.

In bituminous concrete pavement sections, prior to the construction of the safety edge, the fill or in situ material at the edge of pavement shall be compacted so that it is level with the top of the pavement, prior to the final surface overlay.

In bituminous concrete pavement sections, the contractor shall attach a device to the screed of the paver unit that confines the material at the end of the gate and extrudes the asphalt material in such a way that results in a compacted wedge shape pavement edge of 32 degrees (+/- 2 degrees). Contact shall be maintained between the device and the road shoulder surface. The device shall be manufactured so that it can be easily adjusted to transition at cross roads, driveways and obstructions without stopping the paver unit. The device's shape shall constrain the asphalt and cause compaction, as well as increase the density of the extruded profile.

In bituminous concrete pavement sections, the Transtech Shoulder Wedge Maker, Carlson Safety Edge End Gate or an approved equal shall be used to produce the safety edge. Contact information for these wedge shape compaction devices is listed below:

Transtech Systems, Inc.
1594 State Street
Schenectady, NY 12304
1-800-724-6306
www.transtechsys.com

or

Carlson Paving Products
18425 50th Ave. E
Tacoma, WA 98446
1-253-278-9426
www.carlsonpavingproducts.com

or an approved equal.

In P.C.C. pavement sections, the paver screed shall be modified to provide a chamfer at the end of the P.C.C. pavement in accordance with the details and notes on the Plans, or as directed by the Engineer.

Method of Measurement:

Safety Edge will not be measured for payment.

Basis of Payment:

The cost associated with the construction of safety edge(s), including but not limited to the wedge device, preparation and compaction of the fill or in situ material, and placement of the safety edge in accordance with the Plans and Details shall be incidental to the bituminous concrete pavement or P.C.C. pavement item being placed.

10/15/2013

- 401800 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 115 GYRATIONS, PG 64-22
(CARBONATE STONE)
- 401801 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 64-22
(CARBONATE STONE)
- 401804 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 70-22
(CARBONATE STONE)
- 401807 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 76-22
(CARBONATE STONE)

- 401809 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE B, 115 GYRATIONS, PG 64-22
- 401810 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE B, 160 GYRATIONS, PG 64-22
- 401813 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE B, 160 GYRATIONS, PG 70-22
- 401816 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE B, 160 GYRATIONS, PG 76-22

- 401818 - BITUMINOUS CONCRETE, SUPERPAVE, BITUMINOUS CONCRETE BASE
COURSE, 115 GYRATIONS, PG 64-22
- 401819 - BITUMINOUS CONCRETE, SUPERPAVE, BITUMINOUS CONCRETE BASE
COURSE, 160 GYRATIONS, PG 64-22
- 401821 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 64-22,
PATCHING
- 401822 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE B, 160 GYRATIONS, PG 64-22,
PATCHING
- 401823 - BITUMINOUS CONCRETE, SUPERPAVE, BITUMINOUS CONCRETE BASE
COURSE, 160 GYRATIONS, PG 64-22, PATCHING
- 401824 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG-64-22,
WEDGE
- 401825 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE B, 160 GYRATIONS, PG-64-22,
WEDGE

- 401827 -BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 64-22,
(NON-CARBONATE STONE)
- 401830 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 70-22,
(NON-CARBONATE STONE)
- 401833 -BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 76-22,
(NON-CARBONATE STONE)

- 401835 - THIN BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 115 GYRATIONS, PG 64-22
- 401836 - THIN BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 64-22
- 401838 - THIN BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 70-22
- 401840 - THIN BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 76-22

.01 Description:

This specification shall govern the production and construction of bituminous concrete pavement. The following Subsections of the Standard Specifications shall be applicable: 401.01, 401.03 - 401.10, 401.12, and 401.13. All other subsections have been modified herein.

Payment for bituminous concrete shall be in accordance with item 401699. The Contractor shall read and thoroughly understand the requirements of the QA/QC specification as defined in item 401699. It is the responsibility of the Contractor to determine all costs associated with meeting these requirements and to include them in the per ton bids for the various Superpave bituminous concrete items. Payment adjustment factors will be calculated in accordance with the latest version of item 401699.

Bituminous concrete may be produced by one or a combination of several technologies involving asphalt foaming processes and equipment or additives that facilitate the reduction of the temperature at which the mix can be placed and satisfactorily compacted thereby permitting the mix to be produced at reduced temperatures.

.02 Materials:

Use materials conforming to standard specifications 823.

Materials for bituminous concrete shall conform to the requirements of Subsections 823.01, 823.05-823.17, and 823.25 - 823.28 of the Standard Specifications and the following. If the Contractor proposes to use a combination of materials that are not covered by this Specification, the mix design shall be submitted and reviewed by the Engineer 30 calendar days prior to use.

a) **Asphalt Binder:**

Meet the requirements of Superpave performance-grade asphalt binder, as referenced in the Plans, according to M 320¹, Table 1 and tested according to AASHTO R29 with the following test ranges:

TEST Procedure	AASHTO REFERENCE	SPECIFICATION LIMITS
Temperature, °C	M 320	Per Grade
Original DSR, G*/sin (δ)	T 315	1.00 - 2.20 kPa ¹
RTFO DSR, G*/sin (δ)	T 315	>/= 2.20 kPa
PAV DSR, G*/ sin (δ)	T 315	</=5000 kPa
BBR Creep Stiffness, S	T 313	</= 300.0 kPa
BBR m-value	T 313	>/=0.300

Note 1: The exception to M 320 is that the original DSR shall be 1.00 to 2.20 kPa

Substitution of a higher temperature grade will require prior approval by the Engineer.

The highest low temperature grade virgin binder to be used is -22.

Depending on the level of Recycled materials used, the low temperature properties, per T 313, may be different than stated in M 320 or the previous table.

b) **Recycled Materials:**

RAP (Recycled Asphalt Pavement): Bituminous concrete pavement mechanically processed to a homogenous consistency to be recycled through the production plant for use in a new bituminous concrete mixture.

The percentage allowance of recycled materials (recycled asphalt pavement and/or shingles) shall be controlled through the use of the Materials & Research recycled mixture program available through the Materials & Research Section. The program can be used by the Contractor to determine which materials and combinations of materials can be used to meet the specified material on the contract.

If the Contractor proposes to use a combination of materials that are not covered by this program, the mix design shall be submitted and reviewed by the Engineer.

c) **Shingles:**

RAS (Recycled Asphalt Shingles): Materials reclaimed from the shingle manufacturing process such as tabs, punch-outs, and damaged new shingles mechanically broken down with 100% passing the ½ in (12.5 mm) sieve. Shipping, handling, and shredding costs are incidental to the price of Superpave item.

Post-consumer shingles or used shingles are not acceptable. Fiberglass-backed and organic felt-backed shingles shall be kept separate. Both materials shall not be used in the same mixture at the same time. All shingles shall be free of all foreign material and moisture.

The use of Recycled Asphalt Shingles will be considered for 115 gyrations mix designs upon demonstration by the producer of adequate blending of the binder verified by laboratory testing on plant produced material.

d) Mineral Aggregate:

Conform to Section 805 and the following criteria. These criteria apply to the combined aggregate blend.

DESIGN ESAL'S (MILLIONS)	COARSE AGGREGATE ANGULARITY ¹ (% MIN)		FINE AGGREGATE ANGULARITY ² (% MIN)		CLAY CONTENT ³ (% - MIN)	FLAT AND ELONGATED ⁴ (% - MAX)
	≤ 100 MM	> 100 MM	≤ 100 MM	> 100 MM		
< 0.3	55/-	-/-	-	-	40	-
0.3 to < 3	75/-	50/-	40	40	40	-
3 to <10	85/80 ⁵	60/-	45	40	45	-
10 < 30	95/90	80/75	45	40	45	-
30	100/100	100/100	45	45	50	10

¹Coarse Aggregate Angularity is tested according to ASTM D5821.

²Fine Aggregate Angularity is tested according to AASHTO TP-33.

³Clay Content is tested according to AASHTO T176.

⁴Flat and Elongated is tested according to ASTM 4791 with a 5:1 aspect ratio.

⁵85/80 denotes that 85% of the coarse aggregate has one fractured face and 80% has two or more fractured faces.

The following source properties apply to the individual aggregates in the aggregate blend for the proposed JMF.

TEST METHOD	SPECIFICATION LIMITS
Toughness , AASHTO T96 Percent Loss, Maximum	40
Soundness , AASHTO T104 Percent Loss, Maximum for five cycles	20
Deleterious Materials , AASHTO T112 Percent, Maximum	10
Moisture Sensitivity , AASHTO T283 Percent, Minimum	80

For any roadway with a minimum average daily traffic volume (ADT) of 8000 vehicles and a posted speed of 35 mph (60 kph) or greater, the polish value of the composite aggregate blend shall be greater than 8.0 when tested according to Maryland State Highway Administration MSMT 411 B ALaboratory Method of Predicting Frictional Resistance of Polished Aggregates and Pavement Surfaces.@ RAP shall be assigned a value of 5.0. The Contractor shall supply all polish values to the Engineer upon request.

e) **Mineral Filler:**

Conform to AASHTO M17.

f) **Warm Mix Additives:**

For any WMA technology requiring addition of any material by the producer during production, the following information will be submitted with the proposed JMF for review and approval at least 30 calendar days prior to production:

1. WMA technology and/or additive information.
2. WMA technology manufacturer's recommendation for usage.
3. WMA technology target dosage rate and tolerance envelope. Support tolerance envelope with test data demonstrating acceptable mix production properties conforming to all sections of this specification.
4. WMA technology manufacturer's material safety data sheets (MSDS).
5. Documentation of past WMA technology field application including points of contact.
6. Temperature ranges for mixing and compacting.
7. Laboratory test data, samples, and sources of all mix components, and asphalt binder viscosity-temperature relationships.

Follow the manufacturer's recommendation for incorporating additives and WMA technologies into the mix. Comply with the manufacturer's recommendation regarding receiving, storage, and delivery of additives.

If the producer performs blending of the WMA technology in their tank, a separate Quality Control plan shall be submitted by the producer to the Department for review and approval at least 30 calendar days prior to production.

g) **Anti-stripping additives**

Conform to standard specifications Section 829 and blend with the asphalt cement in accordance with this specification. Incorporate anti-stripping additives when the Tensile Strength Ratio (TSR) as determined in accordance with AASHTO T283 is less than 80 or when specified for use by the Engineer.

.03 Bituminous Concrete Production – Quality Control

(a) Process Control - Material Production Quality Control.

Submit through electronic mail a QC Plan from each proposed production plant to the Engineer; no hot-mix asphalt material will be accepted until the Engineer approves the QC Plan. This plan must be submitted to the Engineer on an annual basis for review and approval prior to material production. The Engineer will send a signed copy back to the Contractor stating that it is approved. The approved QC Plan shall govern contractor operations.

The QC Plan shall include actions that will assure all materials and products will conform to the specifications, whether manufactured or processed by the Contractor, or procured from suppliers, subcontractors, or vendors. The Contractor shall perform the inspection and tests required to substantiate product conformance to contract requirements. The Contractor shall document QC inspections and tests, and provide copies to the Engineer when requested. The Contractor shall maintain records of all inspections and tests for at least one year. The records shall include the date, time, and nature of deficiency or deficiencies found; the quantities of material involved until the deficiency was corrected; and the date, time, and nature of corrective actions taken.

In the QC Plan shall detail the type and frequency of inspection, sampling, and testing deemed necessary to measure and control the various properties of material and construction governed by the Specifications. The QC Plan shall include the following elements as a minimum:

- Production Plant - make, type, capacity, and location.
- Production Plant Calibration - components and schedule; address documentation.
- Personnel - include name and telephone number for the following individuals:
- Person responsible for quality control.
- Qualified technician(s) responsible for performing the inspection, sampling, and testing.

- Person who has the authority to make corrective actions on behalf of the Contractor.
- Testing Laboratory - state the frequency of accuracy checks and calibrations of the equipment used for testing; address documentation.
- Load number of QC samples (1-10 if QA sample is not within trucks 1-10)
- Locations where samples will be obtained and the sampling techniques for each test
- Tests to be performed and their normal frequency; the following, at a minimum, shall be conducted:
 - Mixture Temperature: each of the first five trucks, and each load that is sampled for QC or acceptance testing.
 - Gradation analysis of aggregate (and RAP) stockpiles - one washed gradations per week for each aggregate stockpile; RAP: five gradations and asphalt cement contents for dedicated stockpiles where new material is not being added; one gradation and asphalt cement content test per week for stockpiles where material is continually being added to the stockpile.
 - Gradation analysis of non-payment sieves
 - Dust to effective asphalt calculation
 - Moisture content analysis of aggregates - daily.
 - Gradation analysis of the combined aggregate cold feed - one per year per mixture.
 - Bulk specific gravity and absorption of blended material - one per year per mixture.
 - Ignition Oven calibration - one per year per mixture.
 - Hot-Bins: one per year per mixture.
 - Others, as appropriate.
- Procedures for reporting the results of inspection and tests (include schedule).
- Procedures for dealing with non-compliant material or work.
- Presentation of control charts. The contractor shall plot the results of testing on individual control charts for each characteristic. The control charts shall be updated within one working day as test results for each subplot become available. The control charts shall be easily and readily accessible at the plant laboratory. The following parameters shall be plotted from the testing:
 - Asphalt cement content.
 - Volumetrics (air voids, voids in mineral aggregates [VMA])
 - Gradation values for the following sieves:
 - 4.75 mm (#4).
 - 2.36 mm (#8).
 - 0.075 mm (#200).
 - Operational guidelines (trigger points) to address times when the following actions would be considered:
 - Increased frequency of sampling and testing.
 - Plant control/settings/operations change.
 - JMF adjustment.
 - JMF change (See 401644 Section .04(a)(1)).
 - Change in the source of the component materials.
 - Calibration of material production equipment (asphalt pump, belt feeders, etc.).
 - Rejection of material.

When any point of non-compliance with the QC plan, or material not meeting the Specifications, comes to the attention of either the Contractor or the Engineer, the other party shall be notified immediately, and the Contractor shall take appropriate corrective actions. Failure to take corrective actions immediately shall be cause for rejection of material or work by the Engineer. The following are considered significant violations to the Contractor's QC Plan:

- Using testing equipment that is knowingly out of calibration or is not working properly.
- Reporting false information such as test data, JMF information, or any info requested by DeIDOT
- Failure to perform materials testing per their approved QC Plan
- Deviating from AASHTO or DeIDOT testing procedures.
- Use of any material or the use of a JMF component in a proportion that exceeds the allowable tolerance as specified in section 04(a)(1) of this specification not listed in the JMF.
- Use of the wrong PG graded asphalt.
- Failure to take corrective action per action points in the Contractors approved QC plan.

The following steps will be taken for violations listed above:

1. First offence: Written notice of violation to the Contractor
2. Second offence: Written notice of violation and forfeiture of any bonus (material production or pavement construction) payment eligibility under 401699 section .03 for that production shift.

3. Third offence: Written notice of violation, forfeiture of bonus payment eligibility, and a 5% deduction of payment based upon contract unit price in addition to any calculated pay adjustment factors per 401699 Section 03.
4. Fourth offence: Written notice of violation, forfeiture of bonus payment eligibility, 50% deduction of payment based upon contract unit price in addition to any calculated payment adjustment factor per 401699 Section 03, and immediate suspension of the Contractor until corrective actions are taken. Corrective actions shall be submitted in writing to the Engineer for approval. The Engineer may request a meeting with the Contractor to discuss proposed changes prior to lifting suspension.

Violations of Contractor QC plans shall be kept on record for a period of 1 year from the date of violation at the Central Lab.

(b) Material Production Test Equipment.

Establish, maintain, and operate a qualified testing laboratory at the production plant site of sufficient size and layout that will accommodate the testing operations of both the Contractor and the Engineer.

Facilities for the use of the Engineer and inspectors shall be a minimum of 600 square feet of floor space conditioned to maintain constant temperature of 77F with two windows and a door equipped with functional locks and latches, located such that plant activities are plainly visible from one window of the building. Work space shall be furnished with illumination, tables, chairs, desks, telephone, and water including drinking water, sanitary facilities, fuel, and power necessary to conduct all necessary tests.

Maintain all the equipment used for handling, preparing, and testing materials in proper operating condition. For any laboratory equipment malfunction, the Contractor shall remedy the situation within one working day or the Engineer may suspend production. In the case of an equipment malfunction, the Engineer may elect to test the material at another qualified testing laboratory while waiting for repairs to equipment.

Maintain minimum calibration records for the referenced equipment:

- SUPERPAVE[®] Gyratory Compactor: once every year; verified once every month by the Engineer.
- Ovens: once every three months, verified once every month.
- Vacuum Container and Gauge (Rice Bowls): once every three months, verified once every month.
- Balances and Scales: once every year, verified once every month.
- Thermometers: once a year; verified once every month.
- Gyratory Compactor molds and base plates: once every year
- Mechanical Shakers: once every year
- Sieve Verifications: once every year

All calibrations shall be documented and on file for review by the Engineer at any time.

(c) Material Production Test Methods

- AASHTO T312 - Preparing and Determining the Density of Hot Mix Asphalt (HMA) Specimens by Means of the Superpave Gyratory Compactor
- AASHTO T166, Method C (Rapid Method) - Bulk Specific Gravity of Compacted Hot Mix Asphalt (HMA) Using Saturated Surface Dry Specimens
- AASHTO T308 - Determining the Asphalt Binder Content of Hot Mix Asphalt (HMA) by the Ignition Method
- AASHTO T30 - Mechanical Analysis of Extracted Aggregate
- AASHTO T209 - Theoretical Maximum Specific Gravity and Density of Hot Mix Asphalt (HMA)
- ASTM D7227 - Standard Practice for Rapid Drying of Compacted Asphalt Specimens using Vacuum Drying Apparatus

.04 Job Mix Formula (JMF)

Mix Design. Develop and submit a job mix formula for each mixture according to AASHTO R35. Each mix design shall be capable of being produced, placed, and compacted as specified. Assign a unique identification number to each JMF.

a) Development of JMF

Gradation: Use the FHWA Superpave 0.45 Power Chart to define permissible gradations for the specified mixture. Type C shall be either a No.4 (4.75 mm), 3/8" (9.5 mm), or 1/2" (12.5 mm) Nominal Maximum Aggregate Size bituminous concrete. Unless otherwise noted in the Plans, the Type C shall meet the 3/8" (9.5 mm) Nominal Maximum Aggregate Size. Type B bituminous concrete shall be the 3/4" (19.0 mm) Nominal Maximum Aggregate Size and the Bituminous Concrete Base Course (BCBC) shall be the 1" (25.0 mm) Nominal Maximum Aggregate Size. Target values for percent passing each standard sieve for the design aggregate structure shall comply with the Superpave control points and should avoid the restricted zone. Percentages shall be based on the washed gradation of the aggregate according to AASHTO T11.

In addition to the results of the material requirements specified above, the following material properties shall be provided by the contractor: bulk specific gravity G_{sb} , apparent specific gravity G_{sa} , and the absorption of the individual aggregate stockpiles to be used, tested according to AASHTO T84 and AASHTO T85 and reported to three decimal places along with the specific gravity of the mineral filler to be used, tested according to AASHTO T100 and reported to three decimal places.

Superpave Gyrotory Compactive (SGC) Effort:

The Superpave Gyrotory Compaction effort employed throughout mixture design, field quality control, or field quality assurance shall be as indicated below. All mixture specimens tested in the SGC shall be compacted to N_M Height data provided by the SGC shall be employed to calculate volumetric properties at N_i , N_D , and N_M

Superpave Gyrotory Compactive (SGC) Effort:

DESIGN TRAFFIC LEVEL (MILLION ESAL'S)	$N_{INITIAL}$	N_{DESIGN}	$N_{MAXIMUM}$
0.3 to < 3	7	75	115
3 to < 30	8	100	160
≥30	9	125	205

Volumetric Design Parameters. The design aggregate structure at the target asphalt cement content shall satisfy the volumetric criteria below:

DESIGN ESAL'S (MILLION)	REQUIRED DENSITY (% OF THEORETICAL MAXIMUM SPECIFIC GRAVITY)			VOIDS-IN-MINERAL AGGREGATE (% - MINIMUM) NOMINAL MAX. AGGREGATE (MM)					VOIDS FILLED WITH ASPHALT (%)
	$N_{INITIAL}$	N_{DESIGN}	N_{MAX}	25.0	19.0	9.5	12.5	4.75	
0.3 to < 3	≤ 90.5	-	-	-	-	-	-	-	65.0 - 78.0
3 to < 10	-	-	-	-	-	-	-	-	-
10 < 30	-	-	-	-	-	-	-	-	-
≤ 30	≤ 89.0	96.0	≤ 98.0	12.5	13.5	15.5	14.5	16.5	65.0 - 75.0 ¹

Air voids (V_a) at N_{design} shall be 4.0% for all ESAL designs. Air voids (V_a) at N_{max} shall be a minimum of 2.0% for all ESAL designs

The dust to binder ratio for the mix having aggregate gradations above the Primary Control Sieve (PCS) Control Points shall be 0.6-1.2. For aggregate gradations below the PCS Control Points, the dust to binder ratio shall be 0.8-1.6. For the No. 4 (4.75 mm) mix, the dust to binder ratio shall be 0.9-2.0 whether above or below the PCS Control Points.

For 3/8@ (9.5 mm) Nominal Maximum Aggregate Size mixtures, the specified VFA range shall be 73.0% to 76.0% and for 4.75 mm Nominal Maximum Size mixtures, the range shall be 75 % to 78% for design traffic levels \$3 million ESALs.

Gradation Control Points:

The combined aggregates shall conform to the gradation requirement specified in the following table when tested according to T-11 and T-27.

TABLE 1

Nominal Maximum Aggregates Size Control Points, Percent Passing										
SIEVE SIZE	25.0 MM		19.0 MM		12.5 MM		9.5 MM		4.75 MM	
	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
37.5 MM	100	-	-	-	-	-	-	-	-	-
25.0 MM	90	100	100	-	-	-	-	-	-	-
19.0 MM	-	90	90	100	100	-	-	-	-	-
12.5 MM	-	-	-	90	90	100	100	-	100	-
9.5 MM	-	-	-	-	-	90	90	100	95	100
4.75 MM	-	-	-	-	-	-	-	90	90	100
2.36 MM	19	45	23	49	28	58	32	67	-	-
1.18 MM	-	-	-	-	-	-	-	-	30	60
0.075 MM	1	7	2	8	2	10	2	10	6	12

Note: The aggregate’s gradation for each sieve must fall within the minimum and maximum limits.

Gradation Classification

The Primary Control Sieve (PCS) defines the break point of fine and coarse mixtures. The combined aggregates shall be classified as coarse graded when it passes below the Primary Control Sieve (PCS) control point as defined below. All other gradations shall be classified as fine graded.

PCS CONTROL POINT FOR MIXTURE NOMINAL MAXIMUM AGGREGATES SIZE (% PASSING)					
Nominal Maximum Aggregates Size	25.0 mm	19.0 mm	12.5 mm	9.5 mm	4.5 mm
Primary Control Sieve	4.75 mm	4.75 mm	2.36 mm	2.36 mm	1.18 mm
PCS Control Point	40	47	39	47	30-60

Plant Production Tolerances:

Volumetric Property	Superpave Criteria
Air Voids (V_a) at (%) N_m	2.0 (min)
Air Voids (V_a) at N_{design} (%)	6.0 (max)
Voids in Mineral Aggregate (VMA) at N_{design}	
25.0 mm Bituminous Concrete Base Course	-1.5
19.0 mm Type B Hot-Mix	+2.0
12.5 mm Type C Hot-Mix	
9.5 mm Type C Hot-Mix	
4.5 mm Type C Hot-Mix	

The proposed JMF shall include the following:

Submit for approval to the Engineer the following documentation on Pinepave mixture design software prior to starting production of a new mixture:

1. Job mix formula (JMF) design of the component materials and target characteristic values for each mixture proposed for use. The component materials design shall include designating the source and the expected proportion (within 1 percent for the aggregate components and within 0.1 percent for the other components) of each component to be used in order to produce workable bituminous concrete meeting the specified properties. Recycled Asphalt Pavement (RAP) is one individual aggregate component regardless of fractionation size. Recycled Asphalt Shingles (RAS) is a separate component from RAP.
2. The JMF target characteristic values include the mixing temperature range, core temperature range for gyration, the percentage of the asphalt cement component (both total and virgin), and the percentages of the aggregate amounts retained on the sieves to be addressed by the JMF as shown in Table 1.
3. Plot of the design aggregate structure on the FHWA Superpave 0.45 power chart showing the maximum density line and Superpave control points.
4. Plot of the three trial asphalt binder contents at +/- 0.5% gyratory compaction curves where the percent of maximum specific gravity (% of G_{mm}) is plotted against the log base ten of the number of gyrations ($\log(N)$) showing the applicable criteria for N_i , N_d , and N_m .
5. Plot of the percent asphalt binder by total weight of the mix (P_b) versus the following:

 % of G_{mm} at N_d , VMA at N_d , VFA at N_d , Fines to effective asphalt binder (P_{be}) ratio, and unit weight (kg/m^2) at both N_d and N_m .
6. Summary of the consensus property standards test results for the design aggregate structure, summary of the source property standards test results for the individual aggregates in the design aggregate structure, target value of the asphalt binder content, and a table of G_{mm} of the asphalt mixture for the four trial asphalt binder contents determined according to AASHTO T209.
7. Test data with each JMF and tests performed by a Qualified Laboratory on representative materials, verifying the adequacy of the design. Refer to the specifications for each mix type in order to determine the design requirements. The JMF sieve percentage values shall conform to the ranges shown in Table 1.

For any mixture that has a 20% or greater failure rate on any combined volumetric criteria, the JMF will not be approved for use on Department contracts.

8. Provide raw material of each JMF so NCAT Ignition Oven calibration correction numbers can be established for the Engineers and Contractors ovens. The Engineer shall provide an ignition oven correction number for each JMF.

.05 Approval of JMF

The Engineer will have up to three weeks once the JMF is submitted to review the submitted information. All submitted JMF's shall correspond to the Pinepave mixture design software. The Engineer, for evaluation of the submitted JMF, will use the first three test samples. These test results acquired during production shall be within the following range compared to the submitted JMF on the Pinepave mixture design software: G_{mm} : +/- 0.030 and G_{mb} : +/- 0.040

a) **Design Evaluation:**

The Engineer may elect to evaluate the proposed JMF and suitability of all materials through laboratory trial batches. All materials requested by the Engineer shall be provided at the contractor's expense to the Central Laboratory in Dover in a timely manner upon request. To verify the complete mixture design and evaluate the suitability of all materials, the following approximate quantities are required:

- 5.25 gal (20 liters) of the asphalt binder;
- 0.13 gal (0.5 liters) sample of liquid heat-stable anti-strip additive;
- 254 lb. (115 kg) of each coarse aggregate;
- 154 lb. (70 kg) of each intermediate and fine aggregate;
- 22 lb. (10 kg) of mineral filler; and
- 254 lb. (115 kg) of RAP, when applicable.

For more expeditious approval, the Contractor may undertake the following steps:

1. Submit the proper documentation on Pinepave mixture design software.
2. Produce the new mixture for a non-Department project. The Engineer will test the material, by taking three series per section 401800 03(c). The mixture will be approved by the Engineer for Department projects if the test results are within the specifications.

A new JMF is required when any of the following conditions occur:

- A change in the source of any of the aggregate component materials
- A change in the proportion of any aggregate component by more than 5.0%
- A change in the aggregate components resulting in a change in percent passing any sieve as identified in Table 1 by more than 5% of the JMF target.
- A change in the target AC content by more than 0.20% from the JMF target to maintain other Volumetric properties of the approved JMF.
- For any mixture that has a 20% or greater failure rate on any combined volumetric criteria.

Although a new JMF is not required, the Contractor shall inform the Engineer of any proposed changes to an existing JMF. The Contractor shall notify the Engineer by electronic mail of the proposed changes. This notification shall include the total change made from the approved JMF proportions, and the effective time of the change. The Engineer will reply to the proposed changes within one operational day and notify the Contractor of the effective date of the changes.

.06 Construction.

(a) Pavement Construction Test Equipment.

The Contractor shall furnish and use in-place density gauges, and/or coring equipment to meet the requirements of these Specifications.

Weather Limitations.

Place mix only on dry, unfrozen surfaces and only when weather conditions allow for proper production, placement, handling, and compacting.

The following table of ambient temperatures for various binder grades and lift thicknesses for placement with the following parameters:

Lift Thickness (in)	PG Binder		
	76-22	70-22	64-22
1.50	50°F	45°F	40°F
2.00	40°F	38°F	35°F
3.00	32°F	32°F	32°F

- Minimum surface temperature of 32°F and
- Minimum production temperature of 275°F and
- Maximum wind speed of 8 miles per hour

Construction outside of these conditions with WMA technology will be at the discretion of the Engineer.

Compaction:

(b) Pavement Construction - Process Control.

Perform Quality Control of pavement compaction by testing in-place pavement density by the following methods.

- ASTM D2950 Standard Test Method for Density of Bituminous Concrete in Place by Nuclear Methods; the use of other density gauges shall be as per the manufacturer's recommendations.
- AASHTO T166, Method C (Rapid Method) Bulk Specific Gravity of Compacted Hot Mix Asphalt (HMA) Using Saturated Surface Dry Specimens
- ASTM D7227 - Standard Practice for Rapid Drying of Compacted Asphalt Specimens using Vacuum Drying Apparatus

Cores may be cut on the first day of paving or once after the change of a JMF for gauge calibration. The number of cores obtained for calibration purposes shall not exceed the number of QA samples obtained by the Department for payment. The Contractor may use any method to select locations for the Quality Control calibration cores.

Repair all core holes in accordance with 401699 Appendix A.

Method of Measurement:

Method of Measurement will be in accordance with Subsections 401.14 and 401.15 of the Standard Specifications.

Basis of Payment:

All work completed under this item shall be considered for full payment and subsequently modified in accordance with the procedures enumerated under 401699.

Material production quality shall be evaluated per item 401699 - Quality Control/Quality Assurance of Bituminous Concrete .03 (a) Material Production - Tests and Evaluations.

Compaction quality shall be evaluated per Item 401699 - Quality Assurance of Bituminous Concrete .03 (b) Pavement Construction - Tests and Evaluations.

12/7/2015

614508 - WATER MAIN AND ACCESSORIES

Description:

The items shall consist of furnishing, transporting and installing the City of Newark water main capping and accessories in accordance with the locations, details and notes on the Plans, and as directed by the Engineer. The work shall be performed in accordance with these Special Provisions, Delaware Standard Specifications, and the requirements of the Standards and Specifications of the City of Newark. In case of conflict between these Special Provisions, Delaware Standard Specifications, and the Standards and Specifications of the City of Newark, the Standards and Specifications and all other requirements of the City of Newark shall prevail. The City of Newark from hereafter shall be addressed as the Owner. The abandoned water main sections shall be abandoned or salvaged as specified on the Plans.

Materials:

All the materials including pipe, fittings, and all other accessories as listed under this Special Provisions, shall conform to the material and quality requirements of the Standards and Specifications of the Owner of the utility. The Owner shall have right to inspect and reject the materials, if his specifications requirements are not met. It is recommended that the Contractor should contact the Owner of the utility and get himself familiarized with the applicable requirements of the materials required under this contract before submitting his bid.

The Contractor shall be responsible for providing materials including pipe, fittings, and all other appurtenances necessary to make permanent connections to existing utility facilities of whatever material type encountered.

Portland Cement Concrete required for the job shall be Class B, and shall conform to Section 812 of the Delaware Standard Specifications.

Special Requirements:

The Contractor's attention is directed to the following special requirements.

The owner shall have the sole right of determining at what times and in what order the Contractor shall undertake work, of making connections and modifications to the existing water system. Prior notice, a minimum of forty-eight (48) hours shall be given to the owner for inspection and supervision by the Contractor of his intention to begin work involving the water line capping. No work shall be started by the Contractor until he has received permission from both the Engineer and the owner to proceed. The Contractor shall immediately notify both the Engineer and the owner of all delays.

It is of prime importance that the Contractor, in the performance of his work, does not disrupt the operation of the existing water facilities in any manner or at any time, without the express prior approval of the owner. The Contractor shall construct, disinfect, maintain and remove, following construction, such temporary water bypasses as may be required during construction to maintain water mains in service. No separate payment shall be made for such temporary water bypasses.

The Contractor will be permitted to close down specific water mains and services for a period of time not exceeding nine (9) hours after obtaining approval from the owner in order to install water main capping as shown on the Plans. The schedule for capping will be so arranged that the water users will be out-of-service for a minimum period of time. The Contractor will receive no additional compensation for working during off-peak hours, including premium time charges. The Contractor shall be responsible for the cost of inspections when the work extends outside of the hours of 8:00 AM to 4:00 PM.

Before any shutdown, as specified above, the Contractor must give the utility owner and local 911 Center and Fire Department forty-eight (48) hours' notice; and the Contractor must also furnish written notice to all water users in the area, a minimum of forty-eight (48) hours in advance of the closing of any water valves which may interrupt customer water service.

Shutdowns shall not be permitted if tapping sleeves and valves are specified for making the connections.

Any and all emergency repairs required during the period of this contract shall be the responsibility of the Contractor. The owner will notify the Contractor by telecommunication and the Contractor shall be required to attend to the repair immediately. In the event the owner is unable to contact the Contractor for immediate emergency repair work in length of time as determined by the owner, the owner reserves the right to attend to any or all emergency repair work, and to submit the costs of repair directly to the Contractor for complete payment.

All materials and work, or parts thereof, which are unsatisfactory as to any or all requirements of the owner or the Engineer, and/or as specified herein, shall be removed and replaced or repaired in an acceptable manner by the Contractor at his own expense.

The Contractor shall guarantee that all workmanship, materials, and work performed under the contract, shall be in strict accordance with the Drawings, Specifications, and other Contract Documents. This guarantee shall be for a period of two years from and after the date of completion and acceptance of the work. The Contractor shall repair, correct or replace as required, promptly and without charge, all work, equipment and material, or parts thereof, which fail to meet the above guarantee, or which in any way fail to comply with or fail to be in strict accordance with the terms and provisions and requirements of the contract during such two-year period.

Construction Methods:

All work in connection with construction of water mains and water service connections shall conform to the applicable requirements of the Standard Specifications of the owner of the utility, except as modified by the Plans and these Special Provisions. In case of conflict, the Specifications of the owner of the utility shall prevail.

Excavation and Trenching - Excavation shall be performed in accordance with Section 208 - Excavation and Backfill for Pipe Trenches, except as amended herein. The bottom of the trench shall be cut true and even, so that the barrel of the pipe will have a bearing for the full length. The trenches for water mains shall be excavated to such depth as will provide pipe elevations as indicated on the Water Main Relocation Profiles. The trenches for water service connections shall be excavated to the minimum standard depth or to such depth as required to connect to existing mains or service pipes.

Payment for excavation and backfill shall be in accordance with Section 208 of the Standard Specifications.

The Engineer and the owner shall have the right to limit the amount of trench opened in advance of pipe laid, and the amount of pipe laid in advance of backfilling. They shall be empowered at any time to require the refilling of open trenches over completed pipelines, if in their judgment, such action is necessary and the Contractor shall therefore have no claims for extra compensation, even though to accomplish such refilling, he is compelled to temporarily stop excavation or other work at any place.

If work is stopped on any trench or excavation for any reason and the excavation is left open for an unreasonable length of time (in the opinion of the Engineer) in advance of construction, the Contractor shall, if so directed, refill such trench or excavation at his own expense and shall not again open said trench until he is ready to complete the work therein.

Where rock is encountered and blasting is required for trenching, all rock excavation work shall be performed in accordance with Subsection 107.11 of the Standard Specifications and as modified; and the trench shall be excavated an additional six inches (6") below grade. After the excavation is completed, a bed six inches (6") in depth of Borrow Type C shall be placed in the bottom of the trench, leveled off and thoroughly tamped. In absence of item for Rock Excavation under this contract, a fixed price of \$135.00 per cubic yard shall be paid for rock excavation.

Installation of Pipe and Fittings - The laying and jointing of water pipe shall be in accordance with the requirements of the owner's Specifications. All pipe and fittings shall be thoroughly cleaned before laying, and shall be kept clean until acceptance of the work. No pipe may be installed except under the supervision of the owner's inspector.

At the close of the work each day, the end of the pipe shall be tightly closed to prevent dirt, foreign substances, or small animals from entering the line until laying is again resumed.

Pipe and fittings shall be carefully handled and lowered into the trench. Special care shall be taken to make sure all pipes are well bedded on solid foundation. Any defects due to settlement shall be made good by the Contractor at his expense.

Where the manufacturer's recommended pipe joint deflection is exceeded, mechanical joint bends shall be required and installed to the satisfaction of the owner and the Engineer at no extra expense.

Thrust blocks of Portland Cement Concrete Class B of adequate size and weight shall be used on all pressure piping for all fittings and all bends including and in excess of 11 - 1/4 degrees unless specifically called for otherwise on the Plans. Thrust blocks (buttresses) shall conform to the details shown on the Plans and/or the owner's Standard Specifications. No separate payment shall be made for thrust blocks, couplings, service saddles and other required incidentals; and payments for these shall be included in water main pipes.

No pipe shall be laid upon a foundation into which frost has penetrated, nor at any time when the owner or the Engineer shall deem that there is danger of frost penetration at the bottom of the excavation, unless all requirements as to the minimum length of open trench and promptness of refilling are observed.

The Contractor shall keep all excavation free from water or other liquids during the progress of the work; and backfilling of trenches shall meet the applicable requirements of Sections 208 and 210 of the Standard Specifications.

If inspection shows defects, including visible leaks, such defective work or material shall be replaced at the expense of the Contractor, and inspection shall be repeated. All repairs shall be made with new material.

Sterilization of Main - Prior to the final connection of the newly installed pipe into the existing water main, and with the plugs used in the pressure test still in place on the installed pipe, the entire installed system shall be sterilized, using one of the procedures as specified in AWWA Standard C601-54 and as required by the owner of the utility.

The Contractor shall provide an adequate blowoff for use in flushing of the main. Before the water is turned on for use by the consumer from the relocated mains, the owner will conduct bacteriological tests on water samples taken from the blowoff. All expenses incurred in the making of these tests by the owner will be borne by the Contractor. No water shall be turned on for use by the consumer from the newly installed water main until the owner gives final sanitary approval.

Before the final connection is made, all surfaces of the relocated line, and the existing water main that are to become part of the closing joint, including all gaskets and glands, shall be thoroughly cleaned, and shall be treated with a 5% solution of Sodium Hypochlorite. Extreme care is to be exercised in order to prevent the entrance of any contaminants into the main.

All expenses and cost incurred in carrying out the specified sterilization work shall be borne by the Contractor at no extra cost to the owner or the State and shall be included in the contract unit price per linear foot bid for the item Installing Water Main for the various sizes.

Abandoning and/or Removing Existing Water Mains - All existing water mains which are to be abandoned and are located within the limits of excavation shall be removed and become the property of the Contractor. Adjacent pipe openings shall be plugged as required in accordance with the Subsection 202.04 of the Standard Specifications.

Final Location Drawings - Within thirty (30) days after completion of required work, the Contractor shall submit an accurate print or prints showing the horizontal and vertical location of mains, bends and other appurtenances to the Engineer and the owner. State plane coordinates shall be provided for all water main structures installed under this contract.

Method of Measurement:

The measurement of payment shall be for the installation of the materials listed in the breakout sheet in accordance with the units indicated as Each and the number of Linear Feet of pipe(s) of specified diameter(s) excluding the portion of pipe inserted inside the accessories installed in place, complete and accepted.

Basis of Payment:

The quantity of mains and accessories will be paid for at the Contract lump sum. Price and payment shall constitute full compensation for furnishing, transporting and installing the materials, concrete buttresses, pressure testing, sterilizing the water mains and connecting to the existing water main, maintaining service as required and for all labor, equipment, tools and necessary incidentals to achieve and accept operational water main.

No separate payment shall be made for salvaging or abandoning or removing and disposing of existing water mains and cost for such required work shall be incidental to the respective sizes for installing water main.

A breakout sheet attached to the Proposal lists the different elements of work or materials involved in completing this item. The Contractor shall fill in a unit price for each item and the cost (unit price times the proposed quantity). The Lump Sum cost for Item 614508, shall be derived from the total sum of the cost of all items listed. The breakout sheet shall be attached to the Bid Proposal.

The Department reserves the right to delete from the Contract one or more items listed and the right to add or subtract from the quantity of each item. The total price to be paid will be adjusted in accordance with the Contractor's unit prices as required above. There will be no extra compensation or increase in unit prices in the breakout sheet if such additions and/or deletions are made to the quantities.

3/2/17

705505 - RESET STONE/BRICK SIDEWALK AND/OR STONE/BRICK ROADWAY

Description:

This work consists of removing and resetting the existing stone/brick sidewalk and/or roadway in accordance with details, notes on the Plans and as directed by the Engineer.

Materials and Construction Method:

The stone/brick blocks from the existing sidewalks and/or roadway shall be removed, cleaned and stored for later use. Sand and/or mortar required for setting the stones/bricks shall comply with the applicable requirements of Section 610 of the Standard Specifications.

The installation pattern and spacing of stones/bricks shall match the existing sidewalk and/or roadway setting, unless otherwise specified on the Plans. The stones/bricks shall be set on an approved compacted foundation with 2" (50 mm) of sand over it. Joint filler material (sand or mortar) shall be compatible with the original sidewalk and/or roadway.

After completion of stone/brick setting, the sidewalk and/or roadway surface area shall be thoroughly cleaned of mortar and/or as applicable to the contract.

Method of Measurement:

The quantity of stone/brick sidewalk and/or roadway reset will be measured as the number of square feet (square meters) measured at the surface of the sidewalk and/or roadway, reset and accepted.

Basis of Payment:

The quantity of stone/brick sidewalk and/or roadway reset will be paid for at the Contract unit price per square foot (square meter). Price and payment will constitute full compensation for removal, storage and cleaning of stones/bricks, furnishing all materials, resetting and cleaning the sidewalk and/or roadway, disposal of discarded materials, for all labor, tools, equipment, and all necessary incidentals to complete the work. The cost of providing replacement stone/brick for those which are damaged is incidental to this item.

3/5/05

705528 - TEMPORARY CURB RAMP

Description:

This item shall consist of furnishing, erecting and installing Temporary Curb Ramps at the required location(s) and in accordance with the notes and details on the Plans and as directed by the Engineer.

After the completion of the project, the Temporary Curb Ramps shall become the property of the Contractor and shall be removed from the project site.

Materials and Construction Methods:

The Temporary Curb Ramps shall be used as required during maintenance of traffic and pedestrians during construction as directed by the Engineer. Curb ramps must be provided wherever an accessible pedestrian route crosses a curb or experiences a change of grade requiring a temporary curb ramp. The smallest possible slope should be used for all ramps and the maximum slope is 1:12. Transitions from ramps to walks or streets should be flush without abrupt changes. The adjoining landing areas, within three (3) feet of temporary curb ramps, shall not exceed 1:20. Temporary curb ramps must have a minimum width of 36", exclusive of flared sides. Temporary curb ramp surfaces must be stable and slip resistant. Changes in surface level up to ¼ inch may be vertical without edge treatment. Changes in surface level greater than ¼ inch must use a ramp. If a curb ramp is located where pedestrians must walk across the ramp or where the ramp is not shielded by handrails or guardrails, it must have flared sides. The maximum slope of the flare shall be 1:10.

The Contractor shall submit the locations of temporary curb ramps to be used during each stage of construction to the Engineer as part of the maintenance of pedestrian access plan for approval. The Engineer shall approve the Temporary Curb Ramp materials including the posts and methods of fabrication prior to installation.

Due to space limitations, the Contractor may be required to move the temporary curb ramps and/or reposition curb ramps from time to time so that adjacent construction activities and pedestrian access can coexist within the project site simultaneously as required. No payment shall be made for such relocation and the cost shall be incidental to the item.

Method of Measurement:

Temporary Curb Ramps shall be erected by the Contractor as required with payment to be made on an each (EA) used basis for the duration of the contract for temporary curb ramps actually furnished and used as required and approved by the Engineer.

Basis of Payment:

The number of temporary curb ramps measured as described above, shall be paid for at the contract unit price bid per each as required by the Contract. Price and payment shall be full compensation for furnishing, placing, maintaining, repositioning, preparation and cleaning the curb ramp area, removal and disposal of the temporary curb ramps and related accessories, furnishing all labor, materials, equipment, tools and all incidentals necessary to complete the work. Temporary Curb Ramps stolen or damaged shall be replaced at the Contractor's expense.

12/18/08

705530 – TRIANGULAR CHANNELIZING ISLANDS

Description:

Furnish all materials to construct Triangular Channelizing Island(s) on a prepared foundation as shown on the details in Plans, at the location(s) shown on the Plans, and/or as directed by the Engineer.

Materials:

Provide materials as specified in:

Graded Aggregate Base Course	Section 302
Bituminous Pavement	Section 401
Bituminous Patching	Section 406
Portland Cement Concrete	Section 812, Class B
Expansion Joint Material	Subsection 808.06
Curing Compound	Subsection 812.02 (i)
Delineator	As Submitted and approved by Engineer

General: Submit all proposed sources of materials to Materials and Research Section in accordance with Subsection 106.01.

Construction Methods:

- A. Construction of Triangular Channelizing Island(s)
1. Sawcut existing bituminous concrete pavement or PCC pavement, if applicable;
 - a. For bituminous concrete pavements, sawcut 2' minimum from the proposed face of curb of the island to allow enough room to achieve compaction for hot-mix patching;
 - b. For PCC pavement, sawcut at the proposed face of curb.
 2. Remove bituminous concrete pavement or PCC pavement and dispose of in accordance with Subsection 106.09 and/or permits, if applicable;
 3. Prepare the foundation for the curb in accordance with Subsections 701.05;
 4. Place Graded Aggregate Base Course (GABC) for curb installation at the location and depths shown on the plans in accordance with Section 302;
 5. Layout and pour PCC Curb Type II in accordance with Section 701 unless otherwise specified on the plans or directed by the Engineer;
 - a. Finish curb in accordance with Subsection 701.11;
 - b. Cure curb in accordance with Subsection 701.13;
 - c. Backfill curb in accordance with Subsection 701.14 after removal of forms, or upon completion of slip-form operation;
 6. Prepare the foundation for the sidewalk in accordance with Subsection 705.05;
 7. Place concrete for sidewalk at depth(s) shown on plans in accordance with Section 705;
 - a. Install 4" PVC sleeve for signs at locations shown on plans;
 8. Construct Curb Ramps, if applicable, in accordance with the requirements of the Standard Construction Details, any modifications on the plans and to all the applicable requirements of Section(s) 302 and 705 of the Standard Specifications.
 9. Furnish and install Sidewalk Surface Detectable Warning System, if applicable, in accordance with the requirements of the Standard Construction Details and to all the applicable requirements of Section 705.

10. Perform bituminous concrete patching in accordance with Section 406 and/or PCC patching in accordance with Section 503, if applicable, as shown on plans or otherwise match existing pavement structure;
11. Furnish and install Delineator(s) on the leading ends/corners of the island(s).

Method of Measurement:

The quantity of Triangular Channelizing Island(s) will be measured as the number of square foot (square meter), from face of curb to face of curb, of Triangular Channelizing Island(s) installed and accepted.

Sidewalk Surface Detectable Warning System will be measured and paid for under Item No. 705007.

Basis of Payment:

The quantity of Triangular Channelizing Island(s) will be paid for at the Contract unit price per square foot (square meter). Price and payment constitutes full compensation for sawcutting hot-mix, sawcutting concrete full depth, removal and disposal of existing materials, foundation preparation, furnishing and placing all materials including but not limited to; GABC, concrete for curb and sidewalk, expansion joint material, the construction of curb ramps within the limits of the island, bituminous pavement and/or PCC pavement patching, for furnishing and installing delineator(s) and for all labor, tools, and incidentals necessary to complete the work.

No additional payment will be made under other contract items for work necessary to construct the island except Item No. 705007 - Sidewalk Surface Detectable Warning System.

Note: The curb and sidewalk components are not to be placed monolithically unless otherwise directed by the Plans or the Engineer.

10/25/2013

710501 - CONVERTING EXISTING CATCH BASIN TO MANHOLE

Description:

This work consist of furnishing all materials, and constructing a manhole from an existing catch basin in accordance with the locations, notes and details shown on the Plans, and as directed by the Engineer.

Materials and Construction Methods:

Materials and construction methods shall conform to the applicable requirements of Section 708 of the Standard Specifications, and as specified on the Plans.

Portland Cement Concrete shall meet the requirements of Class B, Section 812 of the Standard Specifications.

Method of Measurement:

The quantity of catch basins converted to manholes will be measured as the number of catch basins converted to manholes and accepted.

Basis of Payment:

The quantity of catch basins converted to manholes will be paid for at the Contract unit price per each. Price and payment will constitute full compensation for constructing the manhole from the existing catch basin, for all materials including reinforcing steel, cover & frames and for all labor, equipment, tools, and incidentals necessary to complete the item. The cost for salvaging and delivering gratings to the location as specified on the Plans shall be included in the unit price bid for the item.

7/9/02

710506 - ADJUST AND REPAIR EXISTING SANITARY MANHOLE

Description:

This work consists of adjusting and repairing existing sanitary manholes in accordance with notes and details on the Plans and as directed by the Engineer.

Materials and Construction Methods:

Materials and construction methods shall conform to the applicable requirements of Section 710 of the Standard Specifications, and the Standard Specifications of the owner of the sewer system. If there is a conflict between the Department's Specifications and the Specifications of the owner, the latter will prevail.

Method of Measurement and Basis of Payment:

The method of measurement and basis of payment for the item shall be made in accordance with Subsections 710.09 and 710.10 of the Standard Specifications.

8/28/01

743552 – PEDESTRIAN CHANNELIZING BARRICADE SYSTEM

Description:

Furnish, place, relocate, and maintain a pedestrian channelizing barricade system in accordance with the requirements of the Americans with Disabilities Act (ADA), the Delaware Manual on Uniform Traffic Control Devices (DE MUTCD), these specifications, the plans and details, and as directed by the Engineer.

Materials:

Furnish a pedestrian channelizing barricade system meeting the National Cooperative Highway Research Program (NCHRP) Report 350 or the Manual for Assessing Safety Hardware (MASH) Test Level 2 certification. The approved system must have been tested as a barricade in accordance with the NCHRP 350 and/or MASH testing criteria. Submit a copy of the FHWA certification letter and associated documentation to the Engineer prior to acceptance by the Department and prior to installation of the device on the project.

- A. *Barricade Rails:*
 - 1. Manufactured from high density polyethylene (HDPE) with UV inhibitors.
 - 2. Barricade rails must accommodate a minimum of 7 3/4" (197 mm) wide retroreflective sheeting on both sides of the rails.
 - a. Use white prismatic and fluorescent orange retroreflective sheeting where the white and fluorescent orange colors are placed at 45-degree angles.
- B. *Barricade supports:*
 - 1. Manufactured from high density polyethylene (HDPE) with UV inhibitors and internally ballasted.
 - a. Use ballast material in accordance with manufacturer recommendations.

Construction Methods:

Construct the barricade with continuous delineation along the designated walkway for use as a channelization device.

- A. Assemble the barricade without hardware and in accordance with manufacturer's recommendations.
- B. Provide continuous upper and lower rails for hand or cane trailing.
 - 1. Install upper rail of barricade a minimum 36" (1 m) above the ground, measured from the ground to the top of the upper rail.
 - 2. Install lower rail of the barricade a minimum of 1 1/2" (38 mm) above the ground, measured from the ground to the bottom of the lower rail.
- C. No portion of the barrier structure or supports may extend into the walkway more than 3/4" (19 mm) further than the common plane formed by the upper and lower rails.
- D. Ensure that barricade joints are smooth and snag-resistant to accommodate safe hand trailing.
- E. Provide accommodations for attachment of audible information devices.
- F. Pedestrian channelizing barricades cannot be used as road closure barricades or provide positive protection between the temporary walkway and vehicular traffic.
- G. Remove pedestrian channelizing when it is no longer needed.
 - 1. Dispose of all materials in accordance with Subsection 106.09

Method of Measurement:

Pedestrian channelizing barricade will be measured along the linear centerline of the barricade in units of linear feet per day (LF/DY), acceptably installed, maintained, removed and completed as specified

Basis of Payment:

Pedestrian channelizing barricade will be paid for at the contract unit price bid per linear feet per day for the item Pedestrian Channelizing Barricade. Price and payment includes full compensation for providing certification, furnishing, placing, maintaining, and relocating the barricades as required, all labor, equipment, tools, and all incidentals necessary to complete the work. Replace barricades stolen or damaged at no cost to the Department.

2/23/12

- 744500 - CONDUIT JUNCTION WELL, TYPE 6, PRECAST POLYMER CONCRETE
- 744506 - CONDUIT JUNCTION WELL, TYPE 7, PRECAST POLYMER CONCRETE
- 744507 - CONDUIT JUNCTION WELL, TYPE 8, PRECAST POLYMER CONCRETE
- 744508 - CONDUIT JUNCTION WELL, TYPE 9, PRECAST POLYMER CONCRETE
- 744509 - CONDUIT JUNCTION WELL, TYPE 10, PRECAST POLYMER CONCRETE
- 744520 - CONDUIT JUNCTION WELL, TYPE 1, PRECAST CONCRETE
- 744523 - CONDUIT JUNCTION WELL, TYPE 4, PRECAST CONCRETE
- 744524 - CONDUIT JUNCTION WELL, TYPE 5, PRECAST CONCRETE
- 744530 - CONDUIT JUNCTION WELL, TYPE 11, PRECAST CONCRETE/POLYMER LID-FRAME
- 744531 - CONDUIT JUNCTION WELL, TYPE 14, PRECAST CONCRETE/POLYMER LID-FRAME
- 744532 - CONDUIT JUNCTION WELL, TYPE 15, PRECAST CONCRETE/POLYMER LID-FRAME

Description:

This work consists of supplying, constructing and installing conduit junction wells as shown on the applicable Plan Sheets or Standard Construction details

Materials:

Concrete shall conform to Section 812, Class B of the Standard Specifications.

Castings shall conform to Section 708.05 of the Standard Specifications.

Frames and lids shall be in accordance with Sections 708 and 744 of the Standard Specifications.

All required hardware and wire for Bonding and Grounding as shown on the Standard Construction or applicable Plan details.

Types 6, 7, 8 and 10 are precast polymer concrete stackable boxes with no base.

Precast polymer concrete is reinforced by heavy-weave fiberglass with a compressive strength of 9,000-15,000 psi, impact energy of 30-72 ft. lbs. and a tensile strength of 800-1,100 psi. Precast polymer concrete should be tested according to the requirements of ASTM Method D-543, Section 7, Procedure 1 for chemical resistance.

All precast polymer concrete covers shall be the heavy-duty type with a design load of 15,000 lbs. over a 10" square. The coefficient of friction should be greater than 0.5. The precast polymer concrete cover logo shall bear the inscription "DelDOT" (Types 6, 8, and 10) or "DelDOT TRAFFIC FIBER OPTICS" (Type 7).

Types 11, 14, and 15 are precast polymer frame and lids installed on a precast concrete base. Precast polymer concrete frame and lids shall be the heavy-duty nonconductive type with a design load of 15,000 lbs. over a 10" square. The coefficient of friction should be greater than 0.5. The precast polymer concrete lid logo shall bear the inscription "DelDOT ELECTRIC"(Types 11, 14, and 15)

Construction Methods:

The conduit junction well shall conform to the dimensions shown on the Standard Construction or applicable Plan Details, or on the manufacturer's specifications and shall be built so as to ensure that the cast iron frame and lid or polymer concrete box and cover are set level with the surrounding surface when constructed within pavement, sidewalks, pedestrian curb ramps, etc., and set above grade and graded to drain away from the junction well when constructed in unpaved areas. More than one conduit may extend into the well and shall conform to the dimensions shown on the applicable plan sheets or Standard Construction Details. A stone base shall be built for all types of junction wells. Grounding and bonding of the units shall be performed as shown on the plans or Standard Construction details.

Method of Measurement:

The quantity of junction wells shall be the actual number of conduit junction wells by type, that are supplied, constructed, complete in place, and accepted, including cast iron frames and lids with grounding lugs, precast polymer concrete frame and covers, or precast polymer concrete covers, stone base, bonding, grounding, and splicing if required. Frames and lids or precast polymer concrete covers must be installed prior to acceptance of this item.

Payment for all conduits extending into the junction well shall be included in the items for conduit installation.

The length of ALL conduits within a junction well shall conform to the Standard Construction or applicable Plan Details or as directed by Engineer. Payment for cutting existing conduit as directed by Engineer, where a junction well is replaced with a larger type of junction well is included in the bid price. The removal and replacement of cables within the conduits to be shortened shall be handled under other items of this contract.

Basis of Payment:

Payment for conduit junction wells as measured above shall be made at the Contract unit price per each junction well of the type indicated, completely installed and constructed, including excavation, backfilling, and stone base. Price and payment will constitute full compensation for all labor, equipment, tools, and incidentals required to complete the work.

2/29/12

- 744533 - FURNISH & INSTALL FRAME AND LID FOR JUNCTION WELL, TYPE 1
744534 - FURNISH & INSTALL FRAME AND LID FOR JUNCTION WELL, TYPE 4
744535 - FURNISH & INSTALL FRAME AND LID FOR JUNCTION WELL, TYPE 5
744536 - FURNISH & INSTALL PRECAST POLYMER COVER FOR JUNCTION WELL, TYPE
6
744537 - FURNISH & INSTALL PRECAST POLYMER COVER FOR JUNCTION WELL, TYPE
7
744538 - FURNISH & INSTALL PRECAST POLYMER COVER FOR JUNCTION WELL, TYPE
8
744539 - FURNISH & INSTALL PRECAST POLYMER COVER FOR JUNCTION WELL, TYPE
9
744540 - FURNISH & INSTALL PRECAST POLYMER COVER FOR JUNCTION WELL, TYPE
10
744541 - FURNISH & INSTALL FRAME AND LID FOR JUNCTION WELL, TYPE 11
744542 - FURNISH & INSTALL FRAME AND LID FOR JUNCTION WELL, TYPE 14
744543 - FURNISH & INSTALL FRAME AND LID FOR JUNCTION WELL, TYPE 15

Description:

This work consists of furnishing and installing cast iron frames and lids or precast polymer concrete covers for existing junction wells only. The item shall not be used when furnishing new junction wells as the frames and lids are included in the price for the new units. The frames and lids are as shown on the Standard Construction or applicable Plan Details. The work includes furnishing and installing all required materials and hardware to properly ground the unit, including wire and splicing if required and as shown on the Standard Construction or applicable Plan Details.

Materials:

Castings for frames, lids, and ½” dia. x 1 ¼” grounding lugs shall conform to Section 708.05 of the Standard Specifications and Standard Construction Details or applicable Plan Details.

Precast polymer concrete covers shall be reinforced by heavy-weave fiberglass. All precast polymer concrete covers shall be the heavy-duty type with a design load of 15,000 lbs. over a 10" square and a coefficient of friction greater than 0.5. The precast polymer concrete cover logo shall bear the inscription "DelDOT Traffic" for Types 6, 8, and 10 and "DelDOT Traffic Fiber Optics" for Type 7. The precast polymer concrete cover Type 11, 14, and 15 logo shall bear the inscription "DelDOT ELECTRIC".

Material for Grounding, bonding, and all related hardware and wire (including splicing if required) shall be as shown on the Standard Construction or applicable Plan Details.

Method of Measurement:

The quantity of spare frames and lids or precast polymer concrete covers shall be the actual number of frames and lids or precast polymer concrete covers by type furnished, installed, bonded, grounded and accepted.

Basis of Payment:

The item shall be paid for at the Contract unit price per each. Price and payment will constitute full compensation for all labor, equipment, tools, and incidentals required to complete the work.

2/29/12

744544 – ADJUST OR REPAIR EXISTING CONDUIT JUNCTION WELL

Description:

This work consists of adjusting or repairing existing conduit junction wells, including furnishing all materials, in accordance with this specification, notes and details on the applicable Plans, the Standard Construction Details, and as directed by the Engineer. If Bonding and Grounding of the unit is required, that work will be paid for under “Bonding and Grounding Existing Junction Well”.

Materials:

Portland cement concrete shall conform to the requirements of Section 812, Class B.

Mortar shall conform to the requirements of Section 611.

Brick shall conform to the requirements of Section 611.

Concrete block shall conform to the requirements of Section 819.

Construction Methods:

Repair of conduit junction wells includes repairing/patching the masonry walls and resetting existing frames and lids or precast polymer concrete covers.

Adjusting involves raising the elevation of the frame and lid to match the grade of the surrounding area.

Method of Measurement:

The quantity of conduit junction wells adjusted or repaired will be measured as the actual number of conduit junction wells adjusted or repaired and accepted. If a new frame and lid or precast polymer concrete cover is needed, it will be supplied under a separate item.

Basis of Payment:

The quantity of conduit junction wells will be paid for at the Contract unit price per each junction well. Price and payment will constitute full compensation for excavating, backfilling, compacting and disposing of excess materials, for furnishing and placing all materials and for all labor equipment, tools and incidentals required to complete the work.

2/29/12

- 745601 – FURNISH & INSTALL UP TO 3” FLEXIBLE METALLIC-LIQUIDTIGHT CONDUIT**
- 745602 - FURNISH & INSTALL UP TO 4” SCHEDULE 80 HDPE CONDUIT (BORE)**
- 745603 - FURNISH & INSTALL UP TO 4” SCHEDULE 80 PVC CONDUIT (OPEN CUT)**
- 745604 - FURNISH & INSTALL UP TO 4” SCHEDULE 80 PVC CONDUIT (TRENCH)**
- 745605 - FURNISH & INSTALL UP TO 4” SCHEDULE 80 PVC CONDUIT (ON STRUCTURE)**
- 745606 - FURNISH & INSTALL UP TO 4” GALVANIZED STEEL CONDUIT (TRENCH)**
- 745607 - FURNISH & INSTALL UP TO 4” GALVANIZED STEEL CONDUIT (BORE)**
- 745608 - FURNISH & INSTALL UP TO 4” GALVANIZED STEEL CONDUIT (OPEN CUT)**
- 745609 - FURNISH & INSTALL UP TO 4” GALVANIZED STEEL CONDUIT (ON STRUCTURE)**
- 745610 - FURNISH & INSTALL UP TO 4” NONMETALLIC POLE RISER SHIELD**

Description:

Furnish and install HDPE, PVC, or Galvanized steel conduits of any size less than or equal to 4 inches in diameter (3 inches or less for Flexible Metallic Liquidtight Conduit) as described below.

Materials:

All conduits shall be UL listed.

HDPE Conduit - 4" or less diameter, high density polyethylene (HDPE) schedule 80, smooth wall conduit with permanently pre-lubricated lining, meeting ASTM D2447, ASTM D3035 and NEMA TC7 specifications.

PVC Conduit - 4" or less diameter, schedule 80 rigid polyvinyl chloride (PVC) conduit, meeting Commercial Standard CS-272-65 (PVC), ASTM D-1785 and U.C. Standard 651 specifications.

Galvanized Steel Conduit - 4" or less diameter, rigid galvanized steel conduit meeting National Electric Code 2002, Article 344.

Nonmetallic Pole Riser Shield – 4” diameter or less nonmetallic pole riser shield with belled ends meeting NEMA TC-19 specifications.

Flexible Metallic-Liquidtight Conduit – meets National Electric Code 2002, Article 350

Weatherhead for galvanized or PVC conduit – material shall match the adjoining conduit

Insulated grounding bushing with knockouts - meet or exceed UL 514 B

Condulets for conduit sizes - material shall match the adjoining conduit

Anchors - A 307, Galvanized per A 153

One hole conduit hangers - Steel City Series 6H or 6H-B, CADDY CD3B Rigid Conduit Hanger, or approved equal

End caps - material shall match the adjoining conduit

LONG sweep sections for conduit sizes - material shall match the adjoining conduit, and shall be manufactured 90 degree sweeping bends.

Construction Methods:

General Installation Requirements - The Department has the right to reject any installation method proposed for a given work site. PVC shall not be installed under existing pavement unless it is on a continuous roll or with the Engineer’s written approval.

Conduit installed underground shall be installed in a straight line between terminal points. In straight runs, junction well spacing shall be no more than 600 feet for fiber optic conduit or no more than 300 feet for copper in conduit, or as directed by the Engineer. If bends are required during installation, they must be manufactured sweeping bends. The Engineer will be consulted before any bends are installed to ensure that the proper arc is provided.

Conduit shall have a minimum cover as measured from the finished grade of 24 inches and a maximum cover of 48 inches.

The opening shall be filled half way with the cover material, and tamped down firmly before filling in the remainder of the opening. Additional lifts shall be used as required to install the metallic warning tape at the specified depth. All cover material shall be free of rocks, debris, vegetation or other deleterious material that may damage the conduit. An underground utility warning tape shall be installed as specified in this section and the remainder of the fill shall be added, tamping down the top layer.

Conduit not terminated to a base or in a junction well shall be terminated 2 feet beyond the edge of the pavement unless otherwise directed by the Engineer, and properly capped. Tape is NOT an approved method. Conduit shall not extend more than 3 inches inside a junction well. See Standard Construction Details or applicable Plan Details for typical methods of termination.

All underground conduits shall be marked in the ground with a metallic warning tape. The marking tape shall be buried directly above the conduit run that it identifies, at a depth of approximately 12 inches below final grade. The tape identifying ALL conduits shall be at least 6 inches wide, and have a minimum thickness of 3 mils and 500 percent elongation.

The color of the metallic warning tape identifying fiber optic cable should be bright orange (preferably AULCC orange), and shall read "WARNING - OPTICAL CABLE" or other wording approved by the Engineer that conveys the same message. The color of the tape identifying all other cables shall be bright red, and shall read "WARNING —BURIED ELECTRIC BELOW" or other wording approved by the Engineer that conveys the same message.

Using conduit tools, rigid metallic conduit shall be cut, reamed, and threaded. The thread length shall be as necessary to ensure that the sections of conduits when screwed into a coupling and tightened correctly will butt together and the joint will be watertight. A three-piece threaded union, as approved by the Engineer, shall be used to join two threaded lengths of conduit in the case where a standard coupling will not work. A threaded union shall not be used in a conduit run that is to be driven. At no time is a threadless coupling or a split-bolt coupling to be used for direct buried conduit.

All lengths of HDPE conduit shall be connected with irreversible fusion couplings. Mechanical and removable couplings will not be accepted.

All lengths of PVC conduit shall be connected by one conduit end fitting inside the flared end of the other conduit section. If this is not possible, then a coupling may be used. Regardless of how connection is made, all joints shall be sealed with the appropriate epoxy to ensure that the two conduit pieces bond to one another to form a solid waterproof link. Using conduit tools, the conduit shall be cut and prepared. If approved by the Engineer, a coupler module may be used where conduit segments do not align properly to allow the flared end of one conduit segment to mate with the normal end of the other segment.

Sealed end caps (with knockouts if empty) shall be placed on the ends of all conduits, after compressed air has been used to clear all foreign matter. If not already pre-installed by the manufacturer, a polyester or polypropylene pulling rope or tape (fish wire) with a minimum rated strength of 1250 pounds shall be installed in each conduit for future use. In instances where the Contractor installs the cable, the fish wire may be eliminated. All PVC and HDPE conduits shall have a continuous metallic trace wire installed for the entire length of the conduit run for all fiber installations.

Installation Of Conduit Under Existing Pavement, Directional Bore -

Directional bore shall be used for installation of conduits under existing pavement with a conduit diameter not less than 1-1/2". The size of a bore shall not exceed the outside diameter of the conduit by more than 1 inch. If it does, cement grout shall be pumped into the void. **Only HDPE and/or Galvanized Steel conduit may be installed by Directional Bore methods.**

Installation Of Conduit Under Existing Pavement, Open Cut -

Installation by sawcutting the full pavement depth and removing the existing pavement with an excavator or by hand methods, shall be used only for conduits not less than 1-1/2" diameter. The Engineer must first approve all open cutting of roadways. The width and length of open cut and patch restoration materials shall be as shown on the plan details. The Contractor shall be responsible for the removal of all cut pavement and surplus excavation, and for the replacement and correction of any damaged pavement outside the sawcut limits after the conduit(s) are installed. Asphalt pavement, concrete, base course, sawcutting, and/or borrow from an outside source as required to restore the roadway will be paid for separately under their respective bid items.

Installation Of Conduit Under New Pavement, Unpaved Trench -

Trenching or other approved method shall be used for installation of conduit in unpaved trench or under new pavement. Backfill in conduit trenches shall be compacted thoroughly as it is being placed. At the discretion of the Engineer, sod, that must be removed for the placement of conduit, shall be removed either by the use of an approved sod cutter and then replaced, or 6 inches of topsoil shall be placed and the surface seeded in accordance with Section 908 - Seeding. In areas where new pavement is to be placed or in areas where total reconstruction is taking place, sodding or seeding may not be required by the Engineer. Sodding and/or topsoil from an outside source if required will be paid for separately under their respective bid items. Seeding is considered incidental to the conduit item.

Installation Of Conduit On Structure -

Conduit installed on structure shall consist of drilling anchors into concrete, brick, stone, steel or wood and mounting the conduit with the proper clamps or hangers. The conduit shall be attached to the structure by use of one-hole conduit hangers and approved anchors not more than 36 inches apart. Any 90-degree turns in the conduit run shall be accomplished by placing the proper size and type manufactured sweeping bends for the application needed.

Installation of Nonmetallic Riser Shield or Flexible Metallic Liquidtight Conduit -

Riser Shield and/or Flexible Metallic Liquidtight Conduit installed on wood poles, metal poles, structures, and/or mast arms shall be installed in a straight line. The conduit, when attached to poles, shall be attached with 2-hole straps spaced not more than 36 inches apart with the top-most strap being 12 inches from the weatherhead and the lower-most being 12 inches from the conduit. A weatherhead matching the diameter of the conduit shall be installed on the upper end of the conduit. A conduit of the same size as the conduit being installed, but not smaller than 2 inches shall be placed 48 inches above finished grade. Install two, 2-hole straps of the proper size, evenly spaced below the conduit. Nonmetallic pole risers (U-guard) shall be installed on poles to allow interduct to be connected directly to messenger cable. The underground conduit shall be as close to the base of the pole as possible. If the nonmetallic pole riser or metallic liquidtight conduit is not the same size as the conduit, an adapter shall be used at no additional cost to the Department. The nonmetallic pole riser or metallic liquidtight conduit shall be attached to the pole with 1/4" x 1-1/2" galvanized lag bolts with washers. Lag bolts will be used every 36 inches on BOTH sides of the nonmetallic pole riser or liquidtight conduit, and in the top most and bottom most set of slots. Flexible metallic liquidtight conduit shown on the plans to be installed on mast arms or on metal structure shall also include stainless steel banding placed at a maximum of 5 feet intervals.

Method of Measurement:

The quantity of conduit or riser shield installed as specified, shall be measured as the number of linear feet of each conduit or riser shield installed as specified, complete in place, and accepted.

The length of each conduit installed under existing pavement by a directional bore or by open cutting the pavement shall be measured along the path of the bore or open cut, from the point that cannot be trenched to the point that trenching can resume. The length of any conduit that is reduced or divided (with a junction well or conduit body) shall be measured as part of the larger conduit.

Basis of Payment:

The quantity of conduit or riser shield will be paid for at the Contract unit price per linear foot. Price and payment shall include full compensation for furnishing all conduit and/or riser shield materials, equipment, labor, and incidentals necessary to complete the item.

For conduit installed by Directional Bore, the linear foot payment also includes excavation and backfilling for Bore Equipment, placing the conduit, caps if required, and all other requirements and incidentals listed in the body of this specification.

For conduit installed by Open Cutting existing pavement, the linear foot payment also includes excavating, backfilling, placing the conduit, disposal of excess materials, and all other requirements and incidentals listed in the body of this specification.

For conduit installed in an Unpaved Trench, the linear foot payment also includes excavating, removal of sod if required, backfilling, placing the conduit, disposal of excess materials, replacing excavated on-site sod if required, seeding if required, and all other requirements and incidentals listed in the body of this specification. Sod and/or topsoil furnished from an outside source, will be paid for separately.

For conduit installed on a structure, the linear foot payment also includes furnishing and installing anchors and hangers, removal of excess materials, and all other requirements and incidentals listed in the body of this specification.

For riser shield or flexible metallic conduit installed on poles, mast arms, or structures the linear foot payment also includes furnishing and installing straps, weatherhead, conduit, lag bolts and washers, any other required mounting hardware, and all other requirements and incidentals listed in the body of this specification.

7/20/15

746517 - ALUMINUM LIGHTING STANDARD WITH SINGLE DAVIT ARM, 30' POLE
746518 - ALUMINUM LIGHTING STANDARD WITH SINGLE DAVIT ARM, 35' POLE
746519 - ALUMINUM LIGHTING STANDARD WITH SINGLE DAVIT ARM, 40' POLE
746520 - ALUMINUM LIGHTING STANDARD WITH DOUBLE DAVIT ARM, 30' POLE
746521 - ALUMINUM LIGHTING STANDARD WITH DOUBLE DAVIT ARM, 35' POLE
746522 - ALUMINUM LIGHTING STANDARD WITH DOUBLE DAVIT ARM, 40' POLE
746618 - ALUMINUM LIGHTING STANDARD WITH SINGLE DAVIT ARM, 45' POLE
746628 - ALUMINUM LIGHTING STANDARD WITH SINGLE DAVIT ARM, 15' POLE

Description:

The work consists of furnishing and installing Aluminum Lighting Standard with Single Davit Arm and/or Aluminum Lighting Standard Pole with Double Davit Arms, breakaway transformer base, and luminaires, in accordance with the details on the Plans, and/or as directed by the Engineer to make a functional street lighting system. The foundation will be provided under other items in the contract.

Materials and Construction Methods:

All materials shall be of the best quality and free from all defects. No materials shall be installed until approved by the Engineer. Any material not specifically covered in these specifications shall be in accordance with accepted standards and as directed by the Engineer. Any materials deemed unsatisfactory by the Engineer, shall be replaced by the Contractor.

Lighting standards shall meet or exceed the requirements of the latest edition of AASHTO "Standard Specifications for Structural Supports for Highway Signs, Luminaires and Traffic Signals" based on 90 mph (145 km/hr) wind loads, luminaire weight of 70 lb (32 kg), and a luminaire projected area of 3 ft² (0.3m²). The light pole design shall also consider a combined security camera and associated equipment weight of 70 lb (32 kg) and a security camera and associated equipment projected area of 6.2 ft² (.58 m²) mounted at 20 feet on the pole. Computations signed and sealed by a registered PE licensed in the State of Delaware demonstrating conformance with AASHTO Specifications, with the year of the edition specified, shall be submitted to the Delaware Department of Transportation.

All electrical materials shall conform to the requirements of the National Electrical Code of the national Fire Protection Association, and shall conform to all local and special laws and/or ordinances governing such installations. Where these requirements do not govern, and where not otherwise specified, electrical materials shall conform to the Standardization Rules of the Institute of Electrical and Electronic Engineers.

Shop drawings and catalog cuts for all electrical and related materials shall be submitted by the Contractor for approval.

The bolts are to be supplied by the Contractor. The bolts will be installed using a template, and set so that luminaire arm is perpendicular to the roadway.

Anchor bolts, nuts, couplings, washers, and cap screws shall be of carbon steel conforming to the requirements of ASTM A307, and hot-dip galvanized in accordance with AASHTO M 232/M 232M.

New aluminum lighting standards shall consist of a tapered aluminum shaft having a base welded to the lower end. The pole shaft, pole extensions, and davit arms shall each be spun from one piece of seamless tubing, the strut and arm plates shall be extruded, all of which conform to the requirements of ASTM B221 aluminum alloy 6063-T6. The shaft shall have no circumferential welds, except at the lower end joining the shaft to the base and shall conform to the dimensions listed in the chart below. The shaft shall contain an internal vibration dampening device positioned approximately 2/3 the height of the pole. The top of the lighting standard shaft shall be drilled for two 1/2" (13 mm) lockbolts to secure the davit bracket to the lighting standard shaft. If the pole is not placed on a transformer base, it will have one 3" x 5" (75 mm x 125 mm) handhole which after pole is set should face so that maintainer may view oncoming traffic.

HEIGHT OF POLE	DAVIT ARM LENGTH	OUTER DIAMETER	WALL THICKNESS
30' (9 m)	10' (3.0 m)	10" (250 mm)	0.156" (3.96 mm)
	12' (3.6 m)	10" (250 mm)	0.156" (3.96 mm)
	15' (4.6 m)	10" (250 mm)	0.156" (3.96 mm)
	20' (6.1 m)	10" (250 mm)	0.156" (3.96 mm)
35' (10.5 m)	10' (3.0 m)	10" (250 mm)	0.156" (3.96 mm)
	12' (3.6 m)	10" (250 mm)	0.156" (3.96 mm)
	15' (4.6 m)	10" (250 mm)	0.156" (3.96 mm)
	20' (6.1 m)	10" (250 mm)	0.188" (4.78 mm)
40' (12 m)	10' (3.0 m)	10" (250 mm)	0.188" (4.78 mm)
	12' (3.6 m)	10" (250 mm)	0.188" (4.78 mm)
	15' (4.6 m)	10" (250 mm)	0.188" (4.78 mm)
	20' (6.1 m)	10" (250 mm)	0.219" (5.56 mm)
45' (13.5 m)	10' (3.0 m)	10" (250 mm)	0.188" (4.78 mm)
	12' (3.6 m)	10" (250 mm)	0.188" (4.78 mm)
	15' (4.6 m)	10" (250 mm)	0.188" (4.78 mm)
	20' (6.1 m)	10" (250 mm)	0.250" (6.35 mm)

Bracket arms shall be of the davit type consisting of an aluminum shaft having the outer diameter and wall thickness as listed in the table above. The davit arm shall be designed to slip over the top of the lighting standard shaft for a distance of at least 12" (300 mm). The luminaire end of the davit arm shall be fitted with a 2" (50 mm) NPS aluminum pipe not less than 6" (150 mm) long. The height of the lighting standards will be determined by the Contractor to provide a nominal mounting height as shown on the Plans. The length of the davit arm will be as shown on the Plans or 12' (3.6 m) if not specified elsewhere. Davit arm less than 10' (3.0 m) long shall not be used without written permission from the Chief Traffic Engineer.

Each lighting standard shall be provided with a permanent tag which shall be 2" x 4" (50 mm by 100 mm) fabricated from clear anodized 1/16" (1.6 mm) thick aluminum. The edge shall be smooth and corners rounded and the tag shall be curved to fit the light standard shaft. Tags shall be secured to shafts by means of four (4) 1/8" (3 mm) diameter 18-8 stainless steel round head drive screws of self-tapping screws. The embossed identifying letters and/or numerals shall be not less than 3/4" (19 mm) high with stroke of not less than 3/16" (4.8 mm). Identifying letters and/or numerals shall be designated on the Plans.

Transformer Base:

Transformer bases, when required, shall conform to the latest edition of AASHTO "Standard Specifications for Structural Supports for Highway Signs, Luminaire and Traffic Signals".

Before any work, begins the Contractor shall submit documents showing that the breakaway device meets the current AASHTO Breakaway Design.

For breakaway installations, the standard shall electrically disconnect from the supply wire at the foundation when knocked down by an errant vehicle or from some other cause.

Luminaire:

The following luminaire specifications apply for projects or lighting standards using High Pressure Sodium (HPS) Luminaires. See below for Light Emitting Diode (LED) luminaire specifications.

The luminaire shall have a precision die cast aluminum housing with an optical assembly, a removable mounting door and of wattage and type as specified on the Plans. The luminaire shall be of the multi-voltage ballast regulator type.

The refractor of the optical assembly shall be attached to the luminaire housing thru a hinge and latch arrangement. The optical assembly shall consist of a highly polished aluminum reflector, and a heat resistant shatter resistant borosilicate glass refractor. The refractor door shall be tightly sealed with an appropriate gasket. The latch for the refractor door shall be of sufficient size to enable easy handling and constructed of rust resistant materials; the latch shall produce an audible click when it is properly locked.

The luminaire shall be equipped with a porcelain, corrosion resistant socket. The socket shall be easily adjustable to give one of twelve different light distributions; such adjustments shall be accomplished through adjusting not more than two screws within the optical assembly. The socket in this installation shall be preset to provide a distribution pattern as indicated on the Plans or type III distribution pattern of luminaire if not indicated.

The luminaire shall have a 2 bolt slipfitting suitable for mounting on 1/2" to 2" (13 mm to 50 mm) pipe. The luminaire shall be designed with a leveling pad and capable of being adjusted ± 5 degrees for proper leveling.

The luminaire shall be completely wired so that it shall require only the connection of the power supply cables to a terminal block for energizing the entire fixture.

In order to provide for normal exchange of air between the inside and outside of the optical system, a ventilating channel shall be provided. The channel shall contain a charcoal filter which will prevent the entrance of flying insects and other small animal life forms, as well as provide a cleaning action on the air to remove smoke and dust particles.

All major electrical components, including ballast and the photoelectric control, shall be mounted on a removable door assembly and connected to the fixture electrically through a quick disconnect plug. The removal of the door shall be accomplished by loosening the captive screw and unplugging the quick disconnect plug. The luminaire shall employ solderless push-on type connectors for all wiring connections to facilitate the replacement of any component.

The unit shall contain an integral ballast capable of maintaining the wattage of the H.P.S. lamp throughout the life of the lamp. The ballast and the photoelectric control shall be suitable for operating the units in the wattage as shown on the Plans. The wattage of the luminaires for this Contract are listed on the quantity sheet.

No luminaire shall be installed until the lamp socket position has been inspected and approved by the Engineer. If no light distribution pattern is given the socket position shall produce a light pattern as indicated on the Plans, then type III as designated in the specification for the luminaire. All luminaires shall be adjusted up or down on the slipfitter to provide maximum light on the roadway to be lighted. The connections between the luminaire and service cable shall be made with a connector kit using #10 AWG single wire. Installation of the connector kit shall be in accordance with the manufacturer's recommendations.

The Contractor shall furnish and install one or more of the following luminaires or an approved equal as specified on the Plans and/or as required by the Utility owner.

STANDARD MATERIALS

LUMINAIRE 400 Watt High Pressure Sodium Roadway, with Photo Cell Receptacle and Field Replaceable 9110-60-25 Regulated Multi-voltage Ballast, Type III Light Pattern, or as shown on Plans, 1 1/2" - 2" (38 mm - 50 mm) Slipfitter

Cooper/Crouse Hinds OVY Swing-down
GE M-400A Power/Door

Cat. #OVY40SWW3ET4
Cat. #M4AR40S0A2GMN32

LUMINAIRE 250 Watt High Pressure Sodium Roadway, with Photo Cell Receptacle and Field Replaceable 9110-60-26 Regulated Multi-Voltage Ballast, Type III Light Pattern, or as shown on Plans, 38 mm - 50 mm Slipfitter

Cooper/Crouse-Hinds OVY Swing-down
GE M-250 A2 Power/Door

Cat. #OVY25SWW3ET4
Cat. #M2AR25S0A2GMS32

LUMINAIRE 100 Watt High Pressure Sodium Roadway, with Photo Cell Receptacle and Field Replaceable 9110-60-27 120V Regulator Ballast, Type II Light Pattern, or as shown on Plans, 1 1/4" - 2" (32 mm - 50 mm) Slipfitter

Cooper/Crouse-Hinds OVX Swing-down
GE M-250A2 Power/Door

Cat. #OVX10SK22ET4
Cat. #M24R10S1M1AMS21

LUMINAIRE 70 Watt High Pressure Sodium Alley/Security, 120V with Normal Power Factor Ballast, Photo Cell, 9110-60-28 Lamp and Type II Acrylic Lens for Mounting on 1 1/4" - 2" (32 mm or 50 mm) Bracket (Not Included)

Cooper/Crouse Hinds RMA
(Specify Less Bracket w/Type II Lens)
GE Type 201 SA
(Specify Less Bracket w/Type II Lens)

Cat. #RMA70SR222LV5
Cat. #SAM07S1N5S4LV5ALC

LUMINAIRE 70 Watt High Pressure Sodium Black Colonial, with 120V Photo Cell Receptacle, 120V Reactor 9110-69-34 Ballast, Type III Acrylic Lens, Black Finish with 3" (75 mm) Slipfitter

Cooper/Crouse-Hinds
GE TC 100
ITT American Rev.

Cat. #LXF70SR2334
Cat. #T10R07S1N2AMS3BL
Cat. #47-570E3-6

The following specifications apply for projects or lighting standards using Light Emitting Diode (LED) Luminaires. See above for High Pressure Sodium (HPS) luminaire specifications.

This work consists of furnishing and installing light emitting diode (LED) luminaires with wattages and lumen outputs as shown on the plans on Lighting Standards, in accordance with this specification, as shown on the plans and as directed by the Engineer.

The complete luminaire shall be a LED type powered from a multi-volt, 60 hertz source. The luminaire shall have a heavy-duty die-cast aluminum alloy housing with a polyester powder aluminum finish. The luminaire shall utilize a 4 bolt mounting connection to a horizontal tenon of 1.9" to 2 3/8" outer diameter. The ballast shall be a multi-tap (120/208/240/277 volt) auto-regulating type, capable of starting and operating the lamp down to temperatures of -40°C.

The fixture's lumen output and light distribution shall be as noted on the plans.

The luminaire shall be transported to the site, assembled, wired and attached to the mast arm or pole by use of hardware approved by the Engineer. The unit shall be attached to the proposed service cable and tested. On metal poles, the electrical connections and grounding of pole will be made in the base. If the service cable is not available, a 5 foot (1.5 m) tail shall be left in the pole base.

The luminaire shall have a minimum five-year warranty that begins upon transfer to the Department.

Installations of Lighting Standards: Lighting Standards shall be installed and located in accordance with the Plans, to provide continuously aligned lighting. The bracket arms shall be set perpendicular to the edge of the roadway unless otherwise ordered or specified. If necessary aluminum shims may be used to plumb the pole.

Method of Measurement:

The quantity of aluminum lighting standards with single or double davit arms of the size(s) specified will be measured as the actual number installed and accepted.

Basis of Payment:

The quantity of aluminum lighting standards with single or double davit arms will be paid for at the Contract unit price per each. Price and payment will constitute full compensation for furnishing all materials including labor, equipment, hardware, washers, shims and nuts, supply and installation of the transformer base, supply and installation of poles and davit arm(s), and supply and installation of the luminaires. This price will also include all miscellaneous hardware, connector kits, and wiring from the supply cables to the luminaire(s), labor, tools, equipment, and incidentals necessary to complete the work.

3/2/17

746558 - POLE BASE, TYPE 3C

Description:

Construct and install concrete pole bases in accordance with Contract Documents and as directed by the Engineer.

Materials:

The concrete for pole bases shall conform to Section 812, Class B. Bar reinforcement shall meet the requirements of Section 603 Grade 60 (Grade 420). Ground rods shall be copper covered, approved by the Underwriters' Laboratory and be supplied with approved clamps for connecting the grounding conductor to the rod. Conduit for sweeps shall meet the requirements for galvanized rigid steel conduit in Section 745. Anchor bolts will be supplied by the Department, by the District Engineer in charge of the project. Anchor bolts shall have a minimum yield strength of 55,000 psi (379 MPa).

Construction Methods:

Construct pole base of the type specified and at the location noted in the Plans. Excavate pole base location to the appropriate depth for the type of pole base specified in the Plans. In cut (back) slopes, the required depth below finished grade is measured at the front of the pole base. In fill (fore) slopes, the required depth below finished grade is measured at the back of the pole base. Do not exceed the diameter of the type of pole base to be constructed during excavation. Construct pole base in accordance with the Contract Documents, including placement of anchor bolts, bar reinforcement, conduit sweep and ground rod. Diameter and depth of pole base to be as shown in the Standard Construction Details for the type of pole base indicated in the Plans. Cap the ends of the conduit sweeps with a galvanized threaded conduit plug unless the conduit sweeps are connected to existing conduit. After the concrete has cured, backfill disturbed area around the pole base using approved Material. Place and compact backfill Material in accordance with Section 202. Topsoil and seed disturbed area in accordance with the applicable Sections of the Standard Specifications.

Method of Measurement:

Measure the quantity of pole base as the actual number of pole base of the type specified in the Contract Documents installed, complete in place, and accepted.

Basis of Payment:

The quantity of pole base will be paid at the Contract Unit Price per each for the pole base type specified in the Contract Documents. Price and payment constitutes full compensation for furnishing and placing all Materials including concrete, bar reinforcement, ground rod as required, anchor bolts, conduit sweeps, excavation and backfilling; and for all labor, Equipment, tools and incidentals required to complete the Work as specified and as directed by the Engineer.

3/2/17

746614 - POLE BASE EXTENSION

Description:

This work consists of furnishing and installing all materials necessary to increase the vertical dimension of the pole base. The extension shall consist of reinforced concrete to a depth in accordance with the notes and details in the Contract Documents and as directed by the Engineer.

Materials:

The concrete for pole base extensions shall conform to Section 812, Class B of the Standard Specifications.

Bar reinforcement shall meet the requirements of Section 603 Grade 60 of the Standard Specifications.

Ground rods shall be copper clad, approved by the Underwriter's Laboratory and be supplied with approved clamps for connecting the grounding conductor to the rod.

All applicable requirements of Section 746 of the Standard Specifications shall govern and be supplemented by notes and details on the plans.

Construction Methods:

Where pole bases are required to extend to a depth greater than that given on Standard Construction Details, they shall be extended as directed by the Engineer.

Reinforcing bars shall be extended in a pattern that complies with the Standard Drawings and matches the pattern of the pole base being extended using continuous vertical bars and is in accordance with Section 603.07 of the Standard Specifications.

The pole base extension shall include a longer length ground rod so that a minimum of 8 feet of rod is driven into undisturbed earth and 8 inches is above the final grade of the pole base.

Method of Measurement:

The quantity of pole base extension will be measured by the cubic feet of concrete required to increase the vertical dimension from the standard depth to the increased depth. The volume will be measured by multiplying the vertical increase in depth by the cross-sectional area of the standard pole base. Reinforcement bars, excavation and backfilling will be incidental to this item and included in the unit price bid.

Basis of Payment:

The quantity of pole base extensions will be paid for at the Contract unit price per cubic foot of pole base extension. Price and payment will constitute full compensation for furnishing and placing all materials including bar reinforcement, ground rod as required, excavation, and backfilling; and for all labor, equipment, tools, and incidentals required to complete the work.

9/30/15

746843 - POLE BASE, TYPE 1
746844 - POLE BASE, TYPE 2
746845 - POLE BASE, TYPE 2A
746846 - POLE BASE, TYPE 2B
746847 - POLE BASE, TYPE 3
746848 - POLE BASE, TYPE 3A
746849 - POLE BASE, TYPE 3B
746850 - POLE BASE, TYPE 4A
746851 - POLE BASE, TYPE 4B
746852 - POLE BASE, TYPE 6

Description:

This work consists of constructing and furnishing round or square pole bases Types 1, 2, 2A, 2B, 3, 3A, 3B, 4A, 4B, and 6 for poles in accordance with the Standard Construction Details and at locations as directed by the Engineer.

Materials:

The concrete for pole bases shall conform to Section 812, Class B.

Bar reinforcement shall meet the requirements of Section 603 Grade 60.

Ground rods shall be copper clad, approved by the Underwriter's Laboratory and be supplied with approved clamps for connecting the grounding conductor to the rod.

Conduit for sweeps shall meet the requirements for galvanized rigid steel conduit in Section 745.

Anchor bolts will be supplied by the same entity that supplies the poles.

“Drop-in” Expansion Anchors and Bolts for Type 4A Pole Bases shall be provided by the Contractor. The anchors shall be stainless steel and shall accept ½" diameter stainless steel bolts. Anchors shall be Concrete Fastener Systems Model DIS 12, Hilti HDI SS 303, or approved equal.

Construction Methods:

The bases shall conform to the dimensions as indicated on the Standard Construction Details. A ground rod shall be installed as shown. A minimum of 8 feet of the ground rod must be driven into undisturbed soil.

If a utility or a right-of-way conflict is found when a Type 2 or Type 3 base is specified in the Plans, an alternate base of equivalent strength may be used as directed by the Engineer. A Type 2 base has two equivalents, namely Types 2A and 2B. A Type 3 base has two equivalents, namely Types 3A and 3B.

Though the contract calls for the use of a round pole base, the Contractor may use a square base at its discretion. The end of the conduit sweeps in the ground shall be extended outside the concrete and any forms or sheeting by 12 inches and capped or connected to the existing conduit. If the conduit is to be capped underground for future use, it must be sealed with a galvanized threaded conduit plug. Tape is NOT an approved conduit plug. The location of the conduits shall be marked on the base with arrows drawn in the wet concrete within 6 inches of the outer edge.

Excavation for the pole bases may not exceed the dimension of the foundation by more than 12 inches in any one direction. If a form is used in the excavation more than 18 inches below the ground surface, it is necessary that the area between the form and excavation be filled with Borrow Type C and tamped on all sides in continuous, horizontal layers not to exceed 68 inches in depth, loose measurement.

Where a pole base is to be placed in existing concrete pavement such as a sidewalk, the concrete shall be saw cut in a square pattern or removed to the nearest joint. In other pavement material, a round hole may be cut using an appropriate tool. Any damage to the existing pavement shall be repaired at the Contractor's

expense and shall meet the approval of the Engineer. Any removal or replacement of any type of pavement under this item shall be an incidental cost to this item. The bases shall be edged and have a broom finish. Where water or highly unstable material is encountered during the excavation for the pole base, pole base sheeting may be required and the following steps shall apply:

1. The condition exists in the upper half of the excavation. Stop all work until the Bridge Design Section reviews the condition.
2. The condition exists below the upper half of the excavation:
 - a. For a proposed Type 4A or 4B Base, increase the depth to 4 feet.
 - b. For a proposed Type 1, 2, or 3 Pole Base, substitute a Type 3A Pole Base for all but a Type 3B Pole Base. The depth of the base shall be as determined in (d) below, or 9 feet, whichever is greater.
 - c. For a proposed Type 6 Pole Base, substitute a Type 2 Pole base and increase the depth in accordance with (d) below.
 - d. Determine the depth of the base, which would be in the unsatisfactory area. Multiply that depth by 0.7 and add the result to the original required depth of the base to obtain the final depth of the base. The reinforcing bars shall be extended using the required pattern to match the final depth in accordance with the requirements of Section 603.07 of the Standard Specifications.

Method of Measurement:

The quantity of pole bases will be measured as the actual number of bases constructed, complete in place and accepted. Concrete, excavation and backfilling around the base, ground rods, and the two conduit sweeps in the base are included in this item.

Should excavated material be unsuitable for trench backfill, the Contractor shall furnish material meeting the requirements of Borrow, Type C from other excavations or from borrow sites within the contract limits. Payment will be made using the item under which the material was initially excavated. Hauling, placement, and compaction are incidental to the item being backfilled.

Payment for any additional sweeps shall be paid for separately under the appropriate conduit items. The Contractor's use of square base rather than a specified round base shall not result in any additional cost to the Department.

Basis of Payment:

No payment will be made for backfill material meeting Borrow, Type C requirements that is placed outside of the vertical plans located 18" outside of the neat line perimeter of the vertical face of the pole base foundation.

Any increase in the vertical dimension required herein shall be paid for separately under Item 746614, Pole Base Extension; another item of this contract.

The quantity of pole bases will be paid for at the Contract unit price for each pole base type. If an alternate pole base type is selected by the Engineer, payment will be the Contract unit price for the alternate selected. Price and payment will constitute full compensation for furnishing and placing all materials including concrete, ground rods, and a minimum of two conduit sweeps extending into the base; for excavating, backfilling and compacting around the base; for repairs to damaged existing pavement; for removal or replacement of pavement; and for all labor, equipment, tools, and incidentals required to complete the work.

9/30/15

- 746906 - FURNISH & INSTALL 4-CONDUCTOR #18 AWG SHIELDED OPTICOM CABLE
- 746907 - FURNISH & INSTALL 1-CONDUCTOR #2 AWG STRANDED COPPER
- 746908 - FURNISH & INSTALL 1-CONDUCTOR #4 AWG STRANDED COPPER
- 746909 - FURNISH & INSTALL 1-CONDUCTOR #6 AWG STRANDED COPPER
- 746910 - FURNISH & INSTALL 1-CONDUCTOR #8 AWG STRANDED COPPER
- 746911 - FURNISH & INSTALL 1-CONDUCTOR #10 AWG STRANDED COPPER
- 746912 - FURNISH & INSTALL 1-CONDUCTOR #14 AWG STRANDED COPPER
- 746913 - FURNISH & INSTALL 2-CONDUCTOR #14 AWG ALUMINUM SHIELDED COPPER
- 746914 - FURNISH & INSTALL #6 BARE STRANDED COPPER GROUND
- 746915 - FURNISH & INSTALL #8/2 WIRE UF W/GROUND
- 746916 - FURNISH & INSTALL #8/3 WIRE UF W/GROUND
- 746918 - FURNISH & INSTALL #2/0 AWG STRANDED COPPER
- 746919 - FURNISH & INSTALL #4/0 AWG STRANDED COPPER
- 746920 - FURNISH & INSTALL 14/4 TRAFFIC CONTROL CABLE
- 746921 - FURNISH & INSTALL 14/9 TRAFFIC CONTROL CABLE
- 746922 - FURNISH & INSTALL 14/16 TRAFFIC CONTROL CABLE
- 746923 - FURNISH & INSTALL 14/5 TRAFFIC CONTROL CABLE

Description:

The pay items listed above include furnishing, installing, and splicing if approved, the various types and sizes of cable in conduit, or overhead and lashed to a span wire. All conduit installation will be paid for under their respective items.

Materials:

Cable - All electrical cables shall be manufactured in conformance with the National Electrical Code, 600-Volt, UL approved.

1. Stranded or solid, single conductor copper cables shall be XLP Insulated; USE or RHW rated
2. Type UF cable shall include ground and the number and size of conductors as shown on the plans. Use cable conforming to ANSI/UL 493.
3. 14/4, 14/5, 14/9, 14/16 AWG Solid copper conductor Traffic Signal cable shall conform to IMSA Specification Number 19-1. Provide wire size and number of conductors as shown on the plans or as directed by the Engineer. Additional material requirements for Traffic Signal Cables are as follow:
 - a. If requested, the Contractor shall provide independent test results to verify specification compliance. Costs of testing are incidental to the Cable item being supplied.
 - b. All cables shall be supplied on reels with each reel containing one continuous length of cable.
 - c. Color code to be used as established by IMSA Specifications. In addition to IMSA, DeIDOT requires that individual tracers contrast with the base color to allow easy identification between each base color and the same base color plus tracer.

To test for sufficient color contrast, remove the sheath for a length of 6 inches. All filler material and tapes shall be removed for the same length. All conductors of the same base color will be placed side by side and all other conductors will be hidden. The conductors will be held against a white or ivory surface and viewed from a distance of 6 feet. The base color, tracer, and tracer color must be identified within a period of three seconds after being placed in position. The same test for contrast will also be made for base colors. If either the base color or tracer color test fails, the material will be rejected.
 - d. The tracer line width shall not exceed 3/20 inch when measured perpendicular to the edge of the line. Also, the total width of tracer lines on a conductor may not be equal to or greater than one-half the total circumference of the conductor.
4. Aluminum Shielded Cable shall be shielded two conductor controlled capacitance cable enclosed in an aluminized polyester shield within a polyethylene jacket, rated to 600 volts. The two conductors are AWG # 14 stranded copper. Cable shall meet IMSA 50-2. Referred to as "Home-run Cable".

5. Opticom Cable – must meet the manufacturer’s recommended specifications

Splicing Materials –

1. Insulating (rubber) tape shall be of the self-bonding type and shall be 3M Company, Inc. (Cat. No. 130C, 2228); Plymouth Rubber (Cat. No. 2212); Permacel (Cat. No. 253, P280), or an approved equal.
2. Jacket (plastic) Tape shall be of the waterproof type and shall be 3M Company, Inc. (Cat. No. 33); Plymouth Rubber (Cat. No. 3117); Permacel (Cat. No. P29), or an approved equal.
3. For overhead traffic control cable splices:
Wire Nuts – Ideal 74B or 76B, 3M Highland H-33, or approved equal

Cable Installation

Installation in Conduit:

This work consists of installing various types, sizes, and number of communications or electrical cable(s) in existing conduits, which may or may not contain an existing communications or electrical cable(s) or wire(s). Conduits may be located underground, within mast arms, on wood poles, or on metal poles.

The number of cables to be pulled through each conduit will be as shown on the plans or as directed by the Engineer.

Construction Methods:

All cable must be transported by and unreeled from a cable trailer(s). The laying of reels on the ground and subsequent removal of wire or cable from this position is prohibited. Avoid damaging cable insulation when removing cable from drums or reels, or during installation of the cable.

Hand pulling methods are required for conduit sizes of 1-1/2" or less and are **preferred** for all other sizes. Dynamometer is recommended for use when pulling other than by hand.

Prior to installation, **written approval by the Engineer is required** for the use of any power-assisted methods of pulling communications or electrical cable(s) or wire(s) into conduit. A short piece of material that will part if the strain exceeds the amount specified below shall be used between the pulling grip and the pulling medium, unless industry standards require less:

150 lbs. for all pulls up through 12 pair communications cable; and
300 lbs. for all larger cables

Any and all cable(s) pulled into any conduit without the use of an acceptable pulling grip, Kellems or equal, and without the use of a strain release element or by using methods which may have or did result in pulling forces in excess of strain release material, or using methods which may have or did result in pulling forces in excess of those set forth herein or prescribed by industry standards are **unacceptable**.

Any and all unacceptable cable(s) shall be removed and replaced with new cable(s) using correct methods at no cost to the Department.

The installation of cable(s) in existing conduits shall be accomplished by pulling the cable(s) through the conduits. If required, pulling lubricant of the type recommended by the cable manufacturer will be used. The cable(s) shall be prepared for pulling by reeling them from their respective reels as they enter the conduit or by taking sufficient length from the reel(s) to comprise the set to be pulled. Care shall be taken to avoid damaging insulation and to eliminate any twists or kinks and to marry the cables in a straight lay. Care shall also be taken to prevent entry of moisture into the cable at all times during installation. Cable ends will be sealed using rubber tape and painted with a sealing type of waterproof compound until final splices are made.

The cable(s) shall be hand fed into the conduit. When, in the opinion of the Engineer, additional radius is required to prevent damage to the cable(s) a sleeve shall be used. There shall be no additional payment made for sleeves or their use. Underground cable runs shall be started at one terminal point and shall

be continuous without splices to the final terminal point except for “Home Run Cable” to “Loop Detector Wire”. Opticom cable shall not be spliced in any application.

Additional cable(s) shall be left and arranged in a neat and orderly manner as noted:

1. When pulled through junction wells, 6 feet of copper cable, supported on cable rack assemblies
2. At the control box and other splice locations, 6 feet of cable, neatly arranged and laced with cable ties

When cable already exists in a conduit, the Contractor shall ensure that the placement of a fish does not damage or entangle the existing wire or cable(s). The lead end of a fish shall contain a blunt terminal. Bending and/or taping the end of the fish shall not be satisfactory nor shall any termination which contains rough edges or any sort of hook that might engage an existing wire or cable when the fish is extracted.

Where two or more wires occupy the same conduit, they shall be drawn in together and kept parallel to each other by means of a pulling head. Phase legs shall be arranged circumferentially and in sequence around the neutral wires.

All conduit ends shall be duct sealed after cable installations.

Installation on Span Wire Overhead:

This work consists of installing electrical cable on an existing span wire.

Construction Methods:

All electrical cable must be transported by and unreeled from a cable trailer(s). The laying of reels on the ground and subsequent removal of wire or cable from this position is prohibited. Avoid damaging cable insulation when removing cable from drums or reels, or during installation of the cable.

The electrical cable will not be spliced at the top of the pole but will continue on to be taped onto the span wire. The electrical cable shall be oriented so water will not run along its length and run into the steel pole. The electrical cable shall be installed on the underside of the span wire with no crossover or wraps around the span wire. The electrical cable shall be pulled tight without any kinks and the jacket (plastic) tape wrapped tight around the span wire and electrical cable at least six wraps every twelve to fourteen inches.

At each signal head location, there will be a loop of signal cable 36 inches long.

Splicing:

Traffic Control Cable and Single Conductor Stranded Wire :

General – Traffic signal cable splicing shall only be made above ground in pole hand-holes, transformer bases or on span wire at the signal head. Underground traffic control cable splices (except between loop detector wire and “home-run” cable) or splices in between conduit runs are prohibited. After cables have been installed and pending permanent splicing, the end of each section of cable in the control box and at all splice locations shall be carefully sealed, using rubber tape, and painted with a sealing type of waterproof compound. The circuit number of all cables and wires shall be identified by color coded tape attached to each of the cables and wires in the control box and at all splice locations. The color coded tape shall be secured to the cable or wire with nylon cable ties. Any splices found to be faulty within 90 days of installation shall be remade at the Contractor’s expense. Insulation from each conductor to be spliced shall be removed to expose ½ inch of copper. Use of any tool or method which might nick the conductor is prohibited. Each conductor not being spliced shall be inspected and trimmed so that the conductor does not extend beyond the insulation. After each conductor to be spliced is connected, all conductors both used and not used shall be returned to their original configuration before the insulation was removed and then sealed as specified.

Individual cables shall not extend beyond the splice of the last signal head for each signal phase. Shielded Opticom cable shall not be spliced. Shielded Aluminum Cable (“Home-Run cable”) may be spliced only with the loop detector wire in a junction well. No splicing of the “home-run cable” outside of this junction well is permitted.

Overhead - Conductors to be electrically connected shall be placed side by side with the exposed copper aligned. The copper shall then be twisted clockwise with pliers until a good mechanical connection shall be effected. A proper size wire nut shall be installed and hand tightened. If necessary to cover all the copper, minor trimming may be done. The copper splice shall be 5/16 inch long when trimmed. Care shall be taken to ensure that no insulation is caught up in the copper area of the splice. It is essential that the splice be kept dry. Therefore, care must be taken during taping and by placement of the completed splice to prevent water from entering the splice between or around the cables.

1. **Termination of cable (Butt Splice)** - The sheath of each cable shall be removed as necessary. When all conductors to be joined have been completed, the splice shall be prepared for taping. The cables shall be placed in a butt position and all wires and wire nuts shall be positioned to ensure that no shorts exist and that the splice area is reduced to as small a diameter as possible. Taping shall begin with rubber tape two inches over the intact sheath. Taping shall proceed toward the other cable overlapping half of the tape width until a point two inches on the other cable sheath has been reached. Taping shall then be repeated in the other direction starting one tape width wider than the previous wrap. Where necessary to cover all areas of the splice, overlapping shall be increased. Every area of the splice shall have rubber tape at least four layers (two fully overlapped passes) deep. The rubber tape shall be covered with plastic tape applied in the same fashion.
2. **Taps or Tee Splices** - The sheath of the through cable shall be removed for a distance of 8 inches centered on the point of splice. The sheath of the branch cable(s) shall be removed for a distance of 4 inches. The through cable conductors which are to be joined to the conductors of the branch cable(s) are to be separated out from the others and cut. No other conductors shall be cut for any purpose. Depending upon the need, the branch cable(s) may be placed beside one of the through cables and the splicing proceed or the through cable may be doubled back so that the parts of the through cable and the branch cable(s) are placed side by side. When all conductors to be joined have been completed, the splice shall be prepared for taping. The cables shall be placed in approximately their final position and an inspection for shorts shall be made. After all wire nuts and wires are properly positioned, taping shall begin on the through cable 2 inches from the end for the sheath. It shall proceed with 1/2 inch width overlap across the splice area and onto the other through sheath for a distance of 2 inches. The taping shall start at the end point and return back across the splice to the branch cable(s). It shall proceed along the branch cable(s) and onto the sheath for a distance of one inch. A return along the branch back to the main cable shall be made and the remaining part of the splice shall be taped continuing as before. Every area of the splice shall have rubber tape at least four layers (two fully overlapped passes) deep. The cables shall be placed in their final position and taped with two fully overlapped passes of plastic tape. Plastic tape need not cover the interior areas covered by the rubber tape. The splice shall be placed so that the branch cable(s) enters the splice from below to prevent water from flowing along the branch cable(s) into the splice area.
3. **Termination End of Cable** – Dead ended cables shall have 3” of sheath removed. Each individual cable shall be rubber taped then bundled and re-taped with vinyl tape and coated with waterproofing compound.

Method of Measurement:

The quantity of cable will be measured as the actual number of linear feet of cable furnished and pulled through conduits (underground, in mast arms, or on poles) or installed on a span wire in accordance with these specifications, complete in place, and accepted. All required cable slack left at termination points or in junction wells shall be measured as part of this item.

Basis of Payment:

The quantity of cable furnished and pulled through all conduit (underground, in mast arms, or on poles) or furnished and installed on a span wire will be paid for at the Contract unit price per linear foot of the applicable pay item. Splice installations and all costs related to the splice shall be incidental to the linear foot payment of the cable being spliced. Price and payment will constitute full compensation for all labor, equipment, tools, materials, material testing, splicing, taping, and incidentals required to complete the work as specified above.

7/14/14

746924 - FURNISH & INSTALL LOOP WIRE 1-CONDUCTOR #14 AWG ENCASED IN ¼” FLEXIBLE TUBING IN A LOOP SAWCUT

Description:

Sawcut and seal existing pavement, furnish and install loop detector wire, aluminum shielded “home-run” cable, as shown on the Plans.

Materials:

1. **1-conductor #14 AWG Cable in ¼” Flexible Tubing** - shall consist of cable preinstalled in a polyethylene (PE) plastic duct meeting IMSA 51-5. Cable shall be rated for 600 volts. The cable shall have a temperature tolerance range of at least - 65 to + 176 degrees Fahrenheit. The conductor is AWG #14 stranded copper. Outside diameter of the cable is 0.25 inches. Referred to as “loop wire”
2. **2-conductor #14 AWG Aluminum Shielded Cable** – see specifications for furnish and install cable. Referred to as “home-run cable”.
3. **Flexible embedding sealer** - a cold poured, resilient type epoxy joint sealer, Bondo P 606 or Duracote D115 for concrete or asphalt pavement or E Poxy Industry 36 1 for concrete or E Poxy Industry 11 1 for asphalt pavement, or approved equal. A sealer accelerant or retarder may be added per the manufacturers specifications.
4. **Backer Rod** - 5/8" closed cell foam
5. **Tape** – Vinyl electrical tape shall have a PVC base with rubber based pressure sensitive adhesive. The tape shall be a minimum 7 mils thick and be UL listed and marked per UL Standard 510 as flame retardant and cold resistant. It shall be compatible with synthetic cable insulations, jackets and splicing compounds and rated for wire and cable splices up to 600-volts.
6. For splices in Junction Well (see plan detail):
 - a. **Dual Wall Heat Shrink Tubing** – Heat-shrink tubing shall be medium or heavy wall thickness, irradiated polyolefin tubing containing an adhesive mastic inner wall. Minimum wall thickness prior to contraction shall be 40 mils. When heated, the inner wall shall melt and fill all crevices and interstices of the object being covered while the outer wall shrinks to form a waterproof insulation. Each end of the heat-shrink tube or the open end of the end cap of heat-shrink tubing shall, after contraction, overlap the conductor insulation at least one and one-half inches. Heat-shrink tubing shall conform to the requirements in UL Standard 468D and ANSI C119.1, for extruded insulated tubing at 600 V.
 - b. Soldering iron with Rosin Core solder
 - c. Splicing Kit- In-line barrel type design, resin encapsulating compound kit with UL486 rating. Suitable for use in wet or direct buried locations. Resin encapsulating compounds shall be acceptable for use at 16 degrees C.

Construction Methods:

Loop Wire Installation:

The pavement saw cut shall be 5/8” wide and up to 3½” deep. It shall be “wet-cut” in the directions and sizes specified on the Plans, Standard Details or as directed by the Engineer. Contractor shall remove sharp edges in the saw cut and round the corners.

The saw cut shall be blown out with compressed air to remove all dust, water and particles of loose material prior to sealing.

The loop detector wire will then be installed using blunt tools so as to prevent damage to the polyethylene outer cover. One end of a loop detector wire shall be tagged to indicate start ("S"). A 5/8" backer rod will be placed into the bottom of the saw cut as needed to secure the wiring within the saw cut. All loop detector wires shall be laid in saw cuts in a clockwise rotation beginning with "S". The Engineer may require a High Voltage Ground Test with a 500 VDC megger after the loop detector installation is complete and prior to sealing saw cuts. If the resistance to ground is less than 100 megohms, this work will be rejected.

A sealer and sealer accelerant or retarder (if necessary) shall be applied in accordance with the manufacturer's directions and protected from traffic until it has set. A minimum of 1 inch of sealer shall be installed on top of the loop detector wire and finished flush with the pavement. Drilled holes in the pavement shall also be sealed.

Two loop detector wires shall be installed in a saw cut from the loop to the edge of the road. These two wires shall then extend from the end of the saw cut to a junction well (see Plan Details). Wires shall be parallel, twisted a minimum of 5 wraps per foot, and taped every 12" to 18" from the end of the saw cut to a junction well up to the splice. The loop detector wire shall be installed between the end of the saw cut and junction well through a penetration created by a 1 1/2" rotary drill as directed by the Engineer. The loop detector wire shall be continuous and without splices from the junction well, through the saw cuts and conduit.

Home-run Wire Installation - refer to furnish and install cable specifications and conduit installation specifications. Refer to plans for details.

Splicing – splices between the loop detector wire and home-run cable shall be done in accordance with the plan details.

Conductors to be soldered shall be placed side by side with the exposed copper aligned. The copper shall then be twisted clockwise with pliers until a good mechanical connection is affected. The splice shall be coated with flux, heated with a soldering iron, and rosin core soldered in a manner that minimizes insulation damage. After each soldered connection is completed, it shall be properly insulated with heat shrink tubing.

After the electrical and mechanical connection is completed and before the splicing kit is applied, a test shall be made by the Contractor to ensure that all circuits are complete. An approved splice kit shall be installed as per manufacturer's instructions. A continuity test will be performed at the cabinet by the Department technician after the splicing kit is applied. The Department will be notified of the test results. If the continuity test fails the Contractor shall remake the splice and/or loop at his own expense. If a splice is found to be faulty within 90 calendar days of installation, it shall be the Contractor's responsibility to remake the splice at his own expense.

Method of Measurement:

The quantity of loop detector wire to be measured under this item shall be the number of linear feet of sawcut in which loop detector wire is installed, sealed, tested, and accepted. Sealer, sealer accelerant or retarder shall be incidental to this item. Loop detector wire routed through the rotary drill penetration is considered incidental to the cost of the loop installation. Conduit and associated home-run cable between the junction well and cabinet will be measured and paid for under their respective items, separate from this specification. Splicing of the loop detector wire to a home-run cable in a junction well shall be incidental to the cost of the loop wire.

Basis of Payment:

The quantity of loop detector wire supplied and installed will be paid for at the Contract unit price per linear foot, determined by measuring the footage of sawcut described above. Price and payment shall constitute full compensation for "wet"-sawcutting, furnishing and placing all materials including loop detector wire, backer rod, sealer, and for all labor, equipment, tools, splicing in the junction well, and incidentals necessary to complete this item. The price bid per linear foot of sawcut with Loop Wire shall include drilling required for installation, concrete and pavement patching, sealing the conduit ends, internal bushings shown on the plans, and all incidentals necessary to complete the item.

7/18/14

746925 – FURNISH & INSTALL EMBEDDED METERED SERVICE PEDESTAL (100 AMP)

Description:

Electrical service equipment consists of the equipment necessary to connect a utility company service to a traffic signal controller cabinet, lighting control cabinet, traffic monitoring station cabinet, or other traffic control device cabinet. Provide electrical service equipment at the phasing and amperage specified in the Contract Documents. This work includes coordinating the connection with the local utility company.

Materials:

Embedded Metered Service Pedestal:

Install a galvanized steel post including a 100 amp double pole main circuit breaker for service disconnect, branch circuit breakers, integral meter socket with bypass lever and 20 Amp GFCI duplex receptacle. The post shall be designed for embedment into the soil at least 18 in. and have a stabilizer shoe. Pour a concrete collar around the post as shown in the Contract Documents. The post and meter socket shall meet NEMA 3R. Provide the means to padlock the post closed and to install a utility company seal on the meter. Provide branch circuit breakers as specified. Embedded metered service pedestals shall be UL listed Suitable for Service Equipment, and be acceptable to the local utility companies for use as a service connection.

Circuit Breakers:

Molded case type having a minimum rating of 10,000 amp interrupting capacity (AIC) and be quick make, quick break, thermal magnetic, trip indicating, and have common trip on all multiple breakers with internal tie mechanism. They shall have the current and voltage ratings and number of poles as specified, and be treated to resist fungus and be ambiently compensated for the enclosure and proximity to adjacent breakers. All circuit breakers shall be the plug in type.

Construction Methods:

Utility Connection - Before any control equipment or material is ordered, arrange a meeting with the utility company representatives, Signal Construction Inspection representatives and the Engineer to establish a schedule for utility connections. Do not disconnect, de-energize, reconnect, tamper with, or otherwise handle any of the utility company's facilities. Make the utility service connection to the point of service supplied by the utility company. Make the necessary arrangements with the utility companies to ensure having needed utilities available at the time of turn on. Delays due to utility energization, connection, or disconnection will not be a basis for time extension. Report any difficulties in securing utility company services to the Engineer as soon as possible.

Installation - Embedded Metered Service Pedestal shall be installed per the standard construction or applicable plan details.

Measurement and Payment:

Embedded Metered Service Pedestal will be measured and paid for at the Contract unit price per each. The payment will be full compensation for all enclosures, panel boards, ground rods, circuit breakers, internal wiring, wiring devices, concrete collar, meter sockets, meter, shunts, cover plates, wiring, and for all material, labor, equipment, tools, and incidentals necessary to complete the work. Underground conduit will be measured and paid for separately under the applicable conduit item(s).

Service lateral cable will be measured and paid for separately under the applicable cable item(s). Utility connection coordination with the utility company will not be measured, but the cost will be incidental to other pertinent items. Utility company energizing, connection, and disconnection costs will be the responsibility of the Department.

747513 - LIGHTING CONTROL AND DISTRIBUTION ENCLOSURE (120/240 100 AMP)

Description:

This work consists of furnishing all materials and installing light panels, meters, control and distribution equipment for any highway lighting system.

Materials:

Lighting Control and distribution equipment enclosures shall be dead front type weatherproof metal enclosed self-supporting structures, as specified in the Contract Documents. Free standing enclosures shall be fabricated from sheet aluminum and shall be as specified herein. Panel and control equipment cabinets shall be the manufacturer's standard enclosure for the type and application specified.

Circuit Breakers. Circuit breakers shall be molded case type having a minimum rating of 22,000 amp interrupting capacity (AIC) and be quick make, quick break, thermal magnetic, trip indicating, and have common trip on all multiple breakers with internal tie mechanism. They shall have the current and voltage ratings and number of poles as specified in the Contract Documents, and shall be treated to resist fungus and be ambiently compensated for the enclosure and proximity to adjacent breakers. All circuit breakers shall be the bolt in type.

Photoelectric Controls. Photoelectric controls shall be solid state, cadmium sulfide type with hermetically sealed silicone rectifier rated 120/240 or 277 volts, 60 cycle AC and 1000 watts maximum load. Built in surge protection shall be provided, and a failsafe operating feature shall be included so that the lighting circuits will remain energized in the event the photo control components become inoperative. Nominal operating levels of this control shall turn on at a minimum vertical illumination value of 3 FC (32 lux) and turn off at a maximum vertical illumination value of 6 FC (65 lux). These limitations shall be set by the manufacturer, and tolerances of plus or minus 20 percent for the specified value will be acceptable. Photoelectric controls for luminaires and lighting controls shall be twist lock type. A suitable mounting bracket with locking type receptacle and all other necessary mounting hardware shall be furnished.

Contactors and Relays. Contactors of the current ratings and number of poles specified in the Contract Documents shall be held by permanent magnets. They shall be fully rated for all classes of load to 600 volts AC and shall have an interrupting rating of 600 percent of rated current. A HAND-OFF-AUTOMATIC selector switch shall be provided in the photoelectric cell circuit. Relays shall be the type, size and contact ratings as specified in the Contract Documents.

Panel Boards. Panel boards shall conform to Federal Specification W-P-115 and shall be suitable for operation on the voltage and type service specified in the Contract Documents. They shall be listed and labeled by the Underwriters' Laboratories, Inc. Panel boards shall be equipped with the number and size circuit breakers specified. Circuit breakers in panel boards shall conform to Federal Specification W-C-375 and shall be bolted to copper busses. Buss ratings shall be as specified. Panel shall be provided with modular Transient Voltage Surge Suppressors. (TVSS).

Lightning Arresters. Lightning arresters shall be secondary type, having the specified number of poles and 0-650 volts RMS. Arresters shall be provided with suitable mounting brackets and all other necessary mounting hardware.

Control Power Transformers. Control power transformers shall be the dry type, two windings, of the size and voltage ratings specified in the Contract Documents.

Enclosures. Enclosures shall conform to the NEMA 3R. They shall have door clamps, solid neoprene gaskets, welded seams, stainless steel external hardware and continuous hinges with stainless steel pins. Enclosures shall have two weep holes in the bottom and shall be equipped for padlocking.

Pad Mounted Enclosures. For ventilation, all cabinets shall be provided with louvered vents in the front door with a removable air filter.

- (a) Louvers shall satisfy the NEMA Rod Entry Test for 3R rated ventilated enclosure.
- (b) Filters for all cabinets shall be 16 in. (400mm) long, 12 in. (300mm) wide, and 1 in. (25mm) thick. The filter shall cover the vents and be held firmly in place with top and bottom brackets and a spring loaded upper clamp.
- (c) Exhaust air shall be vented out of the cabinet between the top of the cabinet and the main access door. The exhaust area shall be screened with a screen type material having a maximum hole diameter of 1/8 in. (3.125mm)

Thermostats and Fans. A thermostatically controlled cooling fan shall be provided for all cabinets. The fan and thermostat shall be rated for 125 percent of capacity and they shall be mounted at the top of the cabinet.

- (a) Thermostats shall be the inline type, single pole, 120 volts, 10 amps with a minimum range of 70F to 160F.
- (b) The fan shall have a minimum rated capacity of 100 CFM air flow and a minimum rated design life of 100,000 hours.

Method of Measurement:

The number of Lighting Control and Distribution Enclosures to be measured per each under these items shall be the actual number in accordance with these special provisions complete in place and accepted.

Basis of Payment:

The number of Lighting Control and Distribution Enclosure as determined above, shall be paid for at the contract unit price bid for each item "Lighting Control and Distribution Enclosure 120/240 volts; 100 AMP" installed in accordance with the requirements contained herein, complete in place and accepted, which price and payment shall constitute full compensation for furnishing all materials, including panels, control devices concrete pad foundation and for all labor and equipment necessary for the installation of the electrical equipment specified.

5/7/12

747514 - CABINET BASE TYPE F
747515 - CABINET BASE TYPE M
747516 - CABINET BASE TYPE P
747517 - CABINET BASE TYPE R

Description:

This work consists of constructing cabinet base Type F, M, P and R in accordance with the Standard Construction Details or applicable Plan Details and at locations as directed by plans or the Engineer.

Materials:

Class B Concrete
3/4" x 10' sectional copperclad steel ground rods
5/8" Zinc plated or Stainless Steel Drop-in Anchors manufactured by Hilti Systems, Concrete Fastening Systems, or approved equal
5/8" x 1-1/2" galvanized hex bolts
3/4" acorn type ground clamps
PVC conduit sweeps

Construction Methods:

The base shall conform to the dimensions as indicated in the cabinet base detail on the Standard Construction Details or applicable Plan Sheets. A concrete collar is only required when installed in earth areas or as directed by the engineer. Conduits entering the base must enter only in the designated area. A minimum distance of 1 inch shall be maintained between conduits and a minimum distance of 2 inches between conduits and the ground rods.

A minimum of 8 foot of the ground rods must be driven into undisturbed soil through the 2 inch PVC sleeve. The PVC sleeve shall be driven into the ground so that the top of the sleeve will be flush with the concrete when the base is poured.

Method of Measurement:

The quantity of cabinet bases will be measured as the number of bases constructed in accordance with these specifications, complete in place, and accepted.

All conduit sweeps extending into the cabinet base as shown on the Plans or Standard Details as applicable shall be included in the price for each cabinet base..

Basis of Payment:

The quantity of cabinet bases will be paid for at the Contract unit price per each. Price and payment will constitute full compensation for all concrete, ground rods, labor, equipment, tools, conduit sweeps, and incidentals required to complete the work as shown on the standard details or applicable plan sheets.

10/9/2012

- 748506 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/YELLOW, 4"
- 748507 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/YELLOW, 6"
- 748508 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/YELLOW, 8"
- 748509 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/YELLOW, 12"
- 748510 - PERMANENT PAVEMENT STRIPING, SYMBOL/LEGEND, EPOXY RESIN PAINT
- 748535 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 4"
- 748536 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 6"
- 748537 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 8"
- 748538 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 10"
- 748539 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 12"
- 748540 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 16"
- 748548 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/YELLOW, 5"
- 748549 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/YELLOW, 10"
- 748557 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 3"
- 748559 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 5"
- 748568 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 9"
- 748569 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 14"

Description:

This work consists of striping layout, furnishing and applying white or yellow, epoxy reflectorized pavement markings or black epoxy contrast pavement markings at the locations and in accordance with the patterns indicated on the Plans, or as directed by the Engineer, and in accordance with these specifications.

The white/yellow epoxy marking material shall be hot-applied by spray methods onto bituminous and/or Portland cement concrete pavement surfaces as required by the Plans. Following an application of double drop glass beads of two sizes and upon curing, the resultant epoxy marking shall be an adherent reflectorized stripe of the specified thickness and width that is capable of resisting deformation by traffic. All marking materials shall be certified lead free and free of cadmium, mercury, hexvalent chromium, and other toxic heavy metals.

The black epoxy marking shall be a two-component, hot-spray applied epoxy resin pavement marking material to be used for pavement marking on Portland cement concrete pavement surfaces. Following an aggregate drop, and upon curing, it shall produce an adherent stripe of specified thickness and width capable of resisting wear from traffic. Black contrast pavement markings will be required on all Portland cement concrete pavements.

Materials Requirements:

A. White and Yellow Reflectorized Epoxy

1. Epoxy Composition Requirements:

The epoxy resin composition shall be specifically formulated for use as a pavement marking material and for hot-spray application at elevated temperatures. The type and amounts of epoxy resins and curing agents shall be at the option of the manufacturer, providing the other composition and physical requirements of this specification are met.

The epoxy marking material shall be a two-component (Part A and Part B), 100% solids type system formulated and designed to provide a simple volumetric mixing ratio (e.g. two volumes of Part A to one volume of Part B).

Component A of both white and yellow shall conform to the following requirements:

% BY WEIGHT

	WHITE:	YELLOW:
Pigments	Titanium Dioxide - 18% Min. (ASTM D476, Type II)	Organic Yellow - 6%-10%
Epoxy Resin	75% Min., 82% Max.	70% Min., 77% Max.

The entire pigment composition shall consist of either titanium dioxide and/or organic yellow pigment. No extender pigments are permitted. The white pigment upon analysis, shall contain a minimum of 16.5% TiO₂ (100% purity).

Epoxy Content-WPE (Component A) - The epoxy content of the epoxy resin will be tested in accordance with ASTM D1652 and calculated as the weight per epoxy equivalent (WPE) for both white and yellow. The epoxy content will be determined on a pigment free basis. The epoxy content (WPE) shall meet a target value provided by the manufacturer and approved by the Department's Material and Research Section (from now on will be addressed as Department). A ± 50 tolerance will be applied to the target value to establish the acceptance range.

Amine Value (Component B) - The amine value of the curing agent shall be tested in accordance with ASTM D2074-66 to determine its total amine value. The total amine value shall meet a target value provided by the manufacturer and approved by the Department. A ± 50 tolerance will be applied to the target value to establish the acceptance range.

Toxicity - Upon heating to application temperature, the material shall not exude fumes which are toxic or injurious to persons or property.

Viscosity - Formulations of each component shall be such that the viscosity of both components shall coincide (within 10%) at a recommended spray application.

2. Physical Properties of Mixed Composition:

Unless otherwise noted, all samples are to be prepared and tested at an ambient temperature of 73 ± 5 °F. (23 ± 3 °C).

- a. Color. The white epoxy composition when applied at a minimum wet film thickness of 20 ± 1 mils (500 μ m) as applicable and allowed to dry, shall plot within the boundaries described by the four corner points listed in Tables 1 and 2 of ASTM D 6628-01 when measured in accordance with the test methods prescribed in Section 7 of ASTM D 6628-01.

The yellow epoxy composition when applied at a minimum wet film thickness of 20 ± 1 mils (500 μ m) as applicable and allowed to dry, shall plot within the boundaries described by the four corner points listed in Tables 1 and 2 of ASTM D 6628-01 when measured in accordance with the test methods prescribed in Section 7 of ASTM D 6628-01.

- b. Directional Reflectance. The white epoxy composition (without glass spheres) shall have a daylight directional reflectance of not less than 84% relative to a magnesium oxide standard when tested in accordance with Method 6121 of Federal Test Method Standard No. 141.

The yellow epoxy composition (without glass spheres) shall have a daylight directional reflectance of not less than 55% relative to a magnesium oxide standard when tested in accordance with Method 6121 of Federal Test Method Standard No. 141.

- c. Drying Time (Laboratory). The epoxy composition, when mixed in the proper ratio and applied at a 20 ± 1 mils (500 μ m) minimum wet film thickness, and immediately dressed with large reflective glass spheres (Federal Spec. Type 4) at a rate of 12 lb/gal (1.4 kg/l) of epoxy pavement marking materials, immediately followed by a second drop of AASHTO M-247 Type 1 glass spheres applied at a rate of 12 lb/gal (1.4 kg/L) of epoxy pavement marking material, shall exhibit a no-track condition in 15 minutes or less (ASTM D711). A Bird Applicator or any other doctor blade shall be used to produce a uniform film thickness.

- d. Drying Time (Field). When installed at a minimum wet film thickness of 20+1 mils (500 or 625 um) and reflectorized with glass spheres, the maximum drying times shall correspond to these temperatures:

80°F (27°C)	10 minutes
70°F (21°C)	10 minutes
60°F (16°C)	15 minutes
50°F (10°C)	25 minutes
40°F (4°C)	45 minutes
35°F (2°C)	60 minutes

The composition shall dry to “no-tracking” in approximately 10 minutes, and after thirty (30) minutes shall show no damaging effect from traffic. Dry to “no-tracking” shall be considered as the condition where no visual deposition of the epoxy marking to the pavement surface is observed when viewed from a distance of 100 feet (30 meters), after a passenger car is passed over the line. Regardless of the temperature at the time of installation, the installation contractor shall be responsible for protection of the markings material until dry to a non-tracking state.

- e. Abrasion Resistance. The wear index of the composition shall not exceed 82 when tested in accordance with ASTM C501 using a CS-17 wheel and under a load of 1000 grams for 1000 cycles.
- f. Tensile Strength. The tensile strength of the epoxy composition shall not be less than 6000 psi (41 MPa) when tested in accordance with ASTM D638 using a Type IV specimen [0.125" ± 0.010" (3.18 ± 0.25 mm) thick]. Tests shall be conducted at an ambient temperature of 75 ± 5°F (24 ± 3°C). The testing machine shall operate at a speed of 0.20" (5.1 mm) per minute.

The total conditioning or drying period, from the time the epoxy composition is first mixed to the time of testing, shall not be less than 24 hours nor more than 96 hours. Test specimens for tensile strength determination will be prepared as follows:

A 1/8 inch (3 mm) thick sheet of epoxy material is cast from a reservoir-type mold, fabricated from polytetrafluorethylene (PTFE), 1/8" deep x 10" x 10" (3 mm deep x 250 mm x 250 mm).

Prior to casting, the mold is sprayed with a suitable release agent. A sufficient amount of epoxy composition is mixed in the proper proportions (A:B) and poured level with the top of the mold. Care should be taken so as not to decrease or exceed the 1/8" (3 mm) thickness.

After a period of 1 to 4 hours, the material will have set into a semi-rigid sheet that is flexible enough to die-cut yet rigid enough to retain its shape. While the material is in this “plastic” state, five (5) specimens shall be die-cut and then placed on a flat, smooth, PTFE surface for the completion of the specified conditioning period.

- g. Compressive Strength. The compressive strength of the epoxy composition shall not be less than 12,000 psi (83 MPa) when tested in accordance with ASTM D695 except that a compression tool shall not be necessary. The test specimen shall be a right cylinder [0.50 inch diameter by 1.0 inch length (12 mm diameter by 25 mm length)]. Tests shall be conducted at an ambient temperature of 75 ± 5°F (24 ± 3°C).

The total conditioning or drying period, from the time the epoxy composition is first mixed to the time of testing shall not be less than 24 hours nor more than 96 hours. Test specimens for compressive strength determinations will be prepared as follows:

Five molds will be prepared from 1/2" (12 mm) I.D., 1/16" (1.5 mm) wall thickness acrylic tubing, cut in 1 1/2" (38 mm) lengths. After spraying the inside of the mold with a suitable release agent,⁽¹⁾ the cylindrical tubes are placed in a vertical position on a PTFE sheet base. A sufficient amount of epoxy composition is thoroughly mixed in the proper proportions (A:B) and poured into the mold to a depth of approximately 1 1/4" (32 mm). After a

minimum of 72 hours curing, the specimens are removed from the molds and machined to a length of 1" ± 0.002" (25 mm ± 0.05 mm).

- h. Hardness. The epoxy composition when tested in accordance with ASTM D2240 shall have a Shore D hardness of between 75 and 100. Samples shall be allowed to dry for not less than 24 hours nor more than 96 hours prior to testing.

B. Reflective Glass Spheres/Beads

Reflective glass spheres for drop-on application shall conform to the following requirements:

The glass spheres shall be colorless; clean; transparent; free from milkiness or excessive air bubbles; and essentially clean from-surface scarring or scratching. They shall be spherical in shape and at least 80% of the glass beads shall be true spheres when tested in accordance with ASTM D1155. At least 80% of the Type IV beads shall be true spheres as measured by the visual method.

The refractive index of the spheres shall be a minimum of 1.50 as determined by the liquid immersion method at 77°F (25°C).

The silica content of the glass spheres shall not be less than 60%.

The crushing resistance of the spheres shall be as follows: A 40 lb. (18 kg) dead weight, for 20 to 30 (850 µm to 600 µm) mesh spheres shall be the average resistance when tested in accordance with ASTM D1213.

The glass spheres shall have the following grading when tested in accordance with ASTM D1214.

M247 AASHTO Type 1 Glass Spheres

<u>U.S. Standard Sieve</u>	<u>% Retained</u>	<u>% Passing</u>
#20 (850µm)	0	100
#30 (600µm)	5-25	75-95
#50 (300µm)	40-65	15-35
#100 (150µm)	15-35	0-5
Pan	0-5	

Type 4 Large Spheres

<u>U.S. Standard Sieve</u>	<u>% Retained</u>	<u>% Passing</u>
#10 (2000 µm)	0	100
#12 (1680 µm)	0-5	95-100
#14 (1410 µm)	5-20	80-95
#16 (1190 µm)	40-80	10-40
#18 (1000 µm)	10-40	0-5
#20 (850 µm)	0-5	0-2
Pan	0-2	

The AASHTO M247 Type 1 glass spheres shall be treated with a moisture-proof coating. They shall show no tendency to absorb moisture in storage and shall remain free of clusters and hard lumps. They shall flow freely from dispensing equipment at any time when surface and atmosphere conditions are satisfactory for marking operations. The moisture-resistance of the glass spheres shall be determined in accordance with AASHTO M247 test method 4.4.1.

Type IV glass spheres shall be treated with an adhesion coating. They shall show no tendency to absorb moisture in storage and shall remain free of clusters and hard lumps. They shall flow freely from dispensing equipment at any time when surface and atmosphere conditions are satisfactory for marking operations. The adhesion coating property of the Type IV beads shall be tested in accordance with the dansyl-chloride test.

C. Black Epoxy Contrast Markings

Epoxy Resin Requirements: The two-component, 100% solids, paint shall be formulated and designed to provide a simple volumetric mixing ratio (e.g. 2 part component A to 1 part component B) specifically for service as a hot-spray applied binder for black aggregate in such a manner as to produce maximum adhesion. The material shall be composed of epoxy resins and pigments only.

The paint shall be well mixed in the manufacturing process and shall be free from defects and imperfections that may adversely affect the serviceability of the finished product. The paint shall not thicken, curdle, gel, settle excessively, or otherwise display any objectionable properties after storage. Individual components shall not require mixing prior to use when stored for a maximum of 6 months.

The overall paint composition shall be left to the discretion of the manufacturer, but shall meet the following requirements:

Composition:	<u>Component</u> Carbon Black (ASTM D476 Type III)	<u>Percent By Weight</u> 7±2 percent, by weight
	Talc	14±2 percent, by weight
	Epoxy Resin	79±4 percent, by weight

D. Black Aggregate

The moisture resistant aggregate shall meet the gradation requirements (AASHTO T27) as follows:

<u>Sieve Size</u>	<u>Percent Retained</u>
#30	18-28%
#40	60-80%
#50	2-14%

The moisture resistant aggregate shall have a ceramic coating. The aggregate shall be angular with no dry dispensement pigment allowed.

<u>Hardness:</u>	The black aggregate hardness shall be 6.5-7 on Moh's Mineral Scale.
<u>Porosity:</u>	The black aggregate porosity shall be less than two (2) percent.
<u>Moisture Content:</u>	The black aggregate moisture content shall be less than a half (.5) percent.

E. Packaging and Shipment

Epoxy pavement marking materials shall be shipped to the job site in strong substantial containers. Individual containers shall be plainly marked with the following information:

- a. Name of Product
- b. Lot Number
- c. Batch Number
- d. Test Number
- e. Date of Manufacture
- f. Date of expiration of acceptance (12 months from date of manufacture)
- g. The statement (as appropriate)
 - Part A - Contains Pigment & Epoxy Resin
 - Part B - Contains Catalyst
- h. Quantity
- i. Mixing proportions, Application Temperature and Instructions
- j. Safety Information
- k. Manufacturer's Name and Address

Reflective glass spheres shall be shipped in moisture resistant bags. Each bag shall be marked with the name and address of the manufacturer and the name and net weight of the material.

F. The Department reserves the right to randomly take a one-quart sample of white, yellow and hardener, of the epoxy material or glass spheres without prior notice for testing to ensure the epoxy material meets specifications.

Epoxy Application Equipment:

Application equipment for the placement of epoxy reflectorized pavement markings shall be approved by the Department, prior to the start of work.

At any time throughout the duration of the project, the Contractor shall provide free access to his epoxy application equipment for inspection by the Engineer or his authorized representative.

In general, the application equipment shall be a mobile, truck mounted and self contained pavement marking machine, specifically designed to apply epoxy resin materials and reflective glass spheres in continuous and skip-line patterns. The application equipment shall be maneuverable to the extent that straight lines can be followed and normal curves can be made in a true arc. In addition, the truck mounted unit shall be provided with accessories to allow for the marking of legends, symbols, crosswalks, and other special patterns.

The Engineer may approve the use of a portable applicator in lieu of truck mounted accessories, for use in applying special markings only, provided such equipment can demonstrate satisfactory application of reflectorized epoxy markings in accordance with these specifications.

The applicator shall be capable of installing up to 20,000 lineal feet (6,100 lineal meters) of epoxy reflectorized pavement markings in an 8-hour day and shall include the following features:

1. The applicator shall provide individual material reservoirs, or space, for the storage of Part A and Part B of the epoxy resin composition; for the storage of water; and for the storage of reflective glass spheres.
2. The applicator shall be equipped with heating equipment of sufficient capacity to maintain the individual epoxy resin components at the manufacturer's recommended temperature for spray application and for heating water to a temperature of approximately 140°F (60°C).
3. The glass spheres shall be gravity dropped upon 20 mils (500 um) of epoxy pavement markings to produce a wet-night-reflective pavement marking. The large spheres (Federal Spec. Type 4) shall be applied at a rate of 12 pounds per gallon (1.4 kg/L) of epoxy pavement marking material, immediately followed by a second drop of AASHTO M-247 Type 1 glass spheres applied rate of 12 pounds per gallon (1.4 kg/L) of epoxy pavement marking material. This application rate and the following gradation shall conform to FHWA's FP-96: Standard Specifications for Construction of Roads and Bridges on Federal Highway Projects (pages 757-761 Type 3 and Type 4 Beads).
4. The applicator shall be equipped with metering devices or pressure gauges, on the proportioning pumps. Metering devices or pressure gauges shall be visible to the Engineer.
5. The applicator shall be equipped with all the necessary spray equipment, mixers, compressors, and other appurtenances to allow for the placement of epoxy reflectorized pavement markings in a simultaneous sequence of operations as described below in Construction Details, D. Applications of Epoxy Reflectorized Pavement Markings of this Special Provisions.

Construction Details.

A. General: All pavement marking and patterns shall be placed as shown on the Plans or as directed by the Engineer.

Before any pavement markings work is begun, a schedule of operations shall be submitted for the approval of the Engineer. This schedule shall be submitted 2 weeks prior to the application of the striping.

At least five (5) days prior to starting striping the Contractor shall provide the Engineer with the epoxy manufacturer's written instructions for use. These instructions shall include but not be limited to: mixing ratios, application temperatures, and recommendations for use of water spray.

The application of pavement markings shall be done in the general direction of traffic. Striping against the direction of traffic flow shall not be allowed.

The Contractor shall be responsible for removing, to the satisfaction of the Engineer, tracking marks, spilled epoxy or epoxy markings applied in unauthorized areas.

The hot water spray shall not be used in conjunction with markings applications on any pavement surface, or on any existing durable type marking, unless specifically recommended by the manufacturer of the epoxy material.

- B. Atmospheric Conditions: Epoxy pavement markings shall only be applied during conditions of dry weather and on substantially dry pavement surfaces. At the time of installation the pavement surface temperature shall be a minimum of 35 °F (2 °C) and the ambient temperature shall be a minimum of 35 °F (2 °C) and rising. The Engineer shall be the sole determiner as to when atmospheric conditions and pavement surface conditions are such to produce satisfactory results.
- C. Surface Preparations: The Contractor shall clean the pavement or existing durable marking to the satisfaction of the Engineer.

Surface cleaning and preparation work shall be performed only in the area of the epoxy markings application. At the time of application all pavement surfaces and existing durable markings shall be free of oil, dirt, dust, grease and similar foreign materials. The cost of cleaning these contaminants shall be included in the bid price of this item. Also, the item shall include the cost of removal of the curing component in the area of the epoxy markings application, if concrete curing compounds on new portland cement concrete surfaces have been used. Waterblasting will not be permitted for removal.

- D. Application of White/Yellow Epoxy ReflectORIZED Pavement Markings: White/yellow epoxy reflectORIZED pavement markings shall be placed at the widths and patterns designated on the Contract Plans.

Markings operations shall not begin until applicable surface preparation work is completed, and approved by the Engineer.

White/yellow epoxy pavement markings shall be applied at a minimum uniform thickness of 20 mils (500 µm) on all Portland cement concrete and bituminous concrete pavement, including Stone Matrix Asphalt.

Large reflective glass spheres (Federal Spec. Type 4) shall be applied at the rate of 12 pounds per gallon (1.4 kg/L) of epoxy pavement marking material, immediately followed by a second drop of AASHTO M-247 Type 1 glass spheres applied at a rate of 12 pounds per gallon (1.4 kg/L) of epoxy pavement marking material. Glass spheres shall uniformly cover the length and width of the pavement marking.

- E. Application of Black Epoxy Contrast Pavement Markings: Black epoxy contrast pavement markings shall be placed at the widths designated on the Contract Plans.

Markings operations shall not begin until applicable surface preparation work is completed, and approved by the Engineer.

Black epoxy contrast pavement markings shall be applied at a minimum uniform thickness of 20 mils (500 µm) on all Portland cement concrete surfaces followed by a single drop of graded black aggregate. The width of black epoxy line shall be applied for the following situations:

Center Skip Line - On Portland cement concrete pavements a black contrast skip line shall be 10 feet (3 m) in length of the same width as the white epoxy reflectorized skip. It is to lead the white skip and stop at the beginning of the white skip. The black contrast skip is to have a single application of graded black aggregate.

Edge Lines -White Edge lines on Portland cement concrete pavements shall have a 3 inch black contrast line running parallel to the white edge line. The contrast line shall be to the inside or travel lane side of the edge line. The black contrast marking is to be applied with a single drop of graded black aggregate. Once it has cured sufficiently so as not to track, the reflectorized white line is to be applied along side of the contrast line and the two lines shall adjoin each other.

Dotted Line: All dotted lines on Portland cement concrete pavements shall have a base of black contrast markings which is 4 inches (100 mm) wider than the reflective white marking. The black contrast marking is to be applied first with a single drop of graded black aggregate. Once it has cured sufficiently so as not to track, the reflectorized white line is to be applied on top of it. The reflective line is to be centered along the black contrast line such that a minimum of 2 inches (50 mm) of black contrast marking is visible on either side of the reflective marking.

F. Defective Epoxy Pavement Markings: Epoxy reflectorized pavement markings, which after application and curing are determined by the Engineer to be defective and not in conformance with this specification, shall be repaired. Repair of defective markings shall be the responsibility of the Contractor and shall be performed to the satisfaction of the Engineer as follows:

1. Insufficient film thickness [(less than 20₊₁ mils (500 μm) as applicable] and line widths; insufficient glass bead coverage or inadequate glass bead retention.

Repair Method: Prepare the surface of the defective epoxy marking by shot blasting, sand blasting, or water blasting. No other cleaning methods will be allowed. Surface preparation shall be performed to the extent that a substantial amount of the reflective glass spheres are removed and a roughened epoxy marking surface remains.

Immediately after surface preparation remove loose particles and foreign debris by brooming or blasting with compressed air.

Repair shall be made by re-striping over the cleaned surface, in accordance with the requirements of this specification and at a full 20₊₁ mils (500 μm) minimum line thickness as applicable.

2. Uncured or discolored epoxy (brown patches); insufficient bond to pavement surface (or existing durable marking). Uncured epoxy shall be defined as applied material that fails to cure (dry) in accordance with the requirements of this specification under MATERIALS, A, 2d. DRYING TIME (FIELD); or applied material that fails to cure (dry) within a reasonable time period under actual field conditions, as defined by the Engineer.

Discoloration (brown patches) shall be defined as localized areas or patches of brown or grayish colored epoxy marking material. These areas often occur in a cyclic pattern and also, often are not visible until several days or weeks after markings are applied.

Repair Method: The defective epoxy marking shall be completely removed and cleaned to the underlying pavement surface to the satisfaction of the Engineer.

The extent of removal shall be the defective area plus any adjacent epoxy pavement marking material extending one foot (300 mm) any direction.

After surface preparation work is complete, repair shall be made by re-applying epoxy over the cleaned pavement surface in accordance with the requirements of this specification.

3. Reflectivity for epoxy resin paint.

After satisfactory completion of all striping work and written notification from the Contractor, the Department shall test the striping to ensure it has the minimum reflectivity. The testing will

be completed within 30 calendar days from notification. The Contractor may request that tests be conducted on completed phases or portions of the work. Approval of such a request will be at the discretion of the Engineer. Testing will be done using a LTL-X Retrometer (30 meter geometry). Five readings will be taken per line per mile (1.6 km). Projects less than 1 mile (1.6 km) in length will have a minimum of 5 readings per line. These readings will then be averaged for the overall project average. The required average minimum initial reflectivity reading in millicandellas shall be:

White 450
Yellow 325

Any single reading shall not be less than 350 millicandellas for white and 250 millicandellas for yellow. Without exception, any pavement markings installed that does not meet the above average minimum initial reflectivity numbers shall be removed and replaced, at the installation contractor's expense. Other defects not noted above, but determined by the Engineer to need repair, shall be repaired or replaced as directed by and to the satisfaction of the Engineer. All work in conjunction with the repair or replacement of defective epoxy reflectorized pavement markings shall be performed by the Contractor at no additional cost to the State.

Method of Measurement:

The quantity of permanent pavement striping (white, yellow, or black epoxy resin paint) will be measured by the number of linear feet (meters) of pavement striping line and number of square feet (meter) of symbol installed on the pavement and accepted in accordance with the Plans.

Basis of Payment:

The quantity of permanent pavement striping (white, yellow, or black epoxy resin paint) payment will be paid for at the Contract unit price per linear foot (meter) for 3", 4", 5", 6", 8", 9", 10", 12", 14", 16" (75 mm, 100 mm, 125 mm, 150 mm, 200 mm, 225 mm, 250 mm, 300 mm, 350 mm, or 400 mm) line and the Contract unit price per square foot (meter) of symbol. The quantity of permanent pavement marking (white, yellow, or black epoxy resin paint) will be paid for at the Contract unit price per linear foot (meter) of line and the Contract unit price per square foot (meter) of symbol. Price and payment shall include striping layout, cleaning and preparing the pavement surface, and placing all materials, for all labor, tools, equipment and incidentals necessary to complete the work.

NOTE:

For information only: The following manufacturers are known to us which manufacturer Epoxy Resin Paint for Pavement Striping. The Department does not endorse or require the use of any of the manufacturers listed below. However, a bidder wishes to use another manufacturer's product, it shall be submitted for review and approval prior to submitting a bid proposal. Should the product be deemed unacceptable by the Department, the successful bidder will be required to use only an approved product.

1. POLY CARB, Inc.
33095 Bainbridge Road
Solon, Ohio 44139
Tel. 1-800-CALLMIX
2. IPS - Ennis Paint
P.O. Box 13582
Research Triangle Park, North Carolina 27709
Tel. 1-877-477-7623
3. Epoplex
One Park Avenue
Maple Shade, NJ 08052
Tel. 1-800-822-6920
4. Or an approved equal.

748530 - REMOVAL OF PAVEMENT STRIPING

Description:

This work consists of removing pavement markings of all kinds including paint, tape, etc., in accordance with this special provision, notes on Plans and/or as directed by the Engineer. The Contractor shall coordinate with the Engineer for maintaining traffic during the operation, prior to starting the work.

Materials and Construction Methods:

Paint and Epoxy Resins:

Shot/abrasive grit blasting or water blasting equipment shall be used for removal of markings from pavement surfaces.

Alkyd Thermoplastic:

In addition to the removal techniques discussed for paint and epoxy, grinding (erasing machines) equipment may also be used for removal of markings from pavement surfaces.

The removal operation shall be performed in a manner that will not damage the pavement surface.

The Contractor shall collect and dispose of all shot/abrasive grit and pavement marking materials removed from the pavement surface. Washing or sweeping such material to the roadside will not be permitted.

After removal of striping on bituminous concrete asphalt sealer shall be used to cover any exposed aggregate or embedded paint at no additional cost.

Method of Measurement:

The quantity of pavement striping removal will be measured as the number of square feet (meters) of pavement striping removed and accepted. The area of lines will be calculated by multiplying the nominal width of line times the length and the area of symbols will be as specified in Subsection 748.10 of the Standard Specifications.

Basis of Payment:

The quantity of pavement striping removal will be paid for at the Contract unit price per square foot (meter) for "Removal of Pavement Striping". Price and payment shall be full compensation for furnishing all materials, removing the pavement markings, disposing of the removed marking material, covering up the exposed aggregate, and for all labor, equipment, tools and incidentals necessary to complete the work.

Note:

There will be no measurement and payment for removal of pavement markings placed incorrectly by the Contractor.

5/21/2013

- 748541 - PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT MARKINGS,
4"
- 748542 - PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT MARKINGS,
6"
- 748543 - PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT MARKINGS,
8"
- 748544 - PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT MARKINGS,
12"
- 748545 - PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT MARKINGS,
16"
- 748546 - PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT MARKINGS,
SYMBOL/LEGEND
- 748553 - PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT MARKINGS,
BIKE SYMBOL
- 748554 - PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT MARKINGS,
PEDESTRIAN SYMBOL
- 748555 - PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT MARKINGS,
HANDICAP SYMBOL

Description:

This work consists of furnishing and installing preformed retroreflective thermoplastic pavement marking with a preapplied Federal Specification Type IV glass bead coating throughout its entire cross section on bituminous asphalt pavement at the locations and in accordance with the patterns on the Plans, or as directed by the Engineer.

The preformed retroreflective markings shall conform to the size and dimensions as shown in the Federal "Standard Highway Signs" book found at: <http://mutcd.fhwa.dot.gov/SHSe/pavement.pdf> as referred to in the Delaware Manual on Uniform Traffic Control Devices, Part 3, Markings.

Materials:

General: Only materials listed on the Department's Approved Pavement Markings Material List will be used for this item. The preformed retroreflective markings shall be fusible to bituminous asphalt pavement by means of the normal heat of a propane type of torch. Adhesives, primers or sealers are not necessary prior to the preformed retroreflective markings application on bituminous asphalt pavement.

The preformed retroreflective markings shall conform to pavement contours, breaks and faults through the action of traffic at normal pavement temperatures. The markings shall have resealing characteristics and be capable of fusing to itself and previously applied worn hydrocarbon and/or alkyd thermoplastic pavement markings.

The preformed retroreflective markings shall be capable of application on bituminous asphalt pavement wearing courses during the paving operation in accordance with the manufacturer's instructions. After application the markings shall be immediately ready for traffic. The preformed retroreflective markings shall be suitable for use for one year after the date of receipt when stored in accordance with the manufacturer's recommendations.

The preformed retroreflective thermoplastic markings shall not be brittle and must be sufficiently cohesive and flexible at temperatures exceeding 50°F (10°C) for one person to carry without the danger of fracturing the material prior to application.

Composition: The retroreflective pliant rosin ester thermoplastic pavement markings shall consist of a homogeneous mixture of high quality polymeric thermoplastic binders, pigments, fillers and glass beads. The thermoplastic material must conform to AASHTO M249-79(86) with the exception of the relevant differences due to the material being preformed, and identified herein.

Intermix Glass Beads: The preformed retroreflective material shall contain a minimum of 30% glass spheres which shall conform to AASHTO M247-81 Type 1. Glass spheres shall have a minimum of 80% true spheres overall.

Top Beads: To provide the required retroreflectivity, the preapplied factory top coating of glass beads shall be a combination of both Federal Spec. Type IV and AASHTO M247-81 Type I beads. Federal Spec. Type IV beads shall be evenly disbursed across the entire surface of the product at a minimum rate of 4 lb. (1.8 kg) per 100 ft² (9.3 m²) and the AASHTO at 3 lb.(1.4 kg) per 100 ft² (9.3 m²). In combination, the total glass bead coverage shall be 7-8 lb. (3.2-3.6 kg) per 100 ft² (9.3 m²). The AASHTO M247-81 Type I beads shall have a minimum of 80% true spheres overall and the Federal Spec. Type IV beads shall be 80% true spheres on the 12 and 14 sieves and shall be no less than 75% true spheres on the remaining sieves.

Retroreflectivity: After satisfactory completion of all striping work and written notification from the contractor, the Department shall test the striping to ensure it has the minimum reflectivity. The testing will be completed within 30 calendar days from notification. Testing will be done using a Delta LTL 2000 Retrometer (30 meter geometry). The required minimum initial reflectivity reading in millicandellas shall be:

White 300
Yellow 200
Blue 200

Skid Resistance: The surface of the preformed retroreflective thermoplastic markings shall provide a pre-applied minimum skid resistance value of 45-51 BPN and a post-applied minimum skid resistance value of 45-55 BPN when tested according to ASTM E303-74.

Thickness: The thickness of the supplied material shall have a minimum average thickness of .090" (90 mils) for all Longitudinal lines and a thickness of .125" (125 mils) for all transverse lines and symbols/legends.

Tensile Strength and Elongation: The preformed retroreflective thermoplastic material shall have a minimum tensile strength of 150 lb. per square inch (1054 kg per square mm) of cross section, at .002" (2.28 mil) thickness, when tested according to ASTM D638-76 except that a sample 6" by 1" (150 mm by 25 mm) shall be tested at a temperature between 70°F and 80°F (21°C and 27°C) using a jaw speed of 10" to 12" (250 mm to 300 mm) per minute. The sample shall have a maximum elongation of 20% at break when tested by this method.

Flexibility: The preformed retroreflective thermoplastic marking material shall have flexibility at 50°F such that when a 1" by 6" (25 mm by 150 mm) sample is bent through an arc of 90 degrees at a uniform rate in 10 seconds (9 degrees per second) over a 1" (25 mm) mandrel, no cracking occurs in the test sample. The sample must be conditioned prior to testing at 50°F±2 degrees (10°C) for a minimum of four hours. At least two specimens tested must meet the flexibility requirements at 50°F (10°C) for a passing result.

Environmental Resistance: The applied markings shall be resistance to deterioration due to exposure to sunlight, water, oil, diesel fuels, gasoline, pavement oil content, salt and adverse weather conditions.

Effective Performance Life: When properly applied, in accordance with manufacturer's instructions, the preformed retroreflective pavement markings shall be neat and durable. The markings shall remain skid resistant and show no lifting, shrinkage, tearing, roll back or other signs of poor adhesion for a period of one winter season.

Oil/grease Resistant Test: The preformed retroreflective thermoplastic material shall not dissolve or smear after rubbing a small amount of motor oil on a small piece of the thermoplastic material for two minutes.

Bond Strength: The material shall exhibit a bond strength to Portland Cement Concrete (PCC) equal or exceed 180 psi when tested at room temperature (73.4±3°F) (23°C) in accordance to ASTM Standard Test Method for Bond Strength of thermoplastic marking Material D4796-88. Place a coarse brick in a 400°F (204°C) oven for 5 minutes. Prepare a 4 square inch test specimen. Place the test specimen on the brick and further heat in the 400°F (204°C) oven for 15 minutes. The test specimen is then allowed to cool to room temperature and prepared for testing.

Low Temperature Cracking (Stress) Resistance for Extended Period: The material shall be tested according to AASHTO T250 Section 7 with Section 7.2.3 modified for and extended cold temperature 15

degrees $\pm 3^{\circ}\text{F}$ ($-9.4 \pm 2^{\circ}\text{C}$) exposure period 72 hours. Any cracking shall constitute failure of the material for PCC road surfaces.

Impact Resistance (Gardner Falling Weight): A 2" by 7.5" (50 by 190 mm) specimen shall be applied on a course concrete brick. Using a Gardner Impact Tester, a 2 lb (.91 kg) weight is dropped from a height of 80" (2032 mm). The specimen when tested at room temperature $73.4 \pm 3^{\circ}\text{F}$ (23°C) should show no sign of cracking. (Test procedure is in accordance with ASTM D5420-93).

Packaging: The flexible preformed retroreflective thermoplastic marking materials, for use as transverse or longitudinal markings as well as legends, arrows and symbols shall be available in flat form material or in rolls. Flat material shall be supplied in maximum of 4' (1.2 m) lengths up to 2' (.6 m) in width. The material shall be packed in suitable cartons clearly labeled for ease of identifying the contents.

Construction Methods:

The markings shall be applied in strict accordance with the manufacturer's recommendations on clean and dry surfaces. Marking configurations shall be in accordance with the "Delaware Manual on Uniform Traffic Control Devices, Part 3, Markings."

The preformed retroreflective thermoplastic material shall be fusible to the pavement by means of a propane torch recommended by the manufacturer. Preheating the surface to remove any latent moisture will be done just prior to the placement and installation of the Symbol/ Legend. No markings shall be placed when the ambient temperature is below 40°F (4°C). The material shall be kept in a location above 55°F (13°C) until just before application.

The supplier shall provide technical services as may be required.

Method of Measurement:

The quantity of pavement striping (748541-748545) will be measured by the number of linear feet (linear meters) of 4", 6", 8", 12", or 16" pavement striping line placed and accepted. The quantity of symbol/ legend (748546) will be measured by the number of square feet (meters) of symbol/legend placed and accepted. The quantity of bike symbol, pedestrian symbol, and handicap symbol (748551-748553) will be measured as each placed and accepted. The dimensions for the symbol/legends are as follows:

Bike Rider Symbol shall be 3' x 6' and accompanying 2' x 6' Arrow Symbol.

Pedestrian shall be 4' X 8'.

Handicap Symbol shall be 40" X 40".

Basis of Payment:

The quantity of pavement striping payment will be paid for at the Contract unit price per linear foot (linear meter) for 4", 6", 8", 12" and 16" (100 mm, 150 mm, 200 mm, 300 mm, and 400 mm) line. The quantity of symbol/legend will be paid for at the Contract unit price per square foot (meter). The quantity of bike symbol, pedestrian symbol, and handicap symbol will be paid for at the Contract unit price per each. Price and payment shall include cleaning and preparing the pavement surface, and placing all materials, for all labor, tools, equipment and incidentals necessary to complete the work.

Warranty:

The Contractor shall warrant to the Department that the installed retroreflective preformed thermoplastic pavement markings are free of defects, as hereafter defined, for a period of one winter season beginning at the initial acceptance of the marking installation by the Department. The initial acceptance of the marking installation will occur upon the satisfactory correction of all deficiencies noted in the marking installation during the Final Inspection of the project. The markings shall be warranted against failure due to blistering, excessive cracking, bleeding, staining, discoloration, oil content of the pavement materials, smearing and spreading under heat, deterioration due to contact with grease deposits, oil, diesel fuel, or gasoline drippings, chipping, spalling, poor adhesion to the pavement materials, vehicular damage, and wear from normal maintenance activities including snow plowing.

The Contractor shall repair all defective areas identified by the Department after initial installation or during the Warranty Period. All repairs shall begin immediately following the notice to the Contractor by the Department unless weather limitations prevent the corrective work. Should the contractor not commence work within the period stated in the notice, weather permitting, and pending severity, the Department reserves the right to remedy the condition and charge the contractor for the work. Any corrective work shall be as recommended by the manufacturer of the marking material and approved by the Department. The Department shall be given notification before the Contractor begins corrective work to allow for inspection of the operation. All costs associated with the repair work shall be the responsibility of the contractor. These costs shall include, but are not limited to, removal, material, maintenance of traffic, etc.

6/2/16

749687 - INSTALLATION OR REMOVAL OF TRAFFIC SIGN ON SINGLE SIGN POST

Description:

This work consists of installing or removing traffic sign(s) on a single post or other type of pole at the locations indicated on the Plans or as directed by the Engineer. This specification also includes installation of posts in boring holes constructed under other items.

A single sign totaling more than 9 square feet, or with any dimension, length or width, greater than or equal to 48 inches shall be installed on multiple sign posts under Item 749690 - Installation or Removal of Traffic Sign on Multiple Sign Posts.

Materials:

The Department will provide all sign materials to be used on this project. The Contractor shall contact the DelDOT Sign Shop Supervisor with project plans and quantity sheets at 302-760-2581. Sign fabrication orders require a minimum of four (4) weeks for completion. Orders placed with less than 4 weeks lead-time will result in a delay. Any delay caused by inadequate lead-time due to a late order will be the sole responsibility of the Contractor. The Contractor shall pick-up the sign materials from the DelDOT Sign Shop and deliver them to the job site without any damage to the sign materials.

Construction Methods:

The Contractor shall pick-up necessary signs, sign posts, hardware, and extensions from the Department and install the signs in the locations indicated on the Plans in accordance with the Delaware MUTCD or as directed by the Engineer. The Contractor shall be responsible for obtaining all necessary utility clearances before the signs may be installed. Signs and plaques shall be mounted no lower than the minimum mounting height specified in the Delaware MUTCD. Signs and plaques shall be mounted no higher than one foot above the minimum mounting height specified in the Delaware MUTCD. Any excess sign post protruding above the top of the top sign shall be cut off and removed. For sign removals, the sign posts shall have all nuts, bolts, and other connectors removed. The disturbed ground shall be graded and backfilled accordingly. The Contractor is responsible for disposal of all signing material removed from the project

Method of Measurement:

The number of single sign installations or removals will be measured as the actual number of signs installed or removed and accepted.

Basis of Payment:

The quantity of single sign post installations or removals will be paid for at the Contract unit price per each. Price and payment will constitute full compensation for installing or removing signs and sign materials, pick-up and delivery of sign materials, grading disturbed areas, and for all labor, equipment, tools, and incidentals required to complete the work. Signs that are not installed in accordance with the Delaware MUTCD or signs installed in the incorrect location shall be moved at no additional cost to the Department.

5/28/2013

749688 - INSTALLATION OF 4" DIAMETER HOLE, LESS THAN OR EQUAL TO 6" IN DEPTH
749689 - INSTALLATION OF 4" DIAMETER HOLE, GREATER THAN 6" IN DEPTH

Description:

This work consists of boring a hole 4" in diameter averaging 6" in depth into bituminous concrete or P.C.C. surfaces for installing single or multiple sign posts at the locations indicated on the Plans or as directed by an Engineer.

Materials:

The Contractor shall provide the equipment necessary to bore a 4" hole into paved surfaces, while maintaining the stability of the surrounding paved or P.C.C. surfaces. The depth of the bored hole shall be to the top of the subbase material.

Construction Methods:

The holes shall be bored into pavement or P.C.C. islands, medians, or sidewalk using a mechanical hole borer for such work or other methods approved by the Engineer. The hole shall be 4" in diameter. Holes bigger or smaller than 4" shall be corrected at the Contractor's expense.

Method of Measurement:

The number of 4" holes in diameter bored will be measured as the actual number of holes bored and accepted.

Basis of Payment:

The quantity of holes bored as required above will be paid for at the Contract unit price per each. Price and payment will constitute full compensation for boring holes at the required depth, and for all labor, equipment, tools, and incidentals required to complete the work.

Note:

The cost for installing holes and PVC sleeves for sign posts in newly constructed P.C.C. islands, medians, or sidewalks shall be incidental to the P.C.C. item.

3/23/09

749690 - INSTALLATION OR REMOVAL OF TRAFFIC SIGN ON MULTIPLE SIGN POSTS

Description:

This work consists of installing or removing traffic sign(s) on multiple sign posts at the locations indicated on the Plans or as directed by the Engineer. This specification also includes installation of posts in holes installed under other items.

A single sign totaling more than 9 square feet, or with any dimension, length or width, greater than 48 inches shall be mounted on two (2) posts. Signs with a length greater than or equal to 78 inches shall be mounted on three (3) sign posts.

Materials:

The Department will provide all sign materials to be used on this project. The Contractor shall contact the DelDOT Sign Shop Supervisor with project plans and quantity sheets at 302-760-2581. Sign fabrication orders require a minimum of four (4) weeks for completion. Orders placed with less than 4 weeks lead-time will result in a delay. Any delay caused by inadequate lead-time due to a late order will be the sole responsibility of the Contractor. The Contractor shall pick-up the sign materials from the DelDOT Sign Shop and deliver them to the job site without any damage to the sign materials.

Construction Methods:

The Contractor shall pick-up necessary signs, sign posts, hardware, and extensions from the Department and install the signs in the locations indicated on the Plans in accordance with the Delaware MUTCD or as directed by the Engineer. The Contractor shall be responsible for obtaining all necessary utility clearances before the signs may be installed. Signs and plaques shall be mounted no lower than the minimum mounting height specified in the Delaware MUTCD. Signs and plaques shall be mounted no higher than one foot above the minimum mounting height specified in the Delaware MUTCD. Any excess sign post protruding above the top of the top sign shall be cut off and removed. For sign removals, the sign posts shall have all nuts, bolts, and other connectors removed. For sign removals, the sign posts shall have all nuts, bolts, and other connectors removed. The disturbed ground shall be graded and backfilled accordingly. The Contractor is responsible for disposal of all signing material removed from the project..

Method of Measurement:

The number of sign installations or removals will be measured as the total square foot of the sign(s) installed or removed and accepted.

Basis of Payment:

The quantity of sign installations or removals will be paid for at the Contract unit price per square foot. Price and Payment will constitute full compensation for installing or removing signs and sign materials, pick-up and delivery of sign materials, grading disturbed areas, and for all labor, equipment, tools, and incidentals required to complete the work. Signs that are not installed accordance with the Delaware MUTCD or signs installed in the incorrect location shall be moved at no additional cost to the Department.

5/28/2013

763501 - CONSTRUCTION ENGINEERING

1) Description:

This work consists of construction lay out including; stakes, lines and grades as specified below. Subsection 105.10 Construction Stakes, Lines and Grades of the Standard Specifications is voided.

Based on contract plans and information provided by the Engineer, the Contractor shall stake out right-of-way and easements lines, limits of construction and wetlands, slopes, profile grades, drainage system, centerline or offset lines, benchmarks, structure working points and any additional points to complete the project.

The Engineer will only establish the following:

- (a) Original and final cross-sections for borrow pits.
- (b) Final cross-sections: Top and bottom pay limit elevations for all excavation bid items that are not field measured by Construction inspection personnel. The Contractor shall notify the Engineer when these pay limit elevations are ready and allow for a minimum of two calendar days for the Engineer to obtain the information.
- (c) Line and grade for extra work added on to the project plans.

2) Equipment. The Contractor shall use adequate equipment/instruments in a good working order. He/she shall provide written certification that the equipment/instrument has been calibrated and is within manufacturer's tolerance. The certification shall be dated a maximum of 9 months before the start of construction. The Contractor shall renew the certification a minimum of every 9 months. The equipment/instrument shall have a minimum measuring accuracy of [3mm+2ppmxD] and an angle accuracy of up to 2.0 arc seconds or 0.6 milligons. If the Contractor chooses to use GPS technology in construction stakeout, the Contractor shall provide the Engineer with a GPS rover and Automatic Level for the duration of the contract. The GPS rover shall be in good working condition and of similar make and model used by the Contractor. The Contractor shall provide up to 8 hours of formal training on the Contractor's GPS system to a maximum of four Engineer's appointees (DELDOT Construction Inspectors). At the end of the contract, the Engineer will return the GPS rover to the Contractor. If any of the equipment/instruments are found to be out of adjustment or inadequate to perform its function, such instrument or equipment shall be immediately replaced by the Contractor to the satisfaction of the Engineer. Choosing to use GPS technology does not give the contractor authority to use machine control.- Construction Engineering (GPS) Machine Control Grading shall only be used if noted in the General Notes in the plan set outlining the available files that will be provided to the Contractor and "the Release for delivery of documents in electronic form to a contractor" are signed by all parties prior to delivery of any electronic files. Only files designated in the General Notes shall be provided to the contractor. If machine control grading is allowed on the project see the "machine control" section of this specification. GPS technology and machine control technology shall not be used in the construction of bridges.

3) Engineering/Survey Staff. The Contractor shall provide and have available for the project an adequate engineering staff that is competent and experienced to set lines and grades needed to construct the project. The engineering personnel required to perform the work outlined herein shall have experience and ability compatible with the magnitude and scope of the project. Additionally, the Contractor shall employ an engineer or surveyor licensed in the State of Delaware to be responsible for the quality and accuracy of the work done by the engineering staff. When individuals or firms other than the Contractor perform any professional services under this item, that work shall not be subject to the subcontracting requirements of Subsection 108.01 of the Standard Specifications. The Contractor shall assume full responsibility for any errors and/or omissions in the work of the engineering staff described herein. If construction errors are caused due to erroneous work done under Construction Engineering the Contractor accepts full responsibility, no matter when the error is discovered. Consideration will not be given for any extension of contract time or additional compensation due to delays, corrective work, or additional work that may result from faulty and erroneous construction stakeout, surveying, and engineering required by this specification.

Construction Methods:

4) Performance Requirements:

- (a) Construction Engineering shall include establishing the survey points and survey centerlines; finding, referencing, offsetting the project control points; running a horizontal and vertical circuit to verify the precision of given control points. Establishing plan coordinates and elevation marks for culverts, slopes, subbase, subsurface drains, paving, subgrade, retaining walls, and any other stakes required for control lines and grades; and setting vertical control elevations, such as footings, caps, bridge seats and deck screed. The Contractor shall be responsible for the preservation of the Department's project control points and benchmarks. The Contractor shall establish and preserve any temporary control points (traverse points or benchmarks) needed for construction. Any project control points (traverse points) or benchmarks conflicting with construction of the project shall be relocated by the Contractor. The Contractor as directed by the Engineer must replace any or all stakes that are destroyed at any time during the life of the contract. The Contractor shall re-establish centerline points and stationing prior to final cross-sections by the Engineer. The Vertical Control error of closure shall not exceed $0.035 \text{ ft} \times [\text{Square root of number of miles in the level run}]$ ($0.01 \text{ m} \times [\text{square root of number of kilometers}]$). The Horizontal Control precision ratio shall have a minimum precision of 1:20,000 feet (1 meter per 20,000 meters or 1:20,000) of distance traversed prior to adjustment.
- (b) The Contractor shall perform construction centerline layout of all roadways, ramps and connections, etc. from project control points set by the Engineer. The Contractor using the profiles and typical sections provided in the plans shall calculate proposed grades at the edge of pavement or verify information shown on Grades and Geometric sheets.
- (c) The Contractor shall advise the Engineer of any horizontal or vertical alignment revisions needed to establish smooth transitions to existing facilities. The Contractor must immediately bring to the attention of the Engineer any potential drainage problem within the project limits. The Engineer must approve any proposed variation in profile, width or cross slope.
- (d) The Contractor shall establish the working points, centerlines of bearings on bridge abutments and on piers, mark the location of anchor bolts to be installed, check the elevation of bearing surfaces before and after they are ground and set anchor bolts at their exact elevation and alignment as per Contract Plans. Before completion of the fabrication of beams for bridge superstructures, the Contractor shall verify by accurate field measurements the locations both vertically and horizontally of all bearings and shall assume full responsibility for fabricated beams fitting and bearing as constructed. After beam erection and concurrently with the Department project surveyors or their designated representative, the Contractor shall survey top of beam elevations at a maximum of 10-ft (3.0-meter) stations and compute screed grades. These shall be submitted to the Engineer for review and approval before the stay in place forms are set. Construction stakes and other reference control marks shall be set at sufficiently frequent intervals to assure that all components of the structure are constructed in accordance with the lines and grades shown on the plans. The Contractor will be responsible for all structure alignment control, grade control and all necessary calculations to establish and set these controls.
- (e) The Contractor, using contract plans, shall investigate proposed construction for possible conflicts with existing and proposed utilities. The Contractor shall then report such conflicts to the Engineer for resolution. All stakes for utility relocations, which will be performed by others, after the Notice to Proceed has been given to the Contractor, shall be paid for under item 763597 - Utility Construction Engineering.
- (f) The Contractor shall be responsible for the staking of all sidewalk and curb ramp grades in accordance with the plans and the Departments Standard Construction Details. The Contractor shall review the stakeout with the Engineer prior to construction. The Engineer must approve any deviation from plans, Department Standard Construction Details and Specifications in writing. The Contractor shall be responsible for any corrective actions resulting from problems created by adjustments if they fail to obtain such approval.
- (g) If wetland areas are involved and specifically defined on the Plans the following shall apply:
 - i. It is the intent of these provisions to alert the Contractor, that he/she shall not damage or destroy wetland areas, which exist beyond the construction limits. These provisions will be strictly enforced and the Contractor shall advise his/her personnel and those of any Subcontractor of the importance of these provisions.
 - ii. All clearing operations and delineation of wetlands areas shall be performed in accordance with these Special Provisions. Before any clearing operation commences the Contractor shall demarcate

- wetlands at the Limits of Construction throughout the entire project as shown on the Plans labeled as Limits of Construction or Wetland Delineation to the satisfaction of the Engineer.
- iii. The material to be used for flagging the limits of construction shall be orange vinyl material with the wording "Wetland Boundary" printed thereon. In wooded areas, the flagging shall be tied on the trees, at approximate 20-foot (6.1 meter) intervals through wetland areas. In open field and yard areas that have been identified as wetlands, 3 foot (one meter) wooden grade stakes shall be driven into the ground at approximate 20 foot (6.1 meter) intervals and tied with the flagging.
 - iv. If the flagging has been destroyed and the Engineer determines that its use is still required, the Contractor shall reflag the area at no cost to the Department. If the Contractor, after notification by the Engineer that replacement flagging is needed, does not replace the destroyed flagging within 48 hours, the Engineer may proceed to have the area reflagged. The cost of the reflagging by the Engineer will be charged to the Contractor and deducted from any monies due under the Contract.
 - v. At the completion of construction, the Contractor shall remove all stakes and flagging.
 - vi. The Contractor shall be responsible for any damages to wetlands located beyond the construction limits, which occurs from his/her operations during the life of the Contract. The Contractor shall restore all temporarily disturbed wetland areas to their preconstruction conditions. This includes restoring bank elevations, streambed and wetland surface contours and wetlands vegetation disturbed or destroyed. The expense for this restoration shall be borne solely by the Contractor.
- (h) Whenever the Engineer will be recording data for establishment of pay limits, the Contractor will be invited to obtain the data jointly with the Engineer's Survey Crew(s) in order to agree with the information. If the Contractor's representative is not able to obtain the same data, then the information obtained by the Engineer shall be considered the information to be used in computing the quantities in question.

5) Submittals. All computations necessary to establish the exact position of all work from the control points shall be made and preserved by the Contractor. All computations, survey notes, electronic files, and other records necessary to accomplish the work shall be made available to the Department in a neat and organized manner at any time as directed by the Engineer. The Engineer may check all or any portion of the stakeout survey work or notes made by the Contractor and any necessary correction to the work shall be made as soon as possible. The Contractor shall furnish the Engineer with such assistance as may be required for checking all lines, grades, and measurements established by the Contractor and necessary for the execution of the work. Such checking by the Engineer shall not relieve the Contractor of his/her responsibility for the accuracy or completeness of the work. Copies of all notes must be furnished to the engineer at the completion of the project.

The Contractor shall submit any of the following at the Engineer's request:

- (a) Proposed method of recording information in field books to ensure clarity and adequacy.
- (b) A printout of horizontal control verification, as well as coordinates, differences and error of closure for all reestablished or temporary Control Points.
- (c) A printout of vertical control verification, with benchmark location elevation and differences from plan elevation.
- (d) Sketch of location of newly referenced horizontal control, with text printout of coordinates, method of reference and field notes associated with referencing control - traverse closure report.
- (e) Description of newly established benchmarks with location, elevation and closed loop survey field notes - bench closure report
- (f) All updated electronic and manuscript survey records.
- (g) Stakeout plan for each structure and culvert.
- (h) Computations for buildups over beams, screed grades and overhang form elevations.
- (i) A report showing differences between supplied baseline coordinates and field obtained coordinates, including a list of preliminary input data.
- (j) Any proposed plan alteration to rectify a construction stakeout error, including design calculations, narrative and sealed drawings.
- (k) Baseline for each borrows pit location.
- (l) Detailed sketch of proposed overhead ground mounted signs or signals showing obstructions that may interfere with their installation.
- (m) Copies of cut sheets.

Machine Control Grading

This Section of the specification shall only be used if machine control is authorized for use on the project.

Description:

This specification contains the requirements for grading operations utilizing Global Positioning Systems (GPS).

Use of this procedure and equipment is intended for grading the subgrade surface; it is not intended for the use in constructing final surface grades.

The Contractor may use any manufacturer's GPS machine control equipment and system that results in achieving the grading requirements outlined in section 202 of the standard specifications. The Contractor shall convert the electronic data provided by the Department into the format required by their system. The Department will only provide the information outlined in this document and no additional electronic data will be provided.

The Contractor shall perform at least one 500 foot test section with the selected GPS system to demonstrate that the Contractor has the capabilities, knowledge, equipment, and experience to properly operate the system and meet acceptable tolerances. The engineer will evaluate and make the determination as to whether additional 500 foot test sections are required. If the Contractor fails to demonstrate this ability to the satisfaction of the Department, the Contractor shall construct the project using conventional surveying and staking methods.

Materials:

All equipment required to perform GPS machine control grading, including equipment needed by DelDOT to verify the work, shall be provided by the Contractor and shall be able to generate end results that are in accordance with the requirements of Division 200 - EARTHWORK of the Standard Specifications.

Construction:

a. DelDOT Responsibilities:

1. The Department will set initial vertical and horizontal control points in the field for the project as indicated in the contract documents, (plans set). If the Contractor needs to establish new control points they shall be traversed from existing control points and verified to be accurate by conventional surveying techniques.
2. The Department will provide the project specific localized coordinate system.
3. The Department will provide data in an electronic format to the Contractor as indicated in the General Notes.
 - a. The information provided shall not be considered a representation of actual conditions to be encountered during construction. Furnishing this information does not relieve the Contractor from the responsibility of making an investigation of conditions to be encountered including, but not limited to site visits, and basing the bid on information obtained from these investigations, and the professional interpretations and judgments of the Contractor. The Contractor shall assume the risk of error if the information is used for any purpose for which the information is not intended.
 - b. Any assumption the Contractor makes from this electronic information shall be at their risk. If the Contractor chooses to develop their own digital terrain model the Contractor shall be fully responsible for all cost, liability, accuracy and delays.
 - c. The Department will develop and provide electronic data to the Contractor for their use as part of the contract documents in a format as indicated in the General Notes. The Contractor shall independently ensure that the electronic data will function in their machine control grading system.

4. The Files that are provided were originally created with the computer software applications MicroStation (CADD software) and INROADS (civil engineering software). The data files will be provided in the native formats and other software formats described below. The contractor shall perform necessary conversion of the files for their selected grade control equipment. The Department will furnish the Contractor with the following electronic files:
 - a. CAD files
 - i. Inroads -Existing digital terrain model (.DTM)
 - ii. Inroads -Proposed digital terrain model (.DTM)
 - iii. Microstation -Proposed surface elements - triangles
 - b. Alignment Data Files:
 - i. ASCII Format
5. The Engineer shall perform spot checks of the Contractor's machine control grading results, surveying calculations, records, field procedures, and actual staking. If the Engineer determines that the work is not being performed in a manner that will assure accurate results, the Engineer may order the Contractor to redo such work to the requirements of the contract documents, and in addition, may require the Contractor to use conventional surveying and staking, both at no additional cost to the Department.

B. Contractor's Responsibilities

1. The Contractor shall provide the Engineer with a GPS rover and Automatic Level, for use during the duration of the contract. At the end of the contract, the GPS rover and Automatic Level will be returned to the Contractor. The Contractor shall provide a total of 8 hours of formal training on the Contractor's GPS machine control system to the Engineer and up to three additional Department appointees per rover.
2. The Contractor shall review and apply the data provided by the Department to perform GPS machine control grading.
3. The Contractor shall bear all costs, including but not limited to the cost of actual reconstruction of work, that may be incurred due to application of GPS machine control grading techniques. Grade elevation errors and associated corrections including quantity adjustments resulting from the contractor's use of GPS machine control shall be at no cost to the Department.
4. The Contractor shall convert the electronic data provided by the Department into a format compatible with their system.
5. The Contractor's manipulation of the electronic data provided by the Department shall be performed at their own risk.
6. The Contractor shall check and if necessary, recalibrate their GPS machine control system at the beginning of each workday in accordance with the manufacturer's recommendations, or more frequently as needed to meet the requirements of the project.
7. The Contractor shall meet the accuracy requirements as detailed in the Standard Specifications.
8. The Contractor shall establish secondary control points at appropriate intervals and at locations along the length of the project. These points shall be outside the project limits and/or where work is performed. These points shall be at intervals not to exceed 1000 feet. The horizontal position of these points shall be determined by conventional survey traverse and adjustments from the original baseline control points. The conventional traverse shall meet or exceed the Department's Standards. The elevation of these control points shall be established using differential leveling from the project benchmarks, forming a closed loop. A copy of all new control point information including closure report shall be provided and approved by the Engineer prior to construction activities. The Contractor shall be responsible for all errors resulting from their efforts and shall correct deficiencies to the satisfaction of the Engineer and at no additional cost to the Department.
9. The Contractor shall provide stakes at all alignment control points, at every 500 foot stationing, and where required for coordination activities involving environmental agencies and utility companies at the

Contractor's expense. Work that is done solely for utility companies and that is beyond the work performed under item 763501 - Construction shall follow and be paid for under item 763597 -Utility Construction Engineering.

10. The Contractor shall at a minimum set hubs at the top of finished grade at all hinge points on the cross section at 500 foot intervals on the main line and at least 4 cross sections on side roads and ramps as directed by the engineer or as shown on the plans. Placement of a minimum of 4 control points outside the limits of disturbance for the excavation of borrow pits, Stormwater Management Ponds, wetland mitigation sites etc. These control points shall be established using conventional survey methods for use by the Engineer to check the accuracy of the construction.
11. The Contractor shall preserve all reference points and monuments that are identified and established by the Engineer for the project. If the Contractor fails to preserve these items the Contractor shall reestablish them at no additional cost to the Department.
12. The Contractor shall provide control points and conventional grades stakes at critical points such as, but not limited to, PC's, PT's, superelevation points, and other critical points required for the construction of drainage and roadway structures.
13. No less than 2 weeks before the scheduled preconstruction meeting, the Contractor shall submit to the Engineer for review a written machine control grading work plan which shall include the equipment type, control software manufacturer and version, and proposed location of the local GPS base station used for broadcasting differential correction data to rover units.
14. The Contractor shall follow the guidelines set forth in the "Geometric Geodetic Accuracy Standards and Specifications for Using GPS Relative Positioning Techniques" and follow a minimum of Second Order Class 1, (2-I) classification standards.

Automated equipment operations have a high reliance on accurate control networks from which to take measurements, establish positions, and verify locations and features. Therefore, a strong contract control network in the field which is the same or is strongly integrated with the project control used during the design of the contract is essential to the successful use of this technology with the proposed Digital Terrain Model (DTM). Consistent and well designed site calibration for all machine control operations (as described below under *Contract Control Plan*) are required to ensure the quality of the contract deliverables. The Contract Control Plan is intended to document which horizontal and vertical control will be held for these operations. Continued incorporation of the Base Station(s) as identified in the Contract Control Plan is essential to maintaining the integrity of positional locations and elevations of features. The Contract Control Plan shall be submitted to the Department for review and approval by the Departments Survey Section 3 weeks prior to the start of any machine control work. The Contractor shall operate and maintain all elements of the Machine Grade Control continuously once the operations begin until otherwise approved by the Engineer.

Contract Control Plan:

The Contractor shall develop and submit a Contract Control Plan for all contracts which use Machine Control Grading. Contract control includes all primary and secondary horizontal and vertical control which will be used for the construction contract. Upon the Contractor's completion of the initial survey reconnaissance and control verification, but prior to beginning primary field operations, the Contractor shall submit a Contract Control Plan document (signed and sealed by the Delaware licensed Land Surveyor or Delaware Professional Engineer who oversees its preparation) for acceptance by the Engineer, which shall include the following:

1. A control network diagram of all existing horizontal and vertical control recovered in the field as contract control.
2. Include a summary of the calculated closures of the existing control network, and which control has been determined to have been disturbed or out of tolerance from its original positioning.
3. An explanation of which horizontal and vertical control points will be held for construction purposes. If necessary include all adjustments which may have been made to achieve required closures.

4. An explanation of what horizontal and vertical control (including base stations) was set to accomplish the required stakeout or automated machine operation. Include how the position of these new control points was determined.
5. Describe the proposed method and technique (technology and quality control) for utilizing the control to establish the existing and/or proposed feature location and to verify the completed feature location and/or measured quantity.
6. A listing of the horizontal and vertical datums to be used and the combined factor to be used to account for ellipsoidal reduction factor and grid scale factor.
7. If the Contractor chooses to use machine control as a method of measuring and controlling excavation, fill, material placement or grading operations as a method of measuring and controlling excavation, fill, material placement or grading operations, the Contractor Control Plan shall include the method by which the automated machine guidance system will initially be site calibrated to both the horizontal and vertical contract control, and shall describe the method and frequency of the calibration to ensure consistent positional results.
8. Issues with equipment including inconsistent satellite reception of signals to operate the GPS machine control system will not result in adjustment to the "Basis of Payment" for any construction items or be justification for granting contract time extension.

Method of Measurement:

The quantity of Construction Engineering will not be measured.

Basis of Payment:

Payment will be made at the Lump Sum price bid for the item "Construction Engineering". The price bid shall include the cost of furnishing all labor, equipment, instruments, stakes and other material necessary to satisfactorily complete the work as herein described under this item for all roads and structures that are a part of the contract. Adjustment in payment will be made for the deletion or addition of work not shown in the contract documents.

Monthly payment will be made under this item in proportion to the amount of work done as determined by the Engineer.

3/27/15

763502 - MAINTENANCE OF RAILROAD TRAFFIC (NS)
Norfolk Southern Railway Company

I. AUTHORITY OF RAILROAD ENGINEER AND STATE ENGINEER:

- a. The authorized representative of the Railroad Company, hereinafter referred to as “Railroad Engineer”, shall have final authority in all matters affecting the safe maintenance of Railroad traffic of their Company including the adequacy of the foundations and structures supporting the Railroad tracks.
- b. The authorized representative of the State, hereinafter referred to as the “Engineer”, shall have authority over all other matters as prescribed herein and in the Project Specifications.

II. DEFINITIONS:

- a. For the purpose of this Contract, the following terms, names, titles, and/or abbreviations refer to the following:
 - i. The terms Railroad and NS shall mean the Norfolk Southern Railway Company.
 - ii. The terms DelDOT, State, Department, Agency, Owner of Contract shall mean the Delaware Department of Transportation.

III. NOTICE OF STARTING WORK:

- a. The Contractor shall not commence any work on Railroad rights-of-way until they have complied with the following conditions:
 - i. Given the Railroad written notice, with copy to the Engineer who has been designated to be in charge of the work, at least ten days in advance of the date they propose to begin work on the Railroad’s rights-of-way.

Crossing Surfaces

Chief Engineer - D&C
Norfolk Southern Corp.
175 Spring Street, SW
Building Box 142
Atlanta, Georgia 0303

Warning Devices

Chief Engineer - S&C
Norfolk Southern Corp.
99 Spring Street, SW
Building Box 123
Atlanta, Georgia 30303

Bridges & Structures

Chief Engineer
Bridges and Structures
Norfolk Southern Corp.
99 Spring Street, SW
Atlanta, Georgia 30303

- ii. Obtained written authorization from the Railroad to begin work on Railroad rights-of-way, such authorization to include an outline of specific conditions with which he/she must comply.
 - iii. Obtained written approval from the Railroad of Railroad Protective Insurance Liability coverage as required by paragraph 14 herein.
 - iv. Furnished a schedule for all work within the Railroad rights-of-way as required by paragraph IX.b.i.
- b. The Railroad’s written authorization to proceed with the work shall include the names, addresses, and telephone numbers of the Railroad’s representatives who are to be notified as hereinafter

required. Where more than one representative is designated, the area of responsibility of each representative shall be specified.

IV. INTERFERENCE WITH RAILROAD OPERATIONS:

- a. The Contractor shall so arrange and conduct his/her work that there will be no interference with Railroad operations, including train, signal, telephone and telegraphic services, or damage to the property of the Railroad Company or to poles, wires, and other facilities of tenants on the rights-of-way of the Railroad Company. Whenever work is liable to affect the operations or safety of trains, the method of doing such work shall first be submitted to the Railroad Engineer for approval, but such approval shall not relieve the Contractor from liability. Any work to be performed by the Contractor which requires flagging service or inspection service shall be deferred by the Contractor until the flagging service or inspection service required by the Railroad is available at the job site.
- b. Whenever work within Railroad rights-of-way is of such a nature that impediment to Railroad operations such as use of runaround tracks or necessity for reduced speed is unavoidable, the Contractor shall schedule and conduct his/her operations so that such impediment is reduced to the absolute minimum.
- c. Should conditions arising from, or in connection with the work, require that immediate and unusual provisions be made to protect operations and property of the Railroad, the Contractor shall make such provisions. If in the judgment of the Railroad Engineer, or in their absence, the Engineer, such provision(s) are insufficient, either may require or provide such provisions as they deem necessary. In any event, such unusual provisions shall be at the Contractor's expense and without cost to the Railroad or the State.
- d. "One Call" services do not locate buried Railroad utilities. The contractor shall contact the Railroad's representative two (2) days in advance of work in those places where excavation, pile driving, or heavy loads may damage the Railroad's underground facilities. Upon request from the Contractor or Sponsor, Railroad forces will locate and paint mark or flag the Railroad's underground facilities. The Contractor shall avoid excavation or other disturbances of these facilities. If disturbance or excavation is required near a buried Railroad facility, the contractor shall coordinate with the Railroad to have the facility potholed manually with careful hand excavation. The facility shall be protected by the Contractor during the course of the disturbance under the supervision and direction of the Railroad's representative.

V. TRACK CLEARANCES:

- a. The minimum track clearances to be maintained by the Contractor during construction are shown on the Project Plans. If temporary clearances are not shown on the project plans, the following criteria shall govern the use of falsework and formwork above or adjacent to operated tracks.
 - i. A minimum vertical clearance of 22'-0" above top of highest rail shall be maintained at all times.
 - ii. A minimum horizontal clearance of 13'-0" from centerline of tangent track or 14'-0" from centerline of curved track shall be maintained at all times. Additional horizontal clearance may be required in special cases to be safe for operating conditions. This additional clearance will be determined by the Railroad Engineer.
 - iii. All proposed temporary clearances which are less than those listed above must be submitted to Railroad Engineer for approval prior to construction and must also be authorized by the regulatory body of the State if less than the legally prescribed clearances.
 - iv. The temporary clearance requirements noted above shall also apply to all other physical obstructions including, but not limited to: stockpiled materials, parked equipment, placement or driving of piles, and bracing or other construction supports.

Before undertaking any work within Railroad right-of-way, or before placing any obstruction over any track, the Contractor shall:

- i. Notify the Railroad's representative at least 72 hours in advance of the work.

- ii. Receive assurance from the Railroad's representative that arrangements have been made for flagging service as may be necessary.
- iii. Receive permission from the Railroad's representative to proceed with the work.
- iv. Ascertain that the Engineer has received copies of notice to the Railroad and of the Railroad's response thereto.

VI. CONSTRUCTION PROCEDURES:

a. General:

Construction work and operations by the Contractor on Railroad property shall be:

- i. Subject to the inspection and approval of the Railroad.
- ii. In accord with the Railroad's written outline of specific conditions.
- iii. In accord with the Railroad's general rules, regulations and requirements including those relating to safety, fall protection and personal protective equipment.
- iv. In accord with these Special Provisions.

b. Submittal Requirements:

- i. The Contractor shall submit all construction related correspondence and submittals electronically to the Railroad Engineer.
- ii. The Contractor shall allow for 30 days for the Railroad's review and response.
- iii. All work in the vicinity of the Railroad's property that has the potential to affect the Railroad's train operations or disturb the Railroad's Property must be submitted and approved by the Railroad prior to work being performed.
- iv. All submittals and calculations must be signed and sealed by a registered engineer licensed in the state of the project work.
- v. All submittals shall first be approved by the Sponsor's Engineer and the Railroad Engineer, but such approval shall not relieve the Contractor from liability.
- vi. For all construction projects, the following submittals, but not limited to those listed below, shall be provided for review and approval when applicable:
 - 1. General Means and Methods
 - 2. Ballast Protection
 - 3. Construction Excavation & Shoring
 - 4. Pipe, Culvert, & Tunnel Installations
 - 5. Demolition Procedure
 - 6. Erection & Hoisting Procedure
 - 7. Debris Shielding or Containment
 - 8. Blasting
 - 9. Formwork for the bridge deck, diaphragms, overhang brackets, and protective platforms
 - 10. Bent Cap Falsework. A lift plan will be required if the contractor wants to move the falsework over the tracks.

- vii. The Contractor shall include in all submissions a detailed narrative indicating the progression of work with the anticipated timeframe to complete each task. Work will not be permitted to commence until the Contractor has provided the Railroad with a satisfactory plan that the project will be undertaken without scheduling, performance or safety related issues. Submission shall also provide a listing of the anticipated equipment to be used, the location of all equipment

to be used and insure a contingency plan of action is in place should a primary piece of equipment malfunction.

- c. Ballast Protection
 - i. The Contractor shall submit the proposed ballast protection system detailing the specific filter fabric and anchorage system to be used during all construction activities.
 - ii. The ballast protection is to extend 25' beyond the proposed limit of work, be installed at the start of the project and be continuously maintained to prevent all contaminants from entering the ballast section of all tracks for the entire duration of the project.
- d. Excavation:
 - i. The subgrade of an operated track shall be maintained with edge of berm at least 10'-0" (3.05 m) from centerline of track and not more than 24 (600 mm) below top of rail. Contractor will not be required to make existing section meet this specification if substandard, in which case existing section will be maintained.
- e. Excavation for Structures:
 - i. The Contractor will be required to take special precaution and care in connection with excavating and shoring pits, and in driving piles or sheeting for footings adjacent to tracks to provide adequate lateral support for the tracks and the loads which they carry, without disturbance of track alignment and surface, and to avoid obstructing track clearances with working equipment, tools or other material. The procedure for doing such work, including need of and plans for shoring, shall first be approved by the Engineer and the Railroad Engineer, but such approval shall not relieve the Contractor from liability.

VII. ERECTION & HOISTING PROCEDURES:

- a. General
 - i. Erection plans are required for all spans over the track(s), for all spans adjacent to the track(s), if located on (or partially on) Railroad right-of-way; and in all situations where cranes will be situated on, over, or adjacent to Railroad right-of-way and within a distance of the boom length plus 15'-0" from the centerline of the track.
 - ii. Railroad tracks and other Railroad property must be protected from damage during the erection procedure.
 - iii. A pre-erection meeting shall be conducted with the Sponsor, the Railroad Engineer or their representative, and the key Contractor's personnel prior to the start of the erection procedure.
 - iv. The Railroad Engineer or his designated representative must be present at the site during the entire erection procedure period.
 - v. For field spliced located over Railroad property, a minimum of 50% of the holes for each connection shall be filed with bolts or pins prior to releasing the crane. A minimum of 50% of the holes filled shall be filled with bolts. All bolts must be appropriately tightened. Any changes to previously approved field splice locations must be submitted to the Railroad for review and approval. Refer to Norfolk Southern's Overhead Grade Separation Design Criteria for additional splice details (Norfolk Southern Public Projects Manual Appendix H.1, Section 4.A.3.).
- b. Submittal Requirements
 - i. The Contractor shall submit the following for approval by the Railroad Engineer:
 - 1. As-built beam seat elevations - All as-built bridge seats and top of rail elevations shall be furnished to the Railroad Engineer for review and verification at least 30 days in

advance of the erection, to ensure that minimum vertical clearances as approved in the plans will be achieved.

2. A plan showing the location of cranes, horizontally and vertically, operating radii, with delivery or staging locations shown. The location of all tracks and other Railroad facilities as well as all obstructions such as wire lines, poles, adjacent structures, etc. must also be shown.
 3. Rating sheets showing cranes or lifting devices to be adequate for 150% of the actual weight of the pick, including all rigging components. A complete set of crane charts, including crane counterweight, and boom nomenclature is to be submitted. Safety factors that may have been "built-in" to the crane charts are not to be considered when determining the 150% factor of safety.
 4. Plans and computations showing the weight of the pick must be submitted. Calculations shall be made from plans of the proposed structure showing complete sufficient details with supporting data for the erection of the structure. If plans do not exist, lifting weights must be calculated from field measurements. The field measurements are to be made under the supervision of the Registered Professional Engineer submitting the procedure and calculations.
 5. The Contractor shall provide a sketch of all rigging components from the crane's hook block to the beam. Catalog cuts or information sheets of all rigging components with their lifting capacities shall be provided. All rigging must be adequate for 150% of the actual weight of the pick. Safety factors that may have been "built-in" to the rating charts are not to be considered when determining the 150% factor of safety. All rigging components shall be clearly identified and tagged with their rated lifting capacities. The position of the rigging in the field shall not differ from what is shown on the final plan without prior review from the Sponsor and the Railroad.
 6. A complete erection procedure, including the order of lifts, time required for each lift, and any repositioning or re-hitching of the crane or cranes.
 7. Design and supporting calculations for the temporary support of components, including but not limited to temporary girder tie-downs and falsework.
- c. Blasting:

The Contractor shall obtain advance approval of the Railroad Engineer and the Engineer for use of explosives on or adjacent to Railroad property. The request for permission to use explosives shall include a detailed blasting plan. If permission for use of explosives is granted, the Contractor will be required to comply with the following:

- i. Blasting shall be done with light charges under the direct supervision of a responsible officer or employee of the Contractor and a licensed blaster.
- ii. Electric detonating fuses shall not be used because of the possibility of premature explosions resulting from operation of two-way radios.
- iii. No blasting shall be done without the presence of an authorized representative of the Railroad. At least 72 hours advance notice to the person designated in the Railroad's notice of authorization to proceed (see Section II. Notice of Starting Work) will be required to arrange for the presence of an authorized Railroad representative and such flagging as the Railroad may require.
- iv. Have at the job site adequate equipment, labor and materials and allow sufficient time to clean up debris resulting from the blasting without delay to trains, as well as correcting at his/her expense any track misalignment or other damage to Railroad property resulting from the blasting as directed by the Railway's authorized representative. If his/her actions result in delay of trains, the Contractor shall bear the entire cost thereof.

- d. The Railroad representative will:
 - i. Determine approximate location of trains and advise the Contractor the appropriate amount of time available for the blasting operation and clean-up.
 - ii. Have the authority to order discontinuance of blasting if, in his/her opinion, blasting is too hazardous or is not in accord with these Special Provisions.
- e. Track Monitoring
 - i. At the direction of Railroad Engineer, any activity that has the potential to disturb Railroad track structure may require the Contractor to submit a detailed track monitoring program for approval by the Railroad Engineer.
 - ii. The program shall specify the survey locations, the distance between the location points, and frequency of monitoring before, during and after construction. Railroad reserves the right to modify the survey locations and monitoring frequency as necessary during the project.
 - iii. The survey data shall be collected in accordance with the approved frequency immediately furnished to the Railroad Engineer for analysis.
 - iv. If any movement has occurred as determined by the Railroad Engineer, the Railroad will be immediately notified. Railroad, as its sole discretion, shall have the right to immediately require all Contractor operations to be ceased and determine what corrective action is required. Any corrective action required by the Railroad or performed by the Railroad including the monitoring of corrective action of the Contractor will be at project expense.
- f. Maintenance of Railroad Facilities:
 - i. The Contractor will be required to maintain all ditches and drainage structures free of silt or other obstructions which may result from his/her operations and provide and maintain any erosion control measures as required. The Contractor will promptly repair eroded areas within Railroad rights-of-way and repair any other damage to the property of the Railroad or its tenants.
 - ii. If, in the course of construction, it may be necessary to block a ditch, pipe or other drainage facility, temporary pipes, ditches or other drainage facilities shall be installed to maintain adequate drainage, as approved by the Road Engineer. Upon completion of the work, the temporary facilities shall be removed and the permanent facilities restored.
 - iii. All such maintenance and repair of damages due to the Contractor's operations shall be done at the Contractor's expense.
- g. Storage of Materials and Equipment:
 - i. Materials and equipment shall not be stored within 25 (7.6 m) of the centerline of Railroad's track or where they will interfere with Railroad operations, nor on the rights-of-way of the Railroad Company without first having obtained permission from the Railroad Engineer, and such permission will be with the understanding that the Railroad Company will not be liable for damage to such material and equipment from any cause and that the Railroad Engineer may move or require the Contractor to move, at the Contractor's expense, such material and equipment.
 - ii. All grading or construction machinery that is left parked near the track unattended by a watchman shall be effectively immobilized so that it cannot be moved by unauthorized persons. The Contractor shall protect, defend, indemnify and save Railroad, and any associated, controlled or affiliated corporation, harmless from and against all losses, costs, expenses, claim or liability for loss or damage to property or the loss of life or personal injury, arising out of or incident to the Contractor's failure to immobilize grading or construction machinery.
- h. Cleanup:

- i. Upon completion of the work, the Contractor shall remove from within the limits of the Railroad rights-of-way, all machinery, equipment, surplus materials, falsework, rubbish or temporary buildings of the Contractor, and leave said rights-of-way in a neat condition satisfactory to the Chief Engineer of the Railroad or his/her authorized representative.

VII. DAMAGES:

- a. The Contractor shall assume all liability for any and all damages to his/her work, employees, servants, equipment and materials caused by Railroad traffic.
- b. Any cost incurred by the Railroad for repairing damages to its property or to property of its tenants, caused by or resulting from the operations of the Contractor, shall be paid directly to the Railroad by the Contractor.

VIII. FLAGGING SERVICES:

- a. When Required:
 - i. Flagging will not be provided until the Contractor's insurance has been reviewed & approved by the Railroad.
 - ii. Under the terms of the agreement between the State and the Railroad, the Railroad has sole authority to determine the need for flagging required to protect its operations. In general, the requirements of such services will be whenever the Contractor's personnel or equipment are or are likely to be, working on the Railroad's right-of-way, or across, over, adjacent to, or under a track, or when such work has disturbed or is likely to disturb a Railroad structure or the Railroad roadbed or surface and alignment of any track to such extent that the movement of trains must be controlled by flagging.
 - iii. Normally, the Railroad will assign one flagman to a project; but in some cases, more than one may be necessary, such as yard limits where three (3) flagmen may be required. However, if the Contractor works within distances that violate instructions given by the Railroad's authorized representative or performs work that has not been scheduled with the Railroad's authorized representative, a flagman or flagmen may be required full time until the project has been completed.
 - iv. For Projects exceeding 30 days of construction, Contractor shall provide the flagmen a small work area with a desk/computer and chair within the field/site trailer, including the use of bathroom facilities, where the flagman can check in/out with the Project, as well as to the flagman's home terminal. The work area should provide access to two (2) electrical outlets for recharging radio(s), and a laptop computer; and have the ability to print off needed documentation and orders as needed at the field/site trailer. This should aid in maximizing the flagman's time and efficiency on the Project.
- b. Scheduling and Notification:
 - i. The Contractor's work requiring Railroad flagging should be scheduled to the limit the presence of a flagman at the site to a maximum of 50 hours per week. The Contractor shall receive Railroad approval of work schedules requiring a flagman's presence in excess of 40 hours per week.
 - ii. Not later than the time that approval is initially requested to begin work on Railroad right-of-way, Contractor shall furnish to the Railroad and the State a schedule for all work required to complete the portion of the project within Railroad right-of-way and arrange for a job site meeting between the Contractor, the State, and the Railroad's authorized representative. This schedule may be submitted in the format of a bar graft chart. Flagman or flagmen may not be provided until the job site meeting has been conducted and the Contractor's work scheduled.
 - iii. The Contractor will be required to give the Railroad representative at least 10 working days of advance written notice of intent to begin work within Railroad right-of-way in accordance with this special provision. Once begun, when such work is then suspended at any time, or for any

reason, the Contractor will be required to give the Railroad representative at least 3 working days of advance notice before resuming work on Railroad right-of-way. Such notices shall include sufficient details of the proposed work to enable the Railroad representative to determine if flagging will be required. If such notice is in writing, the Contractor shall furnish the Engineer a copy; if notice is given verbally, it shall be confirmed in writing with copy to the Engineer. If flagging is required, no work shall be undertaken until the flagman, or flagmen is present at the job site. It may take up to 30 days to obtain flagging initially from the Railroad. When flagging begins, the flagman is usually assigned by the Railroad to work at the project site on a continual basis until no longer needed and cannot be called for on a spot basis. If flagging becomes unnecessary and is suspended, it may take up to 30 days to again obtain from the Railroad. Due to Railroad labor agreements, it is necessary to give 5 working days' notice before flagging service may be discontinued and responsibility for payment stopped.

- iv. If, after the flagman is assigned to the project site, an emergency arises that requires the flagman's presence elsewhere, then the Contractor shall delay work on Railroad right-of-way until such time as the flagman is again available. Any additional costs resulting from such delay shall be borne by the Contractor and not the State or Railroad.
- c. Payment:
- i. The State will be responsible for paying the Railroad directly for any and all costs of flagging which may be required to accomplish the construction.
 - ii. The charge to the State by the Railroad will be the actual cost based on the rate of pay for the Railroad's employees who are available for flagging service at the time the service is required.
 - iii. Work by a flagman in excess of 8 hours per day or 40 hours per week, but not more than 12 hours a day will result in overtime pay at 1 and 1/2 times the appropriate rate. Work by a flagman in excess of 12 hours per day will result in overtime at 2 times the appropriate rate. If work is performed on a holiday, the flagging rate is 2 and 1/2 times the normal rate.
 - iv. Railroad work involved in preparing and handling bills will also be charged to the State. Charges to the State by the Railroad shall be in accordance with applicable provisions of Subchapter B, Part 140, Subpart I and Subchapter G, Part 646, Subpart B of the Federal-Aid Policy Guide issued by the Federal Highway Administration on December 9, 1991, including all current amendments. Flagging costs are subject to change.
- d. Verification:
- i. Railroad's flagman will electronically enter flagging time via Railroad's electronic billing system. Any complaints concerning flagging must be resolved in a timely manner. If the need for flagging is questioned, please contact the Railroad Engineer. All verbal complaints will be confirmed in writing by the Contractor within 5 working days with a copy to the Sponsor's Engineer. Address all written correspondence electronically to Railroad Engineer.
 - ii. The Contractor and State will review and sign the Railroad flagman's time sheet (Form 11123), attesting that the flagman was present during the time recorded. Flagmen may be removed by the Railroad if form is not signed. If flagman is removed, the Contractor will not be allowed to re-enter the Railroad right-of-way until the issue is resolved. Any complaints concerning flagman or flagmen must be resolved in a timely manner. If need for flagman or flagmen is questioned, please contact Railroad's Engineer, Grade Separation Structures (404)529-1641. All verbal complaints will be confirmed in writing by the Contractor within 5 working days with a copy to the Engineer. Address all written correspondence to:

CROSSING SURFACES

Norfolk Southern Corp.
Office of Chief Engineer
Bridges & Structures
Attn: T. D. Wyatt
Engineer Grade Separation
99 Spring Street, SW
Atlanta, Georgia 30303

- ii. The Railroad flagman assigned to the project will be responsible for notifying the Project Engineer upon arrival at the job site on the first day (or as soon thereafter as possible) that flagging services begin and on the last day that he/she performs such services for each separate period that services are provided. The Project Engineer will document such notification in the project records. When requested, the Project Engineer will also sign the flagman's diary showing daily time spent and activity at the project site.

IX. HAUL ACROSS RAILROAD:

- a. Where the Plans show or imply that materials of any nature must be hauled across a Railroad, unless the Plans clearly show that the State has included arrangements for such haul in its agreement with the Railroad, the Contractor will be required to make all necessary arrangements with the Railroad regarding means of transporting such materials across the Railroad. The Contractor will be required to bear all costs incidental to such crossings whether services are performed by his/her own forces or by Railroad personnel.
- b. No crossing may be established for use of the Contractor for transporting materials or equipment across the tracks of the Railroad Company unless specific authority for its installation, maintenance, necessary watching and flagging thereof and removal, until a private crossing agreement has been executed between the Contractor and Railroad.

X. WORK FOR THE BENEFIT OF THE CONTRACTOR:

- a. All temporary or permanent changes in wire lines or other facilities which are considered necessary to the project are shown on the Plans; included in the force account agreement between the State and the Railroad or will be covered by appropriate revisions to same which will be initiated and approved by the State and/or the Railroad.
- b. Should the Contractor desire any changes in addition to the above, then he/she shall make separate arrangements with the Railroad for same to be accomplished at the Contractor's expense.

XI. COOPERATION AND DELAYS:

- a. It shall be the Contractor's responsibility to arrange a schedule with the Railroad for accomplishing stage construction involving work by the Railroad or tenants of the Railroad. In arranging his/her schedule he/she shall ascertain, from the Railroad, the lead time required for assembling crews and materials and shall make due allowance therefore.
- b. No charge or claim of the Contractor against either the State or the Railroad will be allowed for hindrance or delay on account of railway traffic; any work done by the Railroad or other delay incident to or necessary for safe maintenance of railway traffic or for any delays due to compliance with these special provisions.

XII. TRAINMAN'S WALKWAYS:

- a. Along the outer side of each exterior track of multiple operated track, and on each side of single operated track, an unobstructed continuous space suitable for trainman's use in walking along trains, extending to a line not less than 10' (3.05 m) from centerline of track, shall be maintained. Any temporary impediments to walkways and track drainage encroachments or obstructions allowed during work hours while Railroad's protective service is provided shall be removed before the close of each work day. If there is any excavation near the walkway, a handrail, with 10' - 0" (3.05 m) minimum clearance from centerline of track, shall be placed.

XIII. GUIDELINES FOR PERSONNEL ON RAILROAD RIGHT-OF-WAY:

- a. The Contractor and/or the Sponsor's personnel authorized to perform work on Railroad's property as specified above are not required to complete Norfolk Southern Roadway Worker Protection Training; However, the Contractor and the Sponsor's personnel must be familiar with Norfolk Southern's standard operating rules and guidelines, should conduct themselves accordingly, and may be removed from the property for failure to follow these guidelines.

- b. All persons shall wear hard hats. Appropriate eye and hearing protection must be used. Working in shorts is prohibited. Shirts must cover shoulders, back and abdomen. Working in tennis or jogging shoes, sandals, boots with high heels, cowboy and other slip-on type boots is prohibited. Hard-sole, lace-up footwear, zippered boots or boots cinched up with straps which fit snugly about the ankle are adequate. Safety boots are strongly recommended.
- c. No one is allowed within 25' (7.6 m) of the centerline of track without specific authorization from the flagman.
- d. All persons working near track while train is passing are to lookout for dragging bands, chains and protruding or shifted cargo.
- e. No one is allowed to cross tracks without specific authorization from the flagman.
- f. All welders and cutting torches working within 25' (7.6 m) of track must stop when train is passing.
- g. No steel tape or chain will be allowed to cross or touch rails without permission.

XIV. GUIDELINES EQUIPMENT ON RAILROAD RIGHT-OF-WAY:

- a. No crane or boom equipment will be allowed to set up to work or park within boom distance plus 15' (4.6 m) of centerline of track without specific permission from Railroad official and flagman.
- b. No crane or boom equipment will be allowed to foul track or lift a load over the track without flag protection and track time.
- c. All employees will stay with their machines when crane or boom equipment is pointed toward track.
- d. All cranes and boom equipment under load will stop work while train is passing (including pile driving).
- e. Swinging loads must be secured to prevent movement while train is passing.
- f. No loads will be suspended above a moving train.
- g. No equipment will be allowed within 25' (7.6 m) of centerline of track without specific authorization of the flagman.
- h. Trucks, tractors or any equipment will not touch ballast line without specific permission from railroad official and flagman.
- i. No equipment or load movement within 25' (7.6 m) or above a standing train or railroad equipment without specific authorization of the flagman.
- j. All operating equipment within 25' (7.6 m) of track must halt operations when a train is passing. All other operating equipment may be halted by the flagman if the flagman views the operation to be dangerous to the passing train.
- k. All equipment, loads and cables are prohibited from touching rails.
- l. While clearing and grubbing, no vegetation will be removed from Railroad embankment with heavy equipment without specific permission from the Railroad Engineer and flagman.
- m. No equipment or materials will be parked or stored on Railroad's property unless specific authorization is granted from the Railroad Engineer.
- n. All unattended equipment that is left parked on Railroad property shall be effectively immobilized so that it cannot be moved by unauthorized persons.

- o. All cranes and boom equipment will be turned away from track after each work day or whenever unattended by an operator.
- p. Prior to performing any crane operations, the Contractor shall establish a single point of contact for the Railroad flagman to remain in communication with at all times. Person must also be in direct contact with the individual(s) directing the crane operation(s).

XV. INSURANCE:

- a. In addition to any other forms of insurance or bonds required under the terms of the contract and specifications, the Prime Contractor will be required to carry insurance of the following kinds and amounts:
 - i. Commercial General Liability Insurance having a combined single limit of not less than **\$2,000,000** per occurrence for all loss, damage, cost and expense, including attorneys' fees, arising out of bodily injury liability and property damage liability during the policy period. Said policy shall include explosion, collapse, and underground hazard (XCU) coverage, shall be endorsed to name Railroad specified in item XV.a.iii.3, below, both as the certificate holder and as an additional insured, and shall include a severability of interests provision.
 - ii. Automobile Liability Insurance with a combined single limit of not less than \$1,000,000 each occurrence for injury to or death of persons and damage to or loss or destruction of property. Said policy or policies shall be endorsed to name Railroad Specified in item XV.a.iii.3, below, both as the certificate holder and as an additional insured, and shall include a severability of interests provision.
 - iii. Railroad Protective Liability Insurance having a combined single limit of not less than **\$2,000,000** each occurrence and **\$6,000,000** in the aggregate applying separately to each annual period. If the project involves track over which passenger trains operate, the insurance limits required are not less than a combined single limit of **\$5,000,000** each occurrence and **\$10,000,000** in the aggregate applying separately to each annual period. Said policy shall provide coverage for all loss, damage or expense arising from bodily injury and property damage liability, and physical damage to property attributed to acts or omissions at the job site.
 - iv. The standards for the Railroad Protective Liability Insurance are as follows:
 - 1. The insurer must be rated A- or better by A.M. Best Company, Inc.

Note: NS does not accept from insurers Chartts (AIG or Affiliated Company Including Lexington Insurance Company), Hudson Group or ACE or Affiliated Company.

- 2. The policy must be written using one of the following combinations of Insurance Services Office ("ISO") Railroad Protective Liability Insurance Form Numbers:
 - A. CG 00 35 01 96 and CG 28 3110 93; or
 - B. CG 00 35 07 98 and CG 28 31 07 98; or
 - C. CG 00 35 10 01; or
 - D. CG 00 35 12 04; or
 - E. CG 00 35 12 07; or
 - F. CG 00 35 04 13.

- 3. The named insured shall read:

Norfolk Southern Railway Company
Three Commercial Place
Norfolk, Virginia 23510-2191
Attn: S. W. Dickerson Risk Management

Note: NS does not share coverage on Railroad Protective Liability Insurance with any other entity on this policy.

4. The description of operations must appear on the Declarations, must match the project description in this agreement, and must include the appropriate Sponsor project and contract identification numbers.
5. The job location must appear on the Declarations and must include the city, state, and appropriate highway name/number, and NS file number for the project number.

Note: Do not include any references to milepost, valuation station, or mile marker on the Insurance policy.

6. The name and address of the prime Contractor must appear on the Declarations.
7. The name and address of the Sponsor must be identified on the Declarations as the "Involved Governmental Authority or Other Contracting Party."
8. Other endorsements/forms that will be accepted are:
 - A. Broad Form Nuclear Exclusion - Form IL 00 21
 - B. 30-day Advance Notice of Non-renewal or cancellation
 - C. Required State Cancellation Endorsement
 - D. Quick Reference or Index Form CL/IL 240
9. Endorsements/forms that are **NOT** acceptable are:
 - A. Any Pollution Exclusion Endorsement except CG 28 31
 - B. Any Punitive or Exemplary Damages Exclusion
 - C. Known injury or Damage Exclusion form CG 00 59
 - D. Any Common Policy Conditions form
 - E. Any other endorsement/form not specifically authorized in item XV.a.iii.8 above.
- b. If any part of the work is sublet, similar insurance, and evidence thereof as specified in XV.a above, shall be provided by or on behalf of the subcontractor to cover its operations on Railroad's right of way.
- c. All insurance required under the preceding subsection "a" shall be underwritten by insurers and be of such form and content, as may be acceptable to the Company. Prior to entry on Railroad right-of-way, the original Railroad Protective Liability Insurance Policy shall be submitted by the Sponsor's Prime Contractor to the Sponsor at the address below for its review and then transmitted to the Railroad. In addition, certificates of insurance evidencing the Sponsor's Prime Contractor's and any subcontractors' Commercial General Liability Insurance shall be issued to the Railroad and the Sponsor at the addresses below, and forwarded to the Sponsor for its review and transmittal to the Railroad. The certificates of insurance shall state that the insurance coverage will not be suspended, voided, canceled, or reduced in coverage or limits without (30) days advance written notice to Railroad and the Sponsor. No work will be permitted by Railroad on its right-of-way until it has reviewed and approved in writing the evidence of insurance required herein.

-For the Sponsor:

Construction Engineer for the DeIDOT District Administrating the Project

-For the Railroad:

Risk Management
Norfolk Southern Railway Company
Three Commercial Place
Norfolk, Virginia 23510-2191

- d. The insurance required herein shall in no way serve to limit the liability of Sponsor or its Contractors under the terms of this agreement.

e. Insurance Submission Procedures

- i. Railroad will only accept initial insurance submissions via US Mail or Overnight carrier to the address noted in XV.c above. Railroad will NOT accept initial insurance submissions via email or faxes. **Please provided point of contact information with the submission including a phone number and e-mail address.**
- ii. Railroad requires the following two (2) forms of insurance in the initial insurance submission to be submitted under a cover letter providing details of the project and contact information:
 1. The full original or certified true countersigned copy of the railroad protective liability insurance policy in its entirety inclusive of all declarations, schedule of forms and endorsements along with the policy forms and endorsements .
 2. The Contractor's commercial general, automobile, and workers' compensation liability insurance certificate of liability insurance evidencing a combined single limit of a minimum of \$2M per occurrence of general and \$1M per occurrence of automobile liability insurance naming Norfolk Southern Railway Company, Three Commercial Place, Norfolk, VA 23510 as the certificate holder and as an additional insured on both the general and automobile liability insurance policy.
 - A. The full original or certified true countersigned copy of the railroad protective liability insurance policy in its entirety inclusive of all declarations, schedule of forms and endorsements along with the policy forms and endorsements.
 - B. The Contractor's commercial general, automobile, and workers' compensation liability insurance certificate of liability insurance evidencing a combined single limit of a minimum of \$2,000,000 per occurrence of general and \$1,000,000 per occurrence of automobile liability insurance naming Norfolk Southern Railway Company, Three Commercial Place, Norfolk, VA 23510 as the certificate holder and as an additional insured on both the general and automobile liability insurance policy.
 3. It should be noted that the Railroad does not accept notation of Railroad Protective insurance on a certificate of liability insurance form or Binders as Railroad must have the full original countersigned policy. Further, please note that mere receipt of the policy is not the only issue but review for compliance. Due to the number of projects system-wide, it typically takes a minimum of 30-45 days for the Railroad to review.

NOTE: The above information listed within Section XVI: Insurance, found above, is based on the most recent information obtained from the Railroad as of the date this Special Provision was written. The Contractor and all their Subcontractors, required to have this type of insurance, are directed to contact the Railroad's Risk Management Section (address found above) in order to meet any insurance revisions or additions required by the Railroad at the time of their bid.

XVI. FAILURE TO COMPLY:

- a. In the event the Contractor violates or fails to comply with any of the requirements of these Special Provisions:
 - i. The Railroad Engineer may require that the Contractor vacate Railroad property.
 - ii. The Engineer may withhold all monies due the Contractor on monthly statements.
- b. Any such orders shall remain in effect until the Contractor has remedied the situation to the satisfaction of the Railroad Engineer and the Engineer.

XVII. PAYMENT FOR COST OF COMPLIANCE:

- a. The payment for the item shall be made for at the Contract unit price per Lump Sum bid for "Maintenance of Railroad Traffic (NS)", which price and payment shall constitute full compensation for maintaining Railroad traffic during the life of the project; submission of drawings

and procedures to the Railroad; for all incidental costs imposed by the Railroad on the Contractor in accordance with the terms and conditions set in these Specifications; meeting all insurance requirements as described herein; for any cost incidental to or arising from the need to meet any or all requirements outlined, herein; for all materials, labor, tools, equipment, and incidentals necessary to complete the work.

- b. Payment for the Railroad Protective Liability Insurance requirements and all other required Insurance not normally held in force by the contractor shall be made under this Item. All other Insurances (such as, but not limited to, auto, etc.) required for this Contract shall be considered incidental to the Contract.

XVIII. PROJECT INFORMATION:

- a. The following information shall be shown on all correspondence with the Railroad:
 - i. Date: _____
 - ii. NS File No.: _____
 - iii. NS Milepost: _____
 - iv. Sponsor's Project No.: _____

NOTE:

- 1. As stated above in this specification, the DelDOT will pay the Railroad directly for protective services required for this project. Should deviation from the sequence of construction plan by the Contractor result in additional costs for protective services than the method and sequence of construction originally shown in the Plans, then that additional cost shall be deducted from monies due the Contractor unless prior permission was obtained from DelDOT to revise the original method.
- 2. The Contractor's attention is drawn to Section VII.a.ii. that reads, in part:

"However, if the Contractor works within distances that violate instructions given by the Railroad's authorized representative or performs work that has not been scheduled with the Railroad's authorized representative, a flagman or flagmen may be required full time until the project has been completed."
- 3. If such "full time" flagging requirements are imposed by the Railroad because of the Contractor's negligence or willful disregard of Railroad requirements, the Contractor will be held responsible for extra cost involved. Time charges for flagging services provided, but not needed for legitimate pursuit of construction will be recorded and charges for such flagging time will be deducted from monies due the Contractor.

6/20/16

907510 - COMPOST FILTER LOG

Description:

This item shall consist of furnishing all materials and constructing a compost filter log in accordance with the locations and notes on the Plans and/or as directed by the Engineer.

Materials:

The filter sock shall be 5 millimeter biodegradable HDPE material, and be at least 18” in diameter. The compost media used within the logs shall be a plant derived compost that complies with compost material standards and DNREC specifications (see table below), including being produced from a certified facility through the U.S. Composting Seal of Testing Assurance (STA) program.

Parameter	Range	Testing Method
Particle Size	For Amendments: 100% pass through a 1/2” screen For Compost Logs: 99% pass through a 2” screen; max. 40% pass through a 3/8” screen	TMECC 2.02-B
pH	6.0-8.0	TMECC 4.11
Manufactured Inert Material	<1% dry weight basis	TMECC 3.08-A
Organic Matter	35-95% dry weight basis	TMECC 5.07-A
Soluble Salt Concentratio	<= 6.0 mmhos/cm	TMECC 4.10-A
Carbon to Nitrogen Ratio	<= 25:1	
Stability (Carbon Dioxide evolution rate)	<= 2 C / unit VS / day	TMECC 5.08-B
Maturity (seed emergence and seedling vigor)	>90% relative to positive control	TMECC 5.05-A
Trace Metals	“Pass”	
Dry Bulk Density	12.5-25 lb/cu.ft.	
Moisture content	40-50%	

Construction Methods:

The compost filter logs shall be assembled by tying a knot in one end of the filter sock, filling the sock with the composted material, then knotting the other end once the desired length is reached. The compost shall be uniform throughout the sock and shall not have any gaps or the presence of large materials that would impede flow and/or create gaps. The compost filter log may be supplied pre-filled and simply rolled out in place.

The ends of the compost filter log should be angled upslope to prevent runoff from washing around the ends; minimum one foot (1') elevation difference. Stakes shall be installed through the middle of the compost filter log, maximum four feet (4') on center. The stakes shall be hardwood stakes, minimum 2" x 2" and 36" long. The stakes shall be set a minimum 12" below grade.

The compost filter logs shall be inspected weekly and after storm events. Accumulated sediment shall be removed when it reaches half of the effective height of the sock, and disposed of in an appropriate manner. If the sock fabric is torn or damaged prior to completion of the project, the compost filter log shall be replaced at the expense of the contractor. If the compost filter log has been flattened due to equipment or vehicular traffic, it shall be re-shaped back to proper dimensions. If the effective height cannot be restored, then the compost filter log shall be replaced at the expense of the contractor.

Upon completion of construction and stabilization of disturbed areas, the contractor shall remove the compost filter log in its entirety.

Method of Measurement:

The quantity of compost filter logs, completed in place and accepted, shall be paid for at the Contract bid per linear foot for "Compost Filter Logs"

Basis of Payment:

Price and payment shall constitute full compensation for furnishing all materials including filter socks, compost material, wooden stakes, disposal of surplus and unsuitable materials, removal and disposal of used filter sock and sediment during and upon completion of construction and for all labor, tools, equipment and incidentals necessary to complete the item.

6/8/15



STATE OF DELAWARE
DEPARTMENT OF TRANSPORTATION
800 BAY ROAD
P.O. BOX 778
DOVER, DELAWARE 19903

JENNIFER COHAN
SECRETARY

UTILITY STATEMENT

March 22, 2017

**State Contract No. T201200108 – HEP NCC, SR 72
and Old Baltimore Pike Intersection Improvements
F.A.P. No. ESTP-N026(09)
Project I.D. No -12-00356
New Castle County, Delaware**

The following utility companies may own and/or maintain facilities within the project limits:

**Suez Water Delaware (United Water Company)
City of Newark Water
Delmarva Power – Electric Distribution
Delmarva Power – Gas
Verizon Delaware, LLC - Communications
New Castle County – Sewer
Comcast Cable Communications
Peg Bandwidth
AT&T
Cavalier Mid Atlantic, LLC**

The following is a breakdown of the Utilities involved, adjustments and/or relocations as required:

Suez Water Delaware (United Water Company):

The Company maintains a water main along the eastern side of SR72 from the southern project limits to approximate Sta 111+40 where it crosses over to the west side of the roadway. The main then crosses Old Baltimore Pike near Sta 6+60 where it continues along the western side of SR72 to the northern project limits. At Sta 111+40 the other line angles east to run along the southern side of Old Baltimore Pike to the project limits. Services to the residential and commercial businesses exist across SR72 and Old Baltimore Pike.

United Water proposes to adjust existing water valves vertically to match proposed grade. The locations are:

12+52 Rt 12+55 Rt 110+40 Rt



United Water proposes to adjust vertically to match proposed grade, or remove if the valves are abandon, the existing water valves at approximate Sta 9+60 Lt.

United Water proposes to install a new valve at 13+20 Lt into the permanent easement and away from the proposed ramp.

It is anticipated that this work will take five (5) calendar days to complete after fourteen (14) calendar days of advance notice is provided from the State Contractor and construction layout of the sidewalk and right of way performed.

Should any additional conflicts be encountered during construction requiring adjustment and/or relocation to the aforementioned utilities existing facilities, the necessary relocation work shall be accomplished by the respective company's forces, as directed by the Engineer.

City of Newark:

The City owns raw water mains along the northbound lanes of SR72 throughout the project limits. At approximate Sta 112+70 there are two stubs, one in each direction from their main, that dead end at the adjacent parcels.

To avoid conflicts with the proposed drainage the State Contractor shall install new valves and restraints, as shown on the construction details, at approximate locations 112+69, 45' Lt and 112+74, 42' Rt. Locations shall be verified with the City of Newark and the Engineer prior to starting work.

The State Contractor shall also vertically adjust water valves to match proposed grades at the following approximate Sta's:

111+10 Rt 112+70 Rt 117+22 Rt.

The City of Newark must be contacted to have an inspector on-site for all work. The City of Newark Standards and Specifications shall be used when performing this work. The water main can only be taken out of service Monday through Thursday 8:00pm – 5:00am so this work will be performed at night. The valve work in the northeast corner of Old Baltimore Pike and SR72 will be performed at the beginning of Phase 1 prior to the installation of the drainage pipes. The valve work in the northwest corner of Old Baltimore Pike and SR72 will be performed at the beginning of Phase 4. All other adjustments will be performed in the appropriate phase.

Should any conflicts be encountered during construction requiring adjustment and/or relocation to the aforementioned utilities existing facilities, the necessary relocation work shall be accomplished by the State's Contractor, in accordance with the utility's specifications, as directed by the Engineer.

Delmarva Power – Electric Distribution:

The Company maintains underground and aerial facilities within the project limits with no anticipated conflicts.

Delmarva shall install 8 luminaires on existing Delmarva poles as shown on the Lighting Plans. The lights shall be leased and added to DelDOT outdoor lighting account no. 2761214-9996. Delmarva proposes to provide two services from the pole 43482/39665 at approximate Sta 113+60 Rt for DelDOT's proposed traffic signals and lighting.

It is anticipated that this work will take five (5) calendar days to complete after fourteen (14) calendar days of advance notice is provided by the Contractor.

Delmarva also proposes to lower the existing splice box at approximate Sta 115+50 Rt to match the proposed grades. There is sufficient slack in the cables to allow for this lowering without impacting the private service.

It is anticipated that this work will take twenty one (21) calendar days to complete after twenty eight (28) calendar days of advance notice is provided by the State Contractor.

Should any additional conflicts be encountered during construction requiring adjustment and/or relocation to the aforementioned utilities existing facilities, the necessary relocation work shall be accomplished by the respective company's forces, as directed by the Engineer.

Delmarva Power - Gas:

The Company maintains underground gas facilities within the project limits. South of the intersection of SR72 and Old Baltimore Pike the company maintains gas mains along both sides of the road. North of the intersection of SR72 and Old Baltimore Pike there main runs along the eastern side of the road to the project limits. On the east side of the intersection with SR72 and Old Baltimore Pike Delmarva maintains facilities along both sides of the roadway. There is also a stub pipe on the southeast corner of the intersection of SR72 and Old Baltimore Pike that ends near station 6+50.

Delmarva proposes to relocate their main in two locations on Old Baltimore Pike to avoid conflicts with proposed the drainage. The main will be relocated back from the roadway into the permanent easement between Sta 12+25 and 13+30 to avoid D1 and P1 conflicts. Delmarva also proposes to install a new crossing of Old Baltimore Pike at approximate Sta 9+70 and abandon their existing crossing near Sta 9+60 to avoid conflicts with proposed pipe P9.

It is anticipated that the above relocation work will take fourteen (14) calendar days to complete after the location of the drainage has been staked and notice to proceed has been given to Delmarva.

NOTE: It is anticipated that Delmarva Power - Gas will complete its proposed work in advance of this contract. The bidders are to determine the extent completion of the

advanced utility work and predicated their bid prices on the extent of utility work completed and anticipated to be completed prior to the start of construction.

Delmarva also proposes to vertically adjust the existing gas valves near Sta 9+75 Lt and Sta 110+60 Rt to match proposed grade. It is anticipated that this work will take one (1) calendar day to complete, at each location, after fourteen (14) days advanced notice has been provided by the State Contractor.

Should any additional conflicts be encountered during construction requiring adjustment and/or relocation to the aforementioned utilities existing facilities, the necessary relocation work shall be accomplished by the respective company's forces, as directed by the Engineer.

Verizon Delaware, LLC:

The Company maintains aerial and underground communications facilities within the project limits.

The aerial line is on the west side of SR72 from the southern project limits to Sta 110+65 where it goes underground. From approximate Sta 113+60 the aerial line is on the east side of SR72 where it continues north to the project limits. Along Old Baltimore Pike there is an aerial line along the northern side of the road within the entire project limits. Another aerial line begins on the south side of the road from Sta 9+10 to the eastern project limits.

Verizon's underground facilities are on the north side of Old Baltimore Pike from pole 43438/39644 that extends to the intersection to SR72 and continues north to the project limits on SR72. Facilities branch off on SR72 at Sta 113+00. Verizon also maintains underground facilities on the west side of SR72 at pole 43477/39636 that extends north to the project limits. Facilities branch off across SR72 near Sta 111+20 and extend to the south side of Old Baltimore Pike to pole 43509/39653. There are also abandon underground facilities on SR72 near Sta 110+00 to the intersection of SR72 and Old Baltimore Pike near Sta 112+70. Abandon facilities also exist from 111+60 to the east side for SR72 to pole 43489/39647

Verizon maintains underground conduit that is in close proximity with proposed drainage pipe P8 in the northwest corner of SR72 and Old Baltimore Pike. The contractor shall use care when excavating at this location.

Verizon proposes to adjust the manhole at Sta 4+80 Lt to match the proposed grade.

Verizon will also vertically adjust the manholes within the roadway to match the proposed grades at Sta 116+00. Verizon has abandon manholes near 111+60 that have been paved over. If needed, they will vertically adjust the throats of the abandon manholes.

It is anticipated that this work will take seven (7) calendar days to complete after thirty (30) calendar days of advanced notice is given by the State Contractor.

Verizon proposes to relocate Pole VZ719/4 (Delmarva No. 43529/39675) at Sta 13+45 Lt. An extension arm will be placed to support the cable running parallel to Old Baltimore Pike and the cable crossing the road will be extended to the new pole.

It is anticipated that this work will take seven (7) calendar days to complete after thirty (30) calendar days of advanced notice is given by the State Contractor and the right of way has been staked.

Should any conflicts be encountered during construction requiring adjustment and/or relocation to the aforementioned utilities existing facilities, the necessary relocation work shall be accomplished by the respective company's forces, as directed by the Engineer.

New Castle County Department of Special Services:

The County maintains sewer facilities within the project limits with no apparent conflicts.

The State's Contractor shall adjust the manholes within the roadway vertically to match the proposed grades. It is anticipated that the manholes at the following stations on Old Baltimore Pike will need to be adjusted:

12+75 Rt

16+75Rt

Should any conflicts be encountered during construction requiring adjustment and/or relocation to the aforementioned utilities existing facilities, the necessary relocation work shall be accomplished by the State's Contractor, in accordance with the utility's specifications, as directed by the Engineer.

Comcast Cable Communications:

The Company maintains aerial and underground communications facilities within the project limits with no apparent conflicts.

Comcast will adjust their underground service from the relocated Verizon pole at Sta 13+45 Lt. It is anticipated that this work will take one (1) calendar day after fourteen (14) days of advanced notice is given by the State Contractor.

Should any conflicts be encountered during construction requiring adjustment and/or relocation to the aforementioned utilities existing facilities, the necessary relocation work shall be accomplished by the respective company's forces, as directed by the Engineer.

Peg Bandwidth:

The Company maintains communications facilities within the project limits with no apparent conflicts.

Should any conflicts be encountered during construction requiring adjustment and/or relocation to the aforementioned utilities existing facilities, the necessary relocation work shall be accomplished by the respective company's forces, as directed by the Engineer.

AT&T:

The Company maintains aerial communications facilities within the project limits with no apparent conflicts. The facility runs southwest on the south side of Old Baltimore Pike then turns north onto the east side of SR72.

Should any conflicts be encountered during construction requiring adjustment and/or relocation to the aforementioned utilities existing facilities, the necessary relocation work shall be accomplished by the respective company's forces, as directed by the Engineer.

Windstream:

The Company maintains aerial communications facilities within the project limits with no apparent conflicts. The facilities run south from I-95 along the eastern side of SR72. After crossing Old Baltimore Pike the lines cross over to the western side of SR72 and continue south on Delmarva's poles to the project limits.

Should any conflicts be encountered during construction requiring adjustment and/or relocation to the aforementioned utilities existing facilities, the necessary relocation work shall be accomplished by the respective company's forces, as directed by the Engineer.

General Notes

1. The contractor's attention is directed to Section 105.09 Utilities, Delaware Standard Specifications, August 2001. The Contractor shall contact Miss Utility (1-800-282-8555) two working days prior to any excavation. The Contractor is responsible for the support and protection of all utilities when excavating. The Contractor is responsible for ensuring proper clearances, including safety clearances, from overhead utilities for construction equipment. The contractor is advised to check the site for access purposes for his equipment and, if necessary, make arrangements directly with utility companies for field adjustments for adequate clearances.
2. It is understood and agreed that the contractor has considered in their bid all permanent and temporary utility appurtenances in their present or relocated positions as shown on the plans or described in the utility statement and/or are readily discernible and that no additional compensation will be allowed for any delays, inconvenience, or damage sustained by him/her to any interference from the utility facilities and appurtenances or the operation of moving the, except that the contractor may be granted an equitable extension of time.

3. The Contractor shall follow all requirements of the Delaware Code, Title 26, Chapter 8. Underground Utility Damage Prevention And Safety. Chapter 8 includes, among other requirements, Section 806. Duties of Excavators which contains the requirement for the Contractor to excavate prudently and carefully and to take all reasonable steps necessary to properly protect, support and backfill underground utility lines. This protection shall include but may not be limited to hand digging, within the limits of the planned excavation or demolition, starting 2 feet of either side of the extremities of the underground utility line for other than parallel type excavations and at reasonable distances along the line of excavation for parallel type excavations.

4. The Contractor shall note that the Delaware Code, Chapter 74B, Section 7405B requires notification to and mutually agreeable measures from the public utility for any person intending to carry on any function, activity work or operation within dangerous proximity of any high voltage overhead lines.

5. As outlined in Chapter 3 of the DelDOT Utilities Manual, utilities are responsible for obtaining all required permits from municipal, State and federal government agencies and railroads. This includes but is not limited to water quality permits/DNREC Water Quality Certification, DNREC Subaqueous Lands/Wetlands permits, DNREC Coastal Zone Consistency Certification, County Floodplain permits (New Castle County only), U.S. Coast Guard permits, US Army Corps 404 permits, sediment and erosion permits, and railroad crossing permits.

6. Utility companies are required to restore any areas disturbed in conjunction with their relocation work. If an area is disturbed by a utility company and is not properly restored, the Department may have the highway contractor perform the necessary restoration. Any additional costs incurred as a result will be forwarded to the utility company.

NOTE: Coordination and cooperation among the utilities and the State's Contractor are of prime importance, therefore, the Contractor is directed to contact the following Utility Representatives with any questions in regard to this work prior to submitting bids and work schedules. Proposed work schedules should reflect the Utility Companies' proposed relocations.

Mr. John Licht	Suez Water Delaware (United Water Co.)	302-252-3036
Mr. Tom Coleman	City of Newark Water	302-366-7000
Mr. Angel Collazo	Delmarva Power - Electric	302-454-4370
Mr. Ted Waugh	Delmarva Power Gas	302-429-3706
Mr. George Zang	Verizon Delaware, LLC	302-422-1238
Mr. David Clark	New Castle County Dept of Special Services	302-395-5705
Mr. Keith Allridge	Comcast Cable Communications	717-776-1073

Mr. Michael Llamas
Mr. Jay Everly
Mr. Harry Sheppard

Peg Bandwidth
AT&T
Windstream

443-827-1786
610-238-6465x232
302 224-7121

PREPARED AND RECOMMENDED BY:



Century Engineering, Inc.

3-22-17
DATE

APPROVED AS TO FORM BY:



Utilities Section, DelDOT

3/22/17
DATE

STATE OF DELAWARE
DEPARTMENT OF TRANSPORTATION
PO BOX 778
DOVER, DELAWARE 19903

CERTIFICATE OF RIGHT-OF-WAY STATUS

STATE PROJECT NO. T201200108

F.A.P. ESTP-N026(09)

HEP NCC, SR72 AND OLD BALTIMORE PIKE
INTERSECTION IMPROVEMENTS

NEW CASTLE COUNTY

Certificate of Right-of-Way Status – 100%

Status - LEVEL 1

As required by 23 CFR, Part 635, and other pertinent Federal and State regulations or laws, the following certifications are hereby made in reference to this highway project:

All necessary real property interests have been acquired in accordance with current FHWA/State directives covering the acquisition of real property; and,

All necessary rights-of-way, including control of access rights when pertinent, have been acquired including legal and physical possession; and,

All project rights of way are currently available in accordance with the project right-of-way plans; and,

Any residential displaced individuals or families have been relocated to decent, safe and sanitary housing, or adequate replacement housing has been made available in accordance with the provisions of the current Federal Highway Administration (FHWA) directive(s) covering the administration of the Highway Relocation Assistance Program; and,

All occupants have vacated the lands and improvements; and,

The State has physical possession and the right to remove, salvage, or demolish any improvements acquired as part of this project, and enter on all land.

RIGHT OF WAY SECTION



Monroe C. Hite III,
Acting Chief of Right of Way



STATE OF DELAWARE
DEPARTMENT OF TRANSPORTATION
800 BAY ROAD
P.O. BOX 778
DOVER, DELAWARE 19903

JENNIFER COHAN
SECRETARY

January 4, 2016

ENVIRONMENTAL REQUIREMENTS

FOR

State Contract No. T201200108
Federal Aid No.: ESTP-N026(09)

Contract Title: HEP NCC, SR 72 and Old Baltimore Pike Intersection Improvements

In accordance with the procedural provisions for implementing the National Environmental Policy Act of 1969, as amended, the referenced project has been processed through the Department's Environmental Review Procedures and has been classified as a Level C/ Class II Action.

Due to the nature of the proposed construction activities, permits are not required for this project. However, the following construction requirements and special provisions have been developed to minimize and mitigate impact to the surrounding environs. These requirements by DelDOT, not specified within the contract, are listed below. These requirements are the responsibility of the contractor and are subject to risk of shut down at the contractor's expense if not followed.

GENERAL REQUIREMENTS:

1. All construction debris, excavated material, brush, rocks, and refuse incidental to such work shall be placed either on shore above the influence of flood waters or on some suitable dumping ground.
2. That effort shall be made to keep construction debris from entering adjacent waterways or wetlands. Any debris that enters those areas shall be removed immediately.
3. The disposal of trees, brush, and other debris in any stream corridor, wetland, surface water, or drainage area is prohibited.

4. DelDOT Environmental Studies Section (302) 760-2264 must be notified if there are any changes to the project methods, footprint, materials, or designs, to allow the Department to coordinate with the appropriate resource agencies (COE, DNREC, and SHPO), for approval.



STATE OF DELAWARE
DEPARTMENT OF TRANSPORTATION
 800 BAY ROAD
 P.O. BOX 778
 DOVER, DELAWARE 19903

JENNIFER COHAN
 SECRETARY

RAILROAD STATEMENT

For

State Contract No.: T201200108

Federal Aid No.: ESTP-N026(09)

Project Title: HEP-NCC, SR 72 and Old Baltimore Pike Intersection Improvements

The following railroad companies maintain facilities within the contract limits:

- | | |
|--|--|
| <input type="checkbox"/> Amtrak | <input type="checkbox"/> Maryland & Delaware |
| <input type="checkbox"/> CSX | <input checked="" type="checkbox"/> Norfolk Southern |
| <input type="checkbox"/> Delaware Coast Line | <input type="checkbox"/> Wilmington & Western |
| <input type="checkbox"/> East Penn | <input type="checkbox"/> None |

DOT Inventory No.:

No. Trains/Day:

Passenger Trains (Y / N):

In accordance with 23 CFR 635, herein is the railroad statement of coordination (check one):

- No Railroad involvement.
- Railroad Agreement unnecessary but railroad flagging required. The contractor shall follow requirements stated in the DelDOT Maintenance of Railroad Traffic Item in the Special Provisions. Contractor shall coordinate railroad flagging with DelDOT's Railroad Program Manager at (302) 760-2183.
- Railroad Agreement required. The necessary railroad agreement, attached, is complete and fully executed. Railroad related work to be undertaken and completed as required for proper coordination with physical construction schedules. The Contractor shall follow requirements stated in the DelDOT Maintenance of Railroad Traffic Item in the Special Provisions. Contractor shall coordinate railroad flagging with DelDOT's Railroad Program Manager at (302) 760-2183.

Approved As To Form:



 Robert A. Perrille
 DelDOT Railroad Program Manager

12/12/16

DATE

BID PROPOSAL FORMS
CONTRACT T201200108.01
FEDERAL AID PROJECT ESTP-N026(09)

UNLESS OTHERWISE DIRECTED, SUBMIT ALL FOLLOWING PAGES TO:

DEPARTMENT OF TRANSPORTATION
BIDDERS ROOM (B1.11.01)
800 BAY ROAD
DOVER, DELAWARE 19901

Identify the following on the outside of the sealed envelope:
- Contract Number T201200108.01
- Name of Contractor

CONTRACT ID: T201200108.01 PROJECT(S): ESTP-N026(09)

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS

SECTION 0001 FIXED QUANTITY

0010	202000 EXCAVATION AND EMBANKMENT	3024.000 CY				
	SECTION 0001 TOTAL					

SECTION 0002 INTERSECTION IMPROVEMENTS

0020	201000 CLEARING AND GRUBBING	LUMP	LUMP			
0030	202573 TEST HOLES	2.000 EACH				
0040	208000 EXCAVATION AND BACKFILLING FOR PIPE TRENCHES	535.000 CY				
0050	209006 BORROW, TYPE F	61.000 CY				
0060	210000 FURNISHING BORROW TYPE "C" FOR PIPE, UTILITY TRENCH, AND STRUCTURE BACKFILL	506.000 CY				
0070	211000 REMOVAL OF STRUCTURES AND OBSTRUCTIONS	LUMP	LUMP			

CONTRACT ID: T201200108.01 PROJECT(S): ESTP-N026(09)

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0080	302007 GRADED AGGREGATE BASE COURSE, TYPE B	619.000 CY				
0090	302008 GRADED AGGREGATE BASE COURSE, TYPE B, PATCHING	231.000 CY				
0100	401816 BITUMINOUS CONCRETE, SUPERPAVE, TYPE B, 160 GYRATIONS, PG 76-22	350.000 TON				
0110	401819 BITUMINOUS CONCRETE, SUPERPAVE, BITUMINOUS CONCRETE BASE COURSE, 160 GYRATIONS, PG 64-22	640.000 TON				
0120	401821 BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 64-22, PATCHING	21.000 TON				
0130	401822 BITUMINOUS CONCRETE, SUPERPAVE, TYPE B, 160 GYRATIONS, PG 64-22, PATCHING	195.000 TON				
0140	401823 BITUMINOUS CONCRETE, SUPERPAVE, BITUMINOUS CONCRETE BASE COURSE, 160 GYRATIONS, PG 64-22, PATCHING	357.000 TON				
0150	401824 BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 64-22, WEDGE	48.000 TON				

CONTRACT ID: T201200108.01 PROJECT(S): ESTP-N026(09)

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0160	401833 BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 76-22, (NON-CARBONATE STONE)	2983.000 TON				
0170	612002 REINFORCED CONCRETE PIPE, 15", CLASS III	35.000 LF				
0180	612003 REINFORCED CONCRETE PIPE, 18", CLASS III	45.000 LF				
0190	612005 REINFORCED CONCRETE PIPE, 24", CLASS III	216.000 LF				
0200	612007 REINFORCED CONCRETE PIPE, 30", CLASS III	119.000 LF				
0210	612009 REINFORCED CONCRETE PIPE, 36", CLASS III	105.000 LF				
0220	614508 WATERMAIN AND ACCESSORIES	LUMP		LUMP		
0230	617002 REINFORCED CONCRETE FLARED END SECTION, 15"	1.000 EACH				
0240	701011 PORTLAND CEMENT CONCRETE CURB, TYPE 2	2859.000 LF				
0250	701022 INTEGRAL PORTLAND CEMENT CONCRETE CURB & GUTTER, TYPE 3-8	1415.000 LF				

CONTRACT ID: T201200108.01 PROJECT(S): ESTP-N026(09)

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0260	705001 P.C.C. SIDEWALK, 4"	SF 8297.000				
0270	705002 P.C.C. SIDEWALK, 6"	SF 3872.000				
0280	705007 SIDEWALK SURFACE DETECTABLE WARNING SYSTEM	SF 326.000				
0290	705008 CURB RAMP, TYPE 1	SF 63.000				
0300	705009 CURB RAMP, TYPE 2, 3, AND/OR 4	SF 66.000				
0310	705505 RESET STONE/BRICK SIDEWALK AND/OR STONE/BRICK ROADWAY	SF 40.000				
0320	705528 TEMPORARY CURB RAMP	EACH 2.000				
0330	705530 TRIANGULAR CHANNELIZING ISLANDS	SF 1663.000				
0340	708051 DRAINAGE INLET, 34" X 24"	EACH 3.000				
0350	708052 DRAINAGE INLET, 48" X 30"	EACH 1.000				

CONTRACT ID: T201200108.01

PROJECT(S): ESTP-N026(09)

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0360	708053 DRAINAGE INLET, 48" X 48"	5.000 EACH				
0370	708060 REPLACE DRAINAGE INLET GRATE(S)	1.000 EACH				
0380	710001 ADJUSTING AND REPAIRING EXISTING DRAINAGE INLET	13.000 EACH				
0390	710002 ADJUSTING AND REPAIRING EXISTING MANHOLE	8.000 EACH				
0400	710501 CONVERTING EXISTING CATCH BASIN TO MANHOLE	1.000 EACH				
0410	710506 ADJUST AND REPAIR EXISTING SANITARY MANHOLE	2.000 EACH				
0420	712006 RIPRAP, R-5	67.000 SY				
0430	713003 GEOTEXTILES, RIPRAP	67.000 SY				
0440	716000 CONVERTING EXISTING DRAINAGE INLET TO JUNCTION BOX	2.000 EACH				
0450	727014 CONSTRUCTION SAFETY FENCE	555.000 LF				


CONTRACT ID: T201200108.01

PROJECT(S): ESTP-N026(09)

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0460	743000 MAINTENANCE OF TRAFFIC	LUMP	LUMP			
0470	743003 ARROWPANELS, TYPE C	337.000 EADY				
0480	743004 FURNISH AND MAINTAIN PORTABLE CHANGEABLE MESSAGE SIGN	84.000 EADY				
0490	743005 FURNISH AND MAINTAIN PORTABLE LIGHT ASSEMBLY	612.000 EADY				
0500	743006 PLASTIC DRUMS	8524.000 EADY				
0510	743007 TRAFFIC OFFICERS	154.000 HOUR		75.00000		11550.00
0520	743010 FURNISH AND MAINTAIN TRUCK MOUNTED ATTENUATOR, TYPE II	231.000 EADY				
0530	743023 TEMPORARY BARRICADES, TYPE III	6808.000 LFDY				
0540	743024 TEMPORARY WARNING SIGNS AND PLAQUES	8677.000 EADY				
0550	743050 FLAGGER, NEW CASTLE COUNTY, STATE	3672.000 HOUR				

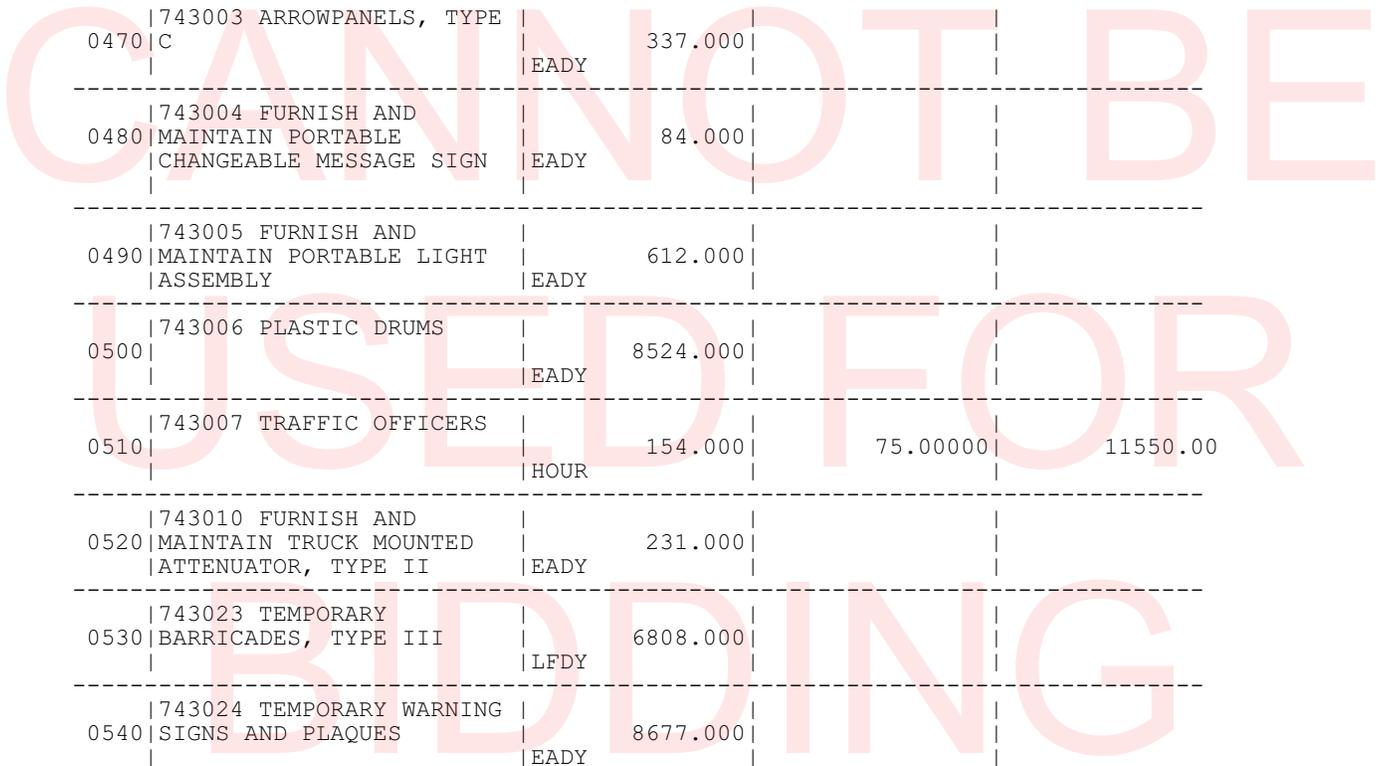

CONTRACT ID: T201200108.01 PROJECT(S): ESTP-N026(09)

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0560	743062 FLAGGER, NEW CASTLE COUNTY, STATE, OVERTIME	368.000 HOUR				
0570	743552 PEDESTRIAN CHANNELIZING BARRICADE	8240.000 LFDY				
0580	744524 CONDUIT JUNCTION WELL, TYPE 5, PRECAST CONCRETE	2.000 EACH				
0590	744530 CONDUIT JUNCTION WELL, TYPE 11, PRECAST CONCRETE/ POLYMER LID-FRAME	17.000 EACH				
0600	744531 CONDUIT JUNCTION WELL, TYPE 14, PRECAST CONCRETE/ POLYMER LID-FRAME	6.000 EACH				
0610	744544 ADJUST OR REPAIR EXISTING CONDUIT JUNCTION WELL	4.000 EACH				
0620	745602 FURNISH & INSTALL UP TO 4" SCHEDULE 80 HDPE CONDUIT (BORE)	1550.000 LF				
0630	745603 FURNISH & INSTALL UP TO 4" SCHEDULE 80 PVC CONDUIT (OPEN CUT)	130.000 LF				
0640	745604 FURNISH & INSTALL UP TO 4" SCHEDULE 80 PVC CONDUIT (TRENCH)	1960.000 LF				
0650	745606 FURNISH & INSTALL UP TO 4" GALVANIZED STEEL CONDUIT (TRENCH)	120.000 LF				

CONTRACT ID: T201200108.01

PROJECT(S): ESTP-N026(09)

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0660	746517 ALUMINUM LIGHTING STANDARD WITH SINGLE DAVIT ARM, 30' POLE	8.000 EACH				
0670	746558 POLE BASE, TYPE 3C	1.000 EACH				
0680	746614 POLE BASE EXTENSION	32.000 CF				
0690	746849 POLE BASE, TYPE 3B	3.000 EACH				
0700	746850 POLE BASE, TYPE 4A	5.000 EACH				
0710	746852 POLE BASE, TYPE 6	8.000 EACH				
0720	746907 FURNISH & INSTALL 1-CONDUCTOR #2 AWG STRANDED COPPER	270.000 LF				
0730	746909 FURNISH & INSTALL 1-CONDUCTOR #6 AWG STRANDED COPPER	3350.000 LF				
0740	746914 FURNISH & INSTALL #6 BARE STRANDED COPPER GROUND	1410.000 LF				
0750	746924 FURNISH & INSTALL LOOP WIRE 1-CONDUCTOR #14 AWG ENCASED IN 1/4" FLEXIBLE TUBING IN A LOOP SAWCUT	1590.000 LF				

CONTRACT ID: T201200108.01

PROJECT(S): ESTP-N026(09)

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0760	746925 FURNISH & INSTALL EMBEDDED METERED SERVICE PEDESTAL (100 AMP)	1.000 EACH				
0770	747513 LIGHTING CONTROL AND DISTRIBUTION ENCLOSURE (120/240; 100 AMP)	1.000 EACH				
0780	747515 CABINET BASE, TYPE M	1.000 EACH				
0790	747516 CABINET BASE, TYPE P	1.000 EACH				
0800	747517 CABINET BASE, TYPE R	1.000 EACH				
0810	748015 PERMANENT PAVEMENT STRIPING, SYMBOL/LEGEND ALKYD-THERMOPLAST IC	2934.000 SF				
0820	748019 TEMPORARY MARKINGS, PAINT, 4"	26486.000 LF				
0830	748026 TEMPORARY MARKINGS, PAINT SYMBOL/LEGEND	4542.000 SF				
0840	748033 PERMANENT PAVEMENT STRIPING, ALKYD-THERMOPLASTIC, 5"	76.000 LF				
0850	748530 REMOVAL OF PAVEMENT STRIPING	356.000 SF				

CONTRACT ID: T201200108.01 PROJECT(S): ESTP-N026(09)

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0860	748548 PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/YELLOW, 5"	17921.000 LF				
0870	748553 PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT MARKINGS, BIKE SYMBOL	20.000 EACH				
0880	749687 INSTALLATION OR REMOVAL OF TRAFFIC SIGN(S) ON SINGLE SIGN POST	109.000 EACH				
0890	749688 INSTALLATION OF 4" DIAMETER HOLE, LESS THAN OR EQUAL TO 6" DEPTH	4.000 EACH				
0900	749690 INSTALLATION OR REMOVAL OF TRAFFIC SIGNS ON MULTIPLE SIGN POSTS	50.000 SF				
0910	750000 ADJUST WATER VALVE BOXES	3.000 EACH				
0920	758000 REMOVAL OF EXISTING PORTLAND CEMENT CONCRETE PAVEMENT, CURB, SIDEWALK, ETC.	1798.000 SY				
0930	759005 FIELD OFFICE, TYPE II	7.000 EAMO				
0940	760000 PAVEMENT - MILLING, HOT-MIX	46549.000 SYIN				

CONTRACT ID: T201200108.01 PROJECT(S): ESTP-N026(09)

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0950	762001 SAW CUTTING, BITUMINOUS CONCRETE	5048.000 LF				
0960	762002 SAW CUTTING, CONCRETE, FULL DEPTH	10.000 LF				
0970	763000 INITIAL EXPENSE	LUMP	LUMP			
0980	763501 CONSTRUCTION ENGINEERING	LUMP	LUMP			
0990	763502 MAINTENANCE OF RAILROAD TRAFFIC	LUMP	LUMP			
1000	905001 SILT FENCE	507.000 LF				
1010	905002 REINFORCED SILT FENCE	40.000 LF				
1020	905004 INLET SEDIMENT CONTROL, DRAINAGE INLET	30.000 EACH				
1030	905005 INLET SEDIMENT CONTROL, CURB INLET	12.000 EACH				
1040	907510 COMPOST FILTER LOG	8.000 LF				

CANNOT BE USED FOR BIDDING

CONTRACT ID: T201200108.01 PROJECT(S): ESTP-N026(09)

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
1050	908004 TOPSOIL, 6" DEPTH	3137.000 SY				
1060	908014 PERMANENT GRASS SEEDING, DRY GROUND	3137.000 SY				
1070	908017 TEMPORARY GRASS SEEDING	3137.000 SY				
1080	908020 EROSION CONTROL BLANKET MULCH	208.000 SY				
	SECTION 0002 TOTAL					
	TOTAL BID					

CANNOT BE USED FOR BIDDING

BREAKOUT SHEET INSTRUCTIONS

BREAKOUT SHEET(S) MUST BE SUBMITTED EITHER WITH YOUR BID DOCUMENTS; OR WITHIN SEVEN (7) CALENDAR DAYS FOLLOWING THE BID DUE DATE BY THE LOWEST APPARENT BIDDER.

BREAKOUT SHEETS ARE TO BE SUBMITTED TO DELDOT'S CONTRACT ADMINISTRATION AS SHOWN BELOW. BREAKOUT SHEETS CANNOT BE CHANGED AFTER AWARD. THE DEPARTMENT WILL REVIEW THE FIGURES SUBMITTED ON THE BREAKOUT SHEET(S) TO ENSURE THEY MATCH THE RESPECTIVE LUMP SUM BID AMOUNT(S). MATHEMATICALLY INCORRECT BREAKOUT SHEETS WILL BE RETURNED FOR IMMEDIATE CORRECTION.

BREAKOUT SHEETS MAY BE SUBMITTED;

VIA E-MAIL TO: DOT-ASK@STATE.DE.US
SUBJECT: **T201200108.01** Breakout Sheet

OR MAILED TO: DELDOT
CONTRACT ADMINISTRATION
PO BOX 778, DOVER, DE 19903

'BREAKOUT SHEET' AND THE PROJECT NUMBER
MUST APPEAR ON THE ENVELOPE.

BREAKOUT SHEET - 1
Item 614508 - WATER MAIN AND ACCESSORIES

CONTRACT NO. T201200108.01

ITEM NO.	APPROX. QTY.	UOM	DESCRIPTION	UNIT PRICE	AMOUNT
1	3	EA	CONCRETE KICKER	\$	\$
2	1	EA	12" END CAP	\$	\$
3	12	LF	3/4" THREADED ROD	\$	\$
4	1	EA	12" MUELLER GATE VALVE (MODEL NO. A-2360, OPEN LEFT)	\$	\$
5	1	EA	12" FRICTION CLAMP	\$	\$
6	1	EA	POURED CONCRETE DEADMAN	\$	\$
7	1	EA	12" MECHANICAL JOINT END CAP WITH 2" THREADED HOLE IN CENTER	\$	\$
8	2	EA	THREADED BRASS NIPPLE - 2"x12"	\$	\$
9	1	EA	CURB STOP MUELLER VALVE (H-15201)	\$	\$
10	1	EA	THREADED 2" BRASS 90° BEND	\$	\$
11	4	LF	2" BRASS PIPING	\$	\$
12	3	EA	CAST IRON VALVE BOX, THREAD TYPE	\$	\$
13	2	LF	12" CLASS #52 DUCTILE IRON PIPE	\$	\$
14	1	EA	2" BRASS THREADED CAP	\$	\$
TOTAL ITEM 614508 - WATER MAIN AND ACCESSORIES \$ _____ (LUMP SUM BID PRICE FOR ITEM 614508 - WATER MAIN AND ACCESSORIES)					

"ATTENTION"

TO BIDDERS

BREAKOUT SHEET(S) MUST BE SUBMITTED EITHER WITH YOUR BID DOCUMENTS; OR WITHIN SEVEN (7) CALENDAR DAYS FOLLOWING THE BID DUE DATE BY THE LOWEST APPARENT BIDDER.

BREAKOUT SHEETS ARE TO BE SUBMITTED TO DELDOT'S CONTRACT ADMINISTRATION AS SHOWN BELOW. BREAKOUT SHEETS CANNOT BE CHANGED AFTER AWARD. THE DEPARTMENT WILL REVIEW THE FIGURES SUBMITTED ON THE BREAKOUT SHEET(S) TO ENSURE THEY MATCH THE RESPECTIVE LUMP SUM BID AMOUNT(S). MATHEMATICALLY INCORRECT BREAKOUT SHEETS WILL BE RETURNED FOR IMMEDIATE CORRECTION.

BREAKOUT SHEETS MAY BE SUBMITTED;

VIA E-MAIL TO: DOT-ASK@STATE.DE.US
SUBJECT: **T201200108.01** Breakout Sheet

OR MAILED TO: DELDOT
CONTRACT ADMINISTRATION
PO BOX 778, DOVER, DE 19903

'BREAKOUT SHEET' AND THE PROJECT NUMBER
MUST APPEAR ON THE ENVELOPE.

**AFFIDAVIT
OF
EMPLOYEE DRUG TESTING PROGRAM**

4104 Regulations for the Drug Testing of Contractor and Subcontractor Employees Working on Large Public Works Projects requires that Contractors and Subcontractors implement a program of mandatory drug testing for Employees who work on Large Public Works Contracts funded all or in part with public funds.

We hereby certify that we have in place or will implement during the entire term of the contract a Mandatory Drug Testing Program for our employees on the jobsite that complies with this regulation:

Contractor/Subcontractor Name: _____

Contractor/Subcontractor Address: _____

Authorized Representative (typed or printed): _____

Authorized Representative (signature): _____

Title: _____

Sworn to and Subscribed before me this _____ day of _____ 20__.

My Commission expires _____ NOTARY PUBLIC _____.

THIS PAGE MUST BE SIGNED, NOTARIZED, AND RETURNED WITH YOUR BID.

CERTIFICATION

Contract No. T201200108.01
Federal Aid Project No. ESTP-N026(09)

The undersigned bidder, _____
whose address is _____
and telephone number is _____ hereby certifies the following:

I/We have carefully examined the location of the proposed work, the proposed plans and specifications, and will be bound, upon award of this contract by the Department of Transportation, to execute in accordance with such award, a contract with necessary surety bond, of which contract this proposal and said plans and specifications shall be a part, to provide all necessary machinery, tools, labor and other means of construction, and to do all the work and to furnish all the materials necessary to perform and complete the said contract within the time and as required in accordance with the requirements of the Department of Transportation, and at the unit prices for the various items as listed on the preceding pages.

Bidder's Certification Statement [US DOT Suspension and Debarment Regulation (49 CFR 29)]:

NOTICE: All contractors who hold prime contracts (Federal Aid) with DelDOT are advised that the prime contractor and subcontractors are required to submit to DelDOT a signed and notary attested copy of the Bidder Certification Statement for each and every subcontract that will be utilized by the prime contractor. This Certification **must** be filed with DelDOT prior to written approval being granted for each and every subcontractor. Copies of the Certification Form are available from the appropriate District Construction Office.

Under penalty of perjury under the laws of the United States, that I/We, or any person associated therewith in the capacity of (owner, partner, director, officer, principal, investigator, project director, manager, auditor, or any position involving the administration federal funds):

- a. am/are not currently under suspension, debarment, voluntary exclusion, or determination of ineligibility by any federal agency;
- b. have not been suspended, debarred, voluntarily excluded or determined ineligible by any federal agency within the past 3 years;
- c. do not have a proposed debarment pending; and,
- d. have not been indicted, convicted, or had a civil judgement rendered against (it) by a court of competent jurisdiction in any matter involving fraud or official misconduct within the past 3 years.

Exceptions will not necessarily result in denial of award, but will be considered in determining bidder responsibility. For any exception noted, indicate below to whom it applies, initiating agency, and dates of action. Providing false information may result in criminal prosecution or administrative sanctions.

(Insert Exceptions)

DBE Program Assurance:

NOTICE: In accordance with 49 CFR Part 26 the undersigned, a legally authorized representative of the bidder listed below, must complete this assurance.

By its signature affixed hereto, assures the Department that it will attain DBE participation as indicated:

Disadvantaged Business Enterprise _____ percent (blank to be filled in by bidder)

The foregoing quantities are considered to be approximate only and are given as the basis for comparison of bids. The Department of Transportation may increase or decrease the amount of any item or portion of the work as may be deemed necessary or expedient. Any such increase or decrease in the quantity for any item will not be regarded as a sufficient ground for an increase or decrease in the unit prices, nor in the time allowed for the completion of the work, except as provided in the contract.

Accompanying this proposal is a surety bond or a security of the bidder assigned to the Department of Transportation, for at least ten (10) percentum of total amount of the proposal, which deposit is to be forfeited as liquidated damages in case this proposal is accepted, and the undersigned shall fail to execute a contract with necessary bond, when required, for the performance of said contract with the Department of Transportation, under the conditions of this proposal, within twenty (20) days after date of official notice of the award of the contract as provided in the requirement and specifications hereto attached; otherwise said deposit is to be returned to the undersigned.

I/We are licensed, or have initiated the license application as required by Section 2502, Chapter 25, Title 30, of the Delaware Code.

By submission of this proposal, each person signing on behalf of the bidder, certifies as to its own organization, under penalty of perjury, that to the best of each signer's knowledge and belief:

1. The prices in this proposal have been arrived at independently without collusion, consultation, communication, or Agreement with any other bidder or with any competitor for the purpose of restricting competition.
2. Unless required by law, the prices which have been quoted in this proposal have not been knowingly disclosed and will not knowingly be disclosed by the bidder, directly or indirectly, to any other bidder or competitor prior to the opening of proposals.
3. No attempt has been made or will be made by the bidder to induce any other person, partnership, or corporation to submit or not to submit a proposal for the purpose of restricting competition.

I/We acknowledge receipt and incorporation of addenda to this proposal as follows:

No.	Date	No.	Date	No.	Date	No.	Date	No.	Date
<hr/> <p>BIDDERS MUST ACKNOWLEDGE RECEIPT OF ALL ADDENDA</p> <p>MUST INSERT DATE OF FINAL QUESTIONS AND ANSWERS ON WEBSITE: _____ </p> <hr/>									

Sealed and dated this _____ day of _____ in the year of our Lord two thousand _____ (20____).

Name of Bidder (Organization)

Corporate
Seal

By: _____
Authorized Signature

Attest _____

Title

SWORN TO AND SUBSCRIBED BEFORE ME this ____ day of _____, 20____.

Notary
Seal

Notary

BID BOND

TO ACCOMPANY PROPOSAL
(Not necessary if security is used)

KNOW ALL MEN BY THESE PRESENTS That: _____
of _____ in the County of _____ and State of _____ as
Principal, and _____ of _____ in the County of
_____ and State of _____ as **Surety**, legally authorized to do business in the State of
Delaware ("**State**"), are held and firmly unto the **State** in the sum of _____
Dollars (\$ _____), or _____ percent not to exceed _____
Dollars (\$ _____) of amount of bid on
Contract No. T201200108.01, to be paid to the **State** for the use and benefit of its Department of
Transportation ("**DeIDOT**") for which payment well and truly to be made, we do bind ourselves, our and
each of our heirs, executors, administrators, and successors, jointly and severally for and in the whole
firmly by these presents.

NOW THE CONDITION OF THIS OBLIGATION IS SUCH That if the above bounden **Principal**
who has submitted to the **DeIDOT** a certain proposal to enter into this contract for the furnishing of certain
materiel and/or services within the **State**, shall be awarded this Contract, and if said **Principal** shall well
and truly enter into and execute this Contract as may be required by the terms of this Contract and
approved by the **DeIDOT**, this Contract to be entered into within twenty days after the date of official
notice of the award thereof in accordance with the terms of said proposal, then this obligation shall be void
or else to be and remain in full force and virtue.

Sealed with _____ seal and dated this _____ day of _____ in the year of our Lord
two thousand and _____ (20__).

SEALED, AND DELIVERED IN THE
presence of

Corporate
Seal

Name of Bidder (Organization)

By: _____
Authorized Signature

Attest _____
Title

Name of **Surety**

Witness: _____ By: _____
Title