

STATE OF DELAWARE

This Copy is for information only.
You must request a CD from
DeIDOT in order to bid.



DEPARTMENT OF TRANSPORTATION

BID PROPOSAL

for

CONTRACT T201407501.01

REMOVAL OF BR 2-357P PEDESTRIAN BRIDGE OVER ST. JONES RIVER

KENT COUNTY

ADVERTISEMENT DATE: May 23, 2016

COMPLETION TIME: 68 Calendar Days

SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION
DELAWARE DEPARTMENT OF TRANSPORTATION
AUGUST 2001

Bids will be received in the Bidder's Room at the Delaware Department of Transportation's Administration Building, 800 Bay Road, Dover, Delaware until 2:00 P.M. local time June 21, 2016

Contract No.T201407501.01

**REMOVAL OF BR 2-357P PEDESTRIAN BRIDGE OVER ST. JONES RIVER
KENT COUNTY**

GENERAL DESCRIPTION

LOCATION

These improvements are located in Kent County more specifically shown on the Location Map(s) of the enclosed Plans.

DESCRIPTION

The improvements consist of furnishing all labor and materials. This project involves the removal of the existing pedestrian bridge over the St. Jones River in its entirety. The removal work consists of removing the two-girder steel superstructure with timber decking/rails, timber piers, and stone/concrete foundation. Other work will include placing riprap or other scour counter measures to protect the stream bank from future scour and the removal of the approach pavement that is no longer needed, as well as other incidental construction in accordance with the location, notes and details shown on the plans and as directed by the Engineer.

COMPLETION TIME

All work on this contract must be complete within 68 Calendar Days. The Contract Time includes an allowance for 7 Weather Days. It is the Department's intent to issue a Notice to Proceed such that work starts on or about September 23, 2016.

PROSPECTIVE BIDDERS NOTES:

1. BIDDERS MUST BE REGISTERED with DeIDOT and request a cd of the official plans and specifications in order to submit a bid. Contact DeIDOT at dot-ask@state.de.us, or (302) 760-2031.
2. QUESTIONS regarding this project are to be e-mailed to dot-ask@state.de.us no less than six business days prior to the bid opening date in order to receive a response. Please include T201407501.01 in the subject line. Responses to inquiries are posted on-line at <http://www.bids.delaware.gov>.
3. THE BID PROPOSAL incorporates a cd containing **Expedite, version 5.9a** and its installation file. Bidders are to use the cd provided to enter their bid amounts into the Expedite file. The Expedite bid file must be printed and submitted in paper form along with the cd and other required documents prior to the Bid due date and time.
4. SURETY BOND - Each proposal must be accompanied by a deposit of either surety bond or security for a sum equal to at least 10% of the bid.
5. **DRUG TESTING** - Regulation 4104; The state Office of Management and Budget has developed regulations that require Contractors and Subcontractors to implement a program of mandatory drug testing for Employees who work on Large Public Works Contracts funded all or in part with public funds pursuant to 29 Del.C. §6908(a)(6). Refer to the full requirements by following the below link: <http://regulations.delaware.gov/register/september2015/final/19%20DE%20Reg%20207%2009-01-15.htm>
Please note a few of the requirements listed below;
 - * At bid submission - submit with the bid a signed affidavit certifying that the Contractor has in place or will implement during the entire term of the contract a Mandatory Drug Testing Program for their Employees that complies with this regulation;
 - * Two business days prior to contract execution - The awarded Contractor shall provide to **DeIDOT** copies of the Employee Drug Testing Program for the Contractor, and may submit any Subcontractor's Employee Drug Testing Program for approval;
 - * Subcontractors - Contractors that employ Subcontractors on the job site may do so only after submitting a copy of the Subcontractor's Employee Drug Testing Program along with the standard required subcontractor information. A Subcontractor shall not commence work until **DeIDOT** has approved the subcontractor in writing;
 - * Testing Report Forms shall be submitted to DeIDOT monthly (forms will be provided).
 - * Penalties for non-compliance are specified in the regulation.
6. Supplemental Specifications to the August 2001 Standard Specifications were issued November 24, 2014 and apply to this project. They can be [viewed here](#). The **Specifications Note** document is for the use by the bidders to reference the new numbers to the past numbers used for bidding purposes on previous Department contracts.

7. No RETAINAGE will be withheld on this contract.
8. The Department's External Complaint Procedure can be viewed on DelDOT's Website at; <http://www.deldot.gov/information/business/>, or you may request a copy by calling (302) 760-2555.
9. **PLEASE NOTE** revisions to 'Equality of Employment Opportunity on Public Works' under General Notices.
10. **REMINDER**; A copy of your Delaware Business License must be submitted with your bid.
11. **Delete** Section 106.06 Buy America Contract Requirement from the Delaware Standard Specifications for Road and Bridge Construction, August, 2001".

**STATE OF DELAWARE
CONSTRUCTION ITEMS UNITS OF MEASURE**

English Code	English Description	Multiply By	Metric Code	Metric Description	Suggested CEC Metric Code
ACRE	Acre	0.4047	ha	Hectare	HECTARE
BAG	Bag	N/A	Bag	Bag	BAG
C.F.	Cubic Foot	0.02832	m ³	Cubic Meter	M3
C.Y.	Cubic Yard	0.7646	m ³	Cubic Meter	M3
EA-DY	Each Day	N/A	EA-DY	Each Day	EA-DY
EA-MO	Each Month	N/A	EA-MO	Each Month	EA-MO
EA/NT	Each Night	N/A	EA-NT	Each Night	EA/NT
EACH	Each	N/A	EA	Each	EACH
GAL	Gallon	3.785	L	Liter	L
HOUR	Hour	N/A	h	Hour	HOUR
INCH	Inch	25.4	mm	Millimeter	MM
L.F.	Linear Foot	0.3048	m	Linear Meter	L.M.
L.S.	Lump Sum	N/A	L.S.	Lump Sum	L.S.
LA-MI	Lane Mile	1.609	LA-km	Lane-Kilometer	LA-KM
LB	Pound	0.4536	kg	Kilogram	KG
MFBM	Thousand Feet of Board Measure	2.3597	m ³	Cubic Meter	M3
MGAL	Thousand Gallons	3.785	kL	Kiloliter	KL
MILE	Mile	1.609	km	Kilometer	KM
S.F.	Square Foot	0.0929	m ²	Square Meter	M2
S.Y.	Square Yard	0.8361	m ²	Square Meter	M2
SY-IN	Square Yard-Inch	0.8495	m ² -25 mm	Square Meter-25 Millimeter	M2-25 MM
TON	Ton	.9072	t	Metric Ton (1000kg)	TON
N.A.*	Kip	4.448	kN	Kilonewton	N.A.*
N.A.*	Thousand Pounds per Square Inch	6.895	MPa	Megapascal	N.A.*

*Not used for units of measurement for payment.

TABLE OF CONTENTS

GENERAL DESCRIPTION.....	<u>i</u>
LOCATION.....	<u>i</u>
DESCRIPTION.....	<u>i</u>
COMPLETION TIME.....	<u>i</u>
PROSPECTIVE BIDDERS NOTES.....	<u>i</u>
CONSTRUCTION ITEMS UNITS OF MEASURE.....	<u>iii</u>
GENERAL NOTICES.....	<u>1</u>
SPECIFICATIONS.....	<u>1</u>
CLARIFICATIONS.....	<u>1</u>
ATTESTING TO NON-COLLUSION.....	<u>1</u>
QUANTITIES.....	<u>1</u>
PREFERENCE FOR DELAWARE LABOR.....	<u>1</u>
EQUALITY OF EMPLOYMENT OPPORTUNITY ON PUBLIC WORKS.....	<u>1</u>
TAX CLEARANCE.....	<u>2</u>
LICENSE.....	<u>2</u>
DIFFERING SITE CONDITIONS.....	<u>2</u>
RIGHT TO AUDIT.....	<u>3</u>
PREVAILING WAGES.....	<u>3</u>
STATE WAGE RATES.....	<u>5</u>
SUPPLEMENTAL SPECIFICATIONS.....	<u>6</u>
SPECIAL PROVISIONS.....	<u>7</u>
CONSTRUCTION ITEM NUMBERS.....	<u>8</u>
401502 - ASPHALT CEMENT COST ADJUSTMENT.....	<u>9</u>
202560 - CONTAMINATED MATERIAL.....	<u>10</u>
207500 - COFFERDAMS.....	<u>12</u>
605533 - CLEANING EXISTING STEEL STRUCTURES, HAZARDOUS BASE (L.S.).....	<u>13</u>
749687 - INSTALLATION OR REMOVAL OF TRAFFIC SIGN ON SINGLE SIGN POST.....	<u>41</u>
749690 - INSTALLATION OR REMOVAL OF TRAFFIC SIGN ON MULTIPLE SIGN POSTS.....	<u>42</u>
763501 - CONSTRUCTION ENGINEERING.....	<u>43</u>
UTILITY STATEMENT.....	<u>47</u>
RIGHT OF WAY CERTIFICATE.....	<u>50</u>
ENVIRONMENTAL STATEMENT.....	<u>51</u>
RAILROAD STATEMENT.....	<u>55</u>
BID PROPOSAL FORMS.....	<u>56</u>
DRUG TESTING AFFIDAVIT.....	<u>62</u>
CERTIFICATION.....	<u>63</u>
BID BOND.....	<u>65</u>

GENERAL NOTICES

SPECIFICATIONS:

The specifications entitled "Delaware Standard Specifications, for Road and Bridge Construction, August, 2001", hereinafter referred to as the Standard Specifications, Supplemental Specifications, the Special Provisions, notes on the Plans, this Bid Proposal, and any addenda thereto shall govern the work to be performed under this contract.

CLARIFICATIONS:

Under any Section or Item included in the Contract, the Contractor shall be aware that when requirements, responsibilities, and furnishing of materials are outlined in the details and notes on the Plans and in the paragraphs preceding the "Basis of Payment" paragraph in the Standard Specifications or Special Provisions, no interpretation shall be made that such stipulations are excluded because reiteration is not made in the "Basis of Payment" paragraph.

ATTESTING TO NON-COLLUSION:

The Department requires as a condition precedent to acceptance of bids a sworn statement executed by, or on behalf of, the person, firm, association, or corporation to whom such contract is to be awarded, certifying that such person, firm, association, or corporation has not, either directly or indirectly, entered into any agreement, participated in any collusion, or otherwise taken any action in restraint of free competitive bidding in connection with such contract. The form for this sworn statement is included in the proposal and must be properly executed in order to have the bid considered.

QUANTITIES:

The quantities shown are for comparison of bids only. The Department may increase or decrease any quantity or quantities without penalty or change in the bid price.

PREFERENCE FOR DELAWARE LABOR:

Delaware Code, Title 29, Chapter 69, Section 6962, Paragraph (d), Subsection (4)b:

"In the construction of all public works for the State or any political subdivision thereof, or by firms contracting with the State or any political subdivision thereof, preference in employment of laborers, workmen or mechanics shall be given to bona fide legal citizens of the State who have established citizenship by residence of at least 90 days in the State. Each public works contract for the construction of public works for the State or any political subdivision thereof shall contain a stipulation that any person, company or corporation who violates this section shall pay a penalty to the Secretary of Finance equal to the amount of compensation paid to any person in violation of this section."

EQUALITY OF EMPLOYMENT OPPORTUNITY ON PUBLIC WORKS:

Delaware Code, Title 29, Chapter 69, Section 6962, Paragraph (d), Subsection (7) states;

- a. As a condition of the awarding of any contract for public works financed in whole or in part by State appropriation, such contracts shall include the following provisions:

During the performance of this contract, the contractor agrees as follows:

- 1. The contractor will not discriminate against any employee or applicant for employment because of race, creed, color, sex, sexual orientation, gender identity or national origin. The contractor will take positive steps to ensure that applicants are employed and that employees are treated during employment without regard to their race, creed, color, sex, sexual orientation, gender identity or national origin. Such action shall include, but not be limited to, the following: employment, upgrading, demotion or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship. The contractor agrees to post in conspicuous places available to employees and applicants for employment notices to be provided by the contracting agency setting forth this nondiscrimination clause.

2. The contractor will, in all solicitations or advertisements for employees placed by or on behalf of the contractor, state that all qualified applicants will receive consideration for employment without regard to race, creed, color, sex, sexual orientation, gender identity or national origin.
3. The contractor will ensure employees receive equal pay for equal work, without regard to sex. Employee pay differential is acceptable if pursuant to a seniority system, a merit system, a system which measures earnings by quantity or quality of production, or if the differential is based on any other factor other than sex.

TAX CLEARANCE:

As payments to each vendor or contractor aggregate \$2,000, the Division of Accounting will report such vendor or contractor to the Division of Revenue, who will then check the vendor or contractor's compliance with tax requirements and take such further action as may be necessary to insure compliance.

LICENSE:

A person desiring to engage in business in this State as a contractor shall obtain a license upon making application to the Division of Revenue.

CONTRACTOR / SUBCONTRACTOR LICENSE: 29 DEL. C. §6967:

(b) No agency shall accept a proposal for a public works contract unless such contractor has provided a proper and current copy of its occupational and/or business license, as required by Title 30, to such agency.

(c) Any contractor that enters a public works contract must provide to the agency to which it is contracting, within 30 days of entering such public works contract, copies of all occupational and business licenses of subcontractors and/or independent contractors that will perform work for such public works contract. However, if a subcontractor or independent contractor is hired or contracted more than 20 days after the contractor entered the public works contract the occupational or business license of such subcontractor or independent contractor shall be provided to the agency within 10 days of being contracted or hired.

DIFFERING SITE CONDITIONS,

SUSPENSIONS OF WORK and SIGNIFICANT CHANGES IN THE CHARACTER OF WORK:

Differing site conditions: During the progress of the work, if subsurface or latent physical conditions are encountered at the site differing materially from those indicated in the contract or if unknown physical conditions of an unusual nature, differing materially from those ordinarily encountered and generally recognized as inherent in the work provided for in the contract are encountered at the site, the party discovering such conditions shall promptly notify the other party in writing of the specific differing conditions before they are disturbed and before the affected work is performed.

Upon written notification, the engineer will investigate the conditions, and if he/she determines that the conditions materially differ and cause an increase or decrease in the cost or time required for the performance of any work under the contract, an adjustment, excluding loss of anticipated profits, will be made and the contract modified in writing accordingly. The engineer will notify the contractor of his/her determination whether or not an adjustment of the contract is warranted.

No contract adjustment which results in a benefit to the contractor will be allowed unless the contractor has provided the required written notice.

No contract adjustment will be allowed under their clause for any effects caused on unchanged work.

Suspensions of work ordered by the engineer: If the performance of all or any portion of the work is suspended or delayed by the engineer in writing for an unreasonable period of time (not originally anticipated, customary or inherent to the construction industry) and the contractor believes that additional compensation and/or contract time is due as a result of such suspension or delay, the contractor shall submit to the engineer in writing a request for adjustment within 7 calendar days of receipt of the notice to resume work. The request shall set forth the reasons and support for such adjustment.

Upon receipt, the engineer will evaluate the contractor's request. If the engineer agrees that the cost and/or time required for the performance of the contract has increased as a result of such suspension and the

suspension was caused by conditions beyond the control of and not the fault of the contractor, its suppliers, or subcontractors at any approved tier, and not caused by weather, the engineer will make an adjustment (excluding profit) and modify the contract in writing accordingly. The engineer will notify the contractor of his/her determination whether or not an adjustment of the contract is warranted.

No contract adjustment will be allowed unless the contractor has submitted the request for adjustment within the time prescribed.

No contract adjustment will be allowed under this clause to the extent that performance would have been suspended or delayed by any other cause, or for which an adjustment is provided for or excluded under any other term or condition of this contract.

Significant changes in the character of work: The engineer reserves the right to make, in writing, at any time during the work, such changes in quantities and such alterations in the work as are necessary to satisfactorily complete the project. Such changes in quantities and alterations shall not invalidate the contract nor release the surety, and the contractor agrees to perform the work as altered.

If the alterations or changes in quantities significantly change the character of the work under the contract, whether or not changed by any such different quantities or alterations, an adjustment, excluding loss of anticipated profits, will be made to the contract. The basis for the adjustment shall be agreed upon prior to the performance of the work. If a basis cannot be agreed upon, then an adjustment will be made either for or against the contractor in such amount as the engineer may determine to be fair and equitable.

The term "significant change" shall be construed to apply only to the following circumstances:

- (A) When the character of the work as altered differs materially in kind or nature from that involved or included in the original proposed construction or
- (B) When a major item of work, as defined elsewhere in the contract, is increased in excess of 125 percent or decreased below 75 percent of the original contract quantity. Any allowance for an increase in quantity shall apply only to that portion in excess of 125 percent of original contract item quantity, or in case of a decrease below 75 percent, to the actual amount of work performed.

RIGHT TO AUDIT

The Department shall have the right to audit the books and records of the contractor or any subcontractor under this contract or subcontract to the extent that the books and records relate to the performance of the contract or subcontract. The books and records shall be maintained by the contractor for a period of 3 years from the date of final payment under the prime contract and by the subcontractor for a period of 3 years from the date of final payment under the subcontract (29 Del.C. §6930)

PREVAILING WAGES

Included in this proposal are the minimum wages to be paid various classes of laborers and mechanics as determined by the Department of Labor of the State of Delaware in accordance with Title 29 Del.C. §6960, relating to wages and the regulations implementing that Section.

REQUIREMENT BY DEPARTMENT OF LABOR FOR SWORN PAYROLL INFORMATION

Title 29 Del.C. §6960 stipulates;

- (b) Every contract based upon these specifications shall contain a stipulation that the employer shall pay all mechanics and laborers employed directly upon the site of the work, unconditionally and not less often than once a week and without subsequent deduction or rebate on any account, the full amounts accrued at time of payment, computed at wage rates not less than those stated in the specifications, regardless of any contractual relationship which may be alleged to exist between the employer and such laborers and mechanics. The specifications shall further stipulate that the scale of wages to be paid shall be posted by the employer in a prominent and easily accessible place at the site of the work, and that there may be withheld from the employer so much of accrued payments as may be considered necessary by the Department of Labor to pay to laborers and mechanics employed by the employer the difference between the rates of wages required by the contract to be paid laborers and mechanics on the work and rates of wages received by such laborers and mechanics to be remitted to the Department of Labor for distribution upon resolution of any claims.

(c) Every contract based upon these specifications shall contain a stipulation that sworn payroll information, as required by the Department of Labor, be furnished weekly. The Department of Labor shall keep and maintain the sworn payroll information for a period of 6 months from the last day of the work week covered by the payroll.

Bidders are specifically directed to note the Department of Labor's prevailing wage regulations implementing §6960 relating to the effective date of the wage rates, at Part VI., Section C., which in relevant part states:

"Public agencies (covered by the provisions of 29 Del.C. §6960) are required to use the rates which are in effect on the date of the publication of specifications for a given project. In the event that a contract is not executed within one hundred twenty (120) days from the date the specifications were published, the rates in effect at the time of the execution of the contract shall be the applicable rates for the project."

Contractor may contact:

Department of Labor, Division of Industrial Affairs, 4425 N. Market Street, Wilmington, DE 19802
Telephone (302) 761-8200

STATE OF DELAWARE
DEPARTMENT OF LABOR
DIVISION OF INDUSTRIAL AFFAIRS
OFFICE OF LABOR LAW ENFORCEMENT
PHONE: (302) 451-3423

Mailing Address:
225 CORPORATE BOULEVARD
SUITE 104
NEWARK, DE 19702

Located at:
225 CORPORATE BOULEVARD
SUITE 104
NEWARK, DE 19702

PREVAILING WAGES FOR HEAVY CONSTRUCTION EFFECTIVE MARCH 15, 2016

CLASSIFICATION	NEW CASTLE	KENT	SUSSEX
ASBESTOS WORKERS	21.82	19.20	41.74
BOILERMAKERS	75.62	31.72	58.19
BRICKLAYERS	46.43	22.91	24.60
CARPENTERS	52.81	52.81	41.97
CEMENT FINISHERS	43.05	24.05	17.91
ELECTRICAL LINE WORKERS	72.73	27.89	63.84
ELECTRICIANS	65.10	65.10	65.10
GLAZIERS	20.17	17.51	11.85
INSULATORS	54.38	54.38	54.38
IRON WORKERS	60.19	60.19	57.58
LABORERS	43.60	43.60	43.60
MILLWRIGHTS	66.83	66.83	53.40
PAINTERS	75.26	75.26	75.26
PILEDRIVERS	72.97	38.86	30.25
PLASTERERS	18.99	16.49	11.15
PLUMBERS/PIPEFITTERS/STEAMFITTERS	82.03	76.87	17.67
POWER EQUIPMENT OPERATORS	61.36	61.36	61.36
SHEET METAL WORKERS	30.35	18.82	17.68
SPRINKLER FITTERS	32.70	12.38	10.25
TRUCK DRIVERS	31.56	20.36	21.99

CERTIFIED: 4/28/2016

BY: *Dan H. Nelson* / for
ADMINISTRATOR, OFFICE OF LABOR LAW ENFORCEMENT

NOTE: THESE RATES ARE PROMULGATED AND ENFORCED PURSUANT TO THE PREVAILING WAGE REGULATIONS ADOPTED BY THE DEPARTMENT OF LABOR ON APRIL 3, 1992.

CLASSIFICATIONS OF WORKERS ARE DETERMINED BY THE DEPARTMENT OF LABOR. FOR ASSISTANCE IN CLASSIFYING WORKERS, OR FOR A COPY OF THE REGULATIONS OR CLASSIFICATIONS, PHONE (302) 451-3423.

NON-REGISTERED APPRENTICES MUST BE PAID THE MECHANIC'S RATE.

PROJECT: T201407501.01 Removal of BR 2-357P Pedestrian Bridge over St. Jones River , Kent County

**SUPPLEMENTAL SPECIFICATIONS
TO THE
AUGUST 2001
STANDARD SPECIFICATIONS**

**EFFECTIVE AS OF THE ADVERTISEMENT
DATE OF THIS PROPOSAL
AND INCLUDED BY REFERENCE**

**The Supplemental Specifications can be viewed and printed from
the Department's Website.**

To access the Website;

- in your internet browser, enter; <http://www.deldot.gov>
- on the left side of the page under 'INFORMATION', Click; 'Publications'
- scroll down under 'MANUALS' and Click; "Standard Specifications 2001"

The full Website Link is;

http://www.deldot.gov/information/pubs_forms/manuals/standard_specifications/index.shtml

Printed copies of the Supplemental Specifications are available upon request. A printed copy of the above referenced Supplemental Specifications will be included in the final contract documents upon award.

The Contractor shall make himself aware of these revisions and corrections (Supplemental Specifications), and apply them to the applicable item(s) of this contract.

SPECIAL PROVISIONS

CONSTRUCTION ITEM NUMBERS

All construction pay items are assigned a six (6) digit number, shown as Item Number on the Plans and/or in the Special Provisions, and shall be interpreted in accordance with the following:

Standard Item Number:

The first three digits of the construction item numbers indicates the Section number as described in the Standard Specifications, and all applicable requirements of the Section shall remain effective unless otherwise modified by the Special Provisions. The last three digits of the construction item identifies the item by sequential number under that Section. Sequential numbers for all items covered under Standard Specifications range from 000 to 499. A comprehensive list of construction item numbers begins on page 421 of the Standard Specifications. Additions to this list will be made as required.

Special Provisions Item Number:

The first three digits of the construction items, covered under Special Provisions, indicates the applicable Section number of the Standard Specifications, and shall be governed fully by the requirements of the Special Provisions. The last three digit of the items covered under Special Provisions identifies the item by sequential number. Sequential numbers for Special Provision items, range from 500 to 999.

Examples

Standard Item Number - 202000 Excavation and Embankment

202 Indicates Section Number

000 Indicates Sequential Number

Special Provision Item Number - 202500 Grading and Reshaping Roadway

202 Indicates Section Number

500 Indicates Sequential Number

NOTE:

PLEASE NOTE revised Supplemental Specifications to the August 2001 Standard Specifications were issued November 24, 2014 and apply to this project. They can be [viewed here](#) and at www.deldot.gov.

SPECIFICATIONS: The Department is currently updating the August 2001 Specifications for Road and Bridge Construction. Through this update, some Divisions were renumbered and some new ones were created and added. The *Specifications Note* document is for the use by the bidders to reference the new numbers to the past numbers used for bidding purposes on previous Department contracts.

401502 - ASPHALT CEMENT COST ADJUSTMENT

For Sections 304, 401, 402, 403, 404, and 405, payments to the Contractor shall be adjusted to reflect increases or decreases in the Delaware Posted Asphalt Cement Price when compared to the Project Asphalt Cement Base Price, as defined in these Special Provisions.

The Delaware Posted Asphalt Cement Price will be issued monthly by the Department and will be the industry posted price for Asphalt Cement, F.O.B. Philadelphia, Pennsylvania. The link for the posting is http://www.deldot.gov/information/business/bids/asphalt_cement_english.shtml.

The Project Asphalt Cement Base Price will be the Delaware Posted Asphalt Cement Price in effect on the date of advertisement.

All deviations of the Delaware Posted Asphalt Cement Price from the Project Asphalt Cement Base Price are eligible for cost adjustment. No minimum increases or decreases or corresponding percentages are required to qualify for cost adjustment.

Actual quantity of asphalt cement qualifying for any Asphalt Cement Cost Adjustment will be computed using the weight of eligible asphalt that is shown on the QA/QC pay sheets as a percentage for the delivered material.

If the mix was not inspected and no QA/QC pay sheet was generated, then the asphalt percentage will be obtained from the job mix formula for that mix ID.

The asphalt percentage eligible for cost adjustment shall only be the virgin asphalt cement added to the mix.

There shall be no separate payment per ton cost of asphalt cement. That cost shall be included in the various unit prices bid per ton for those bid items that contain asphalt cement (mentioned above).

The Asphalt cement cost adjustment will be calculated on grade PG 64-22 asphalt regardless of the actual grade of asphalt used. The Project Asphalt Cement Base Price per ton for the project will be the Delaware Posted Asphalt Cement Price in effect on the date of project advertisement.

If the Contractor exceeds the authorized allotted completion time, the price of asphalt cement on the last authorized allotted work day, shall be the prices used for cost adjustment during the time liquidated damages are assessed. However, if the industry posted price for asphalt cement goes down, the asphalt-cement cost shall be adjusted downward accordingly.

NOTE:

Application of Asphalt Cement Cost Adjustment requirements as indicated above shall apply only to those contracts involving items related to bituminous base and pavements, and with bitumen, having a total of 1,000 tons or more of hot-mix bid quantity in case of Sections 401, 402 and 403; and 15,000 gallons or more in case of Sections 304, 404 and 405.

5/05/15

202560 - CONTAMINATED MATERIAL

Description:

Contaminated Material is defined as solids or liquids (including soil) potentially contaminated with a hazardous substance, requiring special handling and/or disposal per state or federal regulation.

This work describes the excavation, removal and treatment/disposal of contaminated materials resulting from project construction including utility and other types of excavation activities in accordance with the locations and notes on the Plans, and as directed by the Engineer or the Department's environmental representative. The Contractor will be notified of the Department's environmental representative at the pre-construction meeting.

Overview of Costs:

Potential contaminated solids may affect contractor's costs as follows;

Additional cost to normal excavation requirements:

- Cost of 8 mil plastic for placement under and over solid contaminated material,
- Maintaining the segregated contaminated solids staging area.

Reduced cost to normal excavation requirements:

- Not required to, or charged for, transport of contaminated material from site.
- Not required to, or charged for, disposal of contaminated soil.

Potential contaminated liquids will affect contractor's cost as follows;

Additional cost to normal excavation requirements:

-None

Reduced cost to normal excavation requirements:

-None

Construction Methods and Responsibilities:

Contractor's Responsibilities for potential contaminated solids:

The Contractor shall be responsible for providing the appropriate equipment and personnel necessary to excavate, stage, and load contaminated material for off-site disposal, as identified from previous site environmental investigations or identified during construction activities. The work will be performed in accordance with the procedures described in the site specific "Contaminated Material and Water Removal Work Plan" prepared by the Department's environmental representative. The Department will provide a copy of this plan after the project is awarded and before any work begins. The Contractor shall adhere to applicable Occupational Safety and Health standards, Guidelines and/or Laws. This will include compliance with 29 CFR Part 1910.

After award of the Contract, the Contractor shall immediately be responsible for notifying the Department's HAZMAT Program Manager's office (760-2463) for scheduling coordination with the environmental representative. The contractor shall submit a proposed schedule of work to the Department for review and approval prior to any commencement of work on this site. The Contractor is required to perform to a high standard of workmanship to assure protection of workers, local water supplies, and the environment. The Contractor shall coordinate with the utility companies prior to excavation. The Department's environmental representative shall be present during all phases of work associated with the excavation and removal of potentially contaminated material. Payment will not be made for any work done when a Department approved Inspector or environmental representative is not present to provide environmental oversight.

Specific tasks to be performed by the Contractor will include excavating soil per the project specifications. The Contractor will segregate "contaminated" soil as designated by the Department or their environmental representative, from "clean" soil and place the "contaminated" soil in a designated on-site staging area constructed by the Contractor. At a minimum the staging area needs to be lined with 8-mil plastic and a berm constructed to minimize storm water run-off. The "contaminated" soil will need to be covered by the Contractor at the end of each work day. The Contractor will be responsible for loading

contaminated soil onto trucks arranged by the Department's environmental representative on the days the contaminated soil is shipped off-site to a licensed disposal/treatment facility. The Contractor will backfill and compact the excavated area(s) according to the project specifications and payment will be made under that item of the Contract.

Department's Responsibilities:

The Department is responsible for providing and paying; the environmental representative; the transportation of contaminated material for disposal; and the disposal of contaminated material.

The "Contaminated Material and Water Removal Work Plan" will identify; the procedures to be used to excavate and stage the contaminated material; the licensed treatment/disposal facility where the Department will ship the contaminated material; the method the material will be transported to the treatment/disposal facility; and any additional health and safety requirements for site personnel.

The Department's environmental representative will conduct a health and safety briefing prior to commencement of activities on the sites to insure an understanding of all applicable standards, guidelines, laws, procedures, etc. consistent with the successful completion of this type of activity. The Department's environmental representative will conduct air monitoring during any excavation activities at the site to identify and mitigate fire, explosion and vapor hazards.

The Department's environmental representative shall coordinate the excavation activities with all applicable local, state, and federal environmental regulatory agencies. The Department's environmental representative will also oversee the excavation, removal and treatment/disposal of the material in the designated area(s) and perform such tests as field screening for soil contamination utilizing vapor monitoring techniques and collect soil samples for laboratory analysis to meet the requirements of the treatment/disposal facility, DNREC and/or the USEPA. The Department's environmental representative's personnel will subcontract with the disposal/treatment facility to provide transportation and disposal/treatment of all contaminated materials to be removed as part of the project. The Department's environmental representative is responsible for measuring the quantity of contaminated material removed, via certified scale weights, for the Department's records.

Method of Measurement:

The quantity of contaminated material will not be measured. It will be included in the excavation quantity.

Basis of Payment:

No additional payment will be made for the handling of contaminated material included in the excavation quantities. Contractor's costs for handling contaminated material as described herein are to be included in the standard excavation pay items included in this contract, and will constitute full compensation for excavation, constructing and maintaining the segregated soil staging area, placement of the contaminated soil in the staging area, providing plastic and daily covering of the segregated soil staging area, and loading of contaminated soil for removal by the Department.

This item is a contingency item and the Department reserves the right to delete from the Contract. The Contractor shall make no claims for additional compensation because of deletion of the item.

04/04/2014

207500 - COFFERDAMS

Description:

This work consists of furnishing all materials, designing and constructing cofferdams in accordance with the notes on the Plans, this Special Provision and as directed by the Engineer.

Materials:

The type of cofferdam to be constructed shall be selected by the Contractor, however, the design and construction shall be in accordance with the applicable requirements of Section 207 of the Standard Specifications.

Construction Methods:

The Contractor shall submit to the Department's Bridge Section and Stormwater Section for approval, design calculations, detailed layout, working drawings and construction methods, for cofferdam or for other diversion structure as shown on the Plans at least two weeks prior to initiating its construction. The entire submission shall be signed and sealed by a Professional Engineer registered in the State of Delaware prior to submitting to the Department. The Contractor may submit for approval, proprietary diversion device(s) such as PORTADAM or AQUA-BARRIER or approved equal.

Basis of Payment:

The quantity of cofferdams will be paid for at the Contract lump sum. Price and payment will constitute full compensation for furnishing and placing all materials, for design, submission of signed and sealed drawings, installation and removal of materials for cofferdam or any other device(s) used, any excavation in excess of that required for the structure as defined under Subsection 207.06 of the Standard Specifications, unless otherwise covered for payment on the Plans under a different Section, bailing, pumping and draining, sheeting, shoring, for all labor, equipment, tools and incidentals required to complete the work.

12/10/12

605533 - CLEANING EXISTING STEEL STRUCTURES, HAZARDOUS BASE (L.S.)
605629 - CLEANING EXISTING STEEL STRUCTURES, HAZARDOUS BASE (S.F.)

Description:

This work consists of cleaning the entire existing steel structure(s) or a part of it as noted on the Plans; collection; stabilization; and transportation of the "spent material" (rust particles, paint particles and dust, material assumed to be hazardous waste), resulting from cleaning operations, to an approved disposal site(s). The work under this item shall be performed in accordance with these Special Provisions and attached Appendix A.

Prior to the beginning of paint removal work, the Contractor shall set forth in detail and submit to the Delaware Department of Transportation (hereinafter referred to as Department), for approval, the proposed containment system (mini-containment system when only a part of the structure is to be cleaned as required) for complete capture, containment, collection and disposal of the "spent material" generated from paint removal work and testing by an outside laboratory, approved by the Department. The system shall be in compliance with these specifications, State, United States Environmental Protection Agency (EPA) and Occupational Safety and Health Act (OSHA) and other regulatory agencies with jurisdiction, rules, regulations, standards and guidelines in effect while the work is in progress. Upon approval, the plan shall be implemented to capture, contain, collect, and dispose of all "spent material".

The Contractor shall not begin cleaning and/or blasting operation until he/she has submitted final documentation that he/she has an approved disposal site and permits for the handling, storing, and transporting of hazardous waste and nonhazardous waste; and shall be responsible to protect the environment, workers, and the public from toxic substances resulting from the paint removal operations.

Pre-Bid Conference:

Prior to the bid opening, a date will be set if deemed necessary by the Contract Administration (bidder will be notified at the time of purchasing contract documents) for a pre-bid conference to alert the potential bidder to comply with the directives established by the OSHA, EPA and the State of Delaware during and after the execution of this item. It is recommended that the bidder (Prime Contractor) brings his/her Sub-Contractor to be engaged in removing the paint if he/she cannot perform the work of this item.

Materials:

The Contractor shall use recyclable metallic shot and metallic grit meeting the requirements of SSPC AB2 and SSPC AB3 as abrasive materials for removing paint.

Other removal and cleaning methods after approval may be used by the Contractor provided he/she can demonstrate that the proposed method satisfies all the safety and environmental requirements of this specification and provides a cleaned surface satisfactory to the Engineer.

Construction Requirements:

Containment System:

Prior to commencing any cleaning operations, the Contractor shall prepare a Cleaning Contaminant System for the capture, containment, collection and storage of the waste generated by the work, which includes abrasive blasting residue, spent blasting mediums, rust, paint particles, dust, etc.

The Containment System must be capable of containing the waste and resulting residue generated by the work. The Contractor shall strive to achieve total containment (100%); and is required to meet all Federal, State, City and Local regulations using the best available technology as applicable to each bridge site. The Containment System shall meet the requirements of SSPC Guide 6, Class 1A. Visible emissions in excess of SSPC Guide 6, Level 1 (one percent in the work day) shall be cause for immediate shut down until corrections are made. While on the site, tarps shall be held securely in place, and kept sealed at all times during water blasting, paint removal and painting.

For bridges over water, the Containment System shall include a skimming boom consisting of a float with a skirt to collect floating debris. Also, an approved capturing device such as floating curtain, screen or tarp shall be placed under and down wind of the bridge to catch rust, sand and paint particles; and the waste material collected on the capturing device shall be cleaned daily.

Prior to commencing work the Contractor must submit working drawings of the proposed containment system to the Department within 14 days from Notice of Award. The Department will review the drawings and evaluate the system as to its effect on the loading capacity of the existing structure. The Contractor shall also submit the design of the systems to be employed, including an analysis of the dead, live and wind loads which will be added to the existing structure by the containment system and blast waste. The load analysis shall be performed and stamped by a licensed Professional Engineer registered in the State of Delaware and experienced in bridge analysis. The analysis shall assure that the system will not induce a load on the bridge which will create an overstress condition or otherwise effect the structural integrity of the bridge. For bridges 23 feet (7 meters) or greater in height, the containment system submittals shall include a safety net meeting OSHA requirements in 29 CRF 126.105, 29 CRF 126.106, and 29 CRF 126.104. For bridges less than 23 feet (7 meters) in height, the submittals shall include necessary safety measurements such as safety harnesses, lifelines and lanyards meeting OSHA requirements in 29 CRF 126.104. In no case shall the containment system, safety devices, or equipment encroach upon the minimum bridge clearances shown on the Plans, unless otherwise approved by the Engineer.

The following guidelines shall be followed by the Contractor in preparing the Containment Drawing Plans. However, the Contractor may submit for approval a self-contained and self supporting blast and recovery system as an alternative option for removing the paint:

1. Working drawings with Professional Engineer Seal shall be submitted by the Contractor meeting the requirements of Subsection 105.04 of the Standard Specifications.
2. The working drawings shall show Containment System in plan & elevation views including details of clips and hangers.
3. The working drawings shall indicate maximum permissible load of abrasive or waste permitted on the Containment System.
4. The working drawings shall indicate if vehicles with abrasive and waste will be permitted on the bridge; if so indicate allowable load and locations. Vehicle and equipment loads may not be permitted behind abutments if surcharging results.
5. The working drawings shall indicate all restrictions on bridge including any load posting.
6. Permanent attachments or fasteners to the bridge will not be permitted.
7. The working drawings shall show the location(s) of skimming boom(s) if the bridge is over water.
8. The working drawings shall identify all containment system components; and shall indicate all rigid framework, work platform and scaffolding.
9. All curtains, screens or tarps used for containment shall be weighted down.
10. No load shall be attached to the bridge railings unless railing is in good condition, and details and calculations showing loading are approved by the Department.

With submission of the Containment System Drawing, the Contractor shall be required to develop and submit for approval an Effective Safety Program to be followed during the paint removal period. The Contractor's employees, before being engaged in paint removal work, must have proper training in accordance with the OSHA General Industry Standard.

The review and acceptance of the working drawings by the Department shall in no way relieve the Contractor of any responsibility for obtaining the required degree of capture, containment and collection.

Cleaning of Containment System must be properly maintained while work is in progress and shall not deviate from the approved working drawings without prior approval of the Engineer. Air within the containment structure shall be exhausted rapidly to maintain a slight negative pressure, so that outside air is drawn in through specifically designed openings rather than having contaminated air leaking from inside the containment. Also, sufficient fresh air must be circulated so that dust is reduced to enable good visibility for the operator. Public access to all rigging, scaffolding and the containment systems must be denied at all times.

Air Monitoring for PM 10 and TSP Lead:

The intent of the monitoring requirements in this specification is for the Contractor to establish a baseline background reading for the area(s) in proximity to steel cleaning. This specification also requires the Contractor to perform all of the testing required to ensure that lead particles are adequately contained and captured by the Contractor's steel cleaning operations. All costs associated with this work are included in the Contractor's bid price.

The Contractor shall engage a consultant responsible for conducting air monitoring work during the operation of the paint removal period; monitoring shall be conducted on the area downwind of the lead control area. The qualification of the consultant shall be approved by the Department prior to his/her engagement in air monitoring service. The air quality standard shall be monitored in accordance with National Ambient Air Quality Standards (NAAQS). At a minimum this containment system shall achieve a SSPC level 1 Standard Emissions level.

Baseline Monitoring shall take place at each structure where the Contractor is required to clean the existing steel in order to establish preconstruction background readings for the area(s) involved. Baseline Monitoring shall occur for a minimum of 3 consecutive calendar days before the steel cleaning begins. The Contractor shall conduct the monitoring so that the monitored hours match the proposed work schedule for the contract, including nightwork. The minimum duration of the monitoring for each calendar day must be 8 hours, regardless of the Contractor's proposed work schedule. The required sampling type shall be 2 (two) PM-10 and 2 (two) TSP-Lead and the Engineer must approve the locations of the sampling. During lead paint removal, air monitoring shall commence just prior to the start of any lead removal operation and shall continue whenever the contractor is cleaning steel under this item. The required sampling type shall be PM-10 and TSP-Lead and the Engineer must approve the locations of the sampling. If problems with containment occur, the Engineer will require the air monitoring to be reinstalled at the Contractor's expense.

The acceptance level for PM 10 (particles with an aerodynamic diameter less than or equal to a nominal 10 micrometers) shall be 150 micrograms per cubic meter of air for 24-hour average concentration (450 micrograms per cubic meter of air over an eight-hour period assuming no emissions occur from the project for the remaining 16 hours).

The acceptance level for Total Suspended Particulate Matter (TSP) lead emissions shall be 1.5 micrograms per cubic meter of air averaged over a calendar quarter of the year, which can be converted as noted below to achieve daily lead level allowance during the project operation.

$$DA = \frac{90}{PD} \times 1.5 \mu\text{g}/\text{m}^3, \text{ where}$$

DA = Daily Allowance ($\mu\text{g}/\text{m}^3$)

PD = Number of paint removal operation days anticipated in a 90-day period.

For example, if it is expected that 30 days out of 90 will be worked, the TSP lead emission criteria for each of those days would be $4.5 \mu\text{g}/\text{m}^3$, over a 24-hour period ($90/30 \times 1.5$). However, since the paint removal operation will not continue for the full 24 hours, this level of emissions can be increased using the following formula:

$$ADA = DA \times \frac{24}{H}, \text{ where}$$

ADA = Adjusted Daily Allowance ($\mu\text{g}/\text{m}^3$)
H = Hours worked in 24 hours.

Using the above example, if the paint removal operation is continued for eight hours out of each 24-hour workday, the ADA will be $13.5 \mu\text{g}/\text{m}^3$ ($4.5 \mu\text{g}/\text{m}^3 \times 24/8$). Thus, $13.5 \mu\text{g}/\text{m}^3$ could be emitted during the eight hours of work, provided no emissions occur during the remaining 16 hours.

The size of the containment system shall be a work area approximately equivalent to what a work crew can blast clean, inspect, paint and move in a 24 hour period. The Engineer may permit a larger containment system if the Contractor can demonstrate that such a system will increase productivity and not interfere with the flow of traffic. When dust leaks are noted in the containment system, repairs shall be made as soon as possible.

If at any time during the execution of the work, the cleaning containment system fails to function at the required level of efficiency, the Contractor must immediately suspend all operations except those intended to minimize the adverse impact to the environment. Operations shall not resume until modification have been made to correct the cause of the failure.

The Contractor shall have a full time hygienist on the job site during lead paint removal activities to insure required hygiene procedures are being followed.

Cleaning:

All structural steel surfaces shall be cleaned and free of all rust, rust scale, mill scale, paint or other foreign matter in accordance with the requirements of SSPC-SP10.

Should the Contractor elect to use wet or water-vapor sandblasting, the water shall contain 0.32 percent of sodium nitrate and 1.28 percent by weight of ammonium phosphate for the purpose of inhibiting the development of rust.

No visible lead containing residue, debris, or paint chips shall remain or be present outside the containment area upon the completion of the abatement cleanup. Visible lead containing residue, debris, or paint chips outside the containment area shall be cleaned up immediately.

The type of containment systems used when cleaning steel shall be Class 1A for abrasive blasting and Class 2P for Power Tool Cleaning as per SSPC - Guide 6 "Guide for Containing Debris Generated During Paint Removal Operations".

Collection, Storage and Disposal of Hazardous and Non-Hazardous Waste:

All waste discharged and collected from the Containment System must be protected in a manner so as to prevent migration of the waste into the environment; and the Contractor shall abide by all Federal and State regulations relating to collection, storage and disposal of the hazardous waste and solid waste.

The Contractor shall provide a clean up area with soap, water and container for collection and disposing of the hazardous waste at each work site. The Contractor shall obtain a permit for hauling the hazardous waste from the State Department of Natural Resources and Environmental Control (DNREC).

Each day the Contractor shall collect and contain waste material in sealed 55 gallon (208 liter) open head type drums (I.C.C. Specification 17-H). All drums shall be in new condition and approved for use by the Engineer. Drums shall be labeled with the words "HAZARDOUS WASTE" and tagged in accordance with all State regulations including bridge number, Contract number, Contractor's name, contents and the date when waste accumulation in the drum begins. No more than 29 drums of hazardous material shall be kept at the site of each bridge.

The waste to be placed in drums also includes all filters used in abrasive blasting equipment and vacuum power tools for removing hazardous and nonhazardous paint waste; these filters shall be removed when the Contract is complete. At the end of the Contract all such filters shall be removed from equipment used on the project and placed in drums with other hazardous waste for proper disposal.

At the end of each working day the Contractor shall haul the waste material contained and collected to an approved temporary secure accumulation site. This site must be approved by the Engineer and be maintained in a secured condition by the Contractor. Hauling of hazardous waste must be performed by a license hauler.

The accumulation site must be capable of preventing the migration of the lead contaminated waste material into the environment. The accumulation area must also provide protection from vandalism and unauthorized access by the general public. At the completion of the work and in the presence of the Engineer, the Contractor shall take representative samples of the accumulated residues collected at each bridge.

The storage site must be capable of preventing the migration of the lead contaminated waste material into the environment. The storage area must also provide protection from vandalism and unauthorized access by the general public. At the completion of the work, the Contractor shall take representative samples of the accumulated residues collected at each bridge to be analyzed for lead content.

Samples exceeding 5 PPM (parts per million) according to the Toxicity Characteristics Leaching Procedure (TCLP) test shall be considered a hazardous waste and disposed of as hazardous waste. If the sample's toxicity level has dropped to 5 ppm or less, then the waste can be transported and disposed of as industrial waste, provided it is stabilized.

In order to stabilize the industrial waste (below the toxicity level), a slurry made from Portland Cement (10% of waste by volume) and water (50% of cement by volume) shall be added to the waste and thoroughly mixed at the disposal site by the licensed hazardous waste hauler. In no case shall blasting debris or dust collector waste be directly disposed of as an industrial waste. They shall either be stabilized or disposed of as a hazardous waste, irrespective of the results of the TCLP Test.

The samples shall be delivered to a laboratory approved by the Department for testing according to the Toxicity Characteristic Leaching Procedure (TCLP). Should test results indicate and if the contaminants listed in the following are above their respective regulatory limits, the residue shall be deemed a hazardous waste, and must be treated before disposal.

EPA HAZARDOUS WASTE NO.	CONTAMINANT	CAS NO.	REGULATORY LEVEL (mg/L)
D004	Arsenic	7440-38-2	5.0
D005	Barium	7440-39-3	100.0
D006	Cadmium	7440-43-9	1.0
D007	Chromium	7440-47-3	5.0
D008	Lead	7439-92-1	5.0
D009	Mercury	7439-97-6	0.2
D010	Selenium	7782-49-2	1.0
D011	Silver	7440-22-4	5.0

The Contractor shall remove from the accumulation site all treated waste within 90 days from the date of accumulation; and be transported to an industrial dump facility approved by the Delaware Department of Natural Resources and Environmental Control for disposal of such waste. A copy of the completed waste manifest (signed and dated by the Contractor and the Engineer at the site) shall be forwarded to the Department.

Method of Measurement:

For item 605533, the quantity of cleaning existing steel structures will not be measured. For item 605629, the quantity of cleaning existing steel structures will be measured by the square foot (square meter) of area cleaned and accepted.

Basis of Payment:

For item 605533, the quantity of cleaning existing steel structures will be paid for at the Contract lump sum. For item 605629, the quantity of cleaning existing steel structures will be paid for at the Contract unit price per square foot (square meter).

Price and payment shall constitute full compensation for furnishing and installing all materials, working drawings and Professional Engineer's service, Containment System, collection and temporary storage of the waste material as required, air monitoring service including consulting services, testing materials for contaminants, cleaning the structure, revisions and resubmissions of the Containment Plan and or Systems that may be required during the execution of the work, for providing respiratory protection and protective clothing to the worker and Departments employee at the time of inspection, hygiene facilities, for stabilizing the hazardous material and transporting and disposing of the stabilized waste complying with all the requirements as described herein in these special provisions, for all labor, equipment, tools and necessary incidentals to complete the work.

NOTE

The latest issue, revision, or amendment of the references noted below shall govern in execution of this item unless otherwise noted. **If there is a conflict between the attached Appendix A of this Special Provisions and the references noted below, the latter shall prevail.**

1. Steel Structures Painting Council (SSPC) Standards

SSPC-AB2	Specification for Cleanliness of Recycled Ferrous Metal Abrasive
SSPC-AB3	Specification for Newly Manufactured Steel Abrasive.
SSPC-QP 1	Standard Procedure for Evaluating Qualifications of Painting Contractors
SSPC Guide 6I	Guide for Containing Debris Generated During Lead Paint Removal Operations
SSPC Guide 7 (DIS)	Guide for the Disposal of Lead-Contaminated Surface Preparation Debris

2. U.S. Government Code of Federal Regulations

- 29 CFR, Part 1926.62, Safety and Health Regulations for Construction
- 40 CFR, Subchapter I, "Solid Wastes" (parts 260-263, and 268)

3. American National Standards Institute (ANSI)

ANSI/ASC Z9.4 For Exhaust Systems Abrasive Blasting Operations -- Ventilation and Safe Practice

4. State of Delaware

- 7 Del. C., chapter 63 - Hazardous Waste Management Act
- The Delaware Regulations Governing Hazardous Waste (DRGHW)
- 7 Del. C., Chapter 60 - Delaware Water and Air Resources Act
- The Delaware Regulations Governing Solid Waste (DRGSW)

SPECIAL NOTICE TO CONTRACTORS

The following documentation will be required with the Bid Proposal Form. If this documentation is not submitted with the bid, the bid will be considered Non-responsive.

Proof is required that the Prime Contractor, if he/she is performing the cleaning/painting operation, and any cleaning/painting Subcontractors are certified by the Steel Structures Painting Council (SSPC) Painting Contractor Certification Program (PCCP) QP-1 and QP-2. Such certification shall be for the duration of the project.

3/17/09

APPENDIX A

OCCUPATIONAL SAFETY AND HEALTH STANDARD FOR OCCUPATIONAL EXPOSURE TO LEAD DURING CONSTRUCTION

The regulations specified under the following topics and as described herein shall be followed by the Contractor, engaged in removing and cleaning lead base paint from the steel structures. This Appendix is considered as part of the Special Provisions for Items 605629 and 605533 - Cleaning Existing Steel Structures and 605614 and 605618 - Cleaning Existing Steel Structures with Vacuum Power Tools.

- .01 Scope and Application
- .02 Definitions
- .03 Permissible Exposure Limit (PEL)
- .04 Initial Determination and Exposure Monitoring
- .05 Methods of Compliance
- .06 Respiratory Protection
- .07 Protective Work Clothing and Equipment
- .08 Housekeeping
- .09 Hygiene Facilities and Practices
- .10 Medical Surveillance Program
- .11 Medical Examinations and Consultations
- .12 Medical Removal Protection
- .13 Employee Information and Training
- .14 Signs
- .15 Recordkeeping
- .16 Observation of Monitoring

.01 Scope and Application

- A. This Appendix applies to occupational exposure to lead of every employee engaged in construction work. Each employer shall protect the employment and places of employment of each employee engaged in construction work by complying with the Appendix.
- B. Compliance with this Appendix does not preclude or preempt the applicability of any other regulations or standards.

.02 Definitions

For the purpose of this Appendix certain words and terms are defined as follows.

- A. Lead
 - (1) "Lead" means metallic lead, all inorganic lead compounds, and organic lead soaps.
 - (2) "Lead" does not include any other organic lead compounds.

- B. "PEL" means Permissible Exposure Limit.
- C. "TWA" means Time Weighted Average.
- D. All references to "the Employer" herein shall mean "the Contractor", and all references to the Employee(s) shall mean "the Department's and Contractor's Employees".

.03 Permissible Exposure Limit (PEL)

- A. The employer shall ensure that no employee is exposed to lead at concentrations greater than 50 micrograms per cubic meter of air averaged over an 8-hour period.
- B. When an employee is exposed to lead for more than 8 hours in any work day, the employer shall use the following formula to reduce the permissible exposure limit, as a time weighted average (TWA) for that day: Maximum permissible limit (in micrograms/cubic meter) = 400 divided by hours worked in the day.
- C. Respirators. When respirators are used to supplement engineering and work practice controls to comply with the PEL and in accordance with the requirements of Regulation .06, the employer, for the purpose of determining compliance with the PEL, may:
 - (1) Consider employee exposure to be at the level provided by the protection factor of the respirator for those periods the respirator is worn; and
 - (2) Average those periods with exposure levels during periods when respirators are not worn to determine the employee's daily TWA exposure.

.04 Initial Determination and Exposure Monitoring

A. General

- (1) For the purpose of this regulation, employee exposure is that exposure which would occur if the employee were not using a respirator.
- (2) Personal Samples.
 - (a) With the exception of monitoring under Section C, below, the employer shall collect personal samples for the entire time during the shift when lead exposure may occur.
 - (b) The personal samples shall:
 - (i) Include at least one sample for every job classification in each work area during each shift; and
 - (ii) Be representative of the monitored employee's regular, daily exposure to lead.

B. Initial Determination.

- (1) An employer having a jobsite covered by this chapter shall determine before the beginning of potential exposure to lead if an employee may be exposed to lead at or above the PEL level.
- (2) Written record.
 - (a) The employer shall:
 - (i) Make a written record of the determination; and
 - (ii) Post the record in a place accessible to employees.
 - (b) At a minimum, the record shall include:

- (i) The information specified in Section C, below;
- (ii) The date of determination;
- (iii) Location of the jobsite;
- (iv) Process;
- (v) Materials;
- (vi) Location within the jobsite; and
- (vii) The name and social security number of employees monitored.

C. Basis of Initial Determination.

The employer shall base an initial determination on any of the following, relevant considerations:

- (1) Information, observation, calculations, or anticipated operations which indicate employee exposure to lead;
- (2) Previous measurements of airborne lead and analytical methods meeting the criteria of Section I, below; and
- (3) Other indications of potential lead exposure.

D. Positive Initial Determination and Initial Monitoring.

- (1) When a determination conducted under Sections B and C, above, shows the possibility of employee exposure at or above the PEL level, the employer shall conduct exposure monitoring immediately at the start of the operation which may involve lead exposure.
- (2) The monitoring shall be representative of the exposure for each employee in the workplace who is exposed to lead.
- (3) When the type of jobsite, process, and materials involved has not changed, measurements of airborne lead, taken in accordance with Section I, below, and made during the preceding 12 months may be used to satisfy this requirement.

E. Negative Initial Determination.

When the employer determines, in accordance with Sections B and C, above, that no employee is exposed to airborne concentrations of lead at or above the PEL level, the employer shall make a written record of the determination in accordance with Section B.

F. Frequency.

Except as required by Section G, below, when the initial determination or subsequent monitoring reveals employee exposure:

- (1) Above the PEL, the employer shall conduct monitoring quarterly until at least two consecutive measurements, taken at least 7 days apart, are at or below the PEL.

G. Additional Monitoring.

- (1) When there is either a production, jobsite, material, process, control, or personnel change which may result in new or additional lead exposure or any other reason to suspect a change, which may result in new or additional exposures to lead, the employer shall conduct additional monitoring in accordance with this chapter.

- (2) When an employee complains of symptoms which may be attributable to exposure to lead, the employer shall conduct personal monitoring representative of the exposure to each employee in the affected job classification or performing the same operation who may be exposed to lead.

H. Employee Notification.

- (1) Within 5 working days of the receipt of any monitoring results, the employer shall notify each employee in writing of the results which represent that employee's exposure.
- (2) Whenever the results indicate that the representative employee exposure, without regard to respirators, exceeds the PEL, the employer shall include in the written notice:
 - (a) A statement that the PEL was exceeded; and
 - (b) A description of the corrective action that has been, or will be, taken to reduce exposure to a level at or below the PEL.

I. Accuracy of Measurement.

The employer shall use a method of monitoring and analysis which has an accuracy, to a confidence level of 95 percent, of not less than plus or minus 20 percent for airborne concentrations of lead equal to or greater than 50 micrograms/cubic meter averaged over an 8-hour period.

.05 Methods of Compliance

A. Engineering and Work Practice Controls.

- (1) When any employee is exposed to lead above the PEL, the employer shall implement engineering and work practice controls, including administrative controls, to reduce and maintain employee exposure to lead, except to the extent that the employer can demonstrate that these controls are not feasible.
- (2) When the engineering and work practice controls which can be instituted are not sufficient to reduce employee exposure to a level at or below the PEL, the employer shall:
 - (a) Use them to reduce exposure to the lowest feasible level; and
 - (b) Supplement them by the use of respiratory protection which complies with the requirements of Regulation .06.

B. Compliance Program

- (1) Each employer shall establish and implement a written compliance program to reduce exposure.
- (2) Written Program. The written compliance program shall, at a minimum, include:
 - (a) A description of each operation in which lead is expected, including
 - (i) Equipment used,
 - (ii) Materials used,
 - (iii) Controls in place,
 - (iv) Crew size,
 - (v) Employee job responsibilities,
 - (vi) Operating procedures, and
 - (vii) Maintenance practices;

- (b) A description of the specific means that will be employed to achieve compliance;
 - (c) A report of the technology considered in meeting the PEL;
 - (d) A work practice program which includes items required under Regulations .07,.08, and .09;
 - (e) The administrative control schedule required by Section C, if applicable; and
 - (f) Other relevant information.
- (3) Written programs shall be:
- (a) Submitted upon request to the Department; and
 - (b) Available at the jobsite for examination and copying by the Department, any affected employee, or authorized employee representative.
- (4) At least every 6 months, the employer shall:
- (a) Review the written compliance program; and
 - (b) If necessary, revise it to reflect the current status of the program.

C. Administrative Controls.

If administrative controls are used as a means of reducing employee TWA lead exposure, the employer shall establish and implement a job rotation schedule which includes:

- (1) The name or identification number of each affected employee;
- (2) The duration and the exposure level at each job or work station where an affected employee is located; and
- (3) Any other information which may be useful in assessing the reliability of administrative controls in reducing exposure to lead.

.06 Respiratory Protection

A. General.

- (1) When this chapter requires the use of respirators, the employer shall:
 - (a) Provide respirators that comply with the requirements of this regulation, at no cost to the employee; and
 - (b) Ensure their use.
- (2) Respirators shall be used:
 - (a) During the time period necessary to install or implement engineering or work practice controls;
 - (b) In a work situation in which engineering and work practice controls are not sufficient to reduce exposure to a level at or below the PEL; and
 - (c) Whenever an employee requests a respirator.

B. Respirator Selection.

- (1) When a respirator is required under this chapter, the employer shall select the appropriate respirator or combination of respirators in accordance with this section from Table I. Respiratory Protection for Lead Aerosols.
- (2) Powered Air-Purifying Respirators: The employer shall provide a powered air-purifying respirator instead of the respirator specified in Table I Respiratory Protection for Lead Aerosols whenever:
 - (a) An employee chooses to use this type of respirator; and
 - (b) This respirator will provide adequate protection to the employee.
- (3) The employer shall select respirators from among those approved for protection against lead dust, fume, and mist by the Mine Safety and Health Administration (MSHA) and the National Institute for Occupational Safety and Health (NIOSH) under the provisions of 30 CFR Part II.

C. Respirator Usage.

- (1) The employer shall ensure that the respirator issued to the employee:
 - (a) Exhibits minimum facepiece leakage; and
 - (b) Is fitted properly.
- (2) Fit Test.
 - (a) For each employee wearing a negative pressure respirator, the employer shall perform either a quantitative or qualitative face fit test:
 - (i) At the time of initial fitting; and
 - (ii) Minimally, every 6 months after that.
 - (b) The qualitative fit test:
 - (i) May be used only to test the fit of a half-mask respirator when it is otherwise permitted to be worn; and
 - (ii) Shall be conducted in accordance with the directive set in 29 CFR 1926.62.
- (c) The tests shall be used to select facepieces that provide the protection prescribed in Table I. Respiratory Protection for Lead Aerosols.

TABLE I. RESPIRATORY PROTECTION FOR LEAD AEROSOLS

Airborne concentration of lead or condition of use	Required respirator ¹
Not in excess of 0.5 milligram/cubic meter (10X PEL).	Half-mask, air-purifying respirator equipped with high efficiency filters. ^{2,3}
Not in excess of 1.25 milligram/cubic meter (25 x PEL)	Hood or helmet supplied air respirator operated in a continuous flow mode.
Not in excess of 2.5 milligram/cubic meter (50X PEL).	(1) Full facepiece, air-purifying respirator with high efficiency filters. ³

	(2) Any powered, air-purifying respirator with high efficiency filters. ³
Not in excess of 50 milligram/cubic meter (1000x PEL).	Half-mask, supplied-air respirator operated in positive-pressure mode ² .
Not in excess of 100 milligrams/cubic meter (2000X PEL).	Supplied-air respirators with full facepiece, hood, helmet, or suit, operated in positive pressure mode.
Greater than 100 milligrams/cubic meter, unknown concentration or fire fighting.	Full facepiece, self-contained breathing apparatus operated in positive-pressure mode.

¹Respirators specified for high concentrations can be used at lower concentrations of lead.

²Full facepiece is required if the lead aerosols cause eye or skin irritation at the use concentrations.

³A high efficiency particulate filter means 99.97 percent efficiency against 0.3 micron size particles. Certain Specific Type CE blast helmets can be used in atmospheres that are 1000x PEL.

(3) If an employee exhibits difficulty in breathing during the fit test or during use, the employer shall make available to the employee an examination in accordance with Regulation .11A(2) to determine whether the employee can wear a respirator while performing the required duty.

D. Respirator Program.

- (1) The employer shall institute a respiratory protection program in accordance with the applicable section(s) of 29 CFR 1926.62, 29 CFR 1926.1127, and 29 CFR 1910.134.
- (2) The employer shall:
 - (a) Permit an employee who uses a filter respirator to change the filter elements when an increase in breathing resistance is detected;
 - (b) Use identification of filters, cartridges and canisters with NIOSH color coded approved labels as required.
 - (c) Maintain an adequate supply of filter elements for this purpose; and
 - (d) Permit an employee who wears a respirator to leave the work area to wash his or her face and respirator facepiece when necessary to prevent skin irritation associated with respirator use.
 - (e) Record Keeping - Records must be kept and available in accordance with 29CFR 1910, 20 and include medical evaluation, fit testing, and a copy of the respiratory protection program.

.07 Protective Work Clothing and Equipment

A. Provision and Use.

When an employee is exposed to lead above the PEL, without regard to the use of respirators, or when the possibility of skin or eye irritation exists, the employer shall:

- (1) Provide, at no cost to the employee, appropriate protective work clothing and equipment, such as, but not limited to:
 - (a) Coveralls or similar full-body work clothing;
 - (b) Shoes or disposable shoe coverlets, gloves, and hats;

- (c) Face shields, vented goggles, or other appropriate protective equipment which complies with the applicable section(s) of 29 CFR 1926.62.
- (2) Ensure that the employee uses the appropriate protective clothing and equipment.

B. Cleaning and Replacement.

The employer shall:

- (1) Provide the protective clothing required in Section A -
 - (a) In a clean and dry condition,
 - (b) Daily to an employee whose exposure level, without regard to a respirator, is over 200 micrograms/cubic meter of lead as an 8-hour TWA, and
 - (c) At least weekly to other employees;
- (2) Provide for the cleaning, laundering, or disposal of protective clothing and equipment required by Section A;
- (3) Repair or replace required protective clothing and equipment as needed to maintain their effectiveness;
- (4) Ensure that employees remove all protective clothing:
 - (a) At the completion of a work shift, and
 - (b) Only in designated change areas;
- (5) Ensure that contaminated protective clothing which is to be cleaned, laundered, or disposed of, is placed in a closed container which:
 - (a) Is located in the designated change area, and
 - (b) Will prevent dispersion of lead;
- (6) Inform, in writing, any person who cleans or launders protective clothing or equipment of the potentially harmful effects of exposure to lead;
- (7) Ensure that a container required by Section B(5), above, is labelled as follows:

CAUTION: CLOTHING CONTAMINATED WITH LEAD. DO NOT REMOVE DUST BY BLOWING OR SHAKING. DISPOSE OF LEAD CONTAMINATED WASH WATER IN ACCORDANCE WITH APPLICABLE LOCAL, STATE, OR FEDERAL REGULATIONS; and

- (8) Prohibit the removal of lead from protective clothing or equipment by blowing, shaking, or any other means which disperses lead into the air.

.08 Housekeeping

A. Surfaces.

An employer shall maintain all surfaces as free as practicable of accumulations of lead.

B. Cleaning Floors.

- (1) An employer shall vacuum floors and other surfaces where lead accumulates.

- (2) When vacuuming or other equally effective methods are not feasible, an employer shall use wet methods, including wet sweeping, wet shovelling, or wet brushing.
- (3) Floors and other surfaces where lead accumulates may not be cleaned by the use of compressed air.
- (4) An employer may use dry methods only when vacuuming and wet methods are not practicable.

C. Vacuumping.

When vacuuming methods are used, the employer shall ensure that the vacuums are equipped with HEPA filters are used and emptied in a manner which minimizes the re-entry of lead into the workplace.

.09 Hygiene Facilities and Practices.

- A. For the purpose of this regulation, employee exposure is that exposure which would occur without regard to the use of a respirator.
- B. The employer shall ensure that in an area where employees are exposed to lead above the PEL:
 - (1) Neither food nor beverage is present or consumed;
 - (2) Tobacco products are not present or consumed; and
 - (3) Cosmetics are not applied.

C. Designated Change Areas.

- (1) The employer shall provide clean designated change areas for employees who work in areas where their airborne exposure to lead is above the PEL.
- (2) The employer shall ensure that designated change areas are equipped with separate storage facilities for protective work clothing and equipment and for street clothes, sufficient to prevent cross-contamination.

D. Washing Facilities.

- (1) The employer shall ensure that employees who work in areas where their airborne exposure to lead is above the PEL, shower or wash at the end of the work shift.
- (2) The employer shall provide washing facilities in accordance with the applicable section(s) of 29 CFR 1926.62.
- (3) The employer shall ensure that employees who are required to shower or wash pursuant to Section D(1) do not leave the jobsite wearing any clothing or equipment worn during the work shift.

E. Food and Beverage Consumption Areas.

The employer shall:

- (1) Provide employees who work in areas where their airborne exposure to lead is above the PEL with food and beverage consumption areas:
 - (a) Sufficiently removed from the affected work area; and
 - (b) Readily accessible to employees; and

- (2) Ensure that employees who work in areas where their airborne exposure to lead is above the PEL, wash their hands and face prior to eating, drinking, smoking, or applying cosmetics.
- (3) Ensure that employees who work in areas where their airborne consumption areas with protective work clothing or equipment unless surface lead dust has been removed by vacuuming or other cleaning methods.

F. Lavatories.

The employer shall provide an adequate number of lavatory facilities which comply with the applicable section(s) of 29 CFR 1926.62.

.10 Medical Surveillance Program.

A. General.

- (1) The employer shall institute a medical surveillance program for all employees who are or may be exposed above the PEL level. A blood test to determine the lead level is required for all employees before engaged in operation of removing/cleaning the paint. The Department is responsible for its employees for blood test; however, the Contractor shall be responsible for his workers for such test.
- (2) The employer shall ensure that all medical examinations and procedures are performed by, or under the supervision of, a licensed physician.
- (3) The employer shall provide the required medical surveillance, as set forth in Regulation .11:
 - (a) Without cost to employees, and
 - (b) At a reasonable time and place.

B. Biological Monitoring.

- (1) Blood Lead and ZPP or FEP Level Sampling and Analysis: The employer shall make available to each employee covered under Section A(1), above, biological monitoring in the form of blood sampling and analysis for:
 - (a) Lead; and
 - (b) Zinc protoporphyrin (ZPP), or Free erythrocyte protoporphyrin (FEP) levels.
- (2) The biological monitoring shall be provided on the following schedule:
 - (a) Before assignment, when an employee is being assigned for the first time to an area in which airborne concentrations of lead are at or above the PEL level;
 - (b) At least every 2 months during the first 6 months to each employee covered under Section A(1), above, after that, every 6 months;
 - (c) At least every 2 months for each employee whose last blood lead sampling and analysis indicated a blood lead level at or above 40 micrograms/100g of whole blood, until two consecutive blood samples and analysis indicate a blood lead level below 40 micrograms/100g of whole blood;
 - (d) At least monthly during the removal period of each employee removed from exposure to lead due to an elevated blood lead level; and
 - (e) At the termination of employment.

(3) Follow-up Blood Sampling Tests.

When the results of a blood lead level test indicate that an employee's blood lead level exceeds the numerical criteria for medical removal under Regulation .12A(1), the employer shall provide a second (follow-up) blood sampling test within 2 weeks after receiving the results of the first blood sampling test.

(4) Accuracy of Blood Lead Level Sampling and Analysis.

Blood lead level sampling and analysis provided pursuant to these regulations shall;

(a) Have an accuracy, to a confidence level of 95 percent, within plus or minus 15 percent or 6 micrograms/100ml, whichever is greater; and

(b) Be conducted by a laboratory which:

(i) Is licensed by the Centers for Disease Control (CDC), United States Department of Health and Human Services, or

(ii) Has received a satisfactory grade in blood lead proficiency testing from CDC in the prior 12 months.

(5) Employee Notification.

Within 5 working days after receiving biological monitoring results, the employer shall notify in writing:

(a) Each employee of their blood lead level; and

(b) Each employee whose blood lead level exceeds 40 micrograms/100g, that this chapter requires temporary medical removal with Medical Removal Protection benefits when an employee's blood lead level exceeds the numerical criterion for medical removal under Regulation .12A(1).

.11 Medical Examinations and Consultations

A. Frequency.

The employer shall make available medical examinations and consultations to each employee covered under Regulation .10A(1) according to the following schedule:

(1) Immediately, for each employee for whom a blood sampling test conducted at any time during the preceding 12 months indicated a blood lead level at or above 40 micrograms/100g;

(2) As soon as possible, upon notification by an employee that:

(a) The employee has developed signs or symptoms commonly associated with lead intoxication,

(b) The employee desires medical advice concerning the effects of current or past exposure to lead on the employee's ability to procreate a healthy child, or

(c) The employee has demonstrated difficulty in breathing during a respirator fit test or during respirator use; and

(3) As medically appropriate for each employee who was either:

(a) Removed from exposure to lead due to a risk of sustaining material impairment to health, or

- (b) Otherwise limited pursuant to a final medical determination.

B. Content.

Medical examinations made available pursuant to Section A(1), above, shall include all of the following elements:

- (1) A detailed work history and a medical history, with particular attention to:
 - (a) Past lead exposure (occupational and non-occupational),
 - (b) Personal habits (smoking, hygiene), and
 - (c) Past gastrointestinal, hematologic, renal, cardiovascular, reproductive, and neurological problems;
- (2) A thorough physical examination, with particular attention to teeth, gums, hematologic, gastrointestinal, renal, cardiovascular, and neurological systems;
- (3) Pulmonary status, if respiratory protection will be used;
- (4) A blood pressure measurement;
- (5) A blood sample and analysis which determines:
 - (a) Blood lead level which meets the requirements of Regulation .10B(4).
 - (b) Hemoglobin and hematocrit determinations, red cell indices, and examination of peripheral smear morphology,
 - (c) Zinc protoporphyrin or free erythrocyte protoporphyrin,
 - (d) Blood urea nitrogen, and
 - (e) Serum creatinine;
- (6) A routine urinalysis with microscopic examination; and
- (7) Any laboratory or other test which the examining physician deems necessary by sound medical practice.

C. The content of medical examinations made available pursuant to Section A(2) and (3), above, shall:

- (1) Be determined by an examining physician; and
- (2) If requested by an employee, include pregnancy testing or laboratory evaluation of male fertility.

D. Multiple Physician Review Mechanism

- (1) If the employer selects the initial physician who conducts any medical examination or consultation provided to an employee under this chapter, the employee may designate a second physician to:
 - (a) Review any findings, determinations, or recommendations of the initial physician; and
 - (b) Conduct the examinations, consultations, and laboratory tests the second physician deems necessary to facilitate this review.

- (2) The employer shall promptly notify an employee of the right to seek a second medical opinion after each occasion that an initial physician conducts a medical examination or consultation pursuant to this chapter.
- (3) The employer may condition its participation in, and payment for, the multiple physician review mechanism upon the employee doing the following within 15 days after receipt of the foregoing notification, or receipt of the initial physician's written opinion, whichever is later:
 - (a) The employee informing the employer that he or she intends to seek a second medical opinion; and
 - (b) The employee initiating steps to make an appointment with a second physician.
- (4) If the findings, determinations, or recommendations of the second physician differ from those of the initial physician, the employer and the employee shall ensure that efforts are made for the two physicians to resolve any disagreement.
- (5) If the two physicians have been unable to reach agreement quickly, the employer and the employee, through their respective physicians, shall designate a third physician to:
 - (a) Review any findings, determinations, or recommendations of the prior physicians; and
 - (b) Conduct the examinations, consultations, and laboratory tests, and engage in discussions with the prior physicians that the third physician deems necessary to resolve disagreement of the prior physicians.
- (6) The employer shall act consistently with the findings, determinations, and recommendations of the third physician, unless the employer and the employee reach an agreement which is otherwise consistent with the recommendations of at least one of the three physicians.

E. Information Provided to Examining and Consulting Physicians.

- (1) The employer shall provide the initial physician conducting a medical examination or consultation under this chapter the following information:
 - (a) A copy of this chapter;
 - (b) A description of the affected employee's duties as they relate to the employee's lead exposure;
 - (c) The employee's exposure level or anticipated exposure level to lead and to any other toxic substance (if applicable);
 - (d) A description of personal protective equipment used, or to be used;
 - (e) Prior blood lead determinations; and
 - (f) Prior written medical opinions concerning the employee which are in the employer's possession or control.
- (2) The employer shall provide the foregoing information to a second or third physician conducting a medical examination or consultation under this chapter upon request either by the second or third physician, or by the employee.

F. Written Medical Opinions.

- (1) The employer shall obtain and furnish to the employee a copy of a written medical opinion from each examining or consulting physician which contains the following information:

- (a) The physician's opinion as to whether the employee has any detected medical condition which would place the employee at increased risk of material impairment of the employee's health from exposure to lead,
 - (b) Any recommended special protective measures to be provided to the employee,
 - (c) Limitations to be placed upon the employee's exposure to lead,
 - (d) Any recommended limitation upon the employee's use of respirators, including, if a physician determines that the employee cannot wear a negative pressure respirator, a determination of whether the employee can wear a powered air purifying respirator, and
 - (e) The results of the blood lead determinations;
- (2) The employer shall instruct each examining and consulting physician:
- (a) Not to reveal either in the written opinion, or in any other means of communication with the employer, any finding, including laboratory results, or diagnosis unrelated to an employee's occupational exposure to lead, and
 - (b) To advise the employee of any medical condition, occupational or non-occupational, which dictates further medical examination or treatment.

G. Alternate Physician Determination Mechanism.

The employer and the employee or authorized employee representative may agree to use any expeditious alternate physician determination mechanism in place of the multiple physician review mechanism provided by this chapter, provided that the alternate mechanism satisfies the other requirements contained in this chapter.

H. Chelation.

- (1) The employer shall ensure that any person whom he retains, employs, supervises, or controls does not engage in prophylactic chelation of any employee at any time.
- (2) If therapeutic or diagnostic chelation is to be performed by any person in Section H(1), above, the employer shall ensure that:
 - (a) It is done:
 - (i) Under the supervision of a licensed physician,
 - (ii) In a clinical setting,
 - (iii) With thorough and appropriate medical monitoring; and
 - (b) The employee is notified in writing before its occurrence.

.12 Medical Removal Protection

A. Temporary Medical Removal and Return of an Employee.

(1) Temporary Removal Due to Elevated Blood Lead Levels.

The employer shall remove an employee from work having an exposure to lead at or above the action level on each occasion that:

- (a) A periodic and a follow-up blood sampling test conducted pursuant to Regulations .10 and .11 indicates that the employee's blood lead level is at or above 50 micrograms/100g; or

(2) Temporary Removal Due to a Final Medical Determination

- (a) For the purposes of Section A(2), the phrase "final medical determination" means the outcome of either the multiple physician review mechanism or the alternate medical determination mechanism used pursuant to the medical surveillance provisions in Regulation .11, above.
- (b) The employer shall remove an employee from work having an exposure to lead at or above the PEL level on each occasion that a final medical determination results in a medical finding, determination, or opinion that the employee has a detected medical condition which places the employee at increased risk of material health impairment from exposure to lead.
- (c) When a final medical determination results in any recommended special protective measures for an employee, or limitations on an employee's exposure to lead, the employer shall implement the recommendations and act consistently with it.

(3) Return of the Employee to Former Job Status.

- (a) The employer shall return an employee to his or her former job status in accordance with the following schedule:
 - (i) For an employee removed pursuant to Section A(1), when two consecutive blood sampling tests taken at least one month apart indicate that the employee's blood lead level is at or below 40 micrograms/100g of whole blood;
 - (ii) For an employee removed pursuant to Section A(2), when a subsequent final medical determination results in a medical finding, determination, or opinion that the employee no longer has a detected medical condition which places the employee at increased risk of material health impairment from exposure to lead.
- (b) For the purposes of this subsection, the requirement that an employer return an employee to the employee's former job status is not intended to expand upon or restrict any rights an employee has or would have had, absent temporary medical removal, to a specific job classification or position under the terms of a collective bargaining agreement.

(4) Removal of Other Employee Special Protective Measures or Limitations.

The employer shall remove any limitations placed on an employee or end any special protective measures provided to an employee pursuant to a final medical determination when a subsequent final medical determination indicates that the limitations or special protective measures are no longer necessary.

(5) Employer Options Pending a Final Medical Determination.

When a multiple physician review mechanism, or alternate medical determination mechanism used pursuant to Regulation .11, has not yet resulted in a final medical determination with respect to an employee, the employer shall act as follows:

- (a) Removal. The employer may remove the employee from exposure to lead, provide special protective measures to the employee, or place limitations upon the employee, consistent with the medical findings, determinations, or recommendations of any of the physicians who have reviewed the employee's health status.
- (b) Return. The employer may return the employee to his or her former job status, end any special protective measures provided to the employee, and remove any limitations placed upon the employee, consistent with the medical findings,

determinations, or recommendations of any of the physicians who have reviewed the employee's health status, with two exceptions:

- (i) If the initial removal, special protection, or limitations of the employee resulted from a final medical determination which differed from the findings, determinations, or recommendations of the initial physician; or
- (ii) If the employee has been on removal status for the preceding 18 months due to an elevated blood lead level, the employer shall await a final medical determination.

B. Medical Removal Protection Benefits.

(1) Definition of Medical Removal Protection Benefits.

For the purpose of this section, the requirements that an employer provide medical removal protection benefits means that an employer shall maintain the earnings, seniority, and other employment rights and benefits of an employee as though the employee had not been removed from normal exposure to lead or otherwise limited.

(2) Provision of Medical Removal Protection Benefits.

The employer shall provide to an employee up to 18 months of medical removal protection benefits on each occasion that an employee is removed from exposure to lead or otherwise limited pursuant to this chapter.

(3) Follow-up Medical Surveillance During the Period of Employee Removal or Limitation.

During the period of time that an employee is removed from normal exposure to lead, or otherwise limited, the employer may condition the provision of medical removal protection benefits upon the employee's participation in follow-up medical surveillance made available pursuant to this regulation.

(4) Workers' Compensation Claims.

If a removed employee files a claim for workers' compensation payments for a lead-related disability:

- (a) The employer shall continue to provide medical removal protection benefits pending disposition of the claim;
- (b) To the extent that an award is made to the employee for earnings lost during the period of removal, the employer's medical removal protection obligation shall be reduced by the amount of the award; and
- (c) The employer shall receive no credit for workers' compensation payments received by the employee for treatment-related expenses.

(5) Other Credits.

The employer's obligation to provide medical removal protection benefits to a removed employee shall be reduced to the extent that the employee receives:

- (a) Compensation for earnings lost during the period of removal either from a publicly or employer-funded made possible by virtue of the employee's removal.
- (b) Income from employment with another employer compensation program; or

(6) Employees Whose Blood Lead Levels Do Not Adequately Decline Within 18 Months of Removal.

- (a) The employer shall take the measures prescribed by Section B(6)(b) with respect to any employee:
 - (i) Removed from exposure to lead due to an elevated blood lead level; and
 - (ii) Whose blood lead level has not declined within the past 18 months of removal so that the employee has been returned to the employee's former job status.
- (b) The employer shall:
 - (i) Make available to the employee a medical examination pursuant to this chapter to obtain a final medical determination with respect to the employee;
 - (ii) Ensure that the final medical determination obtained indicates whether the employee may be returned to his or her former job status, and if not, what steps should be taken to protect the employee's health;
 - (iii) When the final medical determination has not yet been obtained, or once obtained indicates that the employee may not yet be returned to the employee's former job status, continue to provide medical removal protection benefits to the employee until either the employee is returned to former job status, or a final medical determination is made that the employee is incapable of ever safely returning to the employee's former job status.
- (c) When the employer acts pursuant to a final medical determination which permits the return of the employee to the employee's former job status despite what would otherwise be an unacceptable blood lead level, later questions concerning removing the employee again shall be decided by a final medical determination.
- (d) The employer need not automatically remove the employee pursuant to the blood lead level removal criteria provided by this regulation.

(7) Voluntary Removal or Restriction of An Employee.

Where an employer, although not required by this regulation to do so, removes an employee from exposure to lead or otherwise places limitations on an employee due to the effects of lead exposure on the employee's medical condition, the employer shall provide medical removal protection benefits to the employee equal to that required by Section B(2).

.13 Employee Information and Training

A. Training Program

- (1) Each employer who has a jobsite in which there is a potential exposure to airborne lead at any level shall inform employees of this chapter.
- (2) The employer shall:
 - (a) Institute a training program for employees subject to:
 - (i) Lead exposure at or above the action level, or
 - (ii) The possibility of skin or eye irritation; and
 - (b) Ensure their participation in the training.
- (3) The employer shall provide initial training for those employees covered by Section A(2), above, before the time of initial job assignment.

- (4) The training program shall be repeated at least annually for each employee.
- (5) The employer shall ensure that each employee is informed of:
 - (a) The content of this chapter;
 - (b) The specific nature of the operations which could result in exposure to lead above the action level;
 - (c) The purpose, proper selection, fitting, use, and limitation of respirators;
 - (d) The purpose and a description of:
 - (i) The medical surveillance program, and
 - (ii) The medical removal protection program;
 - (e) The adverse health effects associated with excessive exposure to lead, with particular attention to the adverse reproductive effects on both males and females;
 - (f) The Engineering controls and work practices associated with the employee's job assignment;
 - (g) The contents of any compliance program in effect; and
 - (h) Instructions to employees that chelating agents should not:
 - (i) Routinely be used to remove lead from their bodies, and
 - (ii) Be used at all except under the direction of a licensed physician.
- (6) The employer shall:
 - (a) Obtain and include as part of the training program, the materials pertaining to the Federal Occupational Safety and Health Act, the regulations issued under the Act, and this chapter; and
 - (b) Distribute them to employees.

B. Access to Information and Training Materials

- (1) The employer shall make readily available to all affected employees a copy of this chapter.
- (2) The employer shall provide to the Department upon request, all materials relating to the employee information and training program.

.14 Signs

A. General

- (1) The employer may use signs required by other statutes, regulations, or ordinances in addition to, or in combination with, signs required by this regulation.
- (2) The employer shall ensure that no statement appears on or near any sign required by this regulation which contradicts or detracts from the meaning of the required sign.

B. Signs

- (1) The employer shall post the following warning sign in each work area where the PEL is exceeded:

WARNING

HAZARD

LEAD WORK AREA

NO SMOKING, EATING OR DRINKING

- (2) The employer shall ensure that signs required by this regulation are illuminated and cleaned as necessary so that the legend is readily visible.

.15 Recordkeeping

A. Initial Determination and Exposure Monitoring

- (1) The employer shall establish and maintain an accurate record of:
- (a) Initial determinations; and
 - (b) All monitoring required in Regulation .04.
- (2) This record shall include:
- (a) The information required in Regulation .04;
 - (b) For each sample taken:
 - (i) The date, or dates,
 - (ii) The number of samples,
 - (iii) The duration of sampling,
 - (iv) The location,
 - (v) The results on each sample taken, and
 - (vi) Where applicable, a description of the sampling procedure used to determine representative employee exposure;
 - (c) A description of the sampling and analytical methods used and evidence of their accuracy;
 - (d) The type of respiratory protective devices worn, if any;
 - (e) Name, social security number, and job classification of the employee monitored and of all other employees whose exposure the measurement is intended to represent; and
 - (f) The environmental variables that could affect the measurement of employee exposure.
- (3) The employer shall maintain the initial determination and exposure monitoring records for the longer of:
- (a) 40 years; or
 - (b) The duration of employment plus 20 years.

B. Medical Surveillance

- (1) The employer shall establish and maintain an accurate record for each employee subject to medical surveillance as required by Regulations .10 and .11.
- (2) This record shall include:
 - (a) The name, social security number, and a description of the duties of the employee;
 - (b) One copy of each physician's written opinion;
 - (c) Results of any airborne exposure monitoring conducted for that employee and the representative exposure levels supplied to the physician; and
 - (d) Any employee medical complaints related to exposure to lead.
- (3) The employer shall keep, or ensure that the examining physician keeps, the following medical records;
 - (a) A copy of the medical examination results, including medical and work history, required under Regulations .10 and .11.
 - (b) A description of the laboratory procedures together with a copy of any standards or guidelines used to interpret the test results or references to that information; and
 - (c) A copy of the results of biological monitoring.
- (4) The employer shall maintain or ensure that the physician maintains the medical records for at least 40 years, or for the duration of employment plus 20 years, whichever is longer.

C. Medical Removals

- (1) The employer shall establish and maintain an accurate record for each employee removed from current exposure to lead pursuant to Regulation .12.
- (2) Each record shall include:
 - (a) The name and social security number of the employee;
 - (b) The date of each occasion on which the employee was removed from exposure to lead, together with the corresponding date on which the employee was returned to his or her former job status;
 - (c) A brief explanation of how each removal was, or is being, accomplished; and
 - (d) A statement with respect to each removal indicating whether the reason for the removal was an elevated blood lead level.
- (3) The employer shall maintain each medical removal record for at least the duration of an employee's employment.

D. Availability

- (1) Upon request, the employer shall make all records required by this chapter available to the Department for examination and copying.
- (2) Upon request, the employer shall make environmental monitoring, biological monitoring, and medical removal records required by this chapter available to affected employees or their authorized employee representative for inspection and copying.
- (3) Upon request, the employer shall make an employee's medical records required to be maintained by this regulation available to the affected employee or former employee, or to

a physician or other individual designated by the affected or former employee for examination and copying.

E. Transfer of Records

- (1) When the employer ceases to do business:
 - (a) The successor employer shall receive and retain all records required by this chapter.
 - (b) If there is no successor employer to receive the records required by this chapter and to retain them for the prescribed retention period, the employer shall transmit these records to the Department.
- (2) At the expiration of the record retention period prescribed by this chapter, the employer shall:
 - (a) Notify the Department at least 3 months before the disposal of the records; and
 - (b) Transmit the records to the Department if requested within the period.

.16 Observation of Monitoring

A. Employee Observation

The employer shall provide affected employees or their designated representative an opportunity to observe monitoring of employee exposure to lead conducted pursuant to Regulation .04.

B. Observation Procedures

- (1) When observation of the monitoring of employee exposure to lead requires entry into an area where the use of respirators, protective clothing, or equipment is required, the employer shall:
 - (a) Provide the observer with and ensure the use of the respirators, clothing, and equipment; and
 - (b) Require the observer to comply with all other applicable safety and health procedures.
- (2) Without interfering with the monitoring, observers shall be entitled to:
 - (a) Receive an explanation of the measurement procedures;
 - (b) Observe all steps related to the monitoring of lead performed at the place of exposure; and
 - (c) Record the results obtained or receive copies of the results when returned by the laboratory.

749687 - INSTALLATION OR REMOVAL OF TRAFFIC SIGN ON SINGLE SIGN POST

Description:

This work consists of installing or removing traffic sign(s) on a single post or other type of pole at the locations indicated on the Plans or as directed by the Engineer. This specification also includes installation of posts in boring holes constructed under other items.

A single sign totaling more than 9 square feet, or with any dimension, length or width, greater than or equal to 48 inches shall be installed on multiple sign posts under Item 749690 - Installation or Removal of Traffic Sign on Multiple Sign Posts.

Materials:

The Department will provide all sign materials to be used on this project. The Contractor shall contact the DelDOT Sign Shop Supervisor with project plans and quantity sheets at 302-760-2581. Sign fabrication orders require a minimum of four (4) weeks for completion. Orders placed with less than 4 weeks lead-time will result in a delay. Any delay caused by inadequate lead-time due to a late order will be the sole responsibility of the Contractor. The Contractor shall pick-up the sign materials from the DelDOT Sign Shop and deliver them to the job site without any damage to the sign materials.

Construction Methods:

The Contractor shall pick-up necessary signs, sign posts, hardware, and extensions from the Department and install the signs in the locations indicated on the Plans in accordance with the Delaware MUTCD or as directed by the Engineer. The Contractor shall be responsible for obtaining all necessary utility clearances before the signs may be installed. Signs and plaques shall be mounted no lower than the minimum mounting height specified in the Delaware MUTCD. Signs and plaques shall be mounted no higher than one foot above the minimum mounting height specified in the Delaware MUTCD. Any excess sign post protruding above the top of the top sign shall be cut off and removed. For sign removals, the sign posts shall have all nuts, bolts, and other connectors removed. The disturbed ground shall be graded and backfilled accordingly. The Contractor is responsible for disposal of all signing material removed from the project

Method of Measurement:

The number of single sign installations or removals will be measured as the actual number of signs installed or removed and accepted.

Basis of Payment:

The quantity of single sign post installations or removals will be paid for at the Contract unit price per each. Price and payment will constitute full compensation for installing or removing signs and sign materials, pick-up and delivery of sign materials, grading disturbed areas, and for all labor, equipment, tools, and incidentals required to complete the work. Signs that are not installed in accordance with the Delaware MUTCD or signs installed in the incorrect location shall be moved at no additional cost to the Department.

5/28/2013

749690 - INSTALLATION OR REMOVAL OF TRAFFIC SIGN ON MULTIPLE SIGN POSTS

Description:

This work consists of installing or removing traffic sign(s) on multiple sign posts at the locations indicated on the Plans or as directed by the Engineer. This specification also includes installation of posts in holes installed under other items.

A single sign totaling more than 9 square feet, or with any dimension, length or width, greater than 48 inches shall be mounted on two (2) posts. Signs with a length greater than or equal to 78 inches shall be mounted on three (3) sign posts.

Materials:

The Department will provide all sign materials to be used on this project. The Contractor shall contact the DelDOT Sign Shop Supervisor with project plans and quantity sheets at 302-760-2581. Sign fabrication orders require a minimum of four (4) weeks for completion. Orders placed with less than 4 weeks lead-time will result in a delay. Any delay caused by inadequate lead-time due to a late order will be the sole responsibility of the Contractor. The Contractor shall pick-up the sign materials from the DelDOT Sign Shop and deliver them to the job site without any damage to the sign materials.

Construction Methods:

The Contractor shall pick-up necessary signs, sign posts, hardware, and extensions from the Department and install the signs in the locations indicated on the Plans in accordance with the Delaware MUTCD or as directed by the Engineer. The Contractor shall be responsible for obtaining all necessary utility clearances before the signs may be installed. Signs and plaques shall be mounted no lower than the minimum mounting height specified in the Delaware MUTCD. Signs and plaques shall be mounted no higher than one foot above the minimum mounting height specified in the Delaware MUTCD. Any excess sign post protruding above the top of the top sign shall be cut off and removed. For sign removals, the sign posts shall have all nuts, bolts, and other connectors removed. For sign removals, the sign posts shall have all nuts, bolts, and other connectors removed. The disturbed ground shall be graded and backfilled accordingly. The Contractor is responsible for disposal of all signing material removed from the project..

Method of Measurement:

The number of sign installations or removals will be measured as the total square foot of the sign(s) installed or removed and accepted.

Basis of Payment:

The quantity of sign installations or removals will be paid for at the Contract unit price per square foot. Price and Payment will constitute full compensation for installing or removing signs and sign materials, pick-up and delivery of sign materials, grading disturbed areas, and for all labor, equipment, tools, and incidentals required to complete the work. Signs that are not installed accordance with the Delaware MUTCD or signs installed in the incorrect location shall be moved at no additional cost to the Department.

5/28/2013

763501 - CONSTRUCTION ENGINEERING

Description:

This work consists of construction lay out including; stakes, lines and grades as specified below. Subsection 105.10 Construction Stakes, Lines and Grades of the Standard Specifications is voided.

Based on contract plans and information provided by the Engineer, the Contractor shall stake out right-of-way and easements lines, limits of construction and wetlands, slopes, profile grades, drainage system, centerline or offset lines, benchmarks, structure working points and any additional points to complete the project.

The Engineer will only establish the following:

- (a) Original and final cross-sections for borrow pits.
- (b) Final cross-sections for all excavation items.
- (c) Line and grade for extra work added on to the project plans.

Equipment:

The Contractor shall use adequate equipment/instruments in a good working order. He/she shall provide written certification that the equipment/instrument has been calibrated and is within manufacturer's tolerance. The certification shall be dated a maximum of 9 months before the start of construction. The Contractor shall renew the certification a minimum of every 9 months. The equipment/instrument shall have a minimum measuring accuracy of [3mm+2ppmxD] and an angle accuracy of up to 2.0 arc seconds or 0.6 milligons. If the Contractor chooses to use GPS technology in construction stakeout, the Contractor shall provide the Engineer with a GPS rover for the duration of the contract. The GPS rover shall be in good working condition and of similar make and model used by the Contractor. The Contractor shall provide up to 8 hours of formal training on the Contractor's GPS system to a maximum of four Engineer's appointees. At the end of the contract, the Engineer will return the GPS rover to the Contractor. If any of the equipment/instruments are found to be out of adjustment or inadequate to perform its function, such instrument or equipment shall be immediately replaced by the Contractor to the satisfaction of the Engineer. The Contractor may utilize GPS equipment to perform the excavation and embankment for the project as indicated on the plans. Use of this procedure and equipment is intended for grading the subgrade surface only; it is not intended for use in constructing final surface grades. GPS technology and machine control technology shall not be used in the construction of bridge or structures such as, but not limited to, curb, drainage inlets, manholes, junction boxes, pole bases and pipe inverts.

Engineering/Survey Staff:

The Contractor shall provide and have available for the project an adequate engineering staff that is competent and experienced to set lines and grades needed to construct the project. The engineering personnel required to perform the work outlined herein shall have experience and ability compatible with the magnitude and scope of the project. Additionally, the Contractor shall employ an engineer or surveyor licensed in the State of Delaware to be responsible for the quality and accuracy of the work done by the engineering staff. When individuals or firms other than the Contractor perform any professional services under this item, that work shall not be subject to the subcontracting requirements of Subsection 108.01 of the Standard Specifications. The Contractor shall assume full responsibility for any errors and/or omissions in the work of the engineering staff described herein. If construction errors are caused due to erroneous work done under Construction Engineering the Contractor accepts full responsibility, no matter when the error is discovered. Consideration will not be given for any extension of contract time or additional compensation due to delays, corrective work, or additional work that may result from faulty and erroneous construction stakeout, surveying, and engineering required by this specification.

Construction Methods:

Performance Requirements:

- (a) Construction Engineering shall include establishing the survey points and survey centerlines; finding, referencing, offsetting the project control points; running a horizontal and vertical circuit to check the accuracy of given control points. Establishing plan coordinates and elevations marks for culverts, slopes, subbase,

subsurface drains, paving, subgrade, retaining walls, and any other stakes required for control lines and grades; and setting vertical control elevations, such as footings, caps, bridge seats and deck screed. The Contractor shall be responsible for the preservation of the Department's project control points and benchmarks. The Contractor shall establish and preserve any temporary control points (traverse points or benchmarks) needed for construction. Any project control points (traverse points) or benchmarks conflicting with construction of the project shall be relocated by the Contractor. The Contractor as directed by the Engineer must replace any or all stakes that are destroyed at any time during the life of the contract. The Contractor shall re-establish centerline points and stationing prior to final cross-sections by the Engineer. The Vertical Control error of closure shall not exceed 0.05 ft times [Square root of number of miles in the level run] (0.01 m times [square root of number of kilometers]). The Horizontal Control accuracy ratio shall not exceed an error of closure of 1 foot per 20,000 feet (1 meter per 20,000 meters or 1:20,000) of distance traversed prior to adjustment.

- (b) The Contractor shall perform construction centerline layout of all roadways, ramps and connections, etc. from project control points set by the Engineer. The Contractor using the profiles and typical sections provided in the plans shall calculate proposed grades at the edge of pavement or verify information shown on Grades and Geometric sheets.
- (c) The Contractor shall advise the Engineer of any horizontal or vertical alignment revisions needed to establish smooth transitions to existing facilities. The Contractor shall immediately bring to the attention of the Engineer any potential drainage problem within the project limits. The Engineer must approve any proposed variation in profile, width or cross slope.
- (d) The Contractor shall establish the working points, centerlines of bearings on bridge abutments and on piers, mark the location of anchor bolts to be installed, check the elevation of bearing surfaces after they are ground and set anchor bolts at their exact elevation and alignment as per Contract Plans. Before completion of the fabrication of beams for bridge superstructures, the Contractor shall verify by accurate field measurements the locations both vertically and horizontally of all bearings and shall assume full responsibility for fabricated beams fitting and bearing as constructed. After beam erection and concurrently with the Department project surveyors, the Contractor shall survey top of beam elevations at a maximum of 10-ft (3.0-meter) stations and compute screed grades. These shall be submitted to the Engineer for review and approval before the stay in place forms are set. Construction stakes and other reference control marks shall be set at sufficiently frequent intervals to assure that all components of the structure are constructed in accordance with the lines and grades shown on the plans. The Contractor will be responsible for all structure alignment control, grade control and all necessary calculations to establish and set these controls.
- (e) The Contractor, using contract plans, shall investigate proposed construction for possible conflicts with existing and proposed utilities. The Contractor shall then report such conflicts to the Engineer for resolution. All stakes for advanced utility relocation, which will be performed by others, shall be paid for under item 763597 – Utility Construction Engineering.
- (f) The Contractor shall be responsible for the staking of all sidewalk and curb ramp grades in accordance with the plans and the Departments Standard Construction Details. The Contractor shall review the stakeout with the Engineer prior to construction. The Engineer must approve any deviation from plans, Department Standard Construction Details and Specifications in writing. The Contractor shall be responsible for any corrective actions resulting from problems created by adjustments if they fail to obtain such approval.
- (g) If wetland areas are involved and specifically defined on the Plans the following shall apply:

- i. It is the intent of these provisions to alert the Contractor, that he/she shall not damage or destroy wetland areas, which exist beyond the construction limits. These provisions will be strictly enforced and the Contractor shall advise his/her personnel and those of any Subcontractor of the importance of these provisions.
- ii. All clearing operations and delineation of wetlands areas shall be performed in accordance with these Special Provisions. Before any clearing operation commences the Contractor shall demarcate wetlands at the Limits of Construction throughout the entire project as shown on the Plans labeled as Limits of Construction or Wetland Delineation to the satisfaction of the Engineer.
- iii. The material to be used for flagging the limits of construction shall be orange vinyl material with the wording "Wetland Boundary" printed thereon. In wooded areas, the flagging shall be tied on the trees, at approximate 20-foot (6.1 meter) intervals through wetland areas. In open field and yard areas that have been identified as wetlands, 3 foot (one meter) wooden grade stakes shall be driven into the ground at approximate 20 foot (6.1 meter) intervals and tied with the flagging.
- iv. If the flagging has been destroyed and the Engineer determines that its use is still required, the Contractor shall reflag the area at no cost to the Department. If the Contractor, after notification by the Engineer that replacement flagging is needed, does not replace the destroyed flagging within 48 hours, the Engineer may proceed to have the area reflagged. The cost of the reflagging by the Engineer will be charged to the Contractor and deducted from any monies due under the Contract.
- v. At the completion of construction, the Contractor shall remove all stakes and flagging.
- vi. The Contractor shall be responsible for any damages to wetlands located beyond the construction limits, which occurs from his/her operations during the life of the Contract. The Contractor shall restore all temporarily disturbed wetland areas to their preconstruction conditions. This includes restoring bank elevations, streambed and wetland surface contours and wetlands vegetation disturbed or destroyed. The expense for this restoration shall be borne solely by the Contractor.

Submittals:

All computations necessary to establish the exact position of all work from the control points shall be made and preserved by the Contractor. All computations, survey notes and other records necessary to accomplish the work shall be made available to the Department in a neat and organized manner at anytime as directed by the Engineer. The Engineer may check all or any portion of the stakeout survey work or notes made by the Contractor and any necessary correction to the work shall be made as soon as possible. The Contractor shall furnish the Engineer with such assistance as may be required for checking all lines, grades, and measurements established by the Contractor and necessary for the execution of the work. Such checking by the Engineer shall not relieve the Contractor of his/her responsibility for the accuracy or completeness of the work.

The Contractor shall submit any of the following at the Engineer's request:

- (a) Proposed method of recording information in field books to ensure clarity and adequacy.
- (b) A printout of horizontal control verification, as well as coordinates, differences and error of closure for all reestablished or temporary Control Points.
- (c) A printout of vertical control verification, with benchmark location elevation and differences from plan elevation.

- (d) Sketch of location of newly referenced horizontal control, with text printout of coordinates, method of reference and field notes associated with referencing control.
- (e) Description of newly established benchmarks with location, elevation and closed loop survey field notes.
- (f) All updated electronic and manuscript survey records.
- (g) Stakeout plan for each structure and culvert.
- (h) Computations for buildups over beams, screed grades and overhang form elevations.
- (i) A report showing differences between supplied baseline coordinates and field obtained coordinates, including a list of preliminary input data.
- (j) Any proposed plan alteration to rectify a construction stakeout error, including design calculations, narrative and sealed drawings.
- (k) Baseline for each borrow pit location.
- (l) Detailed sketch of proposed overhead ground mounted signs or signals showing obstructions that may interfere with their installation.
- (m) Copies of cut sheets.

Method of Measurement:

The quantity of Construction Engineering will not be measured.

Basis of Payment:

Payment will be made at the Lump Sum price bid for the item "Construction Engineering". The price bid shall include the cost of furnishing all labor, equipment, instruments, stakes and other material necessary to satisfactorily complete the work as herein described under this item for all roads and structures that are a part of the contract. Adjustment in payment will be made for the deletion or addition of work not shown in the contract documents.

Monthly payment will be made under this item in proportion to the amount of work done as determined by the Engineer.

6/11/2012

**UTILITY STATEMENT
CONSTRUCTION CONTRACT T201407501
P3e # 13-02222
REMOVAL OF BR 2- 357P
PEDESTRIAN BRIDGE OVER
ST. JONES RIVER**

The following utility companies maintain facilities within the project limits:

Delmarva Power
Verizon
Comcast
Chesapeake Utilities

Proposed utility relocations shall occur as described, but are not limited to the following:

DPL maintains a three (3) phase aerial span on the existing utility poles in the eastern (right) offset of the construction baseline of Sorghum Mill Road.

These poles will remain in place and are not in conflict with proposed construction.

On the eastern (right) offset of the Sorghum Mill Road construction baseline at station 4+25 a three (3) phase aerial span begins at utility pole #68/46 and traverses the St. Jones River terminating at a utility pole and guy anchor on the pedestrian asphalt trail.

The aerial span and poles attached therein are not in conflict with proposed construction, and will remain in place.

Verizon maintains aerial telecommunication facilities within the project limits attached to DPL utility poles in the eastern (right) offset of the Sorghum Mill Road construction alignment. Verizon's aerial facilities are not in conflict with proposed construction and will remain in place.

Comcast maintains aerial telecommunication facilities within the project limits attached to DPL utility poles in the eastern (right) offset of the construction baseline of Sorghum Mill Road . Comcast's aerial facilities are not in conflict with proposed construction and will remain in place.

Chesapeake Utilities maintains an underground gas main, directly drilled and installed on the northern offset of the asphalt trail's pavement edge. The facility is buried at an elevation beyond impact and will not conflict with proposed construction.

General Notes

- 1. The Contractor's attention is directed to Section 105.09 Utilities, Delaware Standard Specifications, August 2001. The Contractor shall contact Miss Utility (1-800-282-8555) two working days prior to any excavation. The Contractor is responsible for the support and protection of all utilities for excavation and/or demolition. The Contractor is responsible for ensuring proper clearances, including safety clearances, from overhead utilities for construction equipment. The contractor is advised to check the site for access purposes for his equipment and, if necessary make arrangements directly with utility companies for field adjustments for adequate clearances.**
- 2. It is understood and agreed that the Contractor has considered in his bid all permanent and temporary utility appurtenances in their present or relocated positions as shown on the plans or described in the Utility Statement or are readily discernible and that no additional compensation will be allowed for any delays, inconvenience, or damage due to any interference from the utility facilities and appurtenances or the operation of moving them, except that the Contractor may be granted an equitable extension of time.**
- 3. Coordination and cooperation among the Utility Companies and the State's Contractor are of prime importance. Therefore, the Contractor is directed to contact the following Utility Company representatives with any questions regarding this work prior to submitting bids and work schedules. Proposed work schedules should reflect the Utility Companies' proposed relocations. The Utility Companies do not work on weekends or legal holidays.**
- 4. As outlined in Chapter 3 of the DelDOT Utilities Manual, individual utility companies are responsible for obtaining all required permits from municipal, State and federal government agencies and railroads. This includes but is not limited to water quality permits/DNREC Water Quality Certification, DNREC Subaqueous Lands/Wetlands permits, DNREC Coastal Zone Consistency Certification, County Floodplain permits (New Castle County only), U.S. Coast Guard permits, US Army Corps 404 permits, sediment and erosion permits, and railroad crossing permits.**
- 5. Individual utility companies are required to restore any areas disturbed in conjunction with their relocation work. If an area is disturbed by a utility company and is not properly restored, the Department may have the highway contractor perform the necessary restoration. Any additional costs incurred as a result will be forwarded to the utility company."**

William Whitaker
George Zang
Jim Spencer
Mark Paker

Pepco Holdings, Inc. Distribution
Verizon
Comcast Cablevision
Chesapeake Utilities

302-934-3356
302-422-1238
302-786-6020
302-734-6797

Mar 7 2016
Date


Utility Coordinator

STATE OF DELAWARE
DEPARTMENT OF TRANSPORTATION
PO BOX 778
DOVER, DELAWARE 19903

CERTIFICATE OF RIGHT-OF-WAY STATUS

STATE PROJECT NO. T201407501

F.A.P. NO. N/A for R/W

REMOVAL OF BRIDGE 2-357P PEDESTRIAN BRIDGE
OVER ST. JONES RIVER

KENT COUNTY

Certificate of Right-of-Way Status – 100%

Status - LEVEL 1

As required by 23 CFR, Part 635, and other pertinent Federal and State regulations or laws, the following certifications are hereby made in reference to this highway project:

All necessary real property interests have been acquired in accordance with current FHWA/State directives covering the acquisition of real property; and,

All necessary rights-of-way, including control of access rights when pertinent, have been acquired including legal and physical possession; and,


All project rights of way are currently available in accordance with the project right-of-way plans; and,

Any residential displaced individuals or families have been relocated to decent, safe and sanitary housing, or adequate replacement housing has been made available in accordance with the provisions of the current Federal Highway Administration (FHWA) directive(s) covering the administration of the Highway Relocation Assistance Program; and,

All occupants have vacated the lands and improvements; and,

The State has physical possession and the right to remove, salvage, or demolish any improvements acquired as part of this project, and enter on all land.

RIGHT OF WAY SECTION



Robert Cunningham
Chief of Right of Way

March 14, 2016



STATE OF DELAWARE
DEPARTMENT OF TRANSPORTATION
800 BAY ROAD
P.O. BOX 778
DOVER, DELAWARE 19903

JENNIFER COHAN
SECRETARY

April 25, 2016

STIPULATED

ENVIRONMENTAL REQUIREMENTS

FOR

State Contract No. T201407501

Federal Aid No.: N/A

Contract Title: Removal of BR 2-357P Pedestrian Bridge over St. Jones River

In accordance with the procedural provisions for implementing the National Environmental Policy Act of 1969, as amended, the referenced project has been processed through the Department's Environmental Review Procedures. The following special provisions have been developed to mitigate and/or minimize impacts.

PERMIT REQUIREMENTS:

The construction work that will occur to remove BR 2-357P Pedestrian Bridge over St. Jones River, Kent County, Delaware requires permit approval from the agencies listed below. It is the responsibility of the contracting agency -- the Delaware Department of Transportation, Division of Transportation Solutions -- to obtain the necessary permits to ensure that the contractor complies with the requirements and conditions established by the regulatory agencies. The permit coordination for this project is ongoing. Written authorization from the permitting agencies is required and paperwork for on-site posting is anticipated. As such, the construction work that will occur to remove BR 2-357P Pedestrian Bridge over St. Jones River, Kent County, Delaware will be authorized under the permits listed below:

REQUIRED PERMITS AND APPROVAL STATUS:

- U.S. Army Corps of Engineers (COE) - Nationwide Permit (NWP) #13 and #27 Preconstruction Notification (PCN) is required – **CENAP-OP-R-2016-226-23 – issued 4/15/16 (expires 3/16/17)**
- Delaware Department of Natural Resources and Environmental Control (DNREC) – Wetlands and Subaqueous Lands Section – Subaqueous Lands and Wetlands Permit – **PENDING**
- Delaware Department of Natural Resources and Environmental Control (DNREC) – Water Quality (WQC) and Coastal Zone Consistency (CZM) – **Issued** (project is not located in a Critical Resource Waters (CRW))
- U.S. Coast Guard – Permit & Advanced Notification – See USCG letter dated 10/6/14 for Guidance/Details

SPECIFIC REQUIREMENTS:

Compliance with all requirements of the permits is the responsibility of the contractor, who will follow all special conditions or requirements as stated within those permits. The contractor will be subject to penalties, fines, and the risk of shut down as mandated by laws governing permitting agencies if such conditions and requirements are violated or ignored. Therefore, all special conditions, general requirements, and/or other required provisions specified within the permits must be followed. Those obligations are indicated or listed within the permit package, which can be obtained from the DelDOT Contract Administration Office.

Additional requirements by DelDOT not specified within the permits, but listed below, are also the responsibility of the contractor. Noncompliance with these requirements may result in shut down of the project at the contractor's expense.

1. The contractor shall employ measures during construction to prevent spills of fuels or lubricants. If a spill should occur, efforts shall be undertaken to prevent its entry into wetlands, aquatic, or drainage areas. Any spills entering wetlands, aquatic, or drainage areas shall be removed immediately. The Division of Water Resources (DNREC), Wetlands & Aquatic Protection Branch, 302-739-4691, shall be notified of any spill(s) within six (6) hours of their occurrence. That office will determine the effectiveness of spill and contamination removal and specify remediation efforts as necessary.
2. All construction debris, excavated material, brush, rocks, and refuse incidental to the work shall be placed either on shore above the influence of flood waters or on some suitable disposal site approved by the department.

3. The disposal of trees, brush, and other debris in any stream corridor, wetland surface water or any drainage ditch is prohibited.
4. There shall be no stockpiling of construction materials or temporary fills in wetlands or subaqueous lands unless otherwise specified on project plans and approved by permitting agencies that govern them. It is the contractor's responsibility to coordinate and secure those additional permits/amendments in deviating from the plan.
5. Construction debris shall be kept from entering adjacent waterways, wetlands, ground cover, or drainage areas. Any debris that enters these areas shall be removed immediately. Netting, mats, or establishing confined work areas in stages may be necessary to address these issues.
6. Refuse material resulting from routine maintenance of worker equipment and heavy machinery is prohibited from being disposed or deposited onto or into the ground. All used oils and filters must be recycled or disposed of properly.
7. Use of harmful chemical wash water to clean equipment or machinery is discouraged. If undertaken, the residue water and/or material must be collected or contained such that it will be disposed of properly. It shall not be deposited or disposed of in waterways, streams, wetlands, or drainage areas.
8. The contractor shall follow all requirements as indicated in the Environmental Compliance Sheet. It is the contractor's responsibility to ensure that workers also follow this requirement. As part of the restrictions, please note the timetables reflected in the contract for the in-stream/water work for endangered species protection.
9. Fill material shall be free of oil and grease, debris, wood, general refuse, plaster and other pollutants, and shall contain no broken asphalt.

ENVIRONMENTAL COMPLIANCE SHEET:

The contractor shall pay special attention to specific construction requirements as indicated in the Environmental Compliance Sheet (sheets 7 and 8).

1. Specifically, please note the environmental requirements as indicated in the following notes:
 - Note 2A for U.S. Coast Guard Permit/Advanced Notification – The contractor is responsible for notifying the U.S. Coast Guard. For further details see USCG letter dated 10/06/14 for guidance/details
 - COE Special Condition #8 and EC Note 2B Fisheries – No in-water work or noise introduced into the water column between March 15-June 30 (inclusive), any calendar year

- Note 2B Migratory Birds protected under the Migratory Bird Treaty Act (MBTA) nest underneath BR 2-357P – work must be avoided from April 15 to August 1 (inclusive). Either begin work on the underside of the structure prior to April 15 (to prevent birds from nesting) or wait until after August 1 (after hatchlings have left) to begin work on the underside. IF neither of these options is practicable, then deterrent netting or similar device shall be installed prior to April 15.
 - Note 2B – Osprey – An osprey nest exists adjacent to the project site, work at this site shall be avoided from March 1-September 30 (inclusive).
 - Note 4 for Stream Restoration and Slope Riprap Treatment
 - Note 5 for Protection of Resources
2. DelDOT Environmental Studies Section (302) 760-2264 must be notified if there are any changes to the project methods, footprint, materials, or designs, to allow the Department to coordinate with the appropriate resource agencies (COE, DNREC, and SHPO), for approval.



STATE OF DELAWARE
DEPARTMENT OF TRANSPORTATION
800 BAY ROAD
P.O. BOX 778
DOVER, DELAWARE 19903

JENNIFER COHAN
SECRETARY

RAILROAD STATEMENT

For

State Contract No.: T201407501

Federal Aid No.:

Project Title: Removal of BR 2-357P Pedestrian Bridge over St. Jones River

The following railroad companies maintain facilities within the contract limits:

- | | |
|--|---|
| <input type="checkbox"/> Amtrak | <input type="checkbox"/> Maryland & Delaware |
| <input type="checkbox"/> CSX | <input type="checkbox"/> Norfolk Southern |
| <input type="checkbox"/> Delaware Coast Line | <input type="checkbox"/> Wilmington & Western |
| <input type="checkbox"/> East Penn | <input checked="" type="checkbox"/> None |

DOT Inventory No.: _____ No. Trains/Day: _____ Passenger Trains (Y / N): _____

In accordance with 23 CFR 635, herein is the railroad statement of coordination (check one):

- No Railroad involvement.
- Railroad Agreement unnecessary but railroad flagging required. The contractor shall follow requirements stated in the DeIDOT Maintenance of Railroad Traffic Item in the Special Provisions. Contractor shall coordinate railroad flagging with DeIDOT's Railroad Program Manager at (302) 760-2183.
- Railroad Agreement required. The necessary railroad agreement, attached, is complete and fully executed. Railroad related work to be undertaken and completed as required for proper coordination with physical construction schedules. The Contractor shall follow requirements stated in the DeIDOT Maintenance of Railroad Traffic Item in the Special Provisions. Contractor shall coordinate railroad flagging with DeIDOT's Railroad Program Manager at (302) 760-2183.

Approved As To Form:



Robert A. Perrine
DeIDOT Railroad Program Manager

12/1/15

DATE

BID PROPOSAL FORMS

CONTRACT T201407501.01

CONTRACT ID: T201407501.01

PROJECT(S): T201407501

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
SECTION 0001 NON-FIXED QUANTITIES						
0010	201000 CLEARING AND GRUBBING	LUMP	LUMP			
0020	202000 EXCAVATION AND EMBANKMENT	50.000 CY				
0030	207500 COFFERDAMS	LUMP	LUMP			
0040	209002 BORROW, TYPE B	10.000 CY				
0050	209006 BORROW, TYPE F	110.000 CY				
0060	211000 REMOVAL OF STRUCTURES AND OBSTRUCTIONS	LUMP	LUMP			
0070	605533 CLEANING EXISTING STEEL STRUCTURES, HAZARDOUS BASE, (L.S.)	LUMP	LUMP			
0080	712021 RIPRAP, R-5	1210.000 TON				
0090	720050 GALVANIZED STEEL BEAM GUARDRAIL, TYPE 1-31	112.500 LF				

CONTRACT ID: T201407501.01

PROJECT(S): T201407501

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0100	726001 END ANCHORAGE 31	1.000				
		EACH				
0110	743000 MAINTENANCE OF TRAFFIC	LUMP	LUMP			
0120	743006 PLASTIC DRUMS	952.000				
		EADY				
0130	743023 TEMPORARY BARRICADES, TYPE III	408.000				
		LFDY				
0140	743024 TEMPORARY WARNING SIGNS AND PLAQUES	408.000				
		EADY				
0150	743051 FLAGGER, KENT COUNTY, STATE	320.000				
		HOURL				
0160	743063 FLAGGER, KENT COUNTY, STATE, OVERTIME	80.000				
		HOURL				
0170	749687 INSTALLATION OR REMOVAL OF TRAFFIC SIGN(S) ON SINGLE SIGN POST	9.000				
		EACH				
0180	749690 INSTALLATION OR REMOVAL OF TRAFFIC SIGNS ON MULTIPLE SIGN POSTS	8.000				
		SF				
0190	758000 REMOVAL OF EXISTING PORTLAND CEMENTCONCRETE PAVEMENT, CURB, SIDEWALK, ETC.	75.000				
		SY				

CONTRACT ID: T201407501.01

PROJECT(S): T201407501

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0200	762001 SAW CUTTING, BITUMINOUS CONCRETE	150.000 LF				
0210	762002 SAW CUTTING, CONCRETE, FULL DEPTH	25.000 LF				
0220	763000 INITIAL EXPENSE	LUMP	LUMP			
0230	763501 CONSTRUCTION ENGINEERING	LUMP	LUMP			
0240	905001 SILT FENCE	250.000 LF				
0250	906001 PORTABLE SEDIMENT TANK	2.000 EACH				
0260	906003 SUMP PIT	2.000 EACH				
0270	908001 TOPSOIL (TON)	115.000 TON				
0280	908004 TOPSOIL, 6" DEPTH	700.000 SY				
0290	908017 TEMPORARY GRASS SEEDING	1400.000 SY				

CONTRACT ID: T201407501.01

PROJECT(S): T201407501

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0300	908019 STREAMBANK SEED MIX, SEEDING	1400.000 SY				
0310	908020 EROSION CONTROL BLANKET MULCH	965.000 SY				
0320	909004 TURBIDITY CURTAIN, FLOATING	400.000 LF				
	SECTION 0001 TOTAL					
	TOTAL BID					

CANNOT BE USED FOR BIDDING

**AFFIDAVIT
OF
EMPLOYEE DRUG TESTING PROGRAM**

4104 Regulations for the Drug Testing of Contractor and Subcontractor Employees Working on Large Public Works Projects requires that Contractors and Subcontractors implement a program of mandatory drug testing for Employees who work on Large Public Works Contracts funded all or in part with public funds.

We hereby certify that we have in place or will implement during the entire term of the contract a Mandatory Drug Testing Program for our employees on the jobsite that complies with this regulation:

Contractor/Subcontractor Name: _____

Contractor/Subcontractor Address: _____

Authorized Representative (typed or printed): _____

Authorized Representative (signature): _____

Title: _____

Sworn to and Subscribed before me this _____ day of _____ 20____.

My Commission expires _____. NOTARY PUBLIC _____.

THIS PAGE MUST BE SIGNED AND NOTARIZED

CERTIFICATION
Contract No. T201407501.01

The undersigned bidder, _____
whose address is _____
and telephone number is _____ hereby certifies the following:

I/We have carefully examined the location of the proposed work, the proposed plans and specifications, and will be bound, upon award of this contract by the Department of Transportation, to execute in accordance with such award, a contract with necessary surety bond, of which contract this proposal and said plans and specifications shall be a part, to provide all necessary machinery, tools, labor and other means of construction, and to do all the work and to furnish all the materials necessary to perform and complete the said contract within the time and as required in accordance with the requirements of the Department of Transportation, and at the unit prices for the various items as listed on the preceding pages.

The foregoing quantities are considered to be approximate only and are given as the basis for comparison of bids. The Department of Transportation may increase or decrease the amount of any item or portion of the work as may be deemed necessary or expedient. Any such increase or decrease in the quantity for any item will not be regarded as a sufficient ground for an increase or decrease in the unit prices, nor in the time allowed for the completion of the work, except as provided in the contract.

Accompanying this proposal is a surety bond or a security of the bidder assigned to the Department of Transportation, for at least ten (10) percentum of total amount of the proposal, which deposit is to be forfeited as liquidated damages in case this proposal is accepted, and the undersigned shall fail to execute a contract with necessary bond, when required, for the performance of said contract with the Department of Transportation, under the conditions of this proposal, within twenty (20) days after date of official notice of the award of the contract as provided in the requirement and specifications hereto attached; otherwise said deposit is to be returned to the undersigned.

I/We are licensed, or have initiated the license application as required by Section 2502, Chapter 25, Title 30, of the Delaware Code.

By submission of this proposal, each bidder and each person signing on behalf of any bidder, certifies as to its own organization, under penalty of perjury, that to the best of each signer's knowledge and belief:

1. The prices in this proposal have been arrived at independently without collusion, consultation, communication, or Agreement with any other bidder or with any competitor for the purpose of restricting competition.
2. Unless required by law, the prices which have been quoted in this proposal have not been knowingly disclosed and will not knowingly be disclosed by the bidder, directly or indirectly, to any other bidder or competitor prior to the opening of proposals.
3. No attempt has been made or will be made by the bidder to induce any other person, partnership, or corporation to submit or not to submit a proposal for the purpose of restricting competition.

I/We acknowledge receipt and incorporation of addenda to this proposal as follows:

No.	Date								
-----	------	-----	------	-----	------	-----	------	-----	------

BIDDERS MUST ACKNOWLEDGE RECEIPT OF ALL ADDENDA

MUST INSERT DATE OF FINAL QUESTIONS AND ANSWERS ON WEBSITE: _____



AFFIRMATION:

Within the past five (5) years, has your firm, any affiliate, any predecessor company or entity, owner, Director, officer, partner or proprietor been the subject of a Federal, State, Local government suspension or debarment?

YES _____ NO _____ if yes, please explain _____

Sealed and dated this _____ day of _____ in the year of our Lord two thousand _____ (20____).

Name of Bidder (Organization)

Corporate
Seal

By: _____
Authorized Signature


Attest _____

Title

SWORN TO AND SUBSCRIBED BEFORE ME this ____ day of _____, 20 ____.

Notary
Seal

Notary

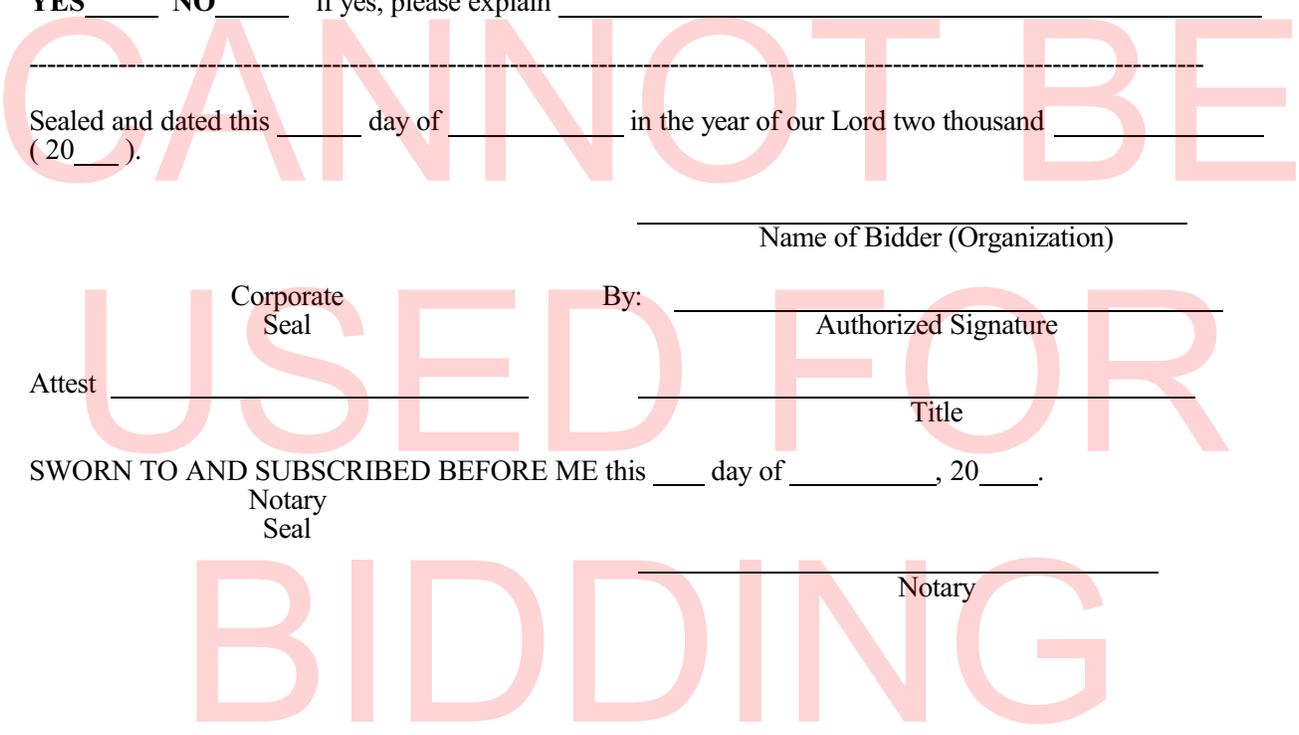

BID BOND

TO ACCOMPANY PROPOSAL
(Not necessary if security is used)

KNOW ALL MEN BY THESE PRESENTS That: _____
of _____ in the County of _____ and State of _____
as **Principal**, and _____ of _____ in the County of _____
and State of _____ as **Surety**, legally authorized to do business in the
State of Delaware ("**State**"), are held and firmly bound unto the **State** in the sum of _____
Dollars (\$ _____), or _____ percent not to exceed _____
Dollars (\$ _____) of amount of bid on Contract
No. T201407501.01, to be paid to the **State** for the use and benefit of its Department of Transportation
("**DelDOT**") for which payment well and truly to be made, we do bind ourselves, our and each of our heirs,
executors, administrators, and successors, jointly and severally for and in the whole firmly by these presents.

NOW THE CONDITION OF THIS OBLIGATION IS SUCH That if the above bounden **Principal** who
has submitted to the **DelDOT** a certain proposal to enter into this contract for the furnishing of certain
materiel and/or services within the **State**, shall be awarded this Contract, and if said **Principal** shall well and
truly enter into and execute this Contract as may be required by the terms of this Contract and approved by
the **DelDOT**, this Contract to be entered into within twenty days after the date of official notice of the award
thereof in accordance with the terms of said proposal, then this obligation shall be void or else to be and
remain in full force and virtue.

Sealed with _____ seal and dated this _____ day of _____ in the year of our Lord
two thousand and _____ (20____).

SEALED, AND DELIVERED IN THE
presence of

Name of Bidder (Organization)

Corporate
Seal

By: _____
Authorized Signature

Attest _____

Title

Name of **Surety**

Witness: _____

By: _____

Title