

STATE OF DELAWARE

This Copy is for information only.
You must request a CD from
DeIDOT in order to bid.



DEPARTMENT OF TRANSPORTATION

BID PROPOSAL

for

CONTRACT T201606107.01

PAVEMENT AND REHABILITATION, NORTH VII, 2016

NEW CASTLE COUNTY

ADVERTISEMENT DATE: February 29, 2016

COMPLETION TIME: 140 Calendar Days

SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION
DELAWARE DEPARTMENT OF TRANSPORTATION
AUGUST 2001

Bids will be received in the Bidder's Room at the Delaware Department of Transportation's Administration Building, 800 Bay Road, Dover, Delaware until 2:00 P.M. local time March 29, 2016

Contract No.T201606107.01

**PAVEMENT AND REHABILITATION, NORTH VII, 2016
NEW CASTLE COUNTY**

GENERAL DESCRIPTION

LOCATION

These improvements are located in New Castle County more specifically shown on the Location Map(s) of the enclosed Plans.

DESCRIPTION

The improvements consist of furnishing all labor and materials for Pavement and Rehabilitation, North VII, 2016, and other incidental construction in accordance with the location, notes and details shown on the plans and as directed by the Engineer.

COMPLETION TIME

All work on this contract must be complete within 140 Calendar Days. It is the Department's intent to issue a Notice to Proceed such that work starts on or about May 23, 2016.

PROSPECTIVE BIDDERS NOTES:

1. BIDDERS MUST BE REGISTERED with DelDOT and request a cd of the official plans and specifications in order to submit a bid. Contact DelDOT at dot-ask@state.de.us, or (302) 760-2031.
2. QUESTIONS regarding this project are to be e-mailed to dot-ask@state.de.us no less than six business days prior to the bid opening date in order to receive a response. Please include T201606107.01 in the subject line. Responses to inquiries are posted on-line at <http://www.bids.delaware.gov>.
3. THE BID PROPOSAL incorporates a cd containing **Expedite, version 5.9a** and its installation file. Bidders are to use the cd provided to enter their bid amounts into the Expedite file. The Expedite bid file must be printed and submitted in paper form along with the cd and other required documents prior to the Bid due date and time.
4. SURETY BOND - Each proposal must be accompanied by a deposit of either surety bond or security for a sum equal to at least 10% of the bid.
5. **DRUG TESTING - Regulation 4104; The state Office of Management and Budget has developed regulations that require Contractors and Subcontractors to implement a program of mandatory drug testing for Employees who work on Large Public Works Contracts funded all or in part with public funds pursuant to 29 Del.C. §6908(a)(6). Refer to the full requirements by following the below link: <http://regulations.delaware.gov/register/september2015/final/19%20DE%20Reg%20207%2009-01-15.htm>**
Please note a few of the requirements listed below; for FAQs [click here](#).
 - * At bid submission - submit with the bid a signed affidavit certifying that the Contractor has in place or will implement during the entire term of the contract a Mandatory Drug Testing Program for their Employees that complies with this regulation;
 - * Two business days prior to contract execution - The awarded Contractor shall provide to DelDOT copies of the Employee Drug Testing Program for the Contractor, and may submit any Subcontractor's Employee Drug Testing Program for approval;
 - * Subcontractors - Contractors that employ Subcontractors on the jobsite may do so only after submitting a copy of the Subcontractor's Employee Drug Testing Program along with the standard subcontractor information. A Contractor or Subcontractor shall not commence work until DelDOT has concluded the Employee Drug Testing Program complies with this Regulation as per Section 3.2;
 - * Testing Report Forms shall be submitted to DelDOT no less than quarterly (forms will be provided).
 - * Penalties for non-compliance are specified in the regulation.
6. Supplemental Specifications to the August 2001 Standard Specifications were issued November 24, 2014 and apply to this project. They can be [viewed here](#). The **Specifications Note** document is for the use by the bidders to reference the new numbers to the past numbers used for bidding purposes on previous Department contracts.
7. No RETAINAGE will be withheld on this contract.
8. The Department's External Complaint Procedure can be viewed on DelDOT's Website at: <http://www.deldot.gov/information/business/>, or you may request a copy by calling (302) 760-2555.

9. **PLEASE NOTE** revisions to 'Equality of Employment Opportunity on Public Works' under General Notices.
10. **REMINDER;** A copy of your Delaware Business License must be submitted with your bid.

**STATE OF DELAWARE
CONSTRUCTION ITEMS UNITS OF MEASURE**

English Code	English Description	Multiply By	Metric Code	Metric Description	Suggested CEC Metric Code
ACRE	Acre	0.4047	ha	Hectare	HECTARE
BAG	Bag	N/A	Bag	Bag	BAG
C.F.	Cubic Foot	0.02832	m ³	Cubic Meter	M3
C.Y.	Cubic Yard	0.7646	m ³	Cubic Meter	M3
EA-DY	Each Day	N/A	EA-DY	Each Day	EA-DY
EA-MO	Each Month	N/A	EA-MO	Each Month	EA-MO
EA/NT	Each Night	N/A	EA-NT	Each Night	EA/NT
EACH	Each	N/A	EA	Each	EACH
GAL	Gallon	3.785	L	Liter	L
HOUR	Hour	N/A	h	Hour	HOUR
INCH	Inch	25.4	mm	Millimeter	MM
L.F.	Linear Foot	0.3048	m	Linear Meter	L.M.
L.S.	Lump Sum	N/A	L.S.	Lump Sum	L.S.
LA-MI	Lane Mile	1.609	LA-km	Lane-Kilometer	LA-KM
LB	Pound	0.4536	kg	Kilogram	KG
MFBM	Thousand Feet of Board Measure	2.3597	m ³	Cubic Meter	M3
MGAL	Thousand Gallons	3.785	kL	Kiloliter	KL
MILE	Mile	1.609	km	Kilometer	KM
S.F.	Square Foot	0.0929	m ²	Square Meter	M2
S.Y.	Square Yard	0.8361	m ²	Square Meter	M2
SY-IN	Square Yard-Inch	0.8495	m ² -25 mm	Square Meter-25 Millimeter	M2-25 MM
TON	Ton	.9072	t	Metric Ton (1000kg)	TON
N.A.*	Kip	4.448	kN	Kilonewton	N.A.*
N.A.*	Thousand Pounds per Square Inch	6.895	MPa	Megapascal	N.A.*

*Not used for units of measurement for payment.

TABLE OF CONTENTS

GENERAL DESCRIPTION..... i
 LOCATION..... i
 DESCRIPTION..... i
 COMPLETION TIME..... i
 PROSPECTIVE BIDDERS NOTES..... i
 CONSTRUCTION ITEMS UNITS OF MEASURE..... iii

GENERAL NOTICES..... 1
 SPECIFICATIONS..... 1
 CLARIFICATIONS..... 1
 ATTESTING TO NON-COLLUSION..... 1
 QUANTITIES..... 1
 PREFERENCE FOR DELAWARE LABOR..... 1
 EQUALITY OF EMPLOYMENT OPPORTUNITY ON PUBLIC WORKS..... 1
 TAX CLEARANCE..... 2
 LICENSE..... 2
 DIFFERING SITE CONDITIONS..... 2
 RIGHT TO AUDIT..... 3

PREVAILING WAGES..... 3
 STATE WAGE RATES..... 5

SUPPLEMENTAL SPECIFICATIONS..... 6

SPECIAL PROVISIONS..... 7
 CONSTRUCTION ITEM NUMBERS..... 8
 401502 - ASPHALT CEMENT COST ADJUSTMENT..... 9
 401580 – RIDE QUALITY OF HOT-MIX PAVEMENT..... 10
 401696 – ENTRANCE, DRIVEWAY AND INTERSECTING STREET PAVING SURCHARGE..... 15
 401699 - QUALITY CONTROL/QUALITY ASSURANCE OF BITUMINOUS CONCRETE.... 16
 401752 – SAFETY EDGE FOR ROADWAY PAVEMENT..... 29
 401755 – RECYCLED ASPHALT PAVEMENT MILLINGS FOR ROADWAY EDGE..... 30
 401823 - BITUMINOUS CONCRETE, SUPERPAVE, BITUMINOUS CONCRETE BASE 31
 401830 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 70-22,. . 32
 501534 –INTERFACE JOINT SEALING REPAIR..... 43
 503001 - PATCHING P.C.C. PAVEMENT, 6' TO 15', TYPE A..... 45
 503002 - PATCHING P.C.C. PAVEMENT, GREATER THAN 15' TO 100', TYPE B. 45
 503006 - DOWEL BARS..... 45
 503501 - CRACK AND JOINT SEALING LESS THAN 3/4" WIDE..... 51
 503502 - CRACK AND JOINT SEALING 3/4" to 1 3/4" WIDE..... 51
 503503 - PATCHING CONCRETE..... 54
 503517 - P.C.C. PATCHING, PARTIAL DEPTH..... 55
 602629 - CRACK SEALING BRIDGE DECKS, APPROACH SLABS, SIDEWALKS, ETC.. . . . 57
 705524 - DETECTABLE WARNING RETROFIT..... 58
 720585 - GUARDRAIL END TREATMENT ATTENUATOR, TYPE 1 - 31..... 60
 720588 - GUARDRAIL END TREATMENT ATTENUATOR, TYPE 3 - 31..... 60
 744544 – ADJUST OR REPAIR EXISTING CONDUIT JUNCTION WELL..... 62
 746924 - FURNISH & INSTALL LOOP WIRE 1-CONDUCTOR #14 AWG ENCASED IN 1/4" FLEXIBLE TUBING IN A LOOP SAWCUT..... 63
 748502 - RAISED/RECESSED PAVEMENT MARKER..... 65
 748548 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/YELLOW,.. 66
 748549 -PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/YELLOW,.. 66
 748557 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 3"..... 66
 748559 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 5"..... 66
 748568 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 9"..... 66
 748569 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 14"..... 66
 748512 - RETROREFLECTIVE PREFORMED PATTERNED MARKINGS, 6 75
 748513 - RETROREFLECTIVE PREFORMED PATTERNED MARKINGS, 12 75

748529 - RETROREFLECTIVE PREFORMED PATTERNED MARKING, SYMBOL/.	<u>75</u>
748566 - RETROREFLECTIVE PREFORMED PATTERNED CONTRAST MARKINGS,.....	<u>75</u>
748530 - REMOVAL OF PAVEMENT STRIPING.....	<u>80</u>
748553 - PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT MARKINGS.	<u>81</u>
749687 - INSTALLATION OR REMOVAL OF TRAFFIC SIGN ON SINGLE SIGN POST.....	<u>85</u>
749688 - INSTALLATION OF 4" DIAMETER HOLE, LESS THAN OR EQUAL TO 6" IN.....	<u>86</u>
749690 - INSTALLATION OR REMOVAL OF TRAFFIC SIGN ON MULTIPLE SIGN POSTS.	<u>87</u>
760507 - PROFILE MILLING, BITUMINOUS CONCRETE.....	<u>88</u>
763621 - CONSTRUCTION ENGINEERING, REHABILITATION.....	<u>90</u>
763643 - MAINTENANCE OF TRAFFIC – ALL INCLUSIVE.....	<u>92</u>
UTILITY STATEMENT.....	<u>97</u>
RIGHT OF WAY CERTIFICATE.....	<u>100</u>
ENVIRONMENTAL STATEMENT.....	<u>101</u>
RAILROAD STATEMENT.....	<u>103</u>
BID PROPOSAL FORMS.....	<u>104</u>
DRUG TESTING AFFIDAVIT.....	<u>114</u>
CERTIFICATION.....	<u>115</u>
BID BOND.....	<u>117</u>

GENERAL NOTICES

SPECIFICATIONS:

The specifications entitled "Delaware Standard Specifications, for Road and Bridge Construction, August, 2001", hereinafter referred to as the Standard Specifications, Supplemental Specifications, the Special Provisions, notes on the Plans, this Bid Proposal, and any addenda thereto shall govern the work to be performed under this contract.

CLARIFICATIONS:

Under any Section or Item included in the Contract, the Contractor shall be aware that when requirements, responsibilities, and furnishing of materials are outlined in the details and notes on the Plans and in the paragraphs preceding the "Basis of Payment" paragraph in the Standard Specifications or Special Provisions, no interpretation shall be made that such stipulations are excluded because reiteration is not made in the "Basis of Payment" paragraph.

ATTESTING TO NON-COLLUSION:

The Department requires as a condition precedent to acceptance of bids a sworn statement executed by, or on behalf of, the person, firm, association, or corporation to whom such contract is to be awarded, certifying that such person, firm, association, or corporation has not, either directly or indirectly, entered into any agreement, participated in any collusion, or otherwise taken any action in restraint of free competitive bidding in connection with such contract. The form for this sworn statement is included in the proposal and must be properly executed in order to have the bid considered.

QUANTITIES:

The quantities shown are for comparison of bids only. The Department may increase or decrease any quantity or quantities without penalty or change in the bid price.

PREFERENCE FOR DELAWARE LABOR:

Delaware Code, Title 29, Chapter 69, Section 6962, Paragraph (d), Subsection (4)b:

"In the construction of all public works for the State or any political subdivision thereof, or by firms contracting with the State or any political subdivision thereof, preference in employment of laborers, workmen or mechanics shall be given to bona fide legal citizens of the State who have established citizenship by residence of at least 90 days in the State. Each public works contract for the construction of public works for the State or any political subdivision thereof shall contain a stipulation that any person, company or corporation who violates this section shall pay a penalty to the Secretary of Finance equal to the amount of compensation paid to any person in violation of this section."

EQUALITY OF EMPLOYMENT OPPORTUNITY ON PUBLIC WORKS:

Delaware Code, Title 29, Chapter 69, Section 6962, Paragraph (d), Subsection (7) states;

- a. As a condition of the awarding of any contract for public works financed in whole or in part by State appropriation, such contracts shall include the following provisions:

During the performance of this contract, the contractor agrees as follows:

1. The contractor will not discriminate against any employee or applicant for employment because of race, creed, color, sex, sexual orientation, gender identity or national origin. The contractor will take positive steps to ensure that applicants are employed and that employees are treated during employment without regard to their race, creed, color, sex, sexual orientation, gender identity or national origin. Such action shall include, but not be limited to, the following: employment, upgrading, demotion or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship. The contractor agrees to post in conspicuous places available to employees and applicants for

employment notices to be provided by the contracting agency setting forth this nondiscrimination clause.

2. The contractor will, in all solicitations or advertisements for employees placed by or on behalf of the contractor, state that all qualified applicants will receive consideration for employment without regard to race, creed, color, sex, sexual orientation, gender identity or national origin.
3. The contractor will ensure employees receive equal pay for equal work, without regard to sex. Employee pay differential is acceptable if pursuant to a seniority system, a merit system, a system which measures earnings by quantity or quality of production, or if the differential is based on any other factor other than sex.

TAX CLEARANCE:

As payments to each vendor or contractor aggregate \$2,000, the Division of Accounting will report such vendor or contractor to the Division of Revenue, who will then check the vendor or contractor's compliance with tax requirements and take such further action as may be necessary to insure compliance.

LICENSE:

A person desiring to engage in business in this State as a contractor shall obtain a license upon making application to the Division of Revenue.

CONTRACTOR / SUBCONTRACTOR LICENSE: 29 DEL. C. §6967:

(b) No agency shall accept a proposal for a public works contract unless such contractor has provided a proper and current copy of its occupational and/or business license, as required by Title 30, to such agency.

(c) Any contractor that enters a public works contract must provide to the agency to which it is contracting, within 30 days of entering such public works contract, copies of all occupational and business licenses of subcontractors and/or independent contractors that will perform work for such public works contract. However, if a subcontractor or independent contractor is hired or contracted more than 20 days after the contractor entered the public works contract the occupational or business license of such subcontractor or independent contractor shall be provided to the agency within 10 days of being contracted or hired.

DIFFERING SITE CONDITIONS,

SUSPENSIONS OF WORK and SIGNIFICANT CHANGES IN THE CHARACTER OF WORK:

Differing site conditions: During the progress of the work, if subsurface or latent physical conditions are encountered at the site differing materially from those indicated in the contract or if unknown physical conditions of an unusual nature, differing materially from those ordinarily encountered and generally recognized as inherent in the work provided for in the contract are encountered at the site, the party discovering such conditions shall promptly notify the other party in writing of the specific differing conditions before they are disturbed and before the affected work is performed.

Upon written notification, the engineer will investigate the conditions, and if he/she determines that the conditions materially differ and cause an increase or decrease in the cost or time required for the performance of any work under the contract, an adjustment, excluding loss of anticipated profits, will be made and the contract modified in writing accordingly. The engineer will notify the contractor of his/her determination whether or not an adjustment of the contract is warranted.

No contract adjustment which results in a benefit to the contractor will be allowed unless the contractor has provided the required written notice. No contract adjustment will be allowed under their clause for any effects caused on unchanged work.

Suspensions of work ordered by the engineer: If the performance of all or any portion of the work is suspended or delayed by the engineer in writing for an unreasonable period of time (not originally anticipated, customary or inherent to the construction industry) and the contractor believes that additional compensation and/or contract time is due as a result of such suspension or delay, the contractor shall submit to the engineer in writing a request for adjustment within 7 calendar days of receipt of the notice to resume work. The request shall set forth the reasons and support for such adjustment.

Upon receipt, the engineer will evaluate the contractor's request. If the engineer agrees that the cost and/or time required for the performance of the contract has increased as a result of such suspension and the suspension was caused by conditions beyond the control of and not the fault of the contractor, its suppliers, or subcontractors at any approved tier, and not caused by weather, the engineer will make an adjustment (excluding profit) and modify the contract in writing accordingly. The engineer will notify the contractor of his/her determination whether or not an adjustment of the contract is warranted.

No contract adjustment will be allowed unless the contractor has submitted the request for adjustment within the time prescribed.

No contract adjustment will be allowed under this clause to the extent that performance would have been suspended or delayed by any other cause, or for which an adjustment is provided for or excluded under any other term or condition of this contract.

Significant changes in the character of work: The engineer reserves the right to make, in writing, at any time during the work, such changes in quantities and such alterations in the work as are necessary to satisfactorily complete the project. Such changes in quantities and alterations shall not invalidate the contract nor release the surety, and the contractor agrees to perform the work as altered.

If the alterations or changes in quantities significantly change the character of the work under the contract, whether or not changed by any such different quantities or alterations, an adjustment, excluding loss of anticipated profits, will be made to the contract. The basis for the adjustment shall be agreed upon prior to the performance of the work. If a basis cannot be agreed upon, then an adjustment will be made either for or against the contractor in such amount as the engineer may determine to be fair and equitable.

The term "significant change" shall be construed to apply only to the following circumstances:

- (A) When the character of the work as altered differs materially in kind or nature from that involved or included in the original proposed construction or
- (B) When a major item of work, as defined elsewhere in the contract, is increased in excess of 125 percent or decreased below 75 percent of the original contract quantity. Any allowance for an increase in quantity shall apply only to that portion in excess of 125 percent of original contract item quantity, or in case of a decrease below 75 percent, to the actual amount of work performed.

RIGHT TO AUDIT

The Department shall have the right to audit the books and records of the contractor or any subcontractor under this contract or subcontract to the extent that the books and records relate to the performance of the contract or subcontract. The books and records shall be maintained by the contractor for a period of 3 years from the date of final payment under the prime contract and by the subcontractor for a period of 3 years from the date of final payment under the subcontract (*29 Del.C. §6930*)

PREVAILING WAGES

Included in this proposal are the minimum wages to be paid various classes of laborers and mechanics as determined by the Department of Labor of the State of Delaware in accordance with Title 29 Del.C. §6960, relating to wages and the regulations implementing that Section.

REQUIREMENT BY DEPARTMENT OF LABOR FOR SWORN PAYROLL INFORMATION

Title 29 Del.C. §6960 stipulates;

- (b) Every contract based upon these specifications shall contain a stipulation that the employer shall pay all mechanics and laborers employed directly upon the site of the work, unconditionally and not less often than once a week and without subsequent deduction or rebate on any account, the full amounts accrued at time of payment, computed at wage rates not less than those stated in the specifications, regardless of any contractual relationship which may be alleged to exist between the employer and such laborers and mechanics. The specifications shall further stipulate that the scale of wages to be paid shall be posted by the employer in a prominent and easily accessible place at the site of the work, and that there may be withheld from the employer so much of accrued payments as may be considered necessary by the

Department of Labor to pay to laborers and mechanics employed by the employer the difference between the rates of wages required by the contract to be paid laborers and mechanics on the work and rates of wages received by such laborers and mechanics to be remitted to the Department of Labor for distribution upon resolution of any claims.

(c) Every contract based upon these specifications shall contain a stipulation that sworn payroll information, as required by the Department of Labor, be furnished weekly. The Department of Labor shall keep and maintain the sworn payroll information for a period of 6 months from the last day of the work week covered by the payroll.

Bidders are specifically directed to note the Department of Labor's prevailing wage regulations implementing §6960 relating to the effective date of the wage rates, at Part VI., Section C., which in relevant part states:

"Public agencies (covered by the provisions of 29 Del.C. §6960) are required to use the rates which are in effect on the date of the publication of specifications for a given project. In the event that a contract is not executed within one hundred twenty (120) days from the date the specifications were published, the rates in effect at the time of the execution of the contract shall be the applicable rates for the project."

Contractor may contact:

Department of Labor, Division of Industrial Affairs, 4425 N. Market Street, Wilmington, DE 19802
Telephone (302) 761-8200

STATE OF DELAWARE
DEPARTMENT OF LABOR
DIVISION OF INDUSTRIAL AFFAIRS
OFFICE OF LABOR LAW ENFORCEMENT
PHONE: (302) 451-3423


Mailing Address:
225 CORPORATE BOULEVARD
SUITE 104
NEWARK, DE 19702

Located at:
225 CORPORATE BOULEVARD
SUITE 104
NEWARK, DE 19702

PREVAILING WAGES FOR HIGHWAY CONSTRUCTION
EFFECTIVE MARCH 13, 2015 - AMENDED JULY 15, 2015

CLASSIFICATION	NEW CASTLE	KENT	SUSSEX
BRICKLAYERS	49.39	49.39	14.51
CARPENTERS	42.55	51.86	41.22
CEMENT FINISHERS	31.06	30.92	19.65
ELECTRICAL LINE WORKERS	22.50	22.50	21.25
ELECTRICIANS	63.60	63.60	63.60
IRON WORKERS	42.20	23.87	25.35
LABORERS	31.10	34.12	37.75
MILLWRIGHTS	16.11	15.63	13.49
PAINTERS	63.14	63.14	63.14
PILEDRIVERS	66.42	23.75	26.95
POWER EQUIPMENT OPERATORS	39.15	32.92	29.04
SHEET METAL WORKERS	22.75	20.31	18.40
TRUCK DRIVERS	32.31	20.65	25.55

CERTIFIED : 2/12/10

BY: 
ADMINISTRATOR, OFFICE OF LABOR LAW ENFORCEMENT


NOTE: THESE RATES ARE PROMULGATED AND ENFORCED PURSUANT TO THE PREVAILING WAGE REGULATIONS ADOPTED BY THE DEPARTMENT OF LABOR ON APRIL 3, 1992.

CLASSIFICATIONS OF WORKERS ARE DETERMINED BY THE DEPARTMENT OF LABOR. FOR ASSISTANCE IN CLASSIFYING WORKERS, OR FOR A COPY OF THE REGULATIONS OR CLASSIFICATIONS, PHONE (302) 451-3423.

NON- REGISTERED APPRENTICES MUST BE PAID THE MECHANICS RATE.

THESE RATES ARE BRING PROVIDED IN ACCORDANCE WITH DELAWARE'S FREEDOM OF INFORMATION ACT.

Re: Contract # T201606107.01, Pavement and Rehabilitation, North VII, 2016, New Castle County, DE

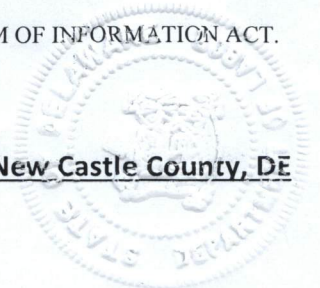

**SUPPLEMENTAL SPECIFICATIONS
TO THE
AUGUST 2001
STANDARD SPECIFICATIONS**

**EFFECTIVE AS OF THE ADVERTISEMENT
DATE OF THIS PROPOSAL
AND INCLUDED BY REFERENCE**

**The Supplemental Specifications can be viewed and printed from
the Department's Website.**

To access the Website;

- in your internet browser, enter; <http://www.deldot.gov>
- on the left side of the page under 'INFORMATION', Click; 'Publications'
- scroll down under 'MANUALS' and Click; "Standard Specifications 2001"

The full Website Link is;

http://www.deldot.gov/information/pubs_forms/manuals/standard_specifications/index.shtml

Printed copies of the Supplemental Specifications are available upon request. A printed copy of the above referenced Supplemental Specifications will be included in the final contract documents upon award.

The Contractor shall make himself aware of these revisions and corrections (Supplemental Specifications), and apply them to the applicable item(s) of this contract.

SPECIAL PROVISIONS

CONSTRUCTION ITEM NUMBERS

All construction pay items are assigned a six (6) digit number, shown as Item Number on the Plans and/or in the Special Provisions, and shall be interpreted in accordance with the following:

Standard Item Number:

The first three digits of the construction item numbers indicates the Section number as described in the Standard Specifications, and all applicable requirements of the Section shall remain effective unless otherwise modified by the Special Provisions. The last three digits of the construction item identifies the item by sequential number under that Section. Sequential numbers for all items covered under Standard Specifications range from 000 to 499. A comprehensive list of construction item numbers begins on page 421 of the Standard Specifications. Additions to this list will be made as required.

Special Provisions Item Number:

The first three digits of the construction items, covered under Special Provisions, indicates the applicable Section number of the Standard Specifications, and shall be governed fully by the requirements of the Special Provisions. The last three digit of the items covered under Special Provisions identifies the item by sequential number. Sequential numbers for Special Provision items, range from 500 to 999.

Examples

Standard Item Number - 202000 Excavation and Embankment

202 Indicates Section Number

000 Indicates Sequential Number

Special Provision Item Number - 202500 Grading and Reshaping Roadway

202 Indicates Section Number

500 Indicates Sequential Number

NOTE:

PLEASE NOTE revised Supplemental Specifications to the August 2001 Standard Specifications were issued November 24, 2014 and apply to this project. They can be [viewed here](#) and at www.deldot.gov.

SPECIFICATIONS: The Department is currently updating the August 2001 Specifications for Road and Bridge Construction. Through this update, some Divisions were renumbered and some new ones were created and added. The *Specifications Note* document is for the use by the bidders to reference the new numbers to the past numbers used for bidding purposes on previous Department contracts.

401502 - ASPHALT CEMENT COST ADJUSTMENT

For Sections 304, 401, 402, 403, 404, and 405, payments to the Contractor shall be adjusted to reflect increases or decreases in the Delaware Posted Asphalt Cement Price when compared to the Project Asphalt Cement Base Price, as defined in these Special Provisions.

The Delaware Posted Asphalt Cement Price will be issued monthly by the Department and will be the industry posted price for Asphalt Cement, F.O.B. Philadelphia, Pennsylvania. The link for the posting is http://www.deldot.gov/information/business/bids/asphalt_cement_english.shtml.

The Project Asphalt Cement Base Price will be the Delaware Posted Asphalt Cement Price in effect on the date of advertisement.

All deviations of the Delaware Posted Asphalt Cement Price from the Project Asphalt Cement Base Price are eligible for cost adjustment. No minimum increases or decreases or corresponding percentages are required to qualify for cost adjustment.

Actual quantity of asphalt cement qualifying for any Asphalt Cement Cost Adjustment will be computed using the weight of eligible asphalt that is shown on the QA/QC pay sheets as a percentage for the delivered material.

If the mix was not inspected and no QA/QC pay sheet was generated, then the asphalt percentage will be obtained from the job mix formula for that mix ID.

The asphalt percentage eligible for cost adjustment shall only be the virgin asphalt cement added to the mix.

There shall be no separate payment per ton cost of asphalt cement. That cost shall be included in the various unit prices bid per ton for those bid items that contain asphalt cement (mentioned above).

The Asphalt cement cost adjustment will be calculated on grade PG 64-22 asphalt regardless of the actual grade of asphalt used. The Project Asphalt Cement Base Price per ton for the project will be the Delaware Posted Asphalt Cement Price in effect on the date of project advertisement.

If the Contractor exceeds the authorized allotted completion time, the price of asphalt cement on the last authorized allotted work day, shall be the prices used for cost adjustment during the time liquidated damages are assessed. However, if the industry posted price for asphalt cement goes down, the asphalt-cement cost shall be adjusted downward accordingly.

NOTE:

Application of Asphalt Cement Cost Adjustment requirements as indicated above shall apply only to those contracts involving items related to bituminous base and pavements, and with bitumen, having a total of 1,000 tons or more of hot-mix bid quantity in case of Sections 401, 402 and 403; and 15,000 gallons or more in case of Sections 304, 404 and 405.

5/05/15

401580 – RIDE QUALITY OF HOT-MIX PAVEMENT

Description:

The purpose of this Special Provision is to modify Standard Specification Section 401.13 to change the method of determining an acceptable riding surface. This Special Provision replaces the entire existing wording in Section 401.13.

The Contractor shall be responsible for providing smoothness characteristics that will meet the requirements of the Contract. The Contractor shall be responsible for providing equipment, maintenance of traffic (MOT) as required by the Delaware MUTCD, and performing testing in accordance to the processes and procedures set forth in this Special Provision. All costs for testing and MOT shall be incidental to this item. Both the International Roughness Index (IRI) and deviations located within a 10' straightedge are used to characterize smoothness in this Special Provision.

Definitions:

Class 1 Project - a project that is full depth construction based on contract documents and document modifications.

Class 2 Project - a project in which a minimum of two smoothness opportunities are performed based on contract documents and document modifications.

Class 3 Project - a project that only one smoothness opportunity is performed based on contract documents and document modifications.

Deviation – a hump or depression found to exceed the tolerances defined in this Special Provision within a 10' straightedge.

ERD File – a file storing numbers in tabular form for plotting and processing purposes. The ERD file format was developed by the Engineering Research Division of the University of Michigan Transportation Institute (UMTRI).

Full Depth Construction – a project that consists of a hot mix asphalt wearing surface placed on a hot-mix asphalt base / binder course or Portland cement concrete, on an aggregate or asphalt / cement stabilized base structure on existing or prepared subgrade materials or borrow.

Inertial Profiler – a high speed or lightweight device used to measure the pavement profile with an accelerometer to form an inertial reference and a height sensor to measure pavement height relative to that reference.

International Roughness Index (IRI) – a statistic, based on computations from a measured longitudinal profile using a quarter-car simulation, calculated to represent the amount of roughness in a pavement surface.

Rolling Ten Foot Straightedge - a rigid 10' straightedge mounted to measurement wheels and used to indicate both high and low deviations.

Smoothness Opportunity – a smoothness opportunity is roadway milling, placement of a leveling course, in place recycling, or placement of a lift of Hot Mix Asphalt. Full depth reclamation is not considered in this Special Provision as a smoothness opportunity. The final wearing surface is considered one smoothness opportunity.

Equipment:

The Contractor shall have available, at all times during paving operations, an approved 10' straightedge. The Contractor shall also have available a high speed or lightweight inertial profiling system meeting the standards set forth in AASHTO MP-11 that is capable of collecting data in both wheelpaths simultaneously. Data collected using the inertial profiling system shall be used to calculate both IRI and deviation locations using on-board computer software. Deviations, as defined in this Special Provision, shall be calculated using a rolling 10' straight edge simulation program capable of isolating deviations greater than or equal to 0.25"

in 10'. If software is not available to calculate the parameters for a rolling 10' straight edge simulation, the Contractor may be permitted to use, at the Engineer's discretion, a rolling 10' straightedge capable of isolating deviations greater than or equal to 0.25" in 10'.

Documentation Required

Prior to the start of corrective actions (milling, overlaying, recycling, etc.), the Contractor shall provide to the Engineer:

1. Manufacturer, Make, and Model of the test system,
2. Equipment Owner,
3. Relevant Certifications,
4. Manufacturer Calibration Procedures, and
5. Relevant Operator Training information.

Testing cannot take place until the Engineer has received this information and provided approval of the proposed test equipment and MOT plan.

Calibration

Prior to testing, the Contractor shall verify that the inertial profiling equipment is calibrated by following the manufacturer's calibration procedure in the presence of the Engineer. Vertical and longitudinal calibrations shall be performed. The Engineer will provide calibration blocks for the Contractor's use at the time of calibration. If the equipment does not pass the calibration procedure, it will not be permitted for use.

Testing:

Testing of the pavement surface includes measurement and calculation of the IRI parameters and deviations in the longitudinal direction. The Contractor shall notify the Engineer at least three (3) working days prior to data collection for both initial and final testing.

Transverse Deviations / Cross Slope

After final rolling and at the Engineer's discretion, the Contractor shall test the surface of each lift and the final wearing surface for deviations in the transverse direction. The Contractor shall have available at all times, and use appropriately, an approved 10' straightedge to be placed perpendicular to the centerline for checking cross slope. Deviations in the transverse direction shall not equal or exceed 0.25". The discount charge for deviations in the transverse direction is described in Section 'Acceptance and Payment' of this Special Provision. Deviations in the transverse direction shall require corrective actions or will be assessed a deviation discount charge at the discretion of the Engineer.

General Testing Requirements for IRI Data Collection

Data used for calculation of the IRI shall be measured in each wheel path using an approved inertial profiling system. Data collected for IRI calculation shall have longitudinal spacing no greater than 6 inches. Wavelengths exceeding 300 feet shall be removed using long wavelength filters. The International Roughness Index shall be calculated using this data and reported in 0.1 mile (528 foot) segments. Three (3) passes shall be made in each lane and direction requiring testing. The filename given to the data set shall include the contract number, the location number, the lane tested and direction tested. For example, the Eastbound left lane of Contract XX-XXX-XX, Location 1, run 3 shall be named:

XXXXXXXXLoc1LEBr3

Testing shall be performed within seven (7) days of the completion of project paving operations. Areas not subject to IRI testing for all Classes of projects include:

1. 50 feet before the first bridge deck expansion joint to 50 feet after the last expansion joint if the bridge deck is excluded from the HMA overlay.
2. 20 feet longitudinally from the center of an existing obstruction located and visible in the pavement surface such as a manhole or water main. Obstructions located within the test area

shall be noted as an event on report printouts using an automated event marking system and should be removed from the calculations prior to report submission.

3. Shoulders, short acceleration and deceleration lanes, and turn lanes less than 1000 feet in length, and median crossovers.

Testing shall be performed in accordance to the following procedures.

1. Clean the roadway path to be measured of all debris and other loose material. Ensure that the roadway surface is dry and free of any standing water.
2. Locate the start of the project limits and mark them to enable automatic start sensors to be activated.
3. Locate the end of the project limits and mark them to enable automatic stop sensors to be activated.
4. Locate any obstructions in the wheelpath / test area and mark them with reflective tape to enable automatic event marking.
5. Establish a pre-test length (150' or the manufacturer's recommended pre-test length, whichever is greater) prior to the start of the project limits.
6. Position the left wheelpath sensor three feet (3') from the left edge marking of each lane tested.
7. Attain a test speed that is within the manufacturers recommendations for the equipment and maintain that test speed throughout the test.

Provide the Department the plot of one profile trace per tested lane and a summary report containing IRI values for each of the three test runs performed in each direction.

Initial Testing, IRI

The original surface for Class 3 projects shall be tested at no cost to the Department prior to performance of any smoothness opportunities in accordance to the methods and parameters in Section 'General Testing Requirements for IRI Data Collection'. Class 1 and Class 2 projects do not require initial testing. Results from initial testing for Class 3 projects shall be submitted to the Engineer within five (5) working days of test completion in the format specified by the Engineer. Results not received within the allotted time frame will be assessed a charge of \$1,000.00 per day at the Engineer's discretion. Three (3) measurements shall be taken for each lane required to meet this Special Provision. No paving shall be permitted until the Contractor has performed initial testing to the satisfaction of the Engineer.

Final Testing

The final surface, after all smoothness operations have been completed, shall be tested in accordance to Section 'General Testing Requirements for IRI Data Collection'. Results of final testing for all projects shall be submitted to the Engineer within five (5) working days of test completion in the format specified by the Engineer. Results not received within the allotted time frame will be assessed a charge of \$1,000.00 per day at the Engineer's discretion. Three measurements shall be taken for each lane to meet the requirements of this Special Provision.

Final Testing for Excessive Deviations

All paved areas, whether subject to IRI testing or not, must be tested to locate deviations in each wheelpath in the longitudinal direction and in the transverse direction. A deviation is considered to be a hump or depression greater than or equal to 0.25" within 10'. Longitudinal deviations shall be located using data collected by an inertial profiling system and processed through a rolling 10'- straightedge simulation, a rolling 10' straightedge, or a rigid 10' straightedge. Transverse deviations shall be located using a rigid 10' straightedge at the discretion of the Engineer. Testing shall be performed within seven (7) days of the completion of paving.

Quality Assurance Testing:

If the Engineer chooses to perform comparison testing, the Contractor shall provide a lane closure at no cost to the Engineer. The length of the lane closure shall be determined for each project location based on site conditions. The minimum closure shall be 0.25 mile and the maximum closure shall be 1 mile. The lane closure shall be at either end of the project limits and will be determined on a project basis at the Engineer's

discretion. If comparison testing indicates a difference greater than 6 in/mi in IRI measurements per 0.1-mile section, the Contractor and Engineer shall work to resolve the differences. If the differences cannot be resolved the equipment will be rejected for use on the project and all data collected to that point will be deemed invalid for that contract. At that point, the Contractor shall propose an alternative piece of testing equipment for use.

Data Reporting:

Test results shall be provided to the Department within five (5) working days of the completion of testing. Results not received within the allotted time frame will be assessed a charge of \$1,000.00 per day at the discretion of the Engineer.

The Department recognizes that inertial profiler manufacturers use different formats for reporting capabilities. Printouts on 8 ½" by 11" paper or strip charts are acceptable.

Data collected using the inertial profiling system shall be provided to the Engineer with the following information clearly displayed on the printout:

1. Profiling Company Name
2. Date of Paving
3. Date of Test
4. Parameters used in the calculation
5. Data file name
6. Testing Personnel

A printout of the pavement profile is required for one (1) of the three (3) runs for each lane and direction tested. A summary chart may be submitted for the remaining test runs. If excessive deviations are calculated using inertial profiling data runs submitted for IRI analysis a summary chart shall be submitted as well. The summary chart shall include the station and wheelpath for deviation reporting. If excessive deviations are manually determined (using a rolling ten-foot straightedge or rigid 10' straightedge), the Engineer will be present during testing and will record the data on site.

Inertial profiling systems have the capability of producing ERD files. An ERD file is requested for each run performed and can be submitted electronically (via email) or on external media (CD). More information about the format of ERD files can be obtained through the Engineer.

Acceptance and Payment:

Acceptance of the final pavement will be based on the results of IRI values and the number of deviations. A section that has an IRI value greater than 100.0 in/mi will require corrective actions. Deviations equal to or in excess of 0.25" in 10' shall be corrected at no expense to the Engineer or have a discount charge of \$200.00 per deviation assessed at the discretion of the Engineer.

An IRI number in inches per mile will be used for each 0.1-mile (528 foot) section as the basis for payment of the surface courses designated by each contract. The average value of the three test runs will be used as the IRI value for payment. Payments for each section will be based on estimated tonnage calculated from plan thickness and widths using the average maximum specific gravity ("Rice") value for all surface mix used at that location. If the plan does not indicate the travel lane width, a default value of 12' will be used. The formula used for tonnage estimation is:

$$\text{Estimated Tonnage} = [(L * W * T) * \text{Rice} * 62.4 \text{ (lb/ft}^3\text{)} * (0.0005 \text{ tons/12 in})]$$

where: L = Length Segment (ft.)
W = Width Lane (ft.)
T = Plan Thickness (in.)

The percentage of improvement for Class 3 projects will be calculated using the following equation:

$$\% \text{ Improvement} = [(\text{Initial IRI} - \text{Final IRI}) / \text{Initial IRI}] * 100$$

The applicable pay adjustments for IRI will be taken from Table A (Class 1 and 2 Projects) and Table B (Class 3 Projects)

$$IRI \text{ Bonus / Penalty} = \text{Estimated Tonnage} * UP * (PA - 100) / 100$$

where: UP = Contract Hot Mix Unit Price (Dollars)
PA = Pay Adjustment (Percent)

The total pay adjustment for paving work performed on each location will be:

$$(\sum IRI \text{ Adj for each section}) - \text{Total Deviations} * 200$$

It will be possible to receive bonus for IRI measurements and a discount charge for excessive deviations on the same project. If a 528' section has an IRI value resulting in a deduction of at least 30% of the section pay (i.e. IRI >100 in/mi), the deviation discount charge for that section is disregarded and the IRI discount charge is the only action taken for that section.

Table A: Payment Adjustments for Class 1 and Class 2 Projects

IRI per 0.1 mile Section (in./mi.)	Payment Adjustments	
	Class 1	Class 2
40.0 and under	103	104
40.1 - 55.0	101	102
55.1 - 65.0	100	101
65.1 - 75.0	99	100
75.1 - 100.0	96	97
>100	70	70

Class 3 projects will be paid based on the percent improvement for each 528' section from the average of the three initial profile traces taken prior to any work action as shown in the Table B.

Table B: Payment Adjustments for Class 3 projects

Percent Improvement from Initial test	Payment Adjustments for Class 3 Projects
> 60.0%	103
45.1 - 60.0%	102
25.1 - 45.0%	101
0 - 25.0%	100
<0%	70

Corrections to the paving surface, such as diamond grinding with approved equipment, patching, or other measures may be taken at the Contractor's expense and at the Engineer's discretion to correct pavement surfaces assessed a discount charge. Areas corrected using these methods will not be eligible for bonus payment, but may be assessed a charge based on the resulting surface after correction. The Engineer reserves the right to require corrective actions such as remove & replace or diamond grinding if the must correct discount charge exceeds 50% of the cost of materials or the IRI exceeds 100 in/mi. The Engineer may also require corrective actions if the deviations are at a height or depth which will create a safety concern on the roadway.

3/9/09

401696 – ENTRANCE, DRIVEWAY AND INTERSECTING STREET PAVING SURCHARGE

Description:

To compensate for work associated with paving the tie-ins at entrances, driveways and intersecting streets when such work cannot be completed as part of the mainline (roadway, auxiliary lanes, shoulder) paving operation. The surcharge limits will extend from the outermost roadway element to the point of tie-in as directed by the Engineer with the following exceptions.

No Surcharge will be paid:

1. When the tie-in does not exceed three feet (0.9 meters) from the outermost roadway element.
2. For paving any portion of a tie-in which exceeds 100 feet (30.48 meters) from the outermost roadway element. The entire tie-in section will be performed under normal paving operations.
3. When the intersecting street is to be paved under the same Contract.
4. For paving of auxiliary lanes and crossovers in the median of divided highways.

Method of Measurement:

The quantity of entrance, driveway and intersecting street paving surcharge will be measured as the actual number of tons (metric tons) of bituminous concrete placed and accepted in entrances, driveways and intersecting streets as described in this item.

Basis of Payment:

The quantity of entrance, driveway and intersecting street paving surcharge will be paid for at the Contract unit price per ton (metric ton). Price and payment will constitute full compensation for the additional labor and equipment costs involved with the reduced production associated with such work.

11/12/2013

401699 - QUALITY CONTROL/QUALITY ASSURANCE OF BITUMINOUS CONCRETE

.01 Description

This item shall govern the Quality Assurance Testing for supplying bituminous asphalt plant materials and constructing bituminous asphalt pavements and the calculation for incentives and disincentives for materials and construction. The Engineer will evaluate all materials and construction for acceptance. The procedures for acceptance are described in this Section. Include the costs for all materials, labor, equipment, tools, and incidentals necessary to meet the requirements of this specification in the bid price per ton for the bituminous asphalt. Payment to the Contractor for the bituminous asphalt item(s) will be based on the Contract price per ton and the pay adjustments described in this specification.

.02 Bituminous Concrete Production – Quality Acceptance

(a) Material Production - Tests and Evaluations.

All acceptance tests shall be performed by qualified technicians at qualified laboratories following AASHTO or DelDOT procedures, and shall be evaluated using Quality Level Analysis. The Engineer will conduct acceptance tests. The Engineer will directly base acceptance on the acceptance test results, the asphalt cement quality, the Contractor's QC Plan work, and the comparisons of the acceptance test results to the QC test results. The Engineer may elect to utilize test results of the Contractor in some situations toward judging acceptance.

Supply and capture samples, as directed by the Engineer under the purview of the Engineer from delivery trucks before the trucks leave the production plant. Hand samples to the Engineer to be marked accordingly. The sample shall represent the material produced by the Contractor, and shall be of sufficient size to allow the Engineer to complete all required acceptance tests. The Engineer will direct the Contractor when to capture these samples, on a statistically random, unbiased basis, established before production begins each day based upon the anticipated production tonnage. The captured sample shall be from the Engineer specified delivery truck. The Contractor may visually inspect the specified delivery load during sampling and elect to reject the load. If the contractor elects to reject the specified delivery truck, each subsequent load will be inspected until a visually acceptable load is produced for acceptance testing. All visually rejected loads shall not be sent to a Department project.

The first sample of the production day will be randomly generated by the Engineer between loads 0 and 12 (0-250 tons). Subsequent samples will be randomly generated by the Engineer on 500-ton sub-lots for the production day. Samples not retrieved in accordance with the Contractor's QC plan will be deemed unacceptable and may be a basis for rejection of material produced. Parallel tests or dispute resolution tests will only be performed on material captured at the same time and location as the acceptance test sample. Parallel test samples or Dispute Resolution samples will be created by splitting a large sample or obtaining multiple samples that equally represent the material. The Engineer will perform all splitting and handling of material after it is obtained by the Contractor.

The Contractor may retain dispute resolution samples or perform parallel tests with the Engineer on any acceptance sample.

The Engineer will evaluate and accept the material on a lot basis. All the material within a lot shall have the same JMF (mixture ID). The lot size shall be targeted for 2000 tons or a maximum period of three days, whichever is reached first. If the 2000th ton target lot size is achieved during a production day, the lot size shall extend to the end of that production day. The Contractor may interrupt the production of one JMF in order to produce different material; this type of interruption will not alter the determination of the size or limits of material represented by a lot. The Engineer will evaluate each lot on a subplot basis. The size for each subplot shall be 100 to 500 tons and testing for the sub lots will be completed on a daily basis. For each subplot, the Engineer will evaluate one sample.

The target size of sub-lots within each lot, except for the first sample of the production day, is equal-sized 500 ton sub lots and will be based upon anticipated production, however, more or fewer sublots, with differing sizes, may result due to the production schedule and conditions. If the actual production is less than anticipated, and it's determined a sample will not be obtained (based upon the anticipated tonnage), a new sample location will be determined on a statistically random, unbiased basis based upon the new actual

production. If the actual production is going to be 50 tons or greater over the anticipated sub lot production, a new sample location will be determined on a statistically random, unbiased basis based upon the new actual production. The Engineer will combine the evaluation and test results for all of the applicable sublots in order to evaluate each individual lot.

If the Engineer is present, and the quantity exceeds 25 tons, a statistically random sample will be used for analysis. When the anticipated production is less than 100 tons and greater than 25 tons, and the Engineer is not present, the contractor shall randomly select a sample using the Engineer's random location program. The captured sample shall be placed in a suitable box, marked to the attention of the Engineer, and submitted to the Engineer for testing. A box sample shall also be obtained by the contractor at the same time and will be used as the Dispute Resolution sample if requested by the Engineer. The Contractor shall also obtain one liquid asphalt sample (1 pint) per grade of asphalt used per day and properly label it with all pertinent information.

The Engineer will conduct the following tests in order to characterize the material for the pavement compaction quality and to judge acceptance and the pay adjustment for the material:

- AASHTO T312 - Preparing and Determining the Density of Hot Mix Asphalt (HMA) Specimens by Means of the Superpave Gyrotory Compactor
- AASHTO T166, Method C (Rapid Method) - Bulk Specific Gravity of Compacted Hot Mix Asphalt (HMA) Using Saturated Surface Dry Specimens
- AASHTO T308 - Determining the Asphalt Binder Content of Hot Mix Asphalt (HMA) by the Ignition Method
- AASHTO T30 - Mechanical Analysis of Extracted Aggregate
- AASHTO T209 - Theoretical Maximum Specific Gravity and Density of Hot Mix Asphalt (HMA)
- ASTM D7227 - Standard Practice for Rapid Drying of Compacted Asphalt Specimens using Vacuum Drying Apparatus

(b) Pavement Construction - Tests and Evaluations.

The Engineer will directly base acceptance on the compaction acceptance test results, and on the inspection of the construction, the Contractor's QC Plan work, ride smoothness as referenced in the contract documents, lift thickness as referenced in the contract documents, joint quality as referenced in the contract documents, surface texture as referenced in the contract documents, and possibly the comparisons of the acceptance test results to the independent test results. For the compaction acceptance testing, the Engineer will sample the work on a statistically random basis, and will test and evaluate the work based on daily production.

Notify the Engineer of any locations within that road segment that may not be suitable to achieve minimum (93%) compaction due to existing conditions prior to paving the road segment. Schedule and hold a meeting in the field with the Engineer in order to discuss all areas that may potentially be applicable to Table 5a before paving starts. Areas that will be considered for Table 5a will be investigated in accordance to the method described in Appendix B. If this meeting is not held prior to paving, no areas will be considered for Table 5a. Areas of allowable exemptions that will not be cored include the following: partial-depth patch areas, driveway entrances, paving locations of less than 100 tons, areas around manholes and driveway entrances, and areas of paving that are under 400 feet in continuous total length and/or 5 feet in width.

The exempt areas around manholes will be a maximum of 4 feet transversely on either side from the center of the manhole, and 20 feet longitudinally on either side from the center of the manhole. The exempt areas around driveway entrances shall be the entire width of the driveway, and 3 feet from the edge of the longitudinal joint next to the driveway. Areas of exemption that will be cored for informational purposes only include: areas where the mat thickness is less than three times the nominal maximum aggregate size as directed by the Engineer, violations of Section 401.08 in the Standard Specifications as directed by the Engineer, and areas shown to contain questionable subgrade properties as proven by substantial yielding under a fully legally loaded truck. Failure to obtain core samples in these areas will result in zero payment for compaction regardless of the exempt status.

The Engineer will evaluate and accept the compaction work on a daily basis. Payment for the compaction will be calculated by using the material production lots as referenced in **.02 Acceptance Plan (a) Material Production - B Tests and Evaluation** and analyzing the compaction results over the individual days covered in the material production lot. The compaction results will be combined with the material results to obtain a payment for this item.

The minimum size of a compaction lot shall be 100 tons. If the compaction lot is between 101 and 1000 tons, the Engineer shall randomly determine four compaction acceptance test locations. If the compaction lot is between 1001 and 1500 tons, the Engineer shall randomly determine six compaction acceptance test locations. If the compaction lot is between 1501 and 2000 tons, the Engineer shall randomly determine eight compaction acceptance test locations. If the compaction lot is greater than 2000 tons, the Engineer shall randomly determine two compaction acceptance test locations per 500 tons.

If a randomly selected area falls within an Engineer approved exemption area, the Engineer will select one more randomly generated location to be tested per the requirements of this Specification. If that cannot be accomplished, or if an entire location has been declared exempt, the compaction testing shall be performed as per these Specifications but a note will be added to the results that the location was an Engineer approved exempt location. Testing locations will be a minimum of 1.0 feet from the newly placed longitudinal joint and 50 feet from a new transverse joint.

Cut one six (6) inch diameter core through the full lift depth at the exact location marked by the Engineer. Cores submitted that are not from the location designated by the Engineer will not be tested and will be paid at zero pay.

Notify the Engineer prior to starting paving operations with approximate tonnage to be placed. The Contractor is then responsible for notifying the appropriate Engineer test personnel within 12 hours of material placement. The Engineer will mark core locations within 24 hours of notification. After determination of locations, the Contractor shall complete testing within two operational days of the locations being marked. If the cores are not cut within two operational days, the area in question will be paid at zero pay for compaction testing.

Provide any traffic control required for the structural number investigation, sampling, and testing work at no additional cost to the Department.

Commence coring of the pavement after the pavement has cooled to a temperature of 140°F or less. Cut each core with care in order to prevent damaging the core. Damaged cores will not be tested. Label each core with contract number, date of construction, and number XX of XX upon removal from the roadway. Place cores in a 6-inch diameter plastic concrete cylinder mold or approved substitute for protection. Separate cores in the same cylinder mold with paper. Attach a completed QC test record for the represented area with the corresponding cores. The Engineer will also complete a test record for areas tested for the QA report and provide to Materials & Research. Deliver the cores to the Engineer for testing, processing, and report distribution at the end of each production day.

Repair core holes per Appendix A, Repairing Core Holes in Bituminous Asphalt Pavements. Core holes shall be filled immediately. Failure to repair core holes at the time of coring will result in zero pay for compaction testing for the area in question. The Engineer will conduct the following tests on the applicable portion of the cores in order to evaluate their quality:

- AASHTO T166, Method C (Rapid Method) – Bulk Specific Gravity of Compacted Hot Mix Asphalt (HMA) Using Saturated Surface Dry Specimens
- AASHTO T209 - Theoretical Maximum Specific Gravity and Density of Hot Mix Asphalt
- ASTM D7227 - Standard Practice for Rapid Drying of Compacted Asphalt Specimens using Vacuum Drying Apparatus

The Engineer will use the average of the last five test values of the same JMF (mixture ID) material at the production plant in order to calculate the average theoretical maximum specific gravity of the cores. The average will be based on the production days test results and as many test results needed from previous days production to have an average of five samples. If there are less than five values available, the Engineer will use the JMF design value in addition to the available values to calculate the average theoretical maximum specific gravity.

.03 Payment and Pay Adjustment Factors.

The Engineer will determine pay adjustments for the bituminous asphalt item(s) in accordance with this specification. The Engineer will determine a pay adjustment factor for the material produced and a pay adjustment factor for the pavement construction. Pay adjustments for material and construction will be calculated independently. When the pay adjustment calculation for either material or construction falls to zero payment per tables 4, 5, or 5a, the maximum pay adjustment for the other factor will not exceed 100.

Pay Adjustment factors will only be calculated on in place material. Removed material will not be used in payment adjustment calculations.

Material Production Pay Adjustments will be calculated based upon 70% of the contract unit price and calculated according to section .03(a) of this specification. Pavement construction Pay Adjustments will be calculated based upon 30% of the contract unit price and calculated according to section .03(b) of this specification.

(a) Material Production - Pay Adjustment.

Calculate the material pay adjustment by evaluating the production material based on the following parameters:

Table 2 - Material Parameter Weight Factors		
Material Parameter	Single Test Tolerance (+/-)	Weight Factor
Asphalt Content	0.4	0.30
#8 Sieve (>=19.0 mm)	7.0	0.30
#8 Sieve (<=12.5 mm)	5.0	0.30
#200 Sieve (0.075mm Sieve)	2.0	0.30
Air Voids (4.0% Target)	2.0	0.10

Using the JMF target value, the single test tolerance (from Table 2), and the test values, the Engineer will use the following steps to determine the material pay adjustment factor for each lot of material:

1. For each parameter, calculate the mean value and the standard deviation of the test values for the lot to the nearest 0.1 unit.
2. For each parameter, calculate the Upper Quality Index (QU):

$$QU = ((JMF \text{ target}) + (\text{single test tolerance}) - (\text{mean value})) / (\text{standard deviation}).$$
3. For each parameter, calculate the Lower Quality Index (QL):

$$QL = ((\text{mean value}) - (JMF \text{ target}) + (\text{single test tolerance})) / (\text{standard deviation}).$$
4. For each parameter, locate the values for the Upper Payment Limit (PU) and the Lower Payment Limit (PL) from Table 3 - Quality Level Analysis by the Standard Deviation Method. (Use the column for “n” representing the number of sublots in the lot. Use the closest value on the table when the exact value is not listed).
5. Calculate the PWL for each parameter from the values located in the previous step:

$$PWL = PU + PL - 100.$$
6. Calculate each parameter’s contribution to the payment adjustment by multiplying its PWL by the weight factor shown in Table 2 for that parameter.
7. Add the calculated adjustments of all the parameters together to determine the Composite PWL for the lot.
8. From Table 4, locate the value of the Pay Adjustment Factor corresponding to the calculated PWL. When all properties of a single test are within the single test tolerance of Table 2, Pay Adjustment factors shall be determined by Column B. When any property of a single test is outside of the Single Test Tolerance parameters defined in Table 2, the Material Pay Adjustment factor shall be determined by Column C
9. For each lot, determine the final material price adjustment:

Final Material Pay Adjustment =
 (Lot Quantity) x (Item Bid Price) x (Pay Adjustment Factor) x 70%. This final pay calculation will be paid to the cent.

In lieu of being assessed a pay adjustment penalty, the Contractor may choose to remove and replace the material at no additional cost to the Department. When the PWL of any material parameter in Table 2 is below 60, the Engineer may require the removal and replacement of the material at no additional cost to the Department. Test results on removed material shall not be used in calculation of future PWL calculations for Mixture ID.

The test results from the Engineer on production that is less than 100 tons will be combined with the two most recently completed Engineer tests with the same Mixture ID to calculate payment for the lot encompassing the single test. If that cannot be accomplished, the approved JMF will be used to calculate payment for the lot encompassing the single test. Payment for previously closed lots will not be affected by the analysis.

When a sample is outside of the allowable single test tolerance for any Materials criteria in Table 2, that sample will be isolated. For payment purposes, the test result of the out of acceptable tolerance sample will be combined with the two previous acceptable samples of the same JMF and analyzed per this specification. The material that is considered out of the acceptable tolerance will only include the material within the represented sub-lot (i.e., a maximum of 500 tons). If the previous acceptable test result is from the previous production day, only the material produced on the second production day will be considered out of tolerance. All future sub lots will not include the isolated test. The pay factors for the out of tolerance sample lot will be calculated using column C of table 4.

If, during production, a QA sample test result does not meet the acceptable tolerances and the Contractors QC sample duplicates the QA sample test result, the Contractor can make an appropriate change to the mixture (within the JMF boundaries), and request to have that sample further isolated. After the Contractor has made appropriate changes, the Contractor will visually inspect each produced load. The first visually acceptable load will be sampled and tested. If that sample test result shows compliance with the specifications, the material that is considered out of the acceptable tolerance will include the material from the previous acceptable test result to the third load after the initially sampled and tested sample. If the sample does not meet the specification requirements, the Engineer will no longer accept material. Production may resume when changes have been made and an acceptable sample and test result is obtained.

Table 3 – Quality Level Analysis by the Standard Deviation Method							
PU or PL	QU and QL for “n” Samples						
	n = 3	n = 4	n = 5	n = 6	n = 7	n = 8	n = 9
100	1.16	1.50	1.79	2.03	2.23	2.39	2.53
99	-	1.47	1.67	1.80	1.89	1.95	2.00
98	1.15	1.44	1.60	1.70	1.76	1.81	1.84
97	-	1.41	1.54	1.62	1.67	1.70	1.72
96	1.14	1.38	1.49	1.55	1.59	1.61	1.63
95	-	1.35	1.44	1.49	1.52	1.54	1.55
94	1.13	1.32	1.39	1.43	1.46	1.47	1.48
93	-	1.29	1.35	1.38	1.40	1.41	1.42
92	1.12	1.26	1.31	1.33	1.35	1.36	1.36
91	1.11	1.23	1.27	1.29	1.30	1.30	1.31
90	1.10	1.20	1.23	1.24	1.25	1.25	1.26
89	1.09	1.17	1.19	1.20	1.20	1.21	1.21
88	1.07	1.14	1.15	1.16	1.16	1.16	1.17
87	1.06	1.11	1.12	1.12	1.12	1.12	1.12
86	1.04	1.08	1.08	1.08	1.08	1.08	1.08
85	1.03	1.05	1.05	1.04	1.04	1.04	1.04

84	1.01	1.02	1.01	1.01	1.00	1.00	1.00
83	1.00	0.99	0.98	0.97	0.97	0.96	0.96
82	0.97	0.96	0.95	0.94	0.93	0.93	0.93
81	0.96	0.93	0.91	0.90	0.90	0.89	0.89
80	0.93	0.90	0.88	0.87	0.86	0.86	0.86
79	0.91	0.87	0.85	0.84	0.83	0.82	0.82
78	0.89	0.84	0.82	0.80	0.80	0.79	0.79
77	0.87	0.81	0.78	0.77	0.76	0.76	0.76
76	0.84	0.78	0.75	0.74	0.73	0.73	0.72
75	0.82	0.75	0.72	0.71	0.70	0.70	0.69
74	0.79	0.72	0.69	0.68	0.67	0.66	0.66
73	0.75	0.69	0.66	0.65	0.64	0.63	0.63
72	0.74	0.66	0.63	0.62	0.61	0.60	0.60
71	0.71	0.63	0.60	0.59	0.58	0.57	0.57
70	0.68	0.60	0.57	0.56	0.55	0.55	0.54
69	0.65	0.57	0.54	0.53	0.52	0.52	0.51
68	0.62	0.54	0.51	0.50	0.49	0.49	0.48
67	0.59	0.51	0.47	0.47	0.46	0.46	0.46
66	0.56	0.48	0.45	0.44	0.44	0.43	0.43
65	0.52	0.45	0.43	0.41	0.41	0.40	0.40
64	0.49	0.42	0.40	0.39	0.38	0.38	0.37
63	0.46	0.39	0.37	0.36	0.35	0.35	0.35
62	0.43	0.36	0.34	0.33	0.32	0.32	0.32

Table 3 – Quality Level Analysis by the Standard Deviation Method

PU or PL	QU and QL for “n” Samples						
	n = 3	n = 4	n = 5	n = 6	n = 7	n = 8	n = 9
61	0.39	0.33	0.31	0.30	0.30	0.29	0.29
60	0.36	0.30	0.28	0.27	0.27	0.27	0.26
59	0.32	0.27	0.25	0.25	0.24	0.24	0.24

Table 4 - PWL Pay Adjustment Factors

PWL	Pay Adjustment Factor (%) Column B	Pay Adjustment Factor (%) Column C
100	+5	0
99	+4	-1
98	+3	-2
97	+2	-3
96	+1	-4
95	0	-5
94	-1	-6
93	-2	-7

92	-3	-8
91	-4	-9
PWL<91	PWL - 100	PWL - 100

(b) Pavement Construction - Pay Adjustments.

The Engineer will determine the pavement construction pay adjustment by evaluating the construction of the pavement, based on the following parameter:

- Degree of compaction of the in-place material

Using the test values for the cores, the Engineer will use the following steps to determine the pavement construction pay adjustment for each lot of work. .

1. Calculate the core bulk specific gravity values from the subplot tests values, to the nearest 0.001 unit. Obtain the Theoretical maximum Specific Gravity values from the corresponding laboratory subplot tests.
2. Calculate the Degree of Compaction:
Degree of Compaction =
((Core Bulk Specific Gravity) / (Theoretical Maximum Specific Gravity)) x 100% recorded to the nearest 0.1%.
3. The average compaction for the sublots shall be averaged together for the compaction level of the lot. The lots compaction test level shall be averaged and recorded to the nearest whole percent.
4. Locate the value of the Payment Adjustment Factor corresponding to the calculated degree of compaction from Table 5 or Table 5a.
5. Determine the pavement construction price adjustment by using the following formula:
Construction Pay adjustment = (Lot Quantity) x (Bid Price) x (Pay Adjustment Factor) x 30%.

Table 5: Compaction Price Adjustment Highway Locations		
Degree of Compaction (%)	Range	Pay Adjustment Factor (%)
>= 97.0	>= 96.75	-100*
96.5	96.26 – 96.74	-5
96.0	95.75 – 96.25	-3
95.5	95.26 – 95.74	-2
95.0	94.75 – 95.25	0
94.5	94.26 – 94.74	0
94.0	93.75 – 94.25	1
93.5	93.26 – 93.74	3
93.0	92.75 – 93.25	5
92.5	92.26 – 92.74	3

92.0	91.75 – 92.25	0
91.5	91.26 – 91.74	0
91.0	90.75 – 91.25	-5
90.5	90.26 – 90.74	-15
90.0	89.75 – 90.25	-20
89.5	89.26 – 89.74	-25
89.0	88.75 – 89.25	-30
88.5	88.26 – 88.74	-50
=<88.0	=<88.25	-100*

* or remove and replace it at Engineer's discretion

Table 5A: Compaction Price Adjustment Other¹ Locations		
Degree of Compaction	Range	Pay Adjustment Factor (%)
>= 97.0	>= 96.75	-100*
96.5	96.26 – 96.74	-5
96.0	95.75 – 96.25	-3
95.5	95.26 – 95.74	-2
95.0	94.75 – 95.25	0
94.5	94.26 – 94.74	0
94.0	93.75 – 94.25	0
93.5	93.26 – 93.74	1
93.0	92.75 – 93.25	3
92.5	92.26 – 92.74	1
92.0	91.75 – 92.25	0
91.5	91.26 – 91.74	0
91.0	90.75 – 91.25	0
90.5	90.26 – 90.74	0
90.0	89.75 – 90.25	0
89.5	89.26 – 89.74	0
89.0	88.75 – 89.25	-1
88.5	88.26 – 88.74	-3
88.0	87.75 – 88.25	-5
87.5	87.26 – 87.74	-10
87.0	86.75 – 87.25	-15

86.5	86.26 – 86.74	-20
86.0	85.75 – 86.25	-25
85.5	85.26 – 85.74	-30
85.0	84.75 – 85.25	-40
84.5	84.26 – 84.74	-50
=< 84.0	=<84.25	-100*

* or remove and replace at Engineer's discretion

¹ This chart is to be used for areas where the structural value of the area to be paved is less than 1.75 as determined by the Engineer. See Appendix B - Method for Obtaining Cores for Determination of Roadway Structure. This chart is applicable to rehabilitation work only; full depth construction will not be considered for Table 5a.

.04 Dispute Resolution.

Disputes or questions about any test result shall be brought to the attention of the Contractor and the Engineer within two operational days of reported test results. The following dispute resolution procedures will be used.

The Engineer and the Contractor will review the sample quality, the test method, the laboratory equipment, and the laboratory technician. If these factors are not the cause of the dispute, a third party dispute resolution will be used.

Third party resolution testing can be performed at either another Contractor’s laboratory, the Engineer’s laboratory, or an independent accredited laboratory. Unless otherwise mutually agreed upon by DAPA and the Engineer, the Engineer’s qualified laboratory in Dover and qualified personnel shall conduct the necessary testing for third party Dispute Resolution after the Engineer has provided reasonable notice to allow the Contractor to witness this testing.

When disputes over production testing occur, the samples used for Dispute Resolution testing will be those samples the properly captured, labeled, and stored, as described in the second paragraph of the section of these specifications titled **.02 Acceptance Plan, (a) Material Production - Tests and Evaluations**. If no samples are available, the original testing results will be used for payment calculations.

Dispute Resolution samples for air void content will be heated by a microwave oven.

If there is a discrepancy between the Engineer’s acceptance test result and the Contractor’s test result, the Contractor may ask for the Dispute Resolution sample to be tested. The Contractor may request up to two dispute resolution samples be tested per calendar year without charge. Any additional Dispute Resolution samples run at the Contractors request where the results substantiate the acceptance test result will be assessed a fee of \$125. Any additional Dispute Resolution samples that substantiate the Contractors test result will not be assessed the fee.

When disputes over compaction core test results occur, the Engineer’s acceptance core will be used for the dispute resolution sample. The Contractor will be advised on when the testing will occur as referenced above to witness the testing. The results of the dispute resolution testing shall replace all of the applicable disputed test results for payment purposes.

Appendix A - Repairing Core Holes in Bituminous Asphalt Pavement

Description.

This appendix describes the procedure required to repair core holes in a bituminous concrete pavement.

Materials and Equipment.

The following material shall be available to complete this work:

- Patch Material - DelDOT approved High Performance Cold Patch material shall be used.

The following equipment shall be available to complete this work:

- Sponge or other absorbent material - Used to extract water from the hole.
- Compaction Hammer - mechanical (electrical, pneumatic, or gasoline driven) tamping device with a flat, circular tamping face smaller than 6 inches in diameter. .

Construction Method.

After core removal from the hole, remove all excess water from within the hole, and prevent water from re-entering the hole.

Place the patch material in lifts no greater than 3 inches and compact with mechanical tamping device. If the hole is deeper than 3 inches, use two lifts of approximately equal depths so that optimum compaction is achieved. Make sure that the patch surface matches the grade of the existing roadway. Make every effort to achieve the greatest possible compaction

Performance Requirements.

The Engineer will judge the patch on the following basis:

- The patch shall be well compacted
- The patch surface shall match the grade of the surrounding roadway surface.

Basis of Payment.

No measurement or payment will be made for the patching work. The Contractor must gain the Engineer's acceptance of the patching work before the Engineer will accept the material represented by the core.

Appendix B - Method for Obtaining Cores for Determination of Roadway Structure

The Contractor is responsible for obtaining cores in areas that they propose are eligible for compaction price adjustments according to Table 5a in this specification. Table 5a is not applicable for new full-depth pavement box construction. Cores submitted for this process shall be obtained according to the following process.

1. Contact Materials & Research (M&R) personnel to determine if information about the area is already available. If M&R has already obtained cores in the location that is being investigated, the contractor may opt to use the laboratory information for the investigation and not core the area on their own.
2. If M&R does not have information concerning the section of the roadway, the contractor needs to contact M&R to arrange for verification of coring operations. Arrangements shall be made to allow for an individual from M&R to be on the site when the cores are obtained. Cores will be turned over to M&R for evaluation.
3. The Contractor is responsible for providing all traffic control and repairing core holes in accordance to 401699 Appendix A - Repairing Core Holes in Bituminous Asphalt Pavements.
4. Cores are to be taken throughout the entire project for the area in question. Cores will be spaced, from the start of the project in increments determined based on field and project specifics. Cores will be evenly distributed throughout the project location. The cores will be taken in the center of the lane in question.
5. Additional cores may be taken at other locations, if surface conditions indicate that there may be a substantial difference in the underlying section. The location of these cores should be documented and submitted to M&R.
6. Cores shall be full depth and include underlying materials. If there is a stone base included in the pavement section, at a minimum 1 core must have information concerning the thickness of the base. This is determined by augering to the subgrade surface.
7. The calculations used to determine the structural capacity of the roadway is as follows. If the contractor finds, upon starting the coring process, that the areas are of greater thickness than applicable to Table 5a, they may terminate the coring process on their own and retract the request.

Structural Number Calculations

Each pavement box material is assigned a structural coefficient based upon AASHTO design guides. The structural coefficient is used to determine the total strength of the pavement section. Materials used in older pavement sections are assigned lower structural coefficients to compensate for aging of the materials. The coefficients used to determine the structural number of an existing pavement are:

Existing Material	Structural Coefficient
HMA	0.32
Asphalt Treated Base	0.26
Soil Cement	0.16
Surface Treatment (Tar & Chip)	0.10
GABC	0.14
Concrete	0 - 0.7*

* The Structural Coefficient of Concrete is dependent upon the condition of the concrete. Compressive strengths & ASR analysis are used to determine condition - contact the Engineer if this situation arises.

Newly placed materials use a different set of structural coefficients. They are as follows:

New Material	Structural Coefficient
HMA	0.40
Asphalt Treated Base (BCBC)	0.32
Soil Cement	0.20
GABC	0.14

Example:

Location includes placement of a 1.25" Type C overlay on 2.25" Type B. Existing roadway is cored and is shown to consist of 2" HMA on 7" GABC.

Calculation:

For the Type B lift the calculation would be:

$$\begin{array}{r}
 \text{Existing HMA} \quad 2 * 0.32 = 0.64 \\
 \text{GABC} \quad 7 * 0.14 = \underline{0.98} \\
 \hline
 1.62
 \end{array}$$

For the Type C lift the calculation would be:

$$\begin{array}{r}
 \text{Newly Placed B} \quad 2.25 * 0.4 = 0.90 \\
 \text{Existing HMA} \quad 2 * 0.32 = 0.64 \\
 \text{GABC} \quad 7 * 0.14 = \underline{0.98} \\
 \hline
 2.52
 \end{array}$$

401752 – SAFETY EDGE FOR ROADWAY PAVEMENT

Description:

This work consists of the construction of safety edge(s) along bituminous concrete pavement or P.C.C. pavement in accordance with the details and notes on the Plans and as directed by the Engineer.

Construction Methods:

The safety edge shall not be constructed adjacent to curb or in front of guardrail sections.

In bituminous concrete pavement sections, prior to the construction of the safety edge, the fill or in situ material at the edge of pavement shall be compacted so that it is level with the top of the pavement, prior to the final surface overlay.

In bituminous concrete pavement sections, the contractor shall attach a device to the screed of the paver unit that confines the material at the end of the gate and extrudes the asphalt material in such a way that results in a compacted wedge shape pavement edge of 32 degrees (+/- 2 degrees). Contact shall be maintained between the device and the road shoulder surface. The device shall be manufactured so that it can be easily adjusted to transition at cross roads, driveways and obstructions without stopping the paver unit. The device's shape shall constrain the asphalt and cause compaction, as well as increase the density of the extruded profile.

In bituminous concrete pavement sections, the Transtech Shoulder Wedge Maker, Carlson Safety Edge End Gate or an approved equal shall be used to produce the safety edge. Contact information for these wedge shape compaction devices is listed below:

Transtech Systems, Inc.
1594 State Street
Schenectady, NY 12304
1-800-724-6306
www.transtechsys.com

or

Carlson Paving Products
18425 50th Ave. E
Tacoma, WA 98446
1-253-278-9426
www.carlsonpavingproducts.com

or an approved equal.

In P.C.C. pavement sections, the paver screed shall be modified to provide a chamfer at the end of the P.C.C. pavement in accordance with the details and notes on the Plans, or as directed by the Engineer.

Method of Measurement:

Safety Edge will not be measured for payment.

Basis of Payment:

The cost associated with the construction of safety edge(s), including but not limited to the wedge device, preparation and compaction of the fill or in situ material, and placement of the safety edge in accordance with the Plans and Details shall be incidental to the bituminous concrete pavement or P.C.C. pavement item being placed.

10/15/2013

401755 – RECYCLED ASPHALT PAVEMENT MILLINGS FOR ROADWAY EDGE

Description:

Furnish and place hot-mix millings along roadway edge at the location(s) shown on the Plans, and/or as directed by the Engineer.

Materials:

Provide recycled asphalt pavement millings uniformly graded having a maximum size of 1 ½” (38 mm) in accordance with Subsection 821.03(c), Type B.

Construction Methods:

1. Place recycled asphalt pavement millings along roadway edge to width(s) and depth(s) shown on Plans in a wedge shape sloped not steeper than 4:1 adjacent to the outermost edge of pavement and/ or as directed by Engineer.
2. Compact with a vibratory roller.
 - A. If soft soil conditions or excessive vibration in adjacent residential areas prohibit use, a static roller may be used as approved by the Engineer.
 - B. Fill any voids.
3. Sweep excess recycled asphalt pavement millings from travel way.

Method of Measurement:

The Engineer will measure the quantity of work acceptably completed. Recycled Asphalt Pavement Millings for Roadway Edge will be measured by tons installed and accepted.

Basis of Payment:

The quantity of Recycled Asphalt Pavement Millings for Roadway Edge will be paid for at the Contract unit price per ton. Price and payment constitutes full compensation for furnishing and placing recycled asphalt pavement millings, compaction, filling voids with millings, sweeping excess material from travel way and for all labor, tools and incidentals necessary to complete the work.

12/15/11

- 401800 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 115 GYRATIONS, PG 64-22 (CARBONATE STONE)**
- 401801 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 64-22 (CARBONATE STONE)**
- 401802 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 205 GYRATIONS, PG 64-22 (CARBONATE STONE)**

- 401803 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 115 GYRATIONS, PG 70-22 (CARBONATE STONE)**
- 401804 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 70-22 (CARBONATE STONE)**
- 401805 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 205 GYRATIONS, PG 70-22 (CARBONATE STONE)**

- 401806 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 115 GYRATIONS, PG 76-22 (CARBONATE STONE)**
- 401807 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 76-22 (CARBONATE STONE)**
- 401808 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 205 GYRATIONS, PG 76-22 (CARBONATE STONE)**

- 401809 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE B, 115 GYRATIONS, PG 64-22**
- 401810 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE B, 160 GYRATIONS, PG 64-22**
- 401811 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE B, 205 GYRATIONS, PG 64-22**

- 401812 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE B, 115 GYRATIONS, PG 70-22**
- 401813 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE B, 160 GYRATIONS, PG 70-22**
- 401814 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE B, 205 GYRATIONS, PG 70-22**

- 401815 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE B, 115 GYRATIONS, PG 76-22**
- 401816 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE B, 160 GYRATIONS, PG 76-22**
- 401817 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE B, 205 GYRATIONS, PG 76-22**

- 401818 - BITUMINOUS CONCRETE, SUPERPAVE, BITUMINOUS CONCRETE BASE COURSE, 115 GYRATIONS, PG 64-22**
- 401819 - BITUMINOUS CONCRETE, SUPERPAVE, BITUMINOUS CONCRETE BASE COURSE, 160 GYRATIONS, PG 64-22**
- 401820 - BITUMINOUS CONCRETE, SUPERPAVE, BITUMINOUS CONCRETE BASE COURSE, 205 GYRATIONS, PG 64-22**

- 401821 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 64-22, PATCHING**
- 401822 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE B, 160 GYRATIONS, PG 64-22, PATCHING**
- 401823 - BITUMINOUS CONCRETE, SUPERPAVE, BITUMINOUS CONCRETE BASE COURSE, 160 GYRATIONS, PG 64-22, PATCHING**
- 401824 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG-64-22, WEDGE**
- 401825 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE B, 160 GYRATIONS, PG-64-22, WEDGE**

- 401826 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 115 GYRATIONS, PG 64-22, (NON-CARBONATE STONE)**
- 401827 -BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 64-22, (NON-CARBONATE STONE)**
- 401828 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 205 GYRATIONS, PG 64-22, (NON-CARBONATE STONE)**

- 401829 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 115 GYRATIONS, PG 70-22, (NON-CARBONATE STONE)**

401830 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 70-22, (NON-CARBONATE STONE)

401831 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 205 GYRATIONS, PG 70-22, (NON-CARBONATE STONE)

401832 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 115 GYRATIONS, PG 76-22, (NON-CARBONATE STONE)

401833 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 76-22, (NON-CARBONATE STONE)

401834 - BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 205 GYRATIONS, PG 76-22, (NON-CARBONATE STONE)

401835 - THIN BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 115 GYRATIONS, PG 64-22

401836 - THIN BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 64-22

401837 - THIN BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 115 GYRATIONS, PG 70-22

401838 - THIN BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 70-22

401839 - THIN BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 115 GYRATIONS, PG 76-22

401840 - THIN BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 76-22

.01 Description:

This specification shall govern the production and construction of bituminous concrete pavement. The following Subsections of the Standard Specifications shall be applicable: 401.01, 401.03 - 401.10, 401.12, and 401.13. All other subsections have been modified herein.

Payment for bituminous concrete shall be in accordance with item 401699. The Contractor shall read and thoroughly understand the requirements of the QA/QC specification as defined in item 401699. It is the responsibility of the Contractor to determine all costs associated with meeting these requirements and to include them in the per ton bids for the various Superpave bituminous concrete items. Payment adjustment factors will be calculated in accordance with the latest version of item 401699.

Bituminous concrete may be produced by one or a combination of several technologies involving asphalt foaming processes and equipment or additives that facilitate the reduction of the temperature at which the mix can be placed and satisfactorily compacted thereby permitting the mix to be produced at reduced temperatures.

.02 Materials:

Use materials conforming to standard specifications 823.

Materials for bituminous concrete shall conform to the requirements of Subsections 823.01, 823.05-823.17, and 823.25 - 823.28 of the Standard Specifications and the following. If the Contractor proposes to use a combination of materials that are not covered by this Specification, the mix design shall be submitted and reviewed by the Engineer 30 calendar days prior to use.

a) **Asphalt Binder:**

Meet the requirements of Superpave performance-grade asphalt binder, as referenced in the Plans, according to M 320¹, Table 1 and tested according to AASHTO R29 with the following test ranges:

TEST Procedure	AASHTO REFERENCE	SPECIFICATION LIMITS
Temperature, °C	M 320	Per Grade
Original DSR, G*/sin (δ)	T 315	1.00 - 2.20 kPa ¹
RTFO DSR, G*/sin (δ)	T 315	>= 2.20 kPa
PAV DSR, G*/ sin (δ)	T 315	</=5000 kPa

TEST Procedure	AASHTO REFERENCE	SPECIFICATION LIMITS
BBR Creep Stiffness, S	T 313	≤ 300.0 kPa
BBR m-value	T 313	≥ 0.300

Note 1: The exception to M 320 is that the original DSR shall be 1.00 to 2.20 kPa

Substitution of a higher temperature grade will require prior approval by the Engineer.

The highest low temperature grade virgin binder to be used is -22.

Depending on the level of Recycled materials used, the low temperature properties, per T 313, may be different than stated in M 320 or the previous table.

b) **Recycled Materials:**

RAP (Recycled Asphalt Pavement): Bituminous concrete pavement mechanically processed to a homogenous consistency to be recycled through the production plant for use in a new bituminous concrete mixture.

The percentage allowance of recycled materials (recycled asphalt pavement and/or shingles) shall be controlled through the use of the Materials & Research recycled mixture program available through the Materials & Research Section. The program can be used by the Contractor to determine which materials and combinations of materials can be used to meet the specified material on the contract.

If the Contractor proposes to use a combination of materials that are not covered by this program, the mix design shall be submitted and reviewed by the Engineer.

c) **Shingles:**

RAS (Recycled Asphalt Shingles): Materials reclaimed from the shingle manufacturing process such as tabs, punch-outs, and damaged new shingles mechanically broken down with 100% passing the 1/2 in (12.5 mm) sieve. Shipping, handling, and shredding costs are incidental to the price of Superpave item.

Post-consumer shingles or used shingles are not acceptable. Fiberglass-backed and organic felt-backed shingles shall be kept separate. Both materials shall not be used in the same mixture at the same time. All shingles shall be free of all foreign material and moisture.

The use of Recycled Asphalt Shingles will be considered for 115 gyrations mix designs upon demonstration by the producer of adequate blending of the binder verified by laboratory testing on plant produced material.

d) **Mineral Aggregate:**

Conform to Section 805 and the following criteria. These criteria apply to the combined aggregate blend.

DESIGN ESAL'S (MILLIONS)	COARSE AGGREGATE ANGULARITY ¹ (% MIN)		FINE AGGREGATE ANGULARITY ² (% MIN)		CLAY CONTENT ³ (% - MIN)	FLAT AND ELONGATED ⁴ (% - MAX)
	≤ 100 MM	> 100 MM	≤ 100 MM	> 100 MM		
< 0.3	55/-	-/-	-	-	40	-
0.3 to < 3	75/-	50/-	40	40	40	-
3 to <10	85/80 ⁵	60/-	45	40	45	-
10 < 30	95/90	80/75	45	40	45	-
30	100/100	100/100	45	45	50	10

¹Coarse Aggregate Angularity is tested according to ASTM D5821.

²Fine Aggregate Angularity is tested according to AASHTO TP-33.

³Clay Content is tested according to AASHTO T176.

⁴Flat and Elongated is tested according to ASTM 4791 with a 5:1 aspect ratio.

⁵ 85/80 denotes that 85% of the coarse aggregate has one fractured face and 80% has two or more fractured faces.

The following source properties apply to the individual aggregates in the aggregate blend for the proposed JMF.

TEST METHOD	SPECIFICATION LIMITS
Toughness, AASHTO T96 Percent Loss, Maximum	40
Soundness, AASHTO T104 Percent Loss, Maximum for five cycles	20
Deleterious Materials, AASHTO T112 Percent, Maximum	10
Moisture Sensitivity, AASHTO T283 Percent, Minimum	80

For any roadway with a minimum average daily traffic volume (ADT) of 8000 vehicles and a posted speed of 35 mph (60 kph) or greater, the polish value of the composite aggregate blend shall be greater than 8.0 when tested according to Maryland State Highway Administration MSMT 411 B ALaboratory Method of Predicting Frictional Resistance of Polished Aggregates and Pavement Surfaces.@ RAP shall be assigned a value of 5.0. The Contractor shall supply all polish values to the Engineer upon request.

e) **Mineral Filler:**

Conform to AASHTO M17.

f) **Warm Mix Additives:**

For any WMA technology requiring addition of any material by the producer during production, the following information will be submitted with the proposed JMF for review and approval at least 30 calendar days prior to production:

1. WMA technology and/or additive information.
2. WMA technology manufacturer's recommendation for usage.
3. WMA technology target dosage rate and tolerance envelope. Support tolerance envelope with test data demonstrating acceptable mix production properties conforming to all sections of this specification.
4. WMA technology manufacturer's material safety data sheets (MSDS).
5. Documentation of past WMA technology field application including points of contact.
6. Temperature ranges for mixing and compacting.
7. Laboratory test data, samples, and sources of all mix components, and asphalt binder viscosity-temperature relationships.

Follow the manufacturer's recommendation for incorporating additives and WMA technologies into the mix. Comply with the manufacturer's recommendation regarding receiving, storage, and delivery of additives.

If the producer performs blending of the WMA technology in their tank, a separate Quality Control plan shall be submitted by the producer to the Department for review and approval at least 30 calendar days prior to production.

g) **Anti-stripping additives**

Conform to standard specifications Section 829 and blend with the asphalt cement in accordance with this specification. Incorporate anti-stripping additives when the Tensile Strength Ratio (TSR) as determined in accordance with AASHTO T283 is less than 80 or when specified for use by the Engineer.

.03 Bituminous Concrete Production – Quality Control

(a) Process Control - Material Production Quality Control.

Submit through electronic mail a QC Plan from each proposed production plant to the Engineer; no hot-mix asphalt material will be accepted until the Engineer approves the QC Plan. This plan must be submitted to the Engineer on an annual basis for review and approval prior to material production. The Engineer will send a signed copy back to the Contractor stating that it is approved. The approved QC Plan shall govern contractor operations.

The QC Plan shall include actions that will assure all materials and products will conform to the specifications, whether manufactured or processed by the Contractor, or procured from suppliers, subcontractors, or vendors. The Contractor shall perform the inspection and tests required to substantiate product conformance to contract requirements. The Contractor shall document QC inspections and tests, and provide copies to the Engineer when requested. The Contractor shall maintain records of all inspections and tests for at least one year. The records shall include the date, time, and nature of deficiency or deficiencies found; the quantities of material involved until the deficiency was corrected; and the date, time, and nature of corrective actions taken.

In the QC Plan shall detail the type and frequency of inspection, sampling, and testing deemed necessary to measure and control the various properties of material and construction governed by the Specifications. The QC Plan shall include the following elements as a minimum:

- Production Plant - make, type, capacity, and location.
- Production Plant Calibration - components and schedule; address documentation.
- Personnel - include name and telephone number for the following individuals:
 - Person responsible for quality control.
 - Qualified technician(s) responsible for performing the inspection, sampling, and testing.
 - Person who has the authority to make corrective actions on behalf of the Contractor.
- Testing Laboratory - state the frequency of accuracy checks and calibrations of the equipment used for testing; address documentation.
- Load number of QC samples (1-10 if QA sample is not within trucks 1-10)
- Locations where samples will be obtained and the sampling techniques for each test
- Tests to be performed and their normal frequency; the following, at a minimum, shall be conducted:
 - Mixture Temperature: each of the first five trucks, and each load that is sampled for QC or acceptance testing.

- Gradation analysis of aggregate (and RAP) stockpiles - one washed gradations per week for each aggregate stockpile; RAP: five gradations and asphalt cement contents for dedicated stockpiles where new material is not being added; one gradation and asphalt cement content test per week for stockpiles where material is continually being added to the stockpile.
- Gradation analysis of non-payment sieves
- Dust to effective asphalt calculation
- Moisture content analysis of aggregates - daily.
- Gradation analysis of the combined aggregate cold feed - one per year per mixture.
- Bulk specific gravity and absorption of blended material - one per year per mixture.
- Ignition Oven calibration - one per year per mixture.
- Hot-Bins: one per year per mixture.
- Others, as appropriate.
- Procedures for reporting the results of inspection and tests (include schedule).
- Procedures for dealing with non-compliant material or work.
- Presentation of control charts. The contractor shall plot the results of testing on individual control charts for each characteristic. The control charts shall be updated within on working day as test results for each subplot become available. The control charts shall be easily and readily accessible at the plant laboratory. The following parameters shall be plotted from the testing:
 - Asphalt cement content.
 - Volumetrics (air voids, voids in mineral aggregates [VMA])
 - Gradation values for the following sieves:
 - 4.75 mm (#4).
 - 2.36 mm (#8).
 - 0.075 mm (#200).
 - Operational guidelines (trigger points) to address times when the following actions would be considered:
 - Increased frequency of sampling and testing.
 - Plant control/settings/operations change.
 - JMF adjustment.
 - JMF change (See 401644 Section .04(a)(1)).
 - Change in the source of the component materials.
 - Calibration of material production equipment (asphalt pump, belt feeders, etc.).
 - Rejection of material.

When any point of non-compliance with the QC plan, or material not meeting the Specifications, comes to the attention of either the Contractor or the Engineer, the other party shall be notified immediately, and the Contractor shall take appropriate corrective actions. Failure to take corrective actions immediately shall be cause for rejection of material or work by the Engineer.

The following are considered significant violations to the Contractor's QC Plan:

- Using testing equipment that is knowingly out of calibration or is not working properly.
- Reporting false information such as test data, JMF information, or any info requested by DeIDOT
- Failure to perform materials testing per their approved QC Plan
- Deviating from AASHTO or DeIDOT testing procedures.
- Use of any material or the use of a JMF component in a proportion that exceeds the allowable tolerance as specified in section 04(a)(1) of this specification not listed in the JMF.
- Use of the wrong PG graded asphalt.
- Failure to take corrective action per action points in the Contractors approved QC plan.

The following steps will be taken for violations listed above:

1. First offence: Written notice of violation to the Contractor
2. Second offence: Written notice of violation and forfeiture of any bonus (material production or pavement construction) payment eligibility under 401699 section .03 for that production shift.

3. Third offence: Written notice of violation, forfeiture of bonus payment eligibility, and a 5% deduction of payment based upon contract unit price in addition to any calculated pay adjustment factors per 401699 Section 03.
4. Fourth offence: Written notice of violation, forfeiture of bonus payment eligibility, 50% deduction of payment based upon contract unit price in addition to any calculated payment adjustment factor per 401699 Section 03, and immediate suspension of the Contractor until corrective actions are taken. Corrective actions shall be submitted in writing to the Engineer for approval. The Engineer may request a meeting with the Contractor to discuss proposed changes prior to lifting suspension.

Violations of Contractor QC plans shall be kept on record for a period of 1 year from the date of violation at the Central Lab.

(b) Material Production Test Equipment.

Establish, maintain, and operate a qualified testing laboratory at the production plant site of sufficient size and layout that will accommodate the testing operations of both the Contractor and the Engineer.

Facilities for the use of the Engineer and inspectors shall be a minimum of 600 square feet of floor space conditioned to maintain constant temperature of 77F with two windows and a door equipped with functional locks and latches, located such that plant activities are plainly visible from one window of the building. Work space shall be furnished with illumination, tables, chairs, desks, telephone, and water including drinking water, sanitary facilities, fuel, and power necessary to conduct all necessary tests. Maintain all the equipment used for handling, preparing, and testing materials in proper operating condition. For any laboratory equipment malfunction, the Contractor shall remedy the situation within one working day or the Engineer may suspend production. In the case of an equipment malfunction, the Engineer may elect to test the material at another qualified testing laboratory while waiting for repairs to equipment.

Maintain minimum calibration records for the referenced equipment:

- SUPERPAVE^R Gyratory Compactor: once every year; verified once every month by the Engineer.
- Ovens: once every three months, verified once every month.
- Vacuum Container and Gauge (Rice Bowls): once every three months, verified once every month.
- Balances and Scales: once every year, verified once every month.
- Thermometers: once a year; verified once every month.
- Gyratory Compactor molds and base plates: once every year
- Mechanical Shakers: once every year
- Sieve Verifications: once every year

All calibrations shall be documented and on file for review by the Engineer at any time.

(c) Material Production Test Methods

- AASHTO T312 - Preparing and Determining the Density of Hot Mix Asphalt (HMA) Specimens by Means of the Superpave Gyratory Compactor
- AASHTO T166, Method C (Rapid Method) - Bulk Specific Gravity of Compacted Hot Mix Asphalt (HMA) Using Saturated Surface Dry Specimens
- AASHTO T308 - Determining the Asphalt Binder Content of Hot Mix Asphalt (HMA) by the Ignition Method
- AASHTO T30 - Mechanical Analysis of Extracted Aggregate
- AASHTO T209 - Theoretical Maximum Specific Gravity and Density of Hot Mix Asphalt (HMA)
- ASTM D7227 - Standard Practice for Rapid Drying of Compacted Asphalt Specimens using Vacuum Drying Apparatus

.04 Job Mix Formula (JMF)

Mix Design. Develop and submit a job mix formula for each mixture according to AASHTO R35. Each mix design shall be capable of being produced, placed, and compacted as specified. Assign a unique identification number to each JMF.

a) Development of JMF

Gradation: Use the FHWA Superpave 0.45 Power Chart to define permissible gradations for the specified mixture. Type C shall be either a No.4 (4.75 mm), 3/8" (9.5 mm), or 1/2" (12.5 mm) Nominal Maximum Aggregate Size bituminous concrete. Unless otherwise noted in the Plans, the Type C shall meet the 3/8" (9.5 mm) Nominal Maximum Aggregate Size. Type B bituminous concrete shall be the 3/4" (19.0 mm) Nominal Maximum Aggregate Size and the Bituminous Concrete Base Course (BCBC) shall be the 1" (25.0 mm) Nominal Maximum Aggregate Size. Target values for percent passing each standard sieve for the design aggregate structure shall comply with the Superpave control points and should avoid the restricted zone. Percentages shall be based on the washed gradation of the aggregate according to AASHTO T11.

In addition to the results of the material requirements specified above, the following material properties shall be provided by the contractor: bulk specific gravity G_{sb} , apparent specific gravity G_{sa} , and the absorption of the individual aggregate stockpiles to be used, tested according to AASHTO T84 and AASHTO T85 and reported to three decimal places along with the specific gravity of the mineral filler to be used, tested according to AASHTO T100 and reported to three decimal places.

Superpave Gyrotory Compactive (SGC) Effort:

The Superpave Gyrotory Compaction effort employed throughout mixture design, field quality control, or field quality assurance shall be as indicated below. All mixture specimens tested in the SGC shall be compacted to N_M Height data provided by the SGC shall be employed to calculate volumetric properties at N_i , N_D , and N_M

Superpave Gyrotory Compactive (SGC) Effort:

DESIGN TRAFFIC LEVEL (MILLION ESAL'S)	$N_{INITIAL}$	N_{DESIGN}	$N_{MAXIMUM}$
0.3 to < 3	7	75	115
3 to < 30	8	100	160
≥ 30	9	125	205

Volumetric Design Parameters. The design aggregate structure at the target asphalt cement content shall satisfy the volumetric criteria below:

DESIGN ESAL'S (MILLION)	REQUIRED DENSITY (% OF THEORETICAL MAXIMUM SPECIFIC GRAVITY)			VOIDS-IN-MINERAL AGGREGATE (% - MINIMUM) NOMINAL MAX. AGGREGATE (MM)					VOIDS FILLED WITH ASPHALT (%)
	$N_{INITIAL}$	N_{DESIGN}	N_{MAX}	25.0	19.0	9.5	12.5	4.75	
0.3 to < 3	≤ 90.5	-	-	-	-	-	-	-	65.0 - 78.0
3 to < 10	-	-	-	-	-	-	-	-	-
10 < 30	-	-	-	-	-	-	-	-	-
≤ 30	≤ 89.0	96.0	≤ 98.0	12.5	13.5	15.5	14.5	16.5	65.0 - 75.0 ¹

Air voids (V_a) at N_{design} shall be 4.0% for all ESAL designs. Air voids (V_a) at N_{max} shall be a minimum of 2.0% for all ESAL designs

The dust to binder ratio for the mix having aggregate gradations above the Primary Control Sieve (PCS) Control Points shall be 0.6-1.2. For aggregate gradations below the PCS Control Points, the dust to binder ratio shall be 0.8-1.6. For the No. 4 (4.75 mm) mix, the dust to binder ratio shall be 0.9-2.0 whether above or below the PCS Control Points.

For 3/8@ (9.5 mm) Nominal Maximum Aggregate Size mixtures, the specified VFA range shall be 73.0% to 76.0% and for 4.75 mm Nominal Maximum Size mixtures, the range shall be 75 % to 78% for design traffic levels \$3 million ESALs.

Gradation Control Points:

The combined aggregates shall conform to the gradation requirement specified in the following table when tested according to T-11 and T-27.

TABLE 1

Nominal Maximum Aggregates Size Control Points, Percent Passing										
SIEVE SIZE	25.0 MM		19.0 MM		12.5 MM		9.5 MM		4.75 MM	
	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
37.5 MM	100	-	-	-	-	-	-	-	-	-
25.0 MM	90	100	100	-	-	-	-	-	-	-
19.0 MM	-	90	90	100	100	-	-	-	-	-
12.5 MM	-	-	-	90	90	100	100	-	100	-
9.5 MM	-	-	-	-	-	90	90	100	95	100
4.75 MM	-	-	-	-	-	-	-	90	90	100
2.36 MM	19	45	23	49	28	58	32	67	-	-
1.18 MM	-	-	-	-	-	-	-	-	30	60
0.075 MM	1	7	2	8	2	10	2	10	6	12

Note: The aggregate’s gradation for each sieve must fall within the minimum and maximum limits.

Gradation Classification

The Primary Control Sieve (PCS) defines the break point of fine and coarse mixtures. The combined aggregates shall be classified as coarse graded when it passes below the Primary Control Sieve (PCS) control point as defined below. All other gradations shall be classified as fine graded.

PCS CONTROL POINT FOR MIXTURE NOMINAL MAXIMUM AGGREGATES SIZE (% PASSING)					
Nominal Maximum Aggregates Size	25.0 mm	19.0 mm	12.5 mm	9.5 mm	4.5 mm
Primary Control Sieve	4.75 mm	4.75 mm	2.36 mm	2.36 mm	1.18 mm
PCS Control Point	40	47	39	47	30-60

Plant Production Tolerances:

Volumetric Property	Superpave Criteria
Air Voids (V_a) at (%) N_m	2.0 (min)
Air Voids (V_a) at N_{design} (%)	6.0 (max)
Voids in Mineral Aggregate (VMA) at N_{design}	
25.0 mm Bituminous Concrete Base Course	-1.5
19.0 mm Type B Hot-Mix	+2.0
12.5 mm Type C Hot-Mix	
9.5 mm Type C Hot-Mix	
4.5 mm Type C Hot-Mix	

The proposed JMF shall include the following:

Submit for approval to the Engineer the following documentation on Pinepave mixture design software prior to starting production of a new mixture:

1. Job mix formula (JMF) design of the component materials and target characteristic values for each mixture proposed for use. The component materials design shall include designating the source and the expected proportion (within 1 percent for the aggregate components and within 0.1 percent for the other components) of each component to be used in order to produce workable bituminous concrete meeting the specified properties. Recycled Asphalt Pavement (RAP) is one individual aggregate component regardless of fractionation size. Recycled Asphalt Shingles (RAS) is a separate component from RAP.
2. The JMF target characteristic values include the mixing temperature range, core temperature range for gyrations, the percentage of the asphalt cement component (both total and virgin), and the percentages of the aggregate amounts retained on the sieves to be addressed by the JMF as shown in Table 1.
3. Plot of the design aggregate structure on the FHWA Superpave 0.45 power chart showing the maximum density line and Superpave control points.
4. Plot of the three trial asphalt binder contents at +/- 0.5% gyratory compaction curves where the percent of maximum specific gravity (% of G_{mm}) is plotted against the log base ten of the number of gyrations ($\log(N)$) showing the applicable criteria for N_i , N_d , and N_m .
5. Plot of the percent asphalt binder by total weight of the mix (P_b) versus the following:
% of G_{mm} at N_d , VMA at N_d , VFA at N_d , Fines to effective asphalt binder (P_{be}) ratio, and unit weight (kg/m^2) at both N_d and N_m .
6. Summary of the consensus property standards test results for the design aggregate structure, summary of the source property standards test results for the individual aggregates in the design aggregate structure, target value of the asphalt binder content, and a table of G_{mm} of the asphalt mixture for the four trial asphalt binder contents determined according to AASHTO T209.
7. Test data with each JMF and tests performed by a Qualified Laboratory on representative materials, verifying the adequacy of the design. Refer to the specifications for each mix type in order to determine the design requirements. The JMF sieve percentage values shall conform to the ranges shown in Table 1.

For any mixture that has a 20% or greater failure rate on any combined volumetric criteria, the JMF will not be approved for use on Department contracts.
8. Provide raw material of each JMF so NCAT Ignition Oven calibration correction numbers can be established for the Engineers and Contractors ovens. The Engineer shall provide an ignition oven correction number for each JMF.

.05 Approval of JMF

The Engineer will have up to three weeks once the JMF is submitted to review the submitted information.

All submitted JMF's shall correspond to the Pinepave mixture design software. The Engineer, for evaluation of the submitted JMF, will use the first three test samples. These test results acquired during production shall be within the following range compared to the submitted JMF on the Pinepave mixture design software: G_{mm} : +/- 0.030 and G_{mb} : +/- 0.040

a) **Design Evaluation:**

The Engineer may elect to evaluate the proposed JMF and suitability of all materials through laboratory trial batches. All materials requested by the Engineer shall be provided at the contractor's expense

to the Central Laboratory in Dover in a timely manner upon request. To verify the complete mixture design and evaluate the suitability of all materials, the following approximate quantities are required:

- 5.25 gal (20 liters) of the asphalt binder;
- 0.13 gal (0.5 liters) sample of liquid heat-stable anti-strip additive;
- 254 lb. (115 kg) of each coarse aggregate;
- 154 lb. (70 kg) of each intermediate and fine aggregate;
- 22 lb. (10 kg) of mineral filler; and
- 254 lb. (115 kg) of RAP, when applicable.

For more expeditious approval, the Contractor may undertake the following steps:

1. Submit the proper documentation on Pinepave mixture design software.
2. Produce the new mixture for a non-Department project. The Engineer will test the material, by taking three series per section 401800 03(c). The mixture will be approved by the Engineer for Department projects if the test results are within the specifications.

A new JMF is required when any of the following conditions occur:

- A change in the source of any of the aggregate component materials
- A change in the proportion of any aggregate component by more than 5.0%
- A change in the aggregate components resulting in a change in percent passing any sieve as identified in Table 1 by more than 5% of the JMF target.
- A change in the target AC content by more than 0.20% from the JMF target to maintain other Volumetric properties of the approved JMF.
- For any mixture that has a 20% or greater failure rate on any combined volumetric criteria.

Although a new JMF is not required, the Contractor shall inform the Engineer of any proposed changes to an existing JMF. The Contractor shall notify the Engineer by electronic mail of the proposed changes. This notification shall include the total change made from the approved JMF proportions, and the effective time of the change. The Engineer will reply to the proposed changes within one operational day and notify the Contractor of the effective date of the changes.

.06 Construction.

(a) Pavement Construction Test Equipment.

The Contractor shall furnish and use in-place density gauges, and/or coring equipment to meet the requirements of these Specifications.

Weather Limitations.

Place mix only on dry, unfrozen surfaces and only when weather conditions allow for proper production, placement, handling, and compacting. The following table of ambient temperatures for various binder grades and lift thicknesses for placement with the following parameters:

Lift Thickness (in)	PG Binder		
	76-22	70-22	64-22
1.50	50 F	45 F	40 F
2.00	40 F	38 F	35 F
3.00	32 F	32 F	32 F

- Minimum surface temperature of 32 F and
- Minimum production temperature of 275 F and
- Maximum wind speed of 8 miles per hour

Construction outside of these conditions with WMA technology will be at the discretion of the Engineer.

Compaction:

(b) Pavement Construction - Process Control.

Perform Quality Control of pavement compaction by testing in-place pavement density by the following methods.

- ASTM D2950 Standard Test Method for Density of Bituminous Concrete in Place by Nuclear Methods; the use of other density gauges shall be as per the manufacturer's recommendations.
- AASHTO T166, Method C (Rapid Method) Bulk Specific Gravity of Compacted Hot Mix Asphalt (HMA) Using Saturated Surface Dry Specimens
- ASTM D7227 - Standard Practice for Rapid Drying of Compacted Asphalt Specimens using Vacuum Drying Apparatus

Cores may be cut on the first day of paving or once after the change of a JMF for gauge calibration. The number of cores obtained for calibration purposes shall not exceed the number of QA samples obtained by the Department for payment. The Contractor may use any method to select locations for the Quality Control calibration cores.

Repair all core holes in accordance with 401699 Appendix A.

Method of Measurement:

Method of Measurement will be in accordance with Subsections 401.14 and 401.15 of the Standard Specifications.

Basis of Payment:

All work completed under this item shall be considered for full payment and subsequently modified in accordance with the procedures enumerated under 401699.

Material production quality shall be evaluated per item 401699 - Quality Control/Quality Assurance of Bituminous Concrete .03 (a) Material Production - Tests and Evaluations.

Compaction quality shall be evaluated per Item 401699 - Quality Assurance of Bituminous Concrete .03 (b) Pavement Construction - Tests and Evaluations.

10/29/2014

501534 –INTERFACE JOINT SEALING REPAIR

Description:

This work consists of inspecting, removing existing material and creating a reservoir using a router or saw, cleaning, drying, and sealing the longitudinal edge of pavement joints in existing asphaltic pavement shoulders immediately adjacent to the edge of the concrete pavement. The work shall conform to the plan details and as hereinafter provided.

Materials:

Furnish material that conforms to the requirements of the Specifications for Joint Sealants, Hot-Poured, for Concrete and Asphalt Pavements, AASHTO Designation: M324 (Type II) and ASTM Designation: D 6690 (Type II) or latest version, to require the bond strength test be run at -20 degrees F (-29 degrees C).

Deliver each lot or batch of sealing compound to the jobsite in the manufacturer's original sealed container. Mark each container with the manufacturer's name, batch or lot number, and the safe heating temperature. Present the manufacturer's certification stating the compound meets the requirements of this specification. Prior to applying the sealant, furnish to the engineer a certificate of compliance and a copy of the manufacturer's recommendations on heating and applying the sealant.

Construction Equipment:

Minimally, provide the equipment necessary to remove the existing sealant and create the reservoir using a router, saw, or both; clean using a vacuum truck, sand blaster and air compressor; and reseal the interface joint and overband using a melter/applicator and squeegee.

To remove the existing sealant and create the reservoir using a router, make rout cuts in a single pass. Two-pass cutting will not be allowed. Use a self-propelled mechanical router capable of routing the bituminous pavement and/or existing sealant. The router blade or blades shall be of such size and configuration to cut the desired joint reservoir in one pass of the router. No spacers between blades shall be allowed, unless the engineer approves the contractor's demonstration obtaining the desired reservoir. Do not use water; only dry routing can occur.

To remove the existing sealant and create the reservoir using a ride saw or walk-behind saw, two cuts may be necessary - one along the asphalt and one along the concrete. When sawing along the asphalt, only cut what is necessary. When sawing along the concrete, do not damage the existing concrete slab. Concrete slab should be free of existing sealant so it will be possible to properly clean. Do not use any kind of hand saw.

The vacuum truck should be in good working condition with no missing brushes. Do not use water.

To clean the joint prior to sealing, use a sand blaster and air compressor of at least 100 psi (7.03 kg/cm²), measured at the source. The compressors for sand and air shall be equipped with traps to maintain the clean, dry, compressed air - free of oil and water.

Melter shall be an approved melter/applicator or tank with applicator, constructed as a double boiler, with the space between the inner and outer shells filled with oil or other satisfactory heat transfer medium. Applicator shall be a direct connecting distributor for applying sealing material through a hand-operated wand or nozzle, in accordance with sealant manufacturer's instructions for insertion into the joint. Use metal tips only.

To create the overband, use a squeegee in good condition, maintaining its shape for a consistent overband width. Squeegee connection to handle shall be sturdy and tight. Remove any organic matter and excess sealant preventing a smooth overband, thereby, keeping the squeegee clean.

Construction Methods:

Conduct the operation so the inspecting, removing existing joint sealant material, creating the reservoir, cleaning, and sealing are continuous operations. Do not allow traffic to knead together or damage the routed joints. Rerout, if necessary, routed joints not sealed before allowing traffic on the pavement when routing and sealing operations resume, at no additional cost to the department. Heat the sealing compound to the pouring temperature the manufacturer recommends in the melter. When using the melter on concrete or asphaltic pavement, properly insulate the melter to ensure heat does not radiate to the pavement surface. Use a router and/or saw(s), as necessary, to create the reservoir in the interface joint to a 1.0:1.0 depth to width ratio. Engineer must approve reservoir prior to sealing.

After creating the interface joint reservoir, use a power vacuum truck or any other method of cleaning (no water) to immediately remove any debris, slurry, dirt, vegetation, or deleterious matter adhering to the joint walls or remaining in the joint cavity, or both. Sand blast and air-blow the joint with a blast of compressed air, 100-psi minimum. Inspect the interface joint to assure no loose, yet attached, sealant is remaining in the reservoir. Continue cleaning until the joint does not have moisture, loose dirt and dust, any vegetation or deleterious matter, and adjacent pavement is clean to the satisfaction of the engineer. If the compressed air produces dirt or other residue in the joint cavity, the contractor shall clean the joint again.

Remove any debris, sand, et cetera, from roadway or surrounding areas due to the interface joint repair process. Do not blow or toss debris into median or into any areas outside the construction area or the shoulders. Picking or scraping up the debris may be necessary. Provide protective screening to the cleaning operation if the cleaning operation could either cause damage to, or interfere with, traffic in adjacent lanes. Engineer must approve protective screening materials and methods. Before opening roadway to traffic, construction area must be clean of debris, sand, et cetera, due to joint sealing repair - including road, shoulders, and grass areas.

Do not seal if rain is imminent. Do not seal when pavement temperature and ambient air temperature fall below 40°F - unless it can be demonstrated a hot air lance is effective to remove moisture and warm the interface joint, per the manufacturer instructions and engineer's approval. When using the hot air lance, take care not to burn the pavement surface. Do not use the hot air lance on neoprene. Under no circumstances shall more than two minutes elapse between using the hot air lance and placing the sealant.

Provide positive temperature control and mechanical agitation in the melter. Heat material to its safe heating temperature per the manufacturer's shipping container or product data sheet. Provide a direct connecting pressure type extruding device with nozzles shaped for insertion into the joint. Immediately remove sealant spilled on the surface of the pavement.

Seal the joints when the sealant material is at the pouring temperature the manufacturer recommends. Fill the joint such that after cooling, the sealant is flush with the overband. Use a squeegee to create an overband, between 1.5 inches to 2 inches on each side of the joint for a total width of approximately 4 inches. Center the overband on the joint. Material should be consistent depth, just enough material necessary to create the overband. It may be necessary to squeegee in both directions to fully seal the joint, especially on ribbed concrete. Sand shall not be spread on the sealed joints to allow for opening to traffic. The sealant shall be tack free prior to any vehicular traffic, including construction vehicles. A de-tack product shall be on-site at all times; use where the engineer specifies.

Method of Measurement:

The quantity of Interface Joint Repair will be measured in linear feet of joints repaired and accepted.

Basis of Payment:

The quantity of Interface Joint Repair will be paid for at the Contract unit price per linear foot. Price and payment shall include full compensation for all equipment necessary in removing any existing material and creating the joint reservoir; inspecting the joint to confirm proper joint preparation; cleaning the joint; furnishing and installing all materials, including sealant; inspecting the quality of the sealant application within the joint, as well as, the overband to assure its complete seal to the road surface; and furnishing all labor, tools, equipment, and incidentals necessary to complete the contract work.

1/27/11

503001 - PATCHING P.C.C. PAVEMENT, 6' TO 15', TYPE A
503002 - PATCHING P.C.C. PAVEMENT, GREATER THAN 15' TO 100', TYPE B
503006 - DOWEL BARS

Section 503 of the Standard Specification is replaced with the following:

503.01 Description. This work consists of removing and disposing of existing Portland cement concrete pavement and replacing it with new Portland cement concrete pavement. The Engineer will designate the boundaries of each repair. This work is not intended for repairing newly constructed Portland cement concrete pavement or for repairing continuously reinforced concrete pavement. This work shall be completed after any planned partial depth patching. It shall also be completed before any diamond grinding, and before any overlay.

Materials

503.02 Portland Cement Concrete. Portland cement concrete shall conform to Class A, Section 812 and have a minimum compressive strength of 2000 psi in six hours as measured by Sure-Cure Mold test cylinders. The Sure-Cure Mold test cylinders and all associated equipment shall be provided by the Contractor. The concrete will be sampled and tested by the Engineer. The Engineer may also use the concrete maturity meter in accordance with AASHTO T325 to determine compressive strength.

This concrete shall also have material present in the mixture to mitigate alkali-silica reactivity (ASR) as per Section 812. The following parameters shall be adhered to by the contractor-submitted mix design for the Portland cement concrete:

CONCRETE PROPERTY	SPECIFICATION
Water/Cementitious Material Ratio	0.40 (Max.)
Air Content (%)	4 - 7
Slump*	2 - 5"
Synthetic Fibers **	1.5 lb/yd ³ min. or as per manufacturer's recommendation

*Slump may be increased up to 8" if a Type F Admixture is utilized. All admixtures utilized in the mixture shall be non-chloride based materials.

** Synthetic fibers shall be alkali resistant polypropylene, polyethylene, or nylon fibers with a minimum length of 1/2" and meet the requirements of ASTM C1116, Type III.

The Contractor, in order to accomplish 2000 psi compressive strength in six hours, shall establish actual combination of weights and proportion of admixtures as required by the field conditions, ambient temperature, humidity, and wind conditions. If the Contractor, due to unfavorable conditions, is unable to accomplish the desired strength in six hours, they may reschedule to the proper timing for performing the patching work.

503.03 Load Transfer Device. Dowel bars shall conform to AASHTO M 227/M 227M grade 65 (grade 450). The entire length of the dowel shall be pre-coated to conform to AASHTO M254. If the slab is less than 10" thick, the dowels shall be 18" long with a diameter of 1 1/4". If the slab is greater than or equal to 10" thick, the dowels shall be 20" long, with a diameter of 1 1/2".

Load transfer assemblies shall be fabricated from corrosion-resistant, coated dowel bars conforming to AASHTO M254. Dowel support baskets shall conform to the requirements of Standard Construction Details or details in the Plans.

503.04 Grout. Epoxy grout, when used for anchoring the dowels in place, shall conform to AASHTO M235. Concrete grout, when used for anchoring the dowels in place, shall be non-shrink grout conforming to the

Corps of Engineers "Specification for Non-Shrink Grout," CRD-C621. The maximum allowable expansion shall be 0.4 percent. The grout shall have a compressive strength no less than 3000 psi at 24 hours when tested according to ASTM C109. The initial set shall be less than 60 minutes when tested under the Corps of Engineers "Method of Test for Time of Setting of Grout Mixtures," CRD-C82.

503.05 Joint Sealants. Hot-poured joint sealant shall conform to the requirements of AASHTO M301 or AASHTO M282.

503.06 Curing Materials. Curing materials shall be as follows:

- (1) *Liquid Membrane Compounds.* The material shall conform to the requirements of AASHTO M 148, for Type 2, Class A or B white-pigmented liquid curing compound.
- (2) *Polyethylene Sheeting.* Polyethylene sheeting shall conform to the requirements of AASHTO M 171.
- (3) *Waterproof Paper.* Waterproof paper shall conform to the requirements of AASHTO M 171.
- (4) *Water Cure.* The water shall conform to Section 803.

503.07 Insulating Blankets. Insulation blankets shall be a minimum of 2" thick of fiberglass, rock wool, or other approved commercial insulation material.

CONSTRUCTION METHODS

503.08 Patching Limits. The areas of old pavement to be patched will be indicated on the Plans, or identified by the Engineer.

The limits of the area where the pavement is to be removed and patched will be painted on the existing pavement by the Engineer.

Patches can be either Type 'A' or Type 'B'. A Type 'A' patch is 15' or less in length. A Type 'B' patch is greater than 15' and less than 100' in length and contains load transfer assemblies spaced at a maximum of 15'.

Pavement replacement greater than 100' in length shall be constructed under **Section 501 Portland Cement Concrete Pavement.**

503.09 Patching Pavement. The Engineer will designate the boundaries of the concrete patch. The ends of the patch shall either match or offset by at least 2' the existing joints, any cracks, or patch ends in the immediate adjacent lanes. Transverse boundaries of the concrete patch shall be at least 2' from the existing joint line.

Patch lengths shall be at least 6' and no more than 15' without a load-transfer device. The patch shall be the full width of the existing slab or as noted on the Plans. The patch depth shall be no less than the existing slab.

The entire perimeter of the patch that is adjacent to concrete shall be sawed full depth by a concrete saw equipped with a diamond blade or approved equal of sufficient size to cut the concrete slabs to the required depth along straight and plumb lines. All perimeter cuts shall be plumb and parallel to or normal to the centerline of the roadway. Cutting, removing, and replacing existing hot-mix overlays up to 8" on the concrete shall be considered incidental to this item. Any over cut into the remaining slabs shall be kept to a minimum and shall be sealed (incidental to the sealing of the patch if not overlaid; if overlay is planned, no sealing will be required.). Any existing tie-steel across the patch perimeter line shall be cut. The Contractor may make additional cuts (such as diagonal and slanted cuts) to facilitate the removal of the concrete within the patch boundaries. The additional cuts to facilitate removal shall be incidental to the saw cutting item and will not be measured or paid. Cutting shall not precede the removal operations by more than two days.

The concrete in the repair area shall be removed by the lift-out technique without damaging the remaining concrete slabs or disturbing the base and subgrade. The lift out technique involves drilling holes into the patch to insert lifting hooks, pins, or chains. Improper actions (such as dropping the removed slab on adjacent concrete pavement, damaging the pavement edge due to Contractors methods, or other actions deemed damaging by the Engineer) leading to slab damage, shall be repaired by the Contractor, by an approved method, at no cost to the Department.

When the lift-out technique is not feasible, concrete in the patch area shall be broken by an approved mechanical pavement breaker or jackhammers and removed. The removal of the existing concrete and hot-mix overlay shall be executed with minimal disturbance to the remaining concrete or foundation. Any damage beyond the limits of the patch, caused by the improper actions of the Contractor shall be repaired to the satisfaction of the Engineer at no cost to the Department.

Where the patch is next to the shoulder and removal of the concrete results in a clean, uniform shoulder edge, the Engineer may allow the Contractor to use the shoulder edge as the form for the new concrete. Any portion of the shoulder pavement structure removed or disturbed by the patching operation shall be repaired in kind by the Contractor and the cost shall be incidental to the patching item(s). Saw cutting the joint between the concrete pavement and shoulder may assist in maintaining a clean, uniform shoulder edge. If the adjacent shoulder is concrete, the saw cut will be measured and paid for. If the adjacent shoulder is hot-mix asphalt, no measurement or payment will be made.

503.10 Patch Preparation. After removal of the concrete, the repair area shall be cleaned out with hand tools. Particular attention shall be given to existing longitudinal joint areas due to the possibility of loose concrete where the joint cracked away from the plumb line during the original construction. All vertical faces shall be cleaned of loose and deleterious material, prior to the placement of concrete.

Any base or subgrade that is unstable shall be removed to a maximum depth of 6" as directed by the Engineer. No new base material shall be placed; the excavated area will be filled with the concrete when the patch concrete is placed. The excavation is to be paid for under Item 212001 - Undercut, Excavation, Patching, with the replacement material to be concrete SY-IN paid for under Item 503503 - Patching Concrete.

After the old concrete is removed, the patch areas shall be protected from water intrusion when precipitation is forecast.

Dowels shall be placed to provide load transfer at mid-depth $\pm 1"$ of the ends of the patch along the transverse joint at $12" \pm 1"$ on-center spacing, at least 6" from the slab edge. The dowel holes shall be drilled parallel to the profile and centerline of the pavement to an embedment depth of half the dowel bar length. The equipment for drilling holes in the face of the remaining concrete slabs must be capable of producing holes of proper size, depth, and angle. The drill must not crack or spall the remaining concrete. A drill support system shall be used to ensure proper hole alignment.

Dowel holes shall be drilled to a diameter of $1 \frac{3}{4}$ for cementitious grout and $1 \frac{9}{16}$ " for epoxy grout. If the existing concrete breaks during drilling, cut away more concrete or relocate the hole to provide a solid support for the dowel. Fill any unused hole with cement grout or epoxy grout. Any damage caused by the Contractor's technique shall be repaired at no added cost to the Department.

The holes shall be blown clean with compressed air prior to placing the anchoring epoxy or grout material. The anchoring material shall be injected into the back of the hole to provide complete coverage around the dowels without any voids. The dowels, each with a grout retention disk, shall be inserted into the holes with a twisting motion and seated into place by tapping. The disk shall be flush to the face of the existing concrete. The dowels shall be solidly held in proper alignment before placement of the patch concrete. Dowel placement and joint construction details for contraction joints within the patch area shall conform to the requirements of Standard Construction Details or details in the Plans.

The following are the allowable dowel translations and rotations: Vertical rotation - the difference in depth (vertical position) between the midpoint and the exposed end of the dowel; the allowable tolerance is $\frac{1}{4}"$ of vertical deviation from the true longitudinal axis of the pavement. Horizontal rotation - the difference in lateral position between the midpoint and the exposed end of the dowel; the allowable tolerance is $\frac{1}{4}"$ of horizontal deviation from the true longitudinal axis of the pavement. Longitudinal translation - the longitudinal distance between the exposed end of the dowel and the edge of the patch is 10" with an allowable tolerance of $\pm 1"$.

The dowels at the end of each patch will be paid for under Item 503006-Dowels. Side forms may be required when the patch is adjacent to a hot mix shoulder and the shoulder is damaged during concrete removal.

Bonding of the transverse and longitudinal sides of the patch to the adjacent concrete slabs shall be prevented by an approved bond-breaking material such as a sheet of plastic over the vertical face or a light coating of a wax based curing compound covering the vertical face.

For existing composite pavements (hot-mix over concrete) that will not be overlaid, a 2" lift of hot-mix shall be placed over the concrete after the concrete has reached strength sufficient to allow opening to traffic.

503.11 Placing Concrete. Portland cement concrete shall be placed according to the requirements of Subsection 501.07. The concrete shall be deposited directly on the foundation and shall be uniformly distributed and spread over the entire foundation. Each patch area shall be cast in one continuous operation.

503.12 Consolidating and Finishing Concrete. The concrete shall be consolidated with an internal vibrator, particularly near the edges, corners, and around the dowels. The vibrator must be capable of visibly affecting the concrete from a distance of 1' from the vibrator head.

Except when a hot-mix surface is required or when an overlay will be placed, the surface of the patch concrete shall be struck off flush with the existing pavement. For patches up to 10' long, the screed shall be placed parallel to the centerline of the roadway. For longer patches, the screed may be placed perpendicular to the centerline of the roadway. The surface of the concrete patch shall be textured to match the surrounding pavement (tining, grooves, etc.), except when an overlay will be placed or diamond grinding will be performed.

The riding surface texture, profile, and cross section of the concrete patches shall meet the following requirements:

When the patch surface will be overlaid with Hot-Mix Asphalt as part of this Contract, the patch shall be broom finished or tined, with the texture applied in a direction perpendicular to the traffic flow. The profile and cross slope shall match the adjacent pavement surface. If the profile in the finished patch area contains excessive surface deviations, the patch is unacceptable. Excessive deviations are surface deviations greater than 1/8" from a reference line between points not greater than 10' apart along the direction of traffic.

When the patch surface will be part of the final surface of the roadway, the patch surface shall be finished to match the texture of the adjacent pavement. The patch surface cross section shall match the preceding and following pavement surfaces. The Engineer may test for excessive deviations with a straightedge, a California-type profilometer, or other surface measuring devices. When tested with a straightedge, excessive deviations are surface deviations greater than 1/8" from a reference line between points not greater than 10' apart along the direction of traffic. When tested with a profilograph, excessive deviations are surface deviations greater than 0.3" above or below a reference line between points not greater than 25' apart along the direction of traffic, when the pavement will not be diamond ground end-to-end after patching. When the pavement will be diamond ground end-to-end after patching, excessive deviations are defined as surface deviations greater than 0.4" above or below a reference line between points not greater than 25' apart along the direction of traffic and less than 0.3" after grinding. The Contractor shall correct unacceptable deviations in the patch areas before starting the end-to-end grinding.

503.13 Curing and Protecting. Curing shall conform to the requirements of Subsections 501.11 and 501.12 and the following:

The patch shall be cured and protected with either a liquid membrane curing compound and polyethylene sheeting or wet burlap and polyethylene sheeting.

When liquid membrane curing compound is used, it shall be applied uniformly upon completion of the patch texturing at a rate of 150 ft²/gallon and then covered with polyethylene sheeting.

When burlap/polyethylene sheeting is used, the patch shall be covered with a layer of wet burlap immediately after the concrete has achieved initial set, and the wet burlap shall be covered with a polyethylene sheet.

After the curing compound/polyethylene sheeting or burlap/polyethylene sheeting is applied, the patch shall be covered with an approved insulation blanket, and it shall remain in place until the concrete has

achieved the design strength. Edges and seams in the insulation shall be secured to prevent penetration of the wind.

503.14 Joints. The transverse and longitudinal joints shall be formed or sawed as shown on the Standard Construction Details Transverse joints within the patch area shall be sawed at the proper time to assure proper cracking at the transverse crack. Cleaning and sealing of the joints with hot poured sealant material shall be completed within 5 days after concrete placement if no overlay is planned.

The non-repaired transverse joints on each side of the patched area shall also be cleaned and resealed. Joints shall be cleaned by mechanical wire brushing or by light sandblasting. Immediately prior to resealing, the joint groove shall receive a final cleaning with compressed air having a minimum pressure of 90 psi .

Repairs to damaged concrete or hot-mix shoulder shall be completed before the patch area is subjected to any traffic loading.

503.15 Defective Work. Concrete which fails to reach the full design strength in the specified 6-hours may be considered defective concrete based upon its structural adequacy.

If the concrete is determined to not be structurally adequate by the Engineer, it is considered defective and it shall be removed and replaced at no additional cost to the Department. If the concrete is determined to be structurally adequate by the Engineer and the concrete can remain in place, the Contractor may accept a prorated payment for the below-specified concrete as referenced below. If the Contractor does not wish to accept the prorated payment, the below-specified concrete shall be removed and replaced at no cost to the Department.

503.16 Method of Measurement. The quantity of Portland cement concrete pavement patch will be measured as the actual number of square yards of concrete patch placed and accepted. The width of measurement will be the full width from outside of the completed patches as constructed, measured parallel to the transverse saw cuts. The length will be the actual length measured parallel to the centerline of the pavement.

The quantity of dowel bars will be measured as the actual number of dowel bars installed and accepted at the ends of each patch. Dowel bars and support assemblies (load transfer assemblies) installed at internal joints in Type B Patches will not be measured but will be considered as incidental to the Contract price per square yard for Item 503002 - Patching P.C.C. Pavement, greater than 15' to 100', Type B.

503.17 Basis of Payment. The quantity of Portland cement concrete pavement patch will be paid for at the Contract unit price per square yard . Price and payment will constitute full compensation for furnishing, hauling, and placing all materials, including high-early strength concrete; load transfer assembly, and joint filler (where applicable).; for removing, and disposing of existing concrete; for preparing the foundation; for tooling, finishing, curing, sealing of over cuts in non-overlay areas, and protecting the new concrete; for disposing of excess material; and for all labor, equipment, tools, and incidentals required to complete the work. In addition, the price and applicable payment(s) will be based on Type A or Type B Patches.

Price Adjustment for Low Strength Concrete. Prorated payment for concrete as specified in Subsection 503.15 shall be calculated as shown in the following equation:

$$\text{Prorated Payment} = \frac{\text{Actual 6-hour Compressive Strength}}{\text{Specified 6-hour Compressive Strength}} \times (\text{Quantity of Concrete}^*) \times (\text{Bid Price}^{**})$$

* The quantity for which the low compressive strength results represent.

** Item bid price; not material cost.

NOTE:

If the Engineer directs the Contractor (in writing) to place Portland cement concrete which is in violation to any applicable Specifications, or if any other Department Specification is violated, this Prorated Payment will not be enforced.

The quantity of dowel bars will be paid for at the Contract unit price per each. Price and payment will constitute full compensation for drilling holes, furnishing and installing grout and dowel bars with grout retention disk and for all labor, equipment, tools, and incidentals required to complete the work.

Saw cutting the perimeter of the patch that is adjacent to concrete (including shoulder if applicable) will be measured and paid for under item 762002 - Saw Cutting, Concrete, Full Depth. All other saw cutting, including the joint between the concrete and hot-mix asphalt shoulder, will be incidental to the patching item(s).

Hot-pour sealant, if applicable, will be measure and paid for under item 503501 .

Any damage caused by the lift-out technique of the Contractor, shall be repaired by the Contractor at no cost to the Department.

10/4/06

503501 - CRACK AND JOINT SEALING LESS THAN 3/4" WIDE
503502 - CRACK AND JOINT SEALING 3/4" to 1 3/4" WIDE

Description:

The item shall consist of cleaning and sealing the existing P.C.C. pavement transverse and longitudinal joints, and pavement cracks in accordance with these specifications, plans, and as directed by the Engineer.

Materials:

Pourable Sealant: The Sealant shall meet the requirements of ASTM D 6690 (Classification-Type II). The Appendix of that specification shall be considered as part of this specification. Application for approval of joint and crack sealant material by the manufacturer shall be submitted to the Department's Materials and Research Section.

Backup Material/Bondbreaker: The backup material/bondbreaker shall be stitched cotton piping cord, polyethylene backer rod, or approved equal material that is compatible with the sealant to be used and capable of withstanding the required sealant application temperature without melting. Back-up material shall be 25% wider than the nominal width of the joints.

The diameter of the backup material/bondbreaker shall be such that when placed in the joint it will support the sealant at its design depth, allowing the sealant to achieve the design shape, prevent the sealant from leaking around and underneath it, and allow the sealant to deform freely when the joint expands and contracts.

The backer rod shall not be stretched during insertion in the joint. When the bottom of the joint opening to be sealed is formed by previously installed expansion joint material (such as at concrete patch locations), a nonreactive adhesive-backed tape shall be inserted in lieu of the backer rod. The tape shall be 1/8 inch (3 mm) wider than the nominal width of the joints.

Sealant Equipment: Proper sealing equipment shall be used for the specific material listed in accordance with the manufacturers recommendations. The equipment for hot applied sealing compounds shall be a melting kettle of a double boiler, indirect heating type, using oil as a heat-transfer medium. The kettle shall have an effective mechanically operated agitator and shall be equipped with a positive thermostatic temperature control which shall be checked for calibration before commencing. Overheating shall not be permitted. The hoses and applicator wand shall be insulated. The nozzle of the mechanical device shall be shaped to fit inside the joint and introduce the sealant between the joint faces.

Construction Methods:

Removal of existing joint sealant, sawing and/or refacing of joints, cleaning, shape factor dimensions, backup material and sealant installation shall be in accordance with these specifications.

Existing Sealant Removal: Any in-place sealant shall be removed from the joint using a vertical cutting edge tool; however, V-shape plow tools will not be permitted. A power driven concrete high pressure water blasting will be permitted.

The sealant shall be removed to the depth required to accommodate any separating and/or backup material used, and to provide the specified depth for the new sealant material to be installed.

Refacing of Joints: Joints shall be sawed or refaced using a power driven concrete saw with diamond or abrasive blades to remove all old sealant from the joint faces to expose new clean concrete and, if required, to cut the joint to the width and depth necessary to provide for an effective shape factor in the joint sealant.

Cleaning Prior to Resealing: Following all sawing, resawing, or refacing operations, the joint faces and opening shall be thoroughly cleaned by sandblasting followed by an oil-free air jet to remove all cuttings or debris remaining on the faces or in the joint opening. The newly exposed joint faces shall be cleaned by sandblasting. The sandblast joint cleaning operation shall be such that when completed the

concrete joint surface which is to receive the new joint sealant shall be free of all tar and asphalt, all old sealant, all discoloration and stain, as well as any and all other forms of contamination of the pore structure--leaving a clean, dry, newly exposed concrete surface.

Immediately prior to the placement of the backup material and the sealant, the joints shall be cleaned with a compressed air stream of at least 100 psi (690 kPa) measured at the source.

The air compressors used for the purpose described above must be equipped with traps capable of removing moisture and oil from the air. Work shall be stopped when there is oil or moisture in the compressed air. Work shall not resume until suitable adjustments are made and the air stream is found to be free of such contaminants.

Under no conditions will the Contractor be permitted to place the sealant if there is dust, moisture, oil, or any other contaminants on that portion of the concrete which is to receive the joint sealant.

The Contractor shall be responsible for protecting the public from hazard or damage during the sandblasting and joint cleaning operations. Rigidly supported plywood sheeting or other suitable material and method used for this purpose shall be subject to the approval of the Engineer.

During all operations, care shall be taken not to damage the subbase, curbs, shoulders, load transfer devices, or pavement. In the event that such damage occurs, it shall be repaired to the satisfaction of the Engineer at no expense to the State.

Limits of Joint Preparation: The work required for the removal of existing joint sealant, widening and/or deepening of the joint openings, if required, refacing of joint faces, and sandblasting of the joint faces should proceed at reasonable production rates. The final stages of joint preparation which includes air pressure cleaning of joints, and placement of separating and/or backup material shall be limited to only that length of joint that can be resealed during a day's production.

Installation of Pourable Sealant: A copy of the manufacturer's recommendations pertaining to the heating and application of the sealant shall be submitted to the Engineer prior to the commencement of work and these recommendations shall be adhered to and followed by the Contractor, with such exceptions as this specification may require.

At the start of the day's operations special procedures may be necessary in order to achieve a sealant temperature consistent with this specification. The Contractor shall ascertain from the manufacturer of the apparatus he is using, the procedures necessary and be able to so execute these procedures prior to his commencement of joint sealing operations.

The recommended pouring temperature shall be 10 degrees (5.5 degrees) below the manufacturer's designated Safe Heating Temperature. The allowable variance from the recommended pouring temperature shall be ± 10 degrees (± 5 degrees).

The first gallon (4 liters) of material to flow out of the applicator wand at the beginning of the day shall be considered spoil and as such be discarded into a container for proper disposal.

The applicator wand shall be returned to the machine and the material recirculated immediately upon the completion of each joint sealing.

Sealant compound shall not be placed unless the face of the joint is completely dry, clean and free of dust, and backup material installed at the required depth to provide a uniform, specified sealant thickness. Manufacturer's recommendations for application temperature shall be followed, however, the atmospheric and pavement temperature shall both be at least 50 degrees F (10 degrees C) but not greater than 90 degrees F (32 degrees C). at the time of application of the sealant. Installation of the sealant shall be such that the in-place sealant shall be well bonded to the concrete and free of voids or entrapped air. The joints shall be uniformly sealed in a neat and workmanlike manner, so that upon completion of the work, the surface of the sealant material shall be $1/4$ in. $\pm 1/16$ in (6 mm ± 1.5 mm) below the adjacent pavement surface. The Contractor shall "spot up" or refill all low joints before final acceptance. Any excess material on the surface of the pavement shall be removed and the pavement surface shall be left in a clean condition. Unless otherwise specified, the period of cure shall be in accordance with the manufacturer's recommendations.

Vehicular or heavy equipment traffic shall not be permitted on the pavement in the area of the joints during the curing period. The sealant shall be placed to conform with the dimensions and shape shown on the Plans and as specified herein. Any failure of the sealed joint due to lack of adhesion or cohesion of joint material; improper or unsatisfactory workmanship by the Contractor; or damage by the Contractor's operations or traffic will be cause for rejection. The joint(s) shall be repaired to the Engineer's satisfaction at no additional cost to the Department.

After a joint has been sealed, all excess sealant or other residue on the pavement surface shall be removed. Traffic shall not be permitted over sealed joints until the sealant is tackfree and until debris from traffic does not imbed into the sealant.

Method of Measurement:

The quantity of crack and joint sealing will be measured as the actual number of linear feet (meters) of cracks and joints sealed and accepted measured along the crack and/or joint, end to end.

Basis of Payment:

The quantity of transverse and longitudinal cracks and joints cleaned and resealed, measured from end-to-end shall be paid for at the Contract unit price per linear foot (meter) for "Crack and Joint Sealing Less than 3/4 in. (19 mm) Wide, and "Crack and Joint Sealing, 3/4 in. to 1 3/4 in. (19 mm to 44 mm) Wide. Price and payment will constitute full compensation for furnishing and placing hot poured joint sealer as specified on the Plans or as directed, backup material, for removal and disposal of existing joint sealer, for all joint resawing and refacing, for sandblast cleaning, airblast cleaning, for all labor, tools, equipment, and incidentals necessary to complete the item.

6/12/14

503503 - PATCHING CONCRETE

Description:

This item consists of furnishing and placing Portland Cement Concrete, conforming to the requirements of Section 503 of the Standard Specifications and/or as modified herein under this Contract. After removal of the existing P.C.C. pavement, if the base material is unsuitable or washed out, the unsuitable material shall be excavated and the void replaced with the same concrete used in the patch area. This additional depth shall not exceed 6" (150 mm) from the bottom of the existing P.C.C. Pavement. Excessive moisture remaining after excavation, shall require construction of a pipe underdrain system, when directed by the Engineer and as shown on the Plans. All excavation below the bottom of existing pavement shall be paid for under the item "Undercut Excavation, Patching".

This item may also be used in areas of composite pavements (hot-mix over concrete) if the Contractor elects to pour concrete patch flush with existing hot-mix pavement to eliminate grade differential. This additional depth shall be as directed by the Engineer, but shall not exceed 6" (150 mm) in depth.

Method of Measurement:

The quantity of concrete patching will be measured as the actual number of square yards per inch of thickness (square meters per 25 mm of thickness) of additional thickness either above or below the existing concrete pavement. The area measured shall be the square yards (square meter) on the surface of the base course and the depth measured in inches (mm) from either top or bottom of the original P.C.C. pavement as determined from the adjacent pavement. The depth shall be as directed by the Engineer, but shall not exceed 6" (150 mm) in measurement or payment.

Basis of Payment:

The quantity of concrete patching will be paid for at the Contract fixed price of \$5.65 per square yard per inch of thickness (\$6.13 per square meter per 25 mm of thickness). Price and payment will constitute full compensation for furnishing and placing additional depth of concrete as described above, for all labor, tools, equipment, and incidentals to complete the item.

NOTE

Also, under the items 503001 - Patching P.C.C. Pavement, 6" to 20", Type A and 503000 - Patching P.C.C. Pavement, Greater than 20" to 100", Type B (503001 - Patching P.C.C. Pavement, 1.8 m to 6 m, Type A and 503002 - Patching P.C.C. Pavement, Greater than 6 m to 30 m, Type B), the Contractor shall be paid for the additional thickness of concrete actually poured in the field above the thickness specified on the P.C.C. Patching Plans at a fixed rate of \$5.65 per square yard per inch of thickness (\$6.13 per square meter per 25 mm of thickness).

10/06/06

503517 - P.C.C. PATCHING, PARTIAL DEPTH

Description:

All the requirements of Section 503 of the Standard Specifications shall be applicable except as modified in this Specification.

This work shall consist of partial depth patching of spalls, potholes, corner breaks or other surface distress in Portland Cement Concrete pavements. The patch area shall be prepared by removal of existing damaged and/or disintegrated concrete from the area indicated on the plans and/or as directed by the Engineer, and patched with materials indicated here or with approved materials.

Materials and Construction Methods:

The Contractor shall use rapid set patch materials (Sika Quick 2500 or Master Builders HD50 or Set 45 or Five Star Highway Patch or approved equal), in strict accordance with the manufacturer's recommendations.

1. The patch materials shall be a blend of selected Portland Cements, specially graded aggregates, admixtures for controlling setting time, water reducers for workability, and an accelerator. The mix shall be mechanically mixed on site.
2. The patch materials shall be supplied in a factory-blended bag/container accompanied with the manufacturer's recommendations.
3. The very rapid-setting cement mortar must be placed 1" in depth per lift for horizontal applications.
4. To prepare a very rapid-setting patching material, aggregate shall be added to the mix conforming to ASTM C-33, at a rate recommended by the manufacturer. The aggregate shall be (Delaware No. 8) 3/8" clean, well-graded, saturated surface dry aggregate, approved for use by Materials & Research.

Batch Portland Cement Concrete will not be permitted for partial depth patching.

Partial depth patches shall be constructed at locations shown on the plans and as directed by the Engineer in the field. A saw cut of prescribed depth shall be made around the perimeter of the patch area to provide a vertical face at the edge. Concrete within the patch area shall be broken and removed to a depth required with light (10-20 lbs.) pneumatic tools until sound and clean concrete is exposed. Care must be taken to avoid fracturing the sound concrete below the patch and undercutting or spalling patch boundaries during the jackhammering operation for the removal of the deteriorated concrete.

If a partial depth repair area abuts a working joint or crack which penetrates the full depth of the slab, an insert or other approved bond-breaking medium shall be used to maintain working joints or cracks.

After the patch surface of the existing concrete has been prepared, and just prior to placement of the patch material, it shall be air cleaned.

The rapid set patch material shall achieve a compressive strength of 2,000 psi.

If the Contractor, because of unfavorable ambient temperature, is unable to accomplish the desired strength, he shall reschedule the proper timing for performing the patching work.

For day time projects only, the areas to be patched shall be prepared and poured allowing sufficient time to accomplish 2,000 psi compressive strength before dark. If the specified compressive strength is not attained, flagman, lights, barricades, warning lights, and other traffic control devices required after dark, shall be placed and maintained by the Contractor at his own expense.

All joints with the existing concrete pavement (transverse and longitudinal) shall be tooled or sawed to form a sealant reservoir with the dimensions of 3/4 by 3/4 inch. An approved bond breaking material (such as tape, backer rod, etc.) shall be placed on the bottom of the reservoir prior to placement of the sealant system in order to allow bonding of the system materials to only the vertical surfaces of the concrete in the reservoir.

The patched areas shall not be open to traffic until so permitted by the Engineer.

Basis of Payment:

The payment for the item shall be made for at the contract unit price per square yard per inch of depth for "P.C.C. Patching, Partial Depth" of specified depth, which price and payment shall constitute full compensation for furnishing and placing all materials, including admixtures, aggregates, and accelerants, removal and disposal of old concrete pavement, curing, joint sealing, for all labor, tools, equipment, and incidentals necessary to complete the work.

2/28/09

602620 - CRACK SEALING BRIDGE DECKS, APPROACH SLABS, SIDEWALKS, ETC.
602629 - CRACK SEALING BRIDGE DECKS, APPROACH SLABS, SIDEWALKS, ETC.

Description:

This item shall consist of furnishing all materials, cleaning the concrete surface area and treating with crack sealer as specifically indicated on the Plans in accordance with these Specifications, notes on the plans, and as directed by the Engineer.

Materials:

The crack sealer shall be a rapid-curing, moisture insensitive, solvent-free, high molecular weight, low viscosity methacrylate or epoxy based crack healer/penetrating sealer. Each shipment of crack sealer shall be accompanied by Materials Safety Data Sheet and a Certification of Compliance that states that the material conforms to the requirements of these Specifications.

Construction Methods:

The Contractor shall become aware and follow the Manufacturer's safety precautions of all materials and shall exercise appropriate measures. Equipment used for cleaning and preparing the surface areas and for the application of the crack sealer shall be subject to approval prior to their use. Prior to the application of the crack sealing material, the concrete surfaces shall be cleaned in accordance with the Manufacturer's recommendations. Generally, this will involve removal of all traces of dust, dirt, salt, grease, oil, curing compounds, waxes, asphalt, laitance, and all other foreign contaminants. The substrate shall be clean, sound, and free of surface moisture prior to application. The Contractor shall closely monitor the surface preparation to avoid any unnecessary surface damage. Surface preparation shall be subject to final approval by the Engineer.

The crack sealing material shall be applied within the ambient temperature range as recommended by the Manufacturer, when no rain is expected within a minimum of two hours following the application, and there is no high winds that would cause an improper application. If rain has preceded the application, the surface shall be allowed to dry at least 24 hours before the application of the crack sealer begins.

If excess sealing material is on the surface after the crack sealing treatment has been completed, the area shall be covered with a light broadcast of a dry sand meeting the requirements of Section 804. The amount of sand used shall be sufficient to absorb the excess material. The time of sand broadcast shall be in accordance with the manufacturer's recommendation.

Traffic, when applicable, shall be kept off the treated surface until the crack sealing material has been completely absorbed, and the surface is dry in accordance with the manufacturer's recommendation. The Contractor shall perform surface preparation and application of the crack sealing material so as not to danger any private and/or public property, endanger pedestrians, workmen and vehicles on the structure, beneath or adjacent to it and marine traffic when applicable.

Method of Measurement:

The quantity of crack sealing under item 602620 will be measured in square feet (meters) of surface area where cracks have been sealed and accepted. The quantity of crack sealing under item 602629 will be measured in linear feet (meters) of cracks sealed and accepted.

Basis of Payment:

The quantity of crack sealing under item 602620 will be paid for at the Contract unit cost per square foot (meter). The quantity of crack sealing under item 602629 will be paid for at the Contract unit cost per linear foot (meter). Price and payment will constitute full compensation for furnishing all materials, surface preparations, application of the crack sealing material and sand, disposal of discarded materials, for all labor, tools, equipment, and all necessary incidentals to complete the work.

3/13/03

705524 - DETECTABLE WARNING RETROFIT

Description:

This work consists of furnishing all materials and installing a detectable warning surface system on an existing sidewalk or curb ramp that complies with the Americans with Disabilities Act (ADA) (1990) for outdoor facilities. The retrofit system shall be in accordance with these Special Provisions, the Plans, the Standard Construction Details and as directed by the Engineer.

Materials:

The Contractor shall submit a sample of the proposed retrofit system to the Engineer for approval. The Contractor shall use the following material system for the retrofit:

1. Precast concrete, or fired clay brick, paver units, each with the truncated dome pattern, set with the existing sidewalk surface.

The Engineer will not approve stamping systems or ceramic tiles.

The Contractor shall certify that the surface of the system is slip resistant. The Contractor shall submit test results for the system when it has been tested using one of the following standard methods:

- ASTM C-1028 - Determining the Static Coefficient of Friction of Ceramic Tile and Other Like Surface by the Horizontal Dynamometer Pull-Meter Method
- ASTM C-2047 - Static Coefficient of Friction of Polish-Coated Floor Surfaces as Measured by the James Machine
- ASTM D-5859 - Determining the Traction of Footwear on Painted Surfaces Using Variable Incidence Tester
- ASTM E-303 - Measuring Surface Frictional Properties Using the British Pendulum Tester
- VOSI V41.21-98 - Universal Specification/est Method for Slip Resistant Walkways, in the Field and Laboratory, as measured by a Drag Type Friction Tester (Voices of Safety International (VOSI): www.voicesosafety.com)

The final surface of the retrofit system shall have a brick red color, unless the color of the existing sidewalk/curb ramp is brick red in color, or as specified on the Plans. A different color shall be chosen resulting in a different color contrast between the detectable warning system retrofit and the existing sidewalk/curb ramp.

All other materials shall conform to Subsection 302.02, Subsections 705.02 through 705.04, and Section 817, Mortar Sand.

Construction Methods:

The entire existing concrete sidewalk or curb ramp width and depth shall be sawcut in conformance with Subsection 762.02 at a location which will allow installation of the detectable warning truncated domes per the Standard Construction Details. The existing sidewalk and base shall be removed in conformance with Subsections 758.02 and 202.03, and new base and sidewalk installed to allow for the thickness of the paver units. The width and thicknesses of the new base and sidewalk shall match the width and thicknesses of the existing base and sidewalk, and installed per the applicable requirements of Subsections 302.03 through 302.04 and Subsections 705.05 through 705.10. The entire section (P.C.C. sidewalk and base material) under the new truncated dome paver units shall be constructed at a lower elevation to permit the installed paver units to be flush with the surrounding ramp/sidewalk surfaces. Paver units shall be set in a bed or mortar and have mortared joints.

At the edges of the system, changes in grade up to 0.25 inch (6 mm) may be vertical. The Contractor shall bevel changes in grade between 0.25 and 0.50 inch (6 and 13 mm) with a slope no steeper than 2 to 1.

For construction of detectable warning retrofit system in existing brick sidewalks, the Contractor shall remove the necessary existing bricks which will allow installation of the detectable warning truncated domes per the Standard Construction Details. The truncated dome paver units shall be placed over the same existing base material and lift thickness as used under the existing brick sidewalk, and shall be placed so that they are

flush with the surrounding ramp/sidewalk surfaces. Following truncated dome paver unit installation, the previously removed bricks shall be used to fill in between the existing brick sidewalk and the truncated dome pavers. Do not reuse bricks with chips, cracks, discolorations or other defects. Cut bricks with a motor driven masonry saw to provide clean, sharp, unchipped edges. Cut bricks to neatly fit adjoining material.

Vibrate the pavers into the existing leveling course with a low amplitude plate vibrator capable of a 3,500 to 5,000 pound compaction force. Perform at least three passes across paving with vibrator. Vibration should not approach closer than three feet from an unrestrained edge.

Spread dry sand and fill joints immediately after vibrating the pavers into leveling course. Brush and vibrate sand until joints are completely filled, then remove excess sand.

Prior to acceptance, any pavers that are chipped, broken, stained or damaged shall be replaced at the Contractor's expense.

Method of Measurement:

The quantity of sidewalk surface detectable warning system retrofit will be measured as the actual number of square feet (square meters) of truncated dome paver units installed and accepted.

Basis of Payment:

The quantity of sidewalk surface detectable warning system retrofit will be paid for at the Contract unit price per square foot (square meter). price and payment will constitute full compensation for sawcutting, concrete removal, brick removal, excavation, disposal, furnishing and installing all materials, and for all labor, equipment, tools and incidentals required to complete the work.

7/27/07

720585 - GUARDRAIL END TREATMENT ATTENUATOR, TYPE 1 - 31
720586 - GUARDRAIL END TREATMENT ATTENUATOR, TYPE 2 - 31
720588 - GUARDRAIL END TREATMENT ATTENUATOR, TYPE 3 - 31

Description:

This work consists of furnishing and installing an impact attenuating guardrail end treatment in accordance with the locations, notes and details on the Plans, the Standard Construction Details, these Special Provisions, and as directed by the Engineer.

Materials:

The end treatment system shall meet the requirements of NCHRP Report No. 350 Test Level 3. The Guardrail End Treatment, Type 1 shall be designed for installation parallel to the roadway. The Guardrail End Treatment, Type 2 shall be designed for installation with the end flared back from the roadway. The Guardrail End Treatment, Type 3 shall be designed for installation where 2 runs of guardrail come together.

The entire end treatment shall be designed for quick and easy replacement after an impact.

Guardrail End Treatment Attenuator Type 1 shall have a minimum of 2 square feet (0.2 square meters) of yellow retroreflective material on the nose. Guardrail End Treatment Attenuator, Type 2 and Type 3 shall have a minimum of 3 square feet (0.3 square meters) of yellow retroreflective material on the nose.

The Contractor shall submit shop drawings, the manufacturer's certification, and the manufacturer's installation instructions to the Engineer. Installation cannot begin until these submissions have been approved by the Engineer.

Construction Methods:

The end treatment system shall be fabricated and installed in accordance with the manufacturer's recommendations and details shown on the Plans.

The end treatment system shall be installed so that there is no rigid object projecting more than 4 (100 mm) above ground level in that portion of the attenuator impacted and broken away by an errant vehicle. It is the intent that the errant vehicle not be snagged by an embedded component of the end treatment attenuator.

The grading between the edge of pavement and the end treatment shall be 10:1 or flatter for the length of the end treatment.

Reflectorized washers are not to be used on attenuators unless specified and/or approved by the manufacturer.

The Guardrail End Treatment Attenuator, Type 1 shall be installed with steel tubes and soil plates for the first 4 (min.) wood post. As an alternate, the first 4 (min.) post may be hinged, breakaway steel post if the manufacturer's specifications permit.

Unless otherwise noted on the Plans, the Guardrail End Treatment Attenuator, Type 1 shall be installed with a 25:1 taper beginning 50' (15 m) from the end of the end treatment.

Method of Measurement:

The quantity of guardrail end treatment attenuators will be measured as the number of each type fabricated, installed and accepted.

Note: All guardrail end treatment attenuators will be considered as 50 feet (15 meters) long. The 50' (15 m) length will begin at the center of the nose post and extend back along the attenuator and guardrail to which it is attached. Any guardrail within the 50' (15 m) length will be considered as part of the guardrail end treatment attenuator and not be measured separately. Measurement for the guardrail will begin 50' (15 m) from the center of the nose post of the attenuator.

Basis of Payment:

The quantity of guardrail end treatment attenuators will be paid for at the Contract unit price per each type of guardrail end treatment attenuator. Price and payment will constitute full compensation for furnishing all materials, fabrication and installation and for all materials, labor, equipment, tools and incidentals required to complete the work.

Note: When this item is completely installed, the Contractor may notify the Engineer and request acceptance. The Engineer will make an inspection of the installation and the Contractor shall correct any deficiencies. Once the corrective work is completed to the satisfaction of the Engineer, the installation will be accepted and the Contractor will be relieved from the responsibility for this item. If this item is damaged before the final acceptance of the project, and the damage is not the result of the Contractor's negligence, the Engineer will notify the Contractor to make repairs, and the Contractor will make repairs at the unit price bid (in the case of complete replacement) or at a negotiated price (in the case of partial replacement or repair). Damage caused by the Contractor shall be repaired at no cost to the Department.

8/12/2013

744544 – ADJUST OR REPAIR EXISTING CONDUIT JUNCTION WELL

Description:

This work consists of adjusting or repairing existing conduit junction wells, including furnishing all materials, in accordance with this specification, notes and details on the applicable Plans, the Standard Construction Details, and as directed by the Engineer. If Bonding and Grounding of the unit is required, that work will be paid for under “Bonding and Grounding Existing Junction Well”.

Materials:

Portland cement concrete shall conform to the requirements of Section 812, Class B.
Mortar shall conform to the requirements of Section 611.
Brick shall conform to the requirements of Section 611.
Concrete block shall conform to the requirements of Section 819.

Construction Methods:

Repair of conduit junction wells includes repairing/patching the masonry walls and resetting existing frames and lids or precast polymer concrete covers.

Adjusting involves raising the elevation of the frame and lid to match the grade of the surrounding area.

Method of Measurement:

The quantity of conduit junction wells adjusted or repaired will be measured as the actual number of conduit junction wells adjusted or repaired and accepted. If a new frame and lid or precast polymer concrete cover is needed, it will be supplied under a separate item.

Basis of Payment:

The quantity of conduit junction wells will be paid for at the Contract unit price per each junction well. Price and payment will constitute full compensation for excavating, backfilling, compacting and disposing of excess materials, for furnishing and placing all materials and for all labor equipment, tools and incidentals required to complete the work.

2/29/12

**746924 - FURNISH & INSTALL LOOP WIRE 1-CONDUCTOR #14 AWG ENCASED IN ¼”
FLEXIBLE TUBING IN A LOOP SAWCUT**

Description:

Sawcut and seal existing pavement, furnish and install loop detector wire, aluminum shielded “home-run” cable, as shown on the Plans.

Materials:

1. **1-conductor #14 AWG Cable in ¼” Flexible Tubing** - shall consist of cable preinstalled in a polyethylene (PE) plastic duct meeting IMSA 51-5. Cable shall be rated for 600 volts. The cable shall have a temperature tolerance range of at least - 65 to + 176 degrees Fahrenheit. The conductor is AWG #14 stranded copper. Outside diameter of the cable is 0.25 inches. Referred to as “loop wire”
2. **2-conductor #14 AWG Aluminum Shielded Cable** – see specifications for furnish and install cable. Referred to as “home-run cable”.
3. **Flexible embedding sealer** - a cold poured, resilient type epoxy joint sealer, Bondo P 606 or Duracote D115 for concrete or asphalt pavement or E Poxy Industry 36 1 for concrete or E Poxy Industry 11 1 for asphalt pavement, or approved equal. A sealer accelerant or retarder may be added per the manufacturers specifications.
4. **Backer Rod** - 5/8" closed cell foam
5. **Tape** – Vinyl electrical tape shall have a PVC base with rubber based pressure sensitive adhesive. The tape shall be a minimum 7 mils thick and be UL listed and marked per UL Standard 510 as flame retardant and cold resistant. It shall be compatible with synthetic cable insulations, jackets and splicing compounds and rated for wire and cable splices up to 600-volts.
6. For splices in Junction Well (see plan detail):
 - a. **Dual Wall Heat Shrink Tubing** – Heat-shrink tubing shall be medium or heavy wall thickness, irradiated polyolefin tubing containing an adhesive mastic inner wall. Minimum wall thickness prior to contraction shall be 40 mils. When heated, the inner wall shall melt and fill all crevices and interstices of the object being covered while the outer wall shrinks to form a waterproof insulation. Each end of the heat-shrink tube or the open end of the end cap of heat-shrink tubing shall, after contraction, overlap the conductor insulation at least one and one-half inches. Heat-shrink tubing shall conform to the requirements in UL Standard 468D and ANSI C119.1, for extruded insulated tubing at 600 V.
 - b. Soldering iron with Rosin Core solder
 - c. Splicing Kit- In-line barrel type design, resin encapsulating compound kit with UL486 rating. Suitable for use in wet or direct buried locations. Resin encapsulating compounds shall be acceptable for use at 16 degrees C.

Construction Methods:

Loop Wire Installation:

The pavement saw cut shall be 5/8” wide and up to 3½” deep. It shall be “wet-cut” in the directions and sizes specified on the Plans, Standard Details or as directed by the Engineer. Contractor shall remove sharp edges in the saw cut and round the corners.

The saw cut shall be blown out with compressed air to remove all dust, water and particles of loose material prior to sealing.

The loop detector wire will then be installed using blunt tools so as to prevent damage to the polyethylene outer cover. One end of a loop detector wire shall be tagged to indicate start ("S"). A 5/8" backer rod will be placed into the bottom of the saw cut as needed to secure the wiring within the saw cut. All loop detector wires shall be laid in saw cuts in a clockwise rotation beginning with "S". The Engineer may require a High Voltage Ground Test with a 500 VDC megger after the loop detector installation is complete and prior to sealing saw cuts. If the resistance to ground is less than 100 megohms, this work will be rejected.

A sealer and sealer accelerant or retarder (if necessary) shall be applied in accordance with the manufacturer's directions and protected from traffic until it has set. A minimum of 1 inch of sealer shall be installed on top of the loop detector wire and finished flush with the pavement. Drilled holes in the pavement shall also be sealed.

Two loop detector wires shall be installed in a saw cut from the loop to the edge of the road. These two wires shall then extend from the end of the saw cut to a junction well (see Plan Details). Wires shall be parallel, twisted a minimum of 5 wraps per foot, and taped every 12" to 18" from the end of the saw cut to a junction well up to the splice. The loop detector wire shall be installed between the end of the saw cut and junction well through a penetration created by a 1 1/2" rotary drill as directed by the Engineer. The loop detector wire shall be continuous and without splices from the junction well, through the saw cuts and conduit.

Home-run Wire Installation - refer to furnish and install cable specifications and conduit installation specifications. Refer to plans for details.

Splicing – splices between the loop detector wire and home-run cable shall be done in accordance with the plan details.

Conductors to be soldered shall be placed side by side with the exposed copper aligned. The copper shall then be twisted clockwise with pliers until a good mechanical connection is affected. The splice shall be coated with flux, heated with a soldering iron, and rosin core soldered in a manner that minimizes insulation damage. After each soldered connection is completed, it shall be properly insulated with heat shrink tubing.

After the electrical and mechanical connection is completed and before the splicing kit is applied, a test shall be made by the Contractor to ensure that all circuits are complete. An approved splice kit shall be installed as per manufacturer's instructions. A continuity test will be performed at the cabinet by the Department technician after the splicing kit is applied. The Department will be notified of the test results. If the continuity test fails the Contractor shall remake the splice and/or loop at his own expense.

If a splice is found to be faulty within 90 calendar days of installation, it shall be the Contractor's responsibility to remake the splice at his own expense.

Method of Measurement:

The quantity of loop detector wire to be measured under this item shall be the number of linear feet of sawcut in which loop detector wire is installed, sealed, tested, and accepted. Sealer, sealer accelerant or retarder shall be incidental to this item. Loop detector wire routed through the rotary drill penetration is considered incidental to the cost of the loop installation. Conduit and associated home-run cable between the junction well and cabinet will be measured and paid for under their respective items, separate from this specification. Splicing of the loop detector wire to a home-run cable in a junction well shall be incidental to the cost of the loop wire.

Basis of Payment:

The quantity of loop detector wire supplied and installed will be paid for at the Contract unit price per linear foot, determined by measuring the footage of sawcut described above. Price and payment shall constitute full compensation for "wet"-sawcutting, furnishing and placing all materials including loop detector wire, backer rod, sealer, and for all labor, equipment, tools, splicing in the junction well, and incidentals necessary to complete this item. The price bid per linear foot of sawcut with Loop Wire shall include drilling required for installation, concrete and pavement patching, sealing the conduit ends, internal bushings shown on the plans, and all incidentals necessary to complete the item.

7/18/14

748502 - RAISED/RECESSED PAVEMENT MARKER

Description:

This work consists of furnishing and installing raised/recessed pavement markers in accordance with the Plans and these specifications.

Materials:

The cast iron housing shall meet the requirements of ASTM A 536-84, Grade 72-45-84.

The reflectors shall meet the requirements of ASTM D 4383-03.

For installation on interstates, freeways, and principal arterials, the pavement marker shall have red reflectorized material on the back side (the side not facing the direction of traffic).

Epoxy shall meet the requirements of AASHTO M237, Type IV.

The followings models have been tested and approved by the Department and shall be used:

The followings models have been tested and approved by the Department and shall be used:

1. Ennis Paint - Stimsonite Model 101LPCR with Model C40 reflective pavement markers.
2. Ray-O-Lite Model 300 Snowplowable Marker with Model 2004 Reflector.
3. Or Approved Equal.

Construction Methods:

Pavement shall be saw cut to match the bottom contour of the marker housing using a saw and blade suitable for the pavement material being sawed. The depth of the cut slot must allow the housing to be set in epoxy, with leveling lugs resting on the pavement surface, so that the front edge of marker is at or below the surface of the pavement. Excessive saw cuts must be repaired to the satisfaction of the Engineer. When cutting is complete, the slot shall be cleaned as recommended by the manufacturer of the epoxy material. The epoxy and pavement marker will be installed in the prepared contour slot in the pavement per the manufacturer's recommendations. Placement shall be in accordance with the DE MUTCD.

Method of Measurement:

The quantity of raised/recessed pavement markers will be measured as the actual number installed and accepted.

Basis of Payment:

The quantity of raised/recessed pavement markers will be paid for at the Contract unit price per each. Price and payment will constitute full compensation for furnishing all materials, installation, saw-cutting, cleaning, disposal of discarded materials, for all labor, tools, equipment, all necessary incidentals associated with the item to complete the work.

07/26/2011

- 748506 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/YELLOW, 4"
- 748507 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/YELLOW, 6"
- 748508 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/YELLOW, 8"
- 748509 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/YELLOW, 12"
- 748510 - PERMANENT PAVEMENT STRIPING, SYMBOL/LEGEND, EPOXY RESIN PAINT
- 748535 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 4"
- 748536 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 6"
- 748537 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 8"
- 748538 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 10"
- 748539 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 12"
- 748540 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 16"
- 748548 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/YELLOW, 5"
- 748549 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/YELLOW, 10"
- 748557 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 3"
- 748559 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 5"
- 748568 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 9"
- 748569 - PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 14"

Description:

This work consists of striping layout, furnishing and applying white or yellow, epoxy reflectorized pavement markings or black epoxy contrast pavement markings at the locations and in accordance with the patterns indicated on the Plans, or as directed by the Engineer, and in accordance with these specifications.

The white/yellow epoxy marking material shall be hot-applied by spray methods onto bituminous and/or Portland cement concrete pavement surfaces as required by the Plans. Following an application of double drop glass beads of two sizes and upon curing, the resultant epoxy marking shall be an adherent reflectorized stripe of the specified thickness and width that is capable of resisting deformation by traffic. All marking materials shall be certified lead free and free of cadmium, mercury, hexvalent chromium, and other toxic heavy metals.

The black epoxy marking shall be a two-component, hot-spray applied epoxy resin pavement marking material to be used for pavement marking on Portland cement concrete pavement surfaces. Following an aggregate drop, and upon curing, it shall produce an adherent stripe of specified thickness and width capable of resisting wear from traffic. Black contrast pavement markings will be required on all Portland cement concrete pavements.

Materials Requirements:

A. White and Yellow Reflectorized Epoxy

1. Epoxy Composition Requirements:

The epoxy resin composition shall be specifically formulated for use as a pavement marking material and for hot-spray application at elevated temperatures. The type and amounts of epoxy resins and curing agents shall be at the option of the manufacturer, providing the other composition and physical requirements of this specification are met.

The epoxy marking material shall be a two-component (Part A and Part B), 100% solids type system formulated and designed to provide a simple volumetric mixing ratio (e.g. two volumes of Part A to one volume of Part B).

Component A of both white and yellow shall conform to the following requirements:

	% BY WEIGHT	
	WHITE:	YELLOW:
Pigments	Titanium Dioxide - 18% Min. (ASTM D476, Type II)	Organic Yellow - 6%-10%
Epoxy Resin	75% Min., 82% Max.	70% Min., 77% Max.

The entire pigment composition shall consist of either titanium dioxide and/or organic yellow pigment. No extender pigments are permitted. The white pigment upon analysis, shall contain a minimum of 16.5% TiO₂ (100% purity).

Epoxy Content-WPE (Component A) - The epoxy content of the epoxy resin will be tested in accordance with ASTM D1652 and calculated as the weight per epoxy equivalent (WPE) for both white and yellow. The epoxy content will be determined on a pigment free basis. The epoxy content (WPE) shall meet a target value provided by the manufacturer and approved by the Department's Material and Research Section (from now on will be addressed as Department). A ± 50 tolerance will be applied to the target value to establish the acceptance range.

Amine Value (Component B) - The amine value of the curing agent shall be tested in accordance with ASTM D2074-66 to determine its total amine value. The total amine value shall meet a target value provided by the manufacturer and approved by the Department. A ± 50 tolerance will be applied to the target value to establish the acceptance range.

Toxicity - Upon heating to application temperature, the material shall not exude fumes which are toxic or injurious to persons or property.

Viscosity - Formulations of each component shall be such that the viscosity of both components shall coincide (within 10%) at a recommended spray application.

2. Physical Properties of Mixed Composition:

Unless otherwise noted, all samples are to be prepared and tested at an ambient temperature of 73 ± 5 F. (23 ± 3 C).

- a. Color. The white epoxy composition when applied at a minimum wet film thickness of 20 ± 1 mils (500 μm) as applicable and allowed to dry, shall plot within the boundaries described by the four corner points listed in Tables 1 and 2 of ASTM D 6628-01 when measured in accordance with the test methods prescribed in Section 7 of ASTM D 6628-01.

The yellow epoxy composition when applied at a minimum wet film thickness of 20 ± 1 mils (500 μm) as applicable and allowed to dry, shall plot within the boundaries described by the four corner points listed in Tables 1 and 2 of ASTM D 6628-01 when measured in accordance with the test methods prescribed in Section 7 of ASTM D 6628-01.

- b. Directional Reflectance. The white epoxy composition (without glass spheres) shall have a daylight directional reflectance of not less than 84% relative to a magnesium oxide standard when tested in accordance with Method 6121 of Federal Test Method Standard No. 141.

The yellow epoxy composition (without glass spheres) shall have a daylight directional reflectance of not less than 55% relative to a magnesium oxide standard when tested in accordance with Method 6121 of Federal Test Method Standard No. 141.

- c. Drying Time (Laboratory). The epoxy composition, when mixed in the proper ratio and applied at a 20 ± 1 mils (500 μm) minimum wet film thickness, and immediately dressed with large reflective glass spheres (Federal Spec. Type 4) at a rate of 12 lb/gal (1.4 kg/l) of epoxy pavement marking materials, immediately followed by a second drop of AASHTO M-247 Type 1 glass spheres applied at a rate of 12 lb/gal (1.4 kg/L) of epoxy pavement marking material, shall exhibit a no-track condition in 15 minutes or less (ASTM D711). A Bird Applicator or any other doctor blade shall be used to produce a uniform film thickness.

- d. Drying Time (Field). When installed at a minimum wet film thickness of 20 ± 1 mils (500 or 625 μm) and reflectorized with glass spheres, the maximum drying times shall correspond to these temperatures:

- 80 F (27C) 10 minutes
- 70 F (21C) 10 minutes
- 60 F (16C) 15 minutes

50	F (10C)	25 minutes
40	F (4C)	45 minutes
35	F (2C)	60 minutes

The composition shall dry to “no-tracking” in approximately 10 minutes, and after thirty (30) minutes shall show no damaging effect from traffic. Dry to no-tracking shall be considered as the condition where no visual deposition of the epoxy marking to the pavement surface is observed when viewed from a distance of 100 feet (30 meters), after a passenger car is passed over the line. Regardless of the temperature at the time of installation, the installation contractor shall be responsible for protection of the markings material until dry to a non-tracking state.

- e. Abrasion Resistance. The wear index of the composition shall not exceed 82 when tested in accordance with ASTM C501 using a CS-17 wheel and under a load of 1000 grams for 1000 cycles.
- f. Tensile Strength. The tensile strength of the epoxy composition shall not be less than 6000 psi (41 MPa) when tested in accordance with ASTM D638 using a Type IV specimen [0.125" \pm 0.010" (3.18 \pm 0.25 mm) thick]. Tests shall be conducted at an ambient temperature of 75 \pm 5 F (24 \pm 3 C). The testing machine shall operate at a speed of 0.20" (5.1 mm) per minute.

The total conditioning or drying period, from the time the epoxy composition is first mixed to the time of testing, shall not be less than 24 hours nor more than 96 hours.

Test specimens for tensile strength determination will be prepared as follows:

A 1/8 inch (3 mm) thick sheet of epoxy material is cast from a reservoir-type mold, fabricated from polytetrafluorethylene (PTFE), 1/8" deep x 10" x 10" (3 mm deep x 250 mm x 250 mm).

Prior to casting, the mold is sprayed with a suitable release agent. A sufficient amount of epoxy composition is mixed in the proper proportions (A:B) and poured level with the top of the mold. Care should be taken so as not to decrease or exceed the 1/8" (3 mm) thickness.

After a period of 1 to 4 hours, the material will have set into a semi-rigid sheet that is flexible enough to die-cut yet rigid enough to retain its shape. While the material is in this “plastic” state, five (5) specimens shall be die-cut and then placed on a flat, smooth, PTFE surface for the completion of the specified conditioning period.

- g. Compressive Strength. The compressive strength of the epoxy composition shall not be less than 12,000 psi (83 MPa) when tested in accordance with ASTM D695 except that a compression tool shall not be necessary. The test specimen shall be a right cylinder [0.50 inch diameter by 1.0 inch length (12 mm diameter by 25 mm length)]. Tests shall be conducted at an ambient temperature of 75 \pm 5 F (24 \pm 3 C).

The total conditioning or drying period, from the time the epoxy composition is first mixed to the time of testing shall not be less than 24 hours nor more than 96 hours.

Test specimens for compressive strength determinations will be prepared as follows:

Five molds will be prepared from 1/2" (12 mm) I.D., 1/16" (1.5 mm) wall thickness acrylic tubing, cut in 1 1/2" (38 mm) lengths. After spraying the inside of the mold with a suitable release agent,⁽¹⁾ the cylindrical tubes are placed in a vertical position on a PTFE sheet base. A sufficient amount of epoxy composition is thoroughly mixed in the proper proportions (A:B) and poured into the mold to a depth of approximately 1 1/4" (32 mm). After a minimum of 72 hours curing, the specimens are removed from the molds and machined to a length of 1" \pm 0.002" (25 mm \pm 0.05 mm).

- h. Hardness. The epoxy composition when tested in accordance with ASTM D2240 shall have a Shore D hardness of between 75 and 100. Samples shall be allowed to dry for not less than 24 hours nor more than 96 hours prior to testing.

B. Reflective Glass Spheres/Beads

Reflective glass spheres for drop-on application shall conform to the following requirements:

The glass spheres shall be colorless; clean; transparent; free from milkiness or excessive air bubbles; and essentially clean from-surface scarring or scratching. They shall be spherical in shape and at least 80% of the glass beads shall be true spheres when tested in accordance with ASTM D1155. At least 80% of the Type IV beads shall be true spheres as measured by the visual method. The refractive index of the spheres shall be a minimum of 1.50 as determined by the liquid immersion method at 77 F (25 C).

The silica content of the glass spheres shall not be less than 60%.

The crushing resistance of the spheres shall be as follows: A 40 lb. (18 kg) dead weight, for 20 to 30 (850 µm to 600 µm) mesh spheres shall be the average resistance when tested in accordance with ASTM D1213.

The glass spheres shall have the following grading when tested in accordance with ASTM D1214.

M247 AASHTO Type 1 Glass Spheres

<u>U.S. Standard Sieve</u>	<u>% Retained</u>	<u>% Passing</u>
#20 (850µm)	0	100
#30 (600µm)	5-25	75-95
#50 (300µm)	40-65	15-35
#100 (150µm)	15-35	0-5
Pan	0-5	

Type 4 Large Spheres

<u>U.S. Standard Sieve</u>	<u>% Retained</u>	<u>% Passing</u>
#10 (2000 µm)	0	100
#12 (1680 µm)	0-5	95-100
#14 (1410 µm)	5-20	80-95
#16 (1190 µm)	40-80	10-40
#18 (1000 µm)	10-40	0-5
#20 (850 µm)	0-5	0-2
Pan	0-2	

The AASHTO M247 Type 1 glass spheres shall be treated with a moisture-proof coating. They shall show no tendency to absorb moisture in storage and shall remain free of clusters and hard lumps. They shall flow freely from dispensing equipment at any time when surface and atmosphere conditions are satisfactory for marking operations. The moisture-resistance of the glass spheres shall be determined in accordance with AASHTO M247 test method 4.4.1.

Type IV glass spheres shall be treated with an adhesion coating. They shall show no tendency to absorb moisture in storage and shall remain free of clusters and hard lumps. They shall flow freely from dispensing equipment at any time when surface and atmosphere conditions are satisfactory for marking operations. The adhesion coating property of the Type IV beads shall be tested in accordance with the dansyl-chloride test.

C. Black Epoxy Contrast Markings

Epoxy Resin Requirements: The two-component, 100% solids, paint shall be formulated and designed to provide a simple volumetric mixing ratio (e.g. 2 part component A to 1 part component B) specifically for service as a hot-spray applied binder for black aggregate in such a manner as to produce maximum adhesion. The material shall be composed of epoxy resins and pigments only.

The paint shall be well mixed in the manufacturing process and shall be free from defects and imperfections that may adversely affect the serviceability of the finished product. The paint shall not thicken, curdle, gel, settle excessively, or otherwise display any objectionable properties after storage. Individual components shall not require mixing prior to use when stored for a maximum of 6 months.

The overall paint composition shall be left to the discretion of the manufacturer, but shall meet the following requirements:

Composition:	<u>Component</u>	<u>Percent By Weight</u>
	Carbon Black (ASTM D476 Type III)	7±2 percent, by weight
	Talc	14±2 percent, by weight
	Epoxy Resin	79±4 percent, by weight

D. Black Aggregate

The moisture resistant aggregate shall meet the gradation requirements (AASHTO T27) as follows:

<u>Sieve Size</u>	<u>Percent Retained</u>
#30	18-28%
#40	60-80%
#50	2-14%

The moisture resistant aggregate shall have a ceramic coating. The aggregate shall be angular with no dry dispensement pigment allowed.

<u>Hardness:</u>	The black aggregate hardness shall be 6.5-7 on Moh's Mineral Scale.
<u>Porosity:</u>	The black aggregate porosity shall be less than two (2) percent.
<u>Moisture Content:</u>	The black aggregate moisture content shall be less than a half (.5) percent.

E. Packaging and Shipment

Epoxy pavement marking materials shall be shipped to the job site in strong substantial containers. Individual containers shall be plainly marked with the following information:

- a. Name of Product
- b. Lot Number
- c. Batch Number
- d. Test Number
- e. Date of Manufacture
- f. Date of expiration of acceptance (12 months from date of manufacture)
- g. The statement (as appropriate)
Part A - Contains Pigment & Epoxy Resin
Part B - Contains Catalyst
- h. Quantity
- i. Mixing proportions, Application Temperature and Instructions
- j. Safety Information
- k. Manufacturer's Name and Address

Reflective glass spheres shall be shipped in moisture resistant bags. Each bag shall be marked with the name and address of the manufacturer and the name and net weight of the material.

F. The Department reserves the right to randomly take a one-quart sample of white, yellow and hardener, of the epoxy material or glass spheres without prior notice for testing to ensure the epoxy material meets specifications.

Epoxy Application Equipment:

Application equipment for the placement of epoxy reflectorized pavement markings shall be approved by the Department, prior to the start of work. At any time throughout the duration of the project, the Contractor shall provide free access to his epoxy application equipment for inspection by the Engineer or his authorized representative.

In general, the application equipment shall be a mobile, truck mounted and self contained pavement marking machine, specifically designed to apply epoxy resin materials and reflective glass spheres in continuous and skip-line patterns. The application equipment shall be maneuverable to the extent that straight lines can be followed and normal curves can be made in a true arc. In addition, the truck mounted unit shall be provided with accessories to allow for the marking of legends, symbols, crosswalks, and other special patterns.

The Engineer may approve the use of a portable applicator in lieu of truck mounted accessories, for use in applying special markings only, provided such equipment can demonstrate satisfactory application of reflectorized epoxy markings in accordance with these specifications.

The applicator shall be capable of installing up to 20,000 lineal feet (6,100 lineal meters) of epoxy reflectorized pavement markings in an 8-hour day and shall include the following features:

1. The applicator shall provide individual material reservoirs, or space, for the storage of Part A and Part B of the epoxy resin composition; for the storage of water; and for the storage of reflective glass spheres.
2. The applicator shall be equipped with heating equipment of sufficient capacity to maintain the individual epoxy resin components at the manufacturer's recommended temperature for spray application and for heating water to a temperature of approximately 140 F (60 C).
3. The glass spheres shall be gravity dropped upon 20 mils (500 um) of epoxy pavement markings to produce a wet-night-reflective pavement marking. The large spheres (Federal Spec. Type 4) shall be applied at a rate of 12 pounds per gallon (1.4 kg/L) of epoxy pavement marking material, immediately followed by a second drop of AASHTO M-247 Type 1 glass spheres applied rate of 12 pounds per gallon (1.4 kg/L) of epoxy pavement marking material. This application rate and the following gradation shall conform to FHWA's FP-96: Standard Specifications for Construction of Roads and Bridges on Federal Highway Projects (pages 757-761 Type 3 and Type 4 Beads).
4. The applicator shall be equipped with metering devices or pressure gauges, on the proportioning pumps. Metering devices or pressure gauges shall be visible to the Engineer.
5. The applicator shall be equipped with all the necessary spray equipment, mixers, compressors, and other appurtenances to allow for the placement of epoxy reflectorized pavement markings in a simultaneous sequence of operations as described below in Construction Details, D. Applications of Epoxy Reflectorized Pavement Markings of this Special Provisions.

Construction Details.

- A. General: All pavement marking and patterns shall be placed as shown on the Plans or as directed by the Engineer.

Before any pavement markings work is begun, a schedule of operations shall be submitted for the approval of the Engineer. This schedule shall be submitted 2 weeks prior to the application of the striping.

At least five (5) days prior to starting striping the Contractor shall provide the Engineer with the epoxy manufacturer's written instructions for use. These instructions shall include but not be limited to: mixing ratios, application temperatures, and recommendations for use of water spray.

The application of pavement markings shall be done in the general direction of traffic. Striping against the direction of traffic flow shall not be allowed.

The Contractor shall be responsible for removing, to the satisfaction of the Engineer, tracking marks, spilled epoxy or epoxy markings applied in unauthorized areas.

The hot water spray shall not be used in conjunction with markings applications on any pavement surface, or on any existing durable type marking, unless specifically recommended by the manufacturer of the epoxy material.

- B. Atmospheric Conditions: Epoxy pavement markings shall only be applied during conditions of dry weather and on substantially dry pavement surfaces. At the time of installation the pavement surface temperature shall be a minimum of 35 F (2 C) and the ambient temperature shall be a minimum of 35 F (2 C) and rising. The Engineer shall be the sole determiner as to when atmospheric conditions and pavement surface conditions are such to produce satisfactory results.

- C. Surface Preparations: The Contractor shall clean the pavement or existing durable marking to the satisfaction of the Engineer.

Surface cleaning and preparation work shall be performed only in the area of the epoxy markings application.

At the time of application all pavement surfaces and existing durable markings shall be free of oil, dirt, dust, grease and similar foreign materials. The cost of cleaning these contaminants shall be included in the bid price of this item. Also, the item shall include the cost of removal of the curing component in the area of the epoxy markings application, if concrete curing compounds on new portland cement concrete surfaces have been used. Waterblasting will not be permitted for removal.

- D. Application of White/Yellow Epoxy Reflectorized Pavement Markings: White/yellow epoxy reflectorized pavement markings shall be placed at the widths and patterns designated on the Contract Plans.

Markings operations shall not begin until applicable surface preparation work is completed, and approved by the Engineer.

White/yellow epoxy pavement markings shall be applied at a minimum uniform thickness of 20 mils (500 μm) on all Portland cement concrete and bituminous concrete pavement, including Stone Matrix Asphalt.

Large reflective glass spheres (Federal Spec. Type 4) shall be applied at the rate of 12 pounds per gallon (1.4 kg/L) of epoxy pavement marking material, immediately followed by a second drop of AASHTO M-247 Type 1 glass spheres applied at a rate of 12 pounds per gallon (1.4 kg/L) of epoxy pavement marking material. Glass spheres shall uniformly cover the length and width of the pavement marking.

- E. Application of Black Epoxy Contrast Pavement Markings: Black epoxy contrast pavement markings shall be placed at the widths designated on the Contract Plans.

Markings operations shall not begin until applicable surface preparation work is completed, and approved by the Engineer.

Black epoxy contrast pavement markings shall be applied at a minimum uniform thickness of 20 mils (500 μm) on all Portland cement concrete surfaces followed by a single drop of graded black aggregate.

The width of black epoxy line shall be applied for the following situations:

Center Skip Line - On Portland cement concrete pavements a black contrast skip line shall be 10 feet (3 m) in length of the same width as the white epoxy reflectorized skip. It is to lead the white skip and stop at the beginning of the white skip. The black contrast skip is to have a single application of graded black aggregate.

Edge Lines -White Edge lines on Portland cement concrete pavements shall have a 3 inch black contrast line running parallel to the white edge line. The contrast line shall be to the inside or travel

lane side of the edge line. The black contrast marking is to be applied with a single drop of graded black aggregate. Once it has cured sufficiently so as not to track, the reflectorized white line is to be applied along side of the contrast line and the two lines shall adjoin each other.

Dotted Line: All dotted lines on Portland cement concrete pavements shall have a base of black contrast markings which is 4 inches (100 mm) wider than the reflective white marking. The black contrast marking is to be applied first with a single drop of graded black aggregate. Once it has cured sufficiently so as not to track, the reflectorized white line is to be applied on top of it. The reflective line is to be centered along the black contrast line such that a minimum of 2 inches (50 mm) of black contrast marking is visible on either side of the reflective marking.

F. Defective Epoxy Pavement Markings: Epoxy reflectorized pavement markings, which after application and curing are determined by the Engineer to be defective and not in conformance with this specification, shall be repaired. Repair of defective markings shall be the responsibility of the Contractor and shall be performed to the satisfaction of the Engineer as follows:

1. Insufficient film thickness [(less than 20±1 mils (500 µm) as applicable] and line widths; insufficient glass bead coverage or inadequate glass bead retention.

Repair Method: Prepare the surface of the defective epoxy marking by shot blasting, sand blasting, or water blasting. No other cleaning methods will be allowed. Surface preparation shall be performed to the extent that a substantial amount of the reflective glass spheres are removed and a roughened epoxy marking surface remains.

Immediately after surface preparation remove loose particles and foreign debris by brooming or blasting with compressed air. Repair shall be made by re-striping over the cleaned surface, in accordance with the requirements of this specification and at a full 20±1 mils (500 µm) minimum line thickness as applicable.

2. Uncured or discolored epoxy (brown patches); insufficient bond to pavement surface (or existing durable marking).

Uncured epoxy shall be defined as applied material that fails to cure (dry) in accordance with the requirements of this specification under MATERIALS, A, 2d. DRYING TIME (FIELD); or applied material that fails to cure (dry) within a reasonable time period under actual field conditions, as defined by the Engineer.

Discoloration (brown patches) shall be defined as localized areas or patches of brown or grayish colored epoxy marking material. These areas often occur in a cyclic pattern and also, often are not visible until several days or weeks after markings are applied.

Repair Method: The defective epoxy marking shall be completely removed and cleaned to the underlying pavement surface to the satisfaction of the Engineer.

The extent of removal shall be the defective area plus any adjacent epoxy pavement marking material extending one foot (300 mm) any direction.

After surface preparation work is complete, repair shall be made by re-applying epoxy over the cleaned pavement surface in accordance with the requirements of this specification.

3. Reflectivity for epoxy resin paint.

After satisfactory completion of all striping work and written notification from the Contractor, the Department shall test the striping to ensure it has the minimum reflectivity. The testing will be completed within 30 calendar days from notification. The Contractor may request that tests be conducted on completed phases or portions of the work. Approval of such a request will be at the discretion of the Engineer. Testing will be done using a LTL-X Retrometer (30 meter geometry). Five readings will be taken per line per mile (1.6 km). Projects less than 1 mile (1.6 km) in length will have a minimum of 5 readings per line. These readings will then be averaged for the overall project average.

The required average minimum initial reflectivity reading in millicandellas shall be:

White 450
Yellow 325

Any single reading shall not be less than 350 millicandellas for white and 250 millicandellas for yellow. Without exception, any pavement markings installed that does not meet the above average minimum initial reflectivity numbers shall be removed and replaced, at the installation contractor's expense.

Other defects not noted above, but determined by the Engineer to need repair, shall be repaired or replaced as directed by and to the satisfaction of the Engineer.

All work in conjunction with the repair or replacement of defective epoxy reflectorized pavement markings shall be performed by the Contractor at no additional cost to the State.

Method of Measurement:

The quantity of permanent pavement striping (white, yellow, or black epoxy resin paint) will be measured by the number of linear feet (meters) of pavement striping line and number of square feet (meter) of symbol installed on the pavement and accepted in accordance with the Plans.

Basis of Payment:

The quantity of permanent pavement striping (white, yellow, or black epoxy resin paint) payment will be paid for at the Contract unit price per linear foot (meter) for 3", 4", 5", 6", 8", 9", 10", 12", 14", 16" (75 mm, 100 mm, 125 mm, 150 mm, 200 mm, 225 mm, 250 mm, 300 mm, 350 mm, or 400 mm) line and the Contract unit price per square foot (meter) of symbol. The quantity of permanent pavement marking (white, yellow, or black epoxy resin paint) will be paid for at the Contract unit price per linear foot (meter) of line and the Contract unit price per square foot (meter) of symbol. Price and payment shall include striping layout, cleaning and preparing the pavement surface, and placing all materials, for all labor, tools, equipment and incidentals necessary to complete the work.

NOTE:

For information only:

The following manufacturers are known to us which manufacturer Epoxy Resin Paint for Pavement Striping. The Department does not endorse or require the use of any of the manufacturers listed below. However, a bidder wishes to use another manufacturer's product, it shall be submitted for review and approval prior to submitting a bid proposal. Should the product be deemed unacceptable by the Department, the successful bidder will be required to use only an approved product.

1. POLY CARB, Inc.
33095 Bainbridge Road
Solon, Ohio 44139
Tel. 1-800-CALLMIX
2. IPS - Ennis Paint
P.O. Box 13582
Research Triangle Park, North Carolina 27709
Tel. 1-877-477-7623
3. Epoplex
One Park Avenue
Maple Shade, NJ 08052
Tel. 1-800-822-6920
4. Or an approved equal.

- 748512 - RETROREFLECTIVE PREFORMED PATTERNED MARKINGS, 6
- 748513 - RETROREFLECTIVE PREFORMED PATTERNED MARKINGS, 12
- 748514 - RETROREFLECTIVE PREFORMED PATTERNED MARKINGS, 8
- 748519 - RETROREFLECTIVE PREFORMED PATTERNED MARKING, 4
- 748529 - RETROREFLECTIVE PREFORMED PATTERNED MARKING, SYMBOL/LEGEND
- 748547 - RETROREFLECTIVE PREFORMED PATTERNED CONTRAST MARKINGS, 9"
- 748556 - RETROREFLECTIVE PREFORMED PATTERNED CONTRAST MARKINGS, 16"
- 748564 - RETROREFLECTIVE PREFORMED PATTERNED MARKINGS, 5"
- 748565 - RETROREFLECTIVE PREFORMED PATTERNED MARKINGS, 10"
- 748566 - RETROREFLECTIVE PREFORMED PATTERNED CONTRAST MARKINGS, 8"
- 748567 - RETROREFLECTIVE PREFORMED PATTERNED CONTRAST MARKINGS, 13"

Description:

This work shall consist of furnishing and installing retroreflective preformed patterned pavement marking in accordance with this provision and in conformance to the existing pavement markings or as established by the Engineer. The Contractor is required to have all subcontractors involved in the placement of these markings attend the pre-placement meeting along with the tape manufacturer representative and Department representatives to coordinate this operation. The subcontractor for pavement markings shall be approved by the Department prior to the preconstruction meeting.

Materials:

General: The preformed patterned markings shall consist of white or yellow films with clear microcrystalline ceramic beads incorporated to provide immediate and continuing retroreflection. The markings shall be suitable for application on new or existing P.C. Concrete or bituminous pavements with a pre-coated pressure sensitive adhesive.

The preformed marking material must be used prior to one year from date of manufacture. When not placed by inlaid method a surface preparation adhesive shall be used. The markings shall be capable of providing retroreflection during both wet and dry conditions.

The markings shall be highly durable retroreflective pliant polymer materials designed for longitudinal and word/symbol markings subjected to high traffic volumes and severe wear conditions such as shear action from crossover or encroachment on typical longitudinal configurations such as edge lines and lane lines. This film shall be manufactured without the use of lead chromate pigments or other similar, lead-containing chemicals.

Composition: The pavement marking shall consist of a mixture of high quality polymeric materials and pigments with glass beads distributed throughout the base cross-sectional area, with a reflective layer of microcrystalline ceramic beads bonded to a durable polyurethane topcoat surface. The patterned surface shall have approximately 50% plus or minus 15% of the surface area raised and presenting a near vertical face, angled from 0 degrees to 60 degrees, to traffic from any direction. The channels between the raised areas shall be substantially free of exposed beads or particles. The marking shall have a pre-coated pressure sensitive adhesive. The edges of the markings shall be clean cut and true.

Retroreflectance: The white and yellow markings shall have the initial expected retroreflectance values as shown in Table 1 under dry, wet, and rainy conditions. The photometric quantity to be measured shall be coefficient of retroreflected luminance (R_L) and shall be expressed as millicandelas per square foot per foot-candle [$(\text{mcd ft}^{-2} \text{ fc}^{-1})$]. The metric equivalent shall be expressed as millicandelas per square meter per lux [$(\text{mcd m}^{-2} \text{ lx}^{-1})$].

Retroreflectance values shall be measured under dry conditions in accordance with the testing procedures of ASTM D4061. Retroreflectance values shall be measured under wet conditions in accordance with ASTM E2176 or ASTM E2177. Wet retroreflectance values measured under a "condition of continuous wetting" (simulated rain) shall be in accordance with ASTM E2176. Wet retroreflectance values measured under a "condition of wetness" shall be in accordance with ASTM E2177.

Table 1		
Expected Initial R_L under dry, wet, and rainy conditions		
<u>White</u>	<u>Dry</u>	<u>Wet & Rainy</u>
Entrance Angle	88.76	88.76
Observation Angle	1.05	1.05
Retroreflected Luminance	500	250
R_L [(mcd m ⁻²) lx ⁻¹]		
<u>Yellow</u>	<u>Dry</u>	<u>Wet & Rainy</u>
Entrance Angle	88.76	88.76
Observation Angle	1.05	1.05
Retroreflected Luminance	300	250
R_L [(mcd m ⁻²) lx ⁻¹]		

Beads, Index of Refraction: All “dry-performing” microcrystalline ceramic beads bonded to the polyurethane-coated, patterned surface of the material shall have a minimum index of refraction of 1.70 when tested using the liquid oil immersion method. All “wet-performing” microcrystalline ceramic beads bonded to the polyurethane-coated, patterned surface of the material shall have a minimum index of refraction of 2.30 when tested using the liquid oil immersion method. The glass beads mixed into the pliant polymer shall have a minimum index of refraction of 1.5 when tested by the liquid oil immersion method.

Beads, Acid Resistance: The beads shall show resistance to corrosion of their surface after exposure to a 1% solution (by weight) of sulfuric acid. The 1% acid solution shall be made by adding 5.7 cc of concentrated acid into 1000 cc of distilled water.

Color: The markings shall consist of white and/or yellow films with pigments selected and blended to conform to standard highway colors.

Skid Resistance: The patterned surface of the markings shall provide an initial average skid resistance value of 45 BPN when tested according to ASTM E 303.

Patchability: The pavement marking material shall be capable of use for patching worn areas of the same type in accordance with manufacturer's instructions.

Thickness: The patterned material without adhesive shall have a minimum caliper of 0.065 inches (1.651mm) at the thickest portion of the patterned cross section and a minimum caliper of 0.020 inches (.508mm) at the thinnest portion of the cross section.

Tolerance: The Contractor will be responsible for applying these markings in a straight manner not exceeding 1/2 (12 mm) per 40 (12 m). Any markings exceeding the 1/2 (12 mm) tolerance will require the Contractor to make corrective action approved by the Engineer and the tape manufacturer representative at no extra cost to the Department.

Construction Methods:

The Contractor shall be certified, by the manufacturer, in the installation of the pavement marking material prior to the start of the markings. The Contractor shall install the pavement marking material in accordance with the manufacturer’s published recommendations.

The manufacturer shall provide technical assistance as required to ensure successful installation of the markings. This shall include a representative on site for the start of the markings, training, product information, problem solving, etc.

Installation of the pavement markings shall be performed in a neat and workmanlike manner. The Contractor shall premark the pavement to ensure correct location of markings and such layout work shall be incidental to the price bid for the pavement marking items. The method for premarking should be as recommended by the manufacturer. A thin layer of paint as a premarking is not recommended. Particular care shall be taken to ensure that the leading edges of the markings are secured to the pavement.

General application rules:

The Air and surface temperature shall be a minimum of 40F.

The pavement must be clean and dry. 24 hours of dry weather where no rain is expected. When not placed by inlaid method a surface preparation adhesive shall be used.

Do not overlap tape - use butt splice.

Do not apply tape on longitudinal seams or joints or cracks.

Do not apply tape on deteriorating pavement surfaces.

Existing markings must be 80% removed.

After application, the markings shall be immediately ready for use by traffic.

Inlay into Fresh Bituminous Concrete:

When markings are specified in the contract for newly paved asphalt concrete surfaces, they shall be applied before public traffic is allowed on the freshly paved surface - the pavement markings shall be inlaid in the fresh surface during final rolling of the mat, in accordance with the manufacturer's recommendations unless otherwise directed by Engineer.

The Contractor shall show how the pavement mats will be placed to avoid applying the tape on longitudinal seams or joints or cracks and maintain correct marking location.

The Contractor shall employ a sufficient number of workers to premark the pavement and install the markings such that all markings are inlaid into the hot pavement prior to the finish rolling. No paving shall be permitted unless the striping crew and materials are on the project site.

- * General procedure for inlay application on fresh asphalt surfaces:
- * Tape is applied after the compaction roller and before the finish roller using minimum water, slow speed and no vibration.
- * Tape shall be applied using equipment recommended by manufacturer
- * Tamping shall be done by the finish roller and in the same direction the tape was applied. A separate roller of a size approved by the tape manufacturer may be required to meet the manufacturer's requirements.
- * Roller shall use minimum speed to prevent wrinkling the tape.
- * Asphalt temperatures shall be between 180 F (66 C) and 120 F (49 C) when tape is applied.

NOTE: Even though the tape will stand these high temperatures the contractor is to use caution to assure the asphalt is firm enough to walk on above 140 F (60 C).

Placement on new P.C. Concrete Pavement:

When markings are specified in the contract for new P.C. concrete pavement surfaces they shall be applied after the concrete has adequately cured as determined by the Engineer and prior to opening to traffic.

1. When a membrane curing compound has been applied to the concrete surface, it shall be removed by sandblasting prior to applying the markings. Cost for such sandblasting shall be incidental to the price bid for the pavement marking item. The road shall be cleaned by sweeping and with high pressure air.
2. The manufacturer shall specify a primer/solvent for the pavement surface.
3. The tape shall be applied with an approved applicator.
4. The tape shall be tamped with a roller tamper cart with a minimum 200 lb (90 kg) load or by slowly (2-3 mph [3-5 km/hr]) driving over the tape with a vehicle tire. Do not twist or turn on the tape. A minimum of three passes back and forth over the tape will be required. All edges of the tape shall be thoroughly tamped.

Placement on Existing Pavement:

When markings are specified in the contract for existing pavement, the pavement surface shall be free of any existing markings.

1. The road shall be cleaned by sweeping and with high pressure air.

Steps 2 through 4 are the same as for new P.C. C. pavement.

Method of Measurement:

This work will be measured for payment by the number of linear feet (meters) of line or square foot (meter) of symbol/legend of Retroreflective Preformed Patterned Markings installed on the pavement and accepted in accordance with the plans.

Basis of Payment:

This work will be paid for at the contract unit price bid per linear foot (meter) of line or square meter of symbol/legend as measured for item "Retroreflective Preformed Patterned Markings" of the type specified. This price shall include cleaning and preparing the pavement surface, furnishing and placing all materials, for all labor, tools, equipment, maintenance bond and incidentals necessary to complete the work.

WARRANTY

The Contractor shall warrant to the Department that the installed retroreflective preformed patterned pavement markings are free of defects, as hereafter defined, for one calendar year beginning at the initial acceptance of the marking installation by the Department. The initial acceptance of the marking installation will occur upon the satisfactory correction of all deficiencies noted in the marking installation during the Final Inspection of the project. The markings shall show no fading, lifting, shrinking, tearing, rollback, distortion or chipping due to vehicular traffic or normal maintenance activities including snow plowing. Although some wear is expected, the markings shall remain intact and serviceable (as defined below) for no less than 95% of the total item quantities in the first year of installation. The Contractor shall repair all defective areas identified by the Department after initial installation or during the Warranty Period. All repairs shall begin immediately following the notice to the Contractor unless weather limitations prevent the corrective work. Should the contractor not commence work within seventy-two hours, weather permitting, and pending severity, the Department reserves the right to remedy the condition and charge the contractor for the work. Any corrective work shall be as recommended by the manufacturer of the marking material and approved by the Department. The Department shall be given notification before the Contractor begins corrective work to allow for inspection of the operation. All costs associated with the repair work shall be the responsible of the contractor. These costs shall include, but are not limited to, removal, material, maintenance of traffic, etc.

Maintenance Bond:

Upon completion of the work, the Contractor shall submit to the Department a Maintenance Bond to insure the State of Delaware during the above Warranty periods. The Maintenance Bond shall meet the following requirements:

- a) A sum equal to 100% of the value of all Retroreflective Preformed Patterned Markings Items paid to the Contractor;
- b) All signatures are original signatures, in ink, and not mechanical reproductions or facsimiles of any kind;
- c) The Contractor is the named principle;
- d) The term of the bond is for one full year;
- e) The term of the Maintenance Bond will be for a period of one year beyond completion of Retroreflective Preformed Patterned Markings; and
- f) Written by a Surety or insurance company that is in good standing and currently licensed to write surety bonds in the State of Delaware by the Delaware Department of Insurance.

MANUFACTURER’S RESPONSIBILITY:

The following information is for use by DelDOT only. The Contractor will not be held responsible for the time frames listed in the chart below.

After satisfactory completion of the one-year warranty period, the contractor will be relieved of his responsibility and the Department shall work directly with the Manufacturer to guarantee the remainder of the warranty as specified below.

In addition, the pavement markings shall warrant the material to retain a minimum reflective value of 150 millicandelas per square foot (meter) per lux for the first year after initial acceptance.

- 1. All reflectance measurements shall be made on a clean, dry surface at a minimum temperature of 40 F (4C).
- 2. All reflectance measurements shall be made using a "LTL 2000" retroreflectometer.
- 3. One year from initial installation acceptance all pavement marking material shall meet the minimum retained coefficient of dry retroreflection value of 125 millicandelas per foot squared per foot-candle (in accordance with ASTM E1710), and meet the minimum retained coefficient of wet retroreflection value of 75 millicandelas per foot squared per foot-candle (in accordance with ASTM E2177) for the following Warranty Periods.

Warranty Periods		
Application	Dry Retroreflectivity Warranty Period	Wet Retroreflectivity Warranty Period
Longitudinal Markings	4 years	2 years
Symbols and Legends	2 years	1 year

03/04/2011

748530 - REMOVAL OF PAVEMENT STRIPING

Description:

This work consists of removing pavement markings of all kinds including paint, tape, etc., in accordance with this special provision, notes on Plans and/or as directed by the Engineer. The Contractor shall coordinate with the Engineer for maintaining traffic during the operation, prior to starting the work.

Materials and Construction Methods:

Paint and Epoxy Resins:

Shot/abrasive grit blasting or water blasting equipment shall be used for removal of markings from pavement surfaces.

Alkyd Thermoplastic:

In addition to the removal techniques discussed for paint and epoxy, grinding (erasing machines) equipment may also be used for removal of markings from pavement surfaces.

The removal operation shall be performed in a manner that will not damage the pavement surface.

The Contractor shall collect and dispose of all shot/abrasive grit and pavement marking materials removed from the pavement surface. Washing or sweeping such material to the roadside will not be permitted.

After removal of striping on bituminous concrete asphalt sealer shall be used to cover any exposed aggregate or embedded paint at no additional cost.

Method of Measurement:

The quantity of pavement striping removal will be measured as the number of square feet (meters) of pavement striping removed and accepted. The area of lines will be calculated by multiplying the nominal width of line times the length and the area of symbols will be as specified in Subsection 748.10 of the Standard Specifications.

Basis of Payment:

The quantity of pavement striping removal will be paid for at the Contract unit price per square foot (meter) for "Removal of Pavement Striping". Price and payment shall be full compensation for furnishing all materials, removing the pavement markings, disposing of the removed marking material, covering up the exposed aggregate, and for all labor, equipment, tools and incidentals necessary to complete the work.

Note:

There will be no measurement and payment for removal of pavement markings placed incorrectly by the Contractor.

5/21/2013

- 748541 - PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT MARKINGS,
4"
- 748542 - PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT MARKINGS,
6"
- 748543 - PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT MARKINGS,
8"
- 748544 - PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT MARKINGS,
12"
- 748545 - PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT MARKINGS,
16"
- 748546 - PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT MARKINGS,
SYMBOL/LEGEND
- 748553 - PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT MARKINGS,
BIKE SYMBOL
- 748554 - PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT MARKINGS,
PEDESTRIAN SYMBOL
- 748555 - PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT MARKINGS,
HANDICAP SYMBOL

Description:

This work consists of furnishing and installing preformed retroreflective thermoplastic pavement marking with a preapplied Federal Specification Type IV glass bead coating throughout its entire cross section on bituminous asphalt pavement at the locations and in accordance with the patterns on the Plans, or as directed by the Engineer.

The preformed retroreflective markings shall conform to the size and dimensions as shown in the Federal "Standard Highway Signs" book found at: <http://mutcd.fhwa.dot.gov/SHSe/pavement.pdf> as referred to in the Delaware Manual on Uniform Traffic Control Devices, Part 3, Markings.

Materials:

General: Only materials listed on the Department's Approved Pavement Markings Material List will be used for this item. The preformed retroreflective markings shall be fusible to bituminous asphalt pavement by means of the normal heat of a propane type of torch. Adhesives, primers or sealers are not necessary prior to the preformed retroreflective markings application on bituminous asphalt pavement.

The preformed retroreflective markings shall conform to pavement contours, breaks and faults through the action of traffic at normal pavement temperatures. The markings shall have resealing characteristics and be capable of fusing to itself and previously applied worn hydrocarbon and/or alkyl thermoplastic pavement markings.

The preformed retroreflective markings shall be capable of application on bituminous asphalt pavement wearing courses during the paving operation in accordance with the manufacturer's instructions. After application the markings shall be immediately ready for traffic. The preformed retroreflective markings shall be suitable for use for one year after the date of receipt when stored in accordance with the manufacturer's recommendations.

The preformed retroreflective thermoplastic markings shall not be brittle and must be sufficiently cohesive and flexible at temperatures exceeding 50°F (10°C) for one person to carry without the danger of fracturing the material prior to application.

Composition: The retroreflective pliant rosin ester thermoplastic pavement markings shall consist of a homogeneous mixture of high quality polymeric thermoplastic binders, pigments, fillers and glass beads. The thermoplastic material must conform to AASHTO M249-79(86) with the exception of the relevant differences due to the material being preformed, and identified herein.

Intermix Glass Beads: The preformed retroreflective material shall contain a minimum of 30% glass spheres which shall conform to AASHTO M247-81 Type 1. Glass spheres shall have a minimum of 80% true spheres overall.

Top Beads: To provide the required retroreflectivity, the preapplied factory top coating of glass beads shall be a combination of both Federal Spec. Type IV and AASHTO M247-81 Type I beads. Federal Spec. Type IV beads shall be evenly disbursed across the entire surface of the product at a minimum rate of 4 lb. (1.8 kg) per 100 ft² (9.3 m²) and the AASHTO at 3 lb.(1.4 kg) per 100 ft² (9.3 m²). In combination, the total glass bead coverage shall be 7-8 lb. (3.2-3.6 kg) per 100 ft² (9.3 m²). The AASHTO M247-81 Type I beads shall have a minimum of 80% true spheres overall and the Federal Spec. Type IV beads shall be 80% true spheres on the 12 and 14 sieves and shall be no less than 75% true spheres on the remaining sieves.

Retroreflectivity: After satisfactory completion of all striping work and written notification from the contractor, the Department shall test the striping to ensure it has the minimum reflectivity. The testing will be completed within 30 calendar days from notification. Testing will be done using a Delta LTL 2000 Retrometer (30 meter geometry). The required minimum initial reflectivity reading in millicandellas shall be:

White 300
Yellow 200
Blue 200

Skid Resistance: The surface of the preformed retroreflective thermoplastic markings shall provide a pre-applied minimum skid resistance value of 45-51 BPN and a post-applied minimum skid resistance value of 45-55 BPN when tested according to ASTM E303-74.

Thickness: The thickness of the supplied material shall have a minimum average thickness of .090" (90 mils) for all Longitudinal lines and a thickness of .125" (125 mils) for all transverse lines and symbols/legends.

Tensile Strength and Elongation: The preformed retroreflective thermoplastic material shall have a minimum tensile strength of 150 lb. per square inch (1054 kg per square mm) of cross section, at .002" (2.28 mil) thickness, when tested according to ASTM D638-76 except that a sample 6" by 1" (150 mm by 25 mm) shall be tested at a temperature between 70°F and 80°F (21°C and 27°C) using a jaw speed of 10" to 12" (250 mm to 300 mm) per minute. The sample shall have a maximum elongation of 20% at break when tested by this method.

Flexibility: The preformed retroreflective thermoplastic marking material shall have flexibility at 50°F such that when a 1" by 6" (25 mm by 150 mm) sample is bent through an arc of 90 degrees at a uniform rate in 10 seconds (9 degrees per second) over a 1" (25 mm) mandrel, no cracking occurs in the test sample. The sample must be conditioned prior to testing at 50°F±2 degrees (10°C) for a minimum of four hours. At least two specimens tested must meet the flexibility requirements at 50°F (10°C) for a passing result.

Environmental Resistance: The applied markings shall be resistance to deterioration due to exposure to sunlight, water, oil, diesel fuels, gasoline, pavement oil content, salt and adverse weather conditions.

Effective Performance Life: When properly applied, in accordance with manufacturer's instructions, the preformed retroreflective pavement markings shall be neat and durable. The markings shall remain skid resistant and show no lifting, shrinkage, tearing, roll back or other signs of poor adhesion for a period of one winter season.

Oil/grease Resistant Test: The preformed retroreflective thermoplastic material shall not dissolve or smear after rubbing a small amount of motor oil on a small piece of the thermoplastic material for two minutes.

Bond Strength: The material shall exhibit a bond strength to Portland Cement Concrete (PCC) equal or exceed 180 psi when tested at room temperature (73.4±3°F) (23°C) in accordance to ASTM Standard Test Method for Bond Strength of thermoplastic marking Material D4796-88. Place a coarse brick in a 400°F (204°C) oven for 5 minutes. Prepare a 4 square inch test specimen. Place the test specimen on the brick and further heat in the 400°F (204°C) oven for 15 minutes. The test specimen is then allowed to cool to room temperature and prepared for testing.

Low Temperature Cracking (Stress) Resistance for Extended Period: The material shall be tested according to AASHTO T250 Section 7 with Section 7.2.3 modified for and extended cold temperature 15 degrees $\pm 3^{\circ}\text{F}$ ($-9.4 \pm 2^{\circ}\text{C}$) exposure period 72 hours. Any cracking shall constitute failure of the material for PCC road surfaces.

Impact Resistance (Gardner Falling Weight): A 2" by 7.5" (50 by 190 mm) specimen shall be applied on a course concrete brick. Using a Gardner Impact Tester, a 2 lb (.91 kg) weight is dropped from a height of 80" (2032 mm). The specimen when tested at room temperature $73.4 \pm 3^{\circ}\text{F}$ (23°C) should show no sign of cracking. (Test procedure is in accordance with ASTM D5420-93).

Packaging: The flexible preformed retroreflective thermoplastic marking materials, for use as transverse or longitudinal markings as well as legends, arrows and symbols shall be available in flat form material or in rolls. Flat material shall be supplied in maximum of 4' (1.2 m) lengths up to 2' (.6 m) in width. The material shall be packed in suitable cartons clearly labeled for ease of identifying the contents.

Construction Methods:

The markings shall be applied in strict accordance with the manufacturer's recommendations on clean and dry surfaces. Marking configurations shall be in accordance with the "Delaware Manual on Uniform Traffic Control Devices, Part 3, Markings."

The preformed retroreflective thermoplastic material shall be fusible to the pavement by means of a propane torch recommended by the manufacturer. Preheating the surface to remove any latent moisture will be done just prior to the placement and installation of the Symbol/ Legend. No markings shall be placed when the ambient temperature is below 40°F (4°C). The material shall be kept in a location above 55°F (13°C) until just before application. The supplier shall provide technical services as may be required.

Method of Measurement:

The quantity of pavement striping (748541-748545) will be measured by the number of linear feet (linear meters) of 4", 6", 8", 12", or 16" pavement striping line placed and accepted. The quantity of symbol/ legend (748546) will be measured by the number of square feet (meters) of symbol/legend placed and accepted. The quantity of bike symbol, pedestrian symbol, and handicap symbol (748551-748553) will be measured as each placed and accepted. The dimensions for the symbol/legends are as follows:

Bike Rider with Helmet and Arrow shall be 3' X 5'.

Pedestrian shall be 4' X 8'.

Handicap Symbol shall be 40" X 40".

Basis of Payment:

The quantity of pavement striping payment will be paid for at the Contract unit price per linear foot (linear meter) for 4", 6", 8", 12" and 16" (100 mm, 150 mm, 200 mm, 300 mm, and 400 mm) line. The quantity of symbol/legend will be paid for at the Contract unit price per square foot (meter). The quantity of bike symbol, pedestrian symbol, and handicap symbol will be paid for at the Contract unit price per each. Price and payment shall include cleaning and preparing the pavement surface, and placing all materials, for all labor, tools, equipment and incidentals necessary to complete the work.

Warranty:

The Contractor shall warrant to the Department that the installed retroreflective preformed thermoplastic pavement markings are free of defects, as hereafter defined, for a period of one winter season beginning at the initial acceptance of the marking installation by the Department. The initial acceptance of the marking installation will occur upon the satisfactory correction of all deficiencies noted in the marking installation during the Final Inspection of the project. The markings shall be warranted against failure due to blistering, excessive cracking, bleeding, staining, discoloration, oil content of the pavement materials, smearing and spreading under heat, deterioration due to contact with grease deposits, oil, diesel fuel, or gasoline drippings, chipping, spalling, poor adhesion to the pavement materials, vehicular damage, and wear from normal maintenance activities including snow plowing.

The Contractor shall repair all defective areas identified by the Department after initial installation or during the Warranty Period. All repairs shall begin immediately following the notice to the Contractor by the Department unless weather limitations prevent the corrective work. Should the contractor not commence work within the period stated in the notice, weather permitting, and pending severity, the Department reserves the right to remedy the condition and charge the contractor for the work. Any corrective work shall be as recommended by the manufacturer of the marking material and approved by the Department. The Department shall be given notification before the Contractor begins corrective work to allow for inspection of the operation. All costs associated with the repair work shall be the responsibility of the contractor. These costs shall include, but are not limited to, removal, material, maintenance of traffic, etc.

2/28/09

749687 - INSTALLATION OR REMOVAL OF TRAFFIC SIGN ON SINGLE SIGN POST

Description:

This work consists of installing or removing traffic sign(s) on a single post or other type of pole at the locations indicated on the Plans or as directed by the Engineer. This specification also includes installation of posts in boring holes constructed under other items.

A single sign totaling more than 9 square feet, or with any dimension, length or width, greater than or equal to 48 inches shall be installed on multiple sign posts under Item 749690 - Installation or Removal of Traffic Sign on Multiple Sign Posts.

Materials:

The Department will provide all sign materials to be used on this project. The Contractor shall contact the DelDOT Sign Shop Supervisor with project plans and quantity sheets at 302-760-2581. Sign fabrication orders require a minimum of four (4) weeks for completion. Orders placed with less than 4 weeks lead-time will result in a delay. Any delay caused by inadequate lead-time due to a late order will be the sole responsibility of the Contractor. The Contractor shall pick-up the sign materials from the DelDOT Sign Shop and deliver them to the job site without any damage to the sign materials.

Construction Methods:

The Contractor shall pick-up necessary signs, sign posts, hardware, and extensions from the Department and install the signs in the locations indicated on the Plans in accordance with the Delaware MUTCD or as directed by the Engineer. The Contractor shall be responsible for obtaining all necessary utility clearances before the signs may be installed. Signs and plaques shall be mounted no lower than the minimum mounting height specified in the Delaware MUTCD. Signs and plaques shall be mounted no higher than one foot above the minimum mounting height specified in the Delaware MUTCD. Any excess sign post protruding above the top of the top sign shall be cut off and removed. For sign removals, the sign posts shall have all nuts, bolts, and other connectors removed. The disturbed ground shall be graded and backfilled accordingly. The Contractor is responsible for disposal of all signing material removed from the project

Method of Measurement:

The number of single sign installations or removals will be measured as the actual number of signs installed or removed and accepted.

Basis of Payment:

The quantity of single sign post installations or removals will be paid for at the Contract unit price per each. Price and payment will constitute full compensation for installing or removing signs and sign materials, pick-up and delivery of sign materials, grading disturbed areas, and for all labor, equipment, tools, and incidentals required to complete the work. Signs that are not installed in accordance with the Delaware MUTCD or signs installed in the incorrect location shall be moved at no additional cost to the Department.

5/28/2013

749688 - INSTALLATION OF 4" DIAMETER HOLE, LESS THAN OR EQUAL TO 6" IN DEPTH

749689 - INSTALLATION OF 4" DIAMETER HOLE, GREATER THAN 6" IN DEPTH

Description:

This work consists of boring a hole 4" in diameter averaging 6" in depth into bituminous concrete or P.C.C. surfaces for installing single or multiple sign posts at the locations indicated on the Plans or as directed by an Engineer.

Materials:

The Contractor shall provide the equipment necessary to bore a 4" hole into paved surfaces, while maintaining the stability of the surrounding paved or P.C.C. surfaces. The depth of the bored hole shall be to the top of the subbase material.

Construction Methods:

The holes shall be bored into pavement or P.C.C. islands, medians, or sidewalk using a mechanical hole borer for such work or other methods approved by the Engineer. The hole shall be 4" in diameter. Holes bigger or smaller than 4" shall be corrected at the Contractor's expense.

Method of Measurement:

The number of 4" holes in diameter bored will be measured as the actual number of holes bored and accepted.

Basis of Payment:

The quantity of holes bored as required above will be paid for at the Contract unit price per each. Price and payment will constitute full compensation for boring holes at the required depth, and for all labor, equipment, tools, and incidentals required to complete the work.

Note:

The cost for installing holes and PVC sleeves for sign posts in newly constructed P.C.C. islands, medians, or sidewalks shall be incidental to the P.C.C. item.

3/23/09

749690 - INSTALLATION OR REMOVAL OF TRAFFIC SIGN ON MULTIPLE SIGN POSTS

Description:

This work consists of installing or removing traffic sign(s) on multiple sign posts at the locations indicated on the Plans or as directed by the Engineer. This specification also includes installation of posts in holes installed under other items.

A single sign totaling more than 9 square feet, or with any dimension, length or width, greater than 48 inches shall be mounted on two (2) posts. Signs with a length greater than or equal to 78 inches shall be mounted on three (3) sign posts.

Materials:

The Department will provide all sign materials to be used on this project. The Contractor shall contact the DelDOT Sign Shop Supervisor with project plans and quantity sheets at 302-760-2581. Sign fabrication orders require a minimum of four (4) weeks for completion. Orders placed with less than 4 weeks lead-time will result in a delay. Any delay caused by inadequate lead-time due to a late order will be the sole responsibility of the Contractor. The Contractor shall pick-up the sign materials from the DelDOT Sign Shop and deliver them to the job site without any damage to the sign materials.

Construction Methods:

The Contractor shall pick-up necessary signs, sign posts, hardware, and extensions from the Department and install the signs in the locations indicated on the Plans in accordance with the Delaware MUTCD or as directed by the Engineer. The Contractor shall be responsible for obtaining all necessary utility clearances before the signs may be installed. Signs and plaques shall be mounted no lower than the minimum mounting height specified in the Delaware MUTCD. Signs and plaques shall be mounted no higher than one foot above the minimum mounting height specified in the Delaware MUTCD. Any excess sign post protruding above the top of the top sign shall be cut off and removed. For sign removals, the sign posts shall have all nuts, bolts, and other connectors removed. For sign removals, the sign posts shall have all nuts, bolts, and other connectors removed. The disturbed ground shall be graded and backfilled accordingly. The Contractor is responsible for disposal of all signing material removed from the project..

Method of Measurement:

The number of sign installations or removals will be measured as the total square foot of the sign(s) installed or removed and accepted.

Basis of Payment:

The quantity of sign installations or removals will be paid for at the Contract unit price per square foot. Price and Payment will constitute full compensation for installing or removing signs and sign materials, pick-up and delivery of sign materials, grading disturbed areas, and for all labor, equipment, tools, and incidentals required to complete the work. Signs that are not installed accordance with the Delaware MUTCD or signs installed in the incorrect location shall be moved at no additional cost to the Department.

5/28/2013

760507 - PROFILE MILLING, BITUMINOUS CONCRETE
760508 - PROFILE MILLING, CONCRETE

Description:

This work consists of furnishing a pavement-milling machine or cold planer and planing the existing bituminous concrete pavement or P.C.C. Pavement at the locations and to the nominal depths shown on the Plans and/or as directed by the Engineer to obtain a smooth profile on the existing roadway surface. Unless otherwise noted on the Plans or specifications the Contractor shall reuse, salvage and/or dispose of the milled material.

Equipment:

The milling equipment shall be a commercially designed and manufactured milling machine capable of performing the work in a manner satisfactory to the Engineer. The machine shall be power-operated and self-propelled, shall have sufficient power, traction and stability to remove a thickness of material to a specified depth. In addition, the machine must accurately and automatically establish profile grades by referencing the existing pavement surface. This shall be accomplished by means of 1.) a ski of 30 (9 m) minimum length with an accuracy of ± 0.125 in 30 (3 mm in 9 m) or 2.) a minimum of three (3) ultra sonic, non-ground contacting sensors with an accuracy of ± 0.100 in 25 (2.5 mm in 7.5 m). If noted on the Plans, a profile grade shall be established independent of the existing pavement surface. In such case the machine shall be capable of following the independent grade line (e.g. string line). The machine shall have an automatic system for controlling grade elevation and cross slope. The machine shall also be equipped with a means to effectively control dust generated by the cutting operation.

Construction Methods:

The surface resulting from the planing operation shall be in accordance with notes and details on the Plans and shall be characterized by uniform, discontinuous longitudinal striations and shall not be gouged or torn. Imperfections exceeding 5/16" (8 mm) at any point along the surface as a result of missing teeth or faulty operation shall be removed by approved methods.

Before opening the milled surface to traffic, all loose material shall be removed from the surface with a power vacuum sweeper.

Whenever the milling operation causes water to pond or lay within the wheelpaths of the roadway the Contractor shall alleviate this problem by cutting bleeders into the shoulder or median to provide positive drainage. Cost for such work will be incidental to this item.

If the road is to remain open to traffic, longitudinal vertical drop-offs in excess of 2" (50 mm) at lane lines or at the centerline shall not be left overnight.

Transverse faces at the beginning and end of the milling operation existing at the end of a work period shall be tapered 20:1 or flatter in a manner approved by the Engineer to avoid a hazard for traffic.

Surface material that cannot be removed by cold planing equipment because of physical or geometrical restraints shall be removed by other methods acceptable to the Engineer.

If independent grade reference is required, it shall be designated in the Plans and/or Contract documents and elevations shall be provided by the Plans or at the direction of the Engineer.

If a severe bump exist in the pavement surface extra effort shall be taken at these locations to improve the profile. Manual changes to the cutter head may be needed at these locations to achieve this. It is the intent to remove bumps and irregularities in the pavement and produce a smooth milled surface for hot-mix resurfacing.

If the existing bituminous surface is over concrete the intent is to remove all of the existing bituminous material to the top of the concrete surface unless otherwise directed by the Plans or the Engineer. If milling to remove open graded hot mix, the milling operation must remove all of the open graded hot mix from the roadway surface.

Method of Measurement:

The quantity of pavement milling will be measured as the number of square yards per inch (square meters per 25 mm) of depth as shown on the Plans or established by the Engineer. The nominal depth shown on the Plans and initially set on the milling machine, even though it will vary automatically during profiling, will be the depth measured and paid.

Basis of Payment:

The quantity of pavement milling will be paid for at the Contract unit price per square yard per inch (square meter per 25 mm) of depth. Price and payment will constitute full compensation for furnishing an accepted pavement-milling machine and operator, for removal and disposal of the milled material or delivery to a designated site, for transporting equipment, for all labor, tools equipment and incidentals necessary to complete the item.

10/25/13

763621 - CONSTRUCTION ENGINEERING, REHABILITATION

Description:

Collect survey information and provide layout as described in this provision and as noted on the Plans. Assume full responsibility for any errors and/or omissions in the work of all engineering staff employed.

Provide and have available for the project adequate engineering staff that is:

1. Competent and experienced to set lines and grades needed to construct the project;
2. Able to perform the work to the scope and magnitude outlined herein.

Construction Engineering functions and requirements:

1. Provide all necessary surveying equipment required for all engineering work on the project.
 - a. Check all equipment/instruments prior to use on the project.
 - b. Immediately replace or recalibrate equipment found to be out of adjustment or inadequate to perform its function to the satisfaction of the Engineer.
2. Perform all computations necessary to establish the exact position of the work from control points and preserve.
 - a. Maintain adequate workbooks of all computations survey notes and other records.
 - b. Make available to the Department, neat and legible, all computations, survey notes and other records necessary to accomplish the work.
3. Preliminary topographic survey for all proposed curb ramps locations identified in the Plans and the layout of grade information provided by the Engineer for curb ramp construction;
4. Obtain topographic information a minimum of 25' in each direction from the back of curb where the curb ramp is proposed;
 - a. Grades for the edge of pavement, gutter line (if applicable), top of curb, front and back edge of sidewalk, existing obstructions such as utility poles, junction wells, traffic poles and cabinets, manholes, valves, fire hydrants, drainage inlets, steps, retaining walls, building faces or other obstructions that are directly adjacent or within the proposed curb ramp limits.
 - b. Collect data in a format that is compatible with DelDOT Design Standards and submit to the Engineer for evaluation curb ramps that are located in areas with multiple obstructions, limited area, or other unique characteristics that require more detailed layout. The Engineer will provide the final grades for construction of these curb ramps.
5. Establish necessary grades to ensure all proposed curb ramps, roadways or ditches, installation of drainage structures, or other items of work as determined by the Engineer, have positive drainage;

Note:

Professional services performed under this item by individuals/firms other than the Contractor are not subject to the subcontracting requirements of Subsection 108.01 of the Standard Specifications.

Method of Measurement:

The quantity of Construction Engineering - Rehabilitation will be measured as the actual number of hours the Contractor's survey crew is in the field actively engaged in Construction Engineering – Rehabilitation Work.

Basis of Payment:

The quantity of Construction Engineering – Rehabilitation will be paid for at the Contract unit price per hour. Price and payment constitutes full compensation for furnishing all labor, equipment, instruments, stakes, and other material necessary to satisfactorily complete the work as herein described under this item.

7/10/2012

763643 - MAINTENANCE OF TRAFFIC – ALL INCLUSIVE

Description:

This item shall consist of furnishing, installing, maintaining and/or relocating the necessary temporary traffic control devices used to maintain vehicular, bicycle and pedestrian traffic, including persons with disabilities in accordance with the Americans with Disabilities Act, as amended. All work shall be performed in a manner that will provide reasonably safe passage with the least practicable obstruction to all users, including vehicular, bicycle and pedestrian traffic.

All requirements of the Delaware Manual on Uniform Traffic Control Devices (MUTCD), Part 6, herein referred to as the Delaware MUTCD. (latest edition with all revisions made up to the date of Advertisement of this project) shall apply for all temporary traffic control devices. Any, and all, control, direction, management and maintenance of traffic shall be performed in accordance with the requirements of the Delaware MUTCD, notes on the Plans, this specification, and as directed by the Engineer.

The Contractor shall be aware that the Case Diagrams and safety measures outlined in the Delaware MUTCD are for common construction situations and modifications may be warranted based on the complexity of the job. The Contractor shall submit justification for modifications to the Temporary Traffic Control Plan (TTCP) to the Engineer for approval prior to implementation.

The Department reserves the right to impose additional restrictions, as needed, for the operational movement and safety of the traveling public. The Department reserves the right to suspend the Contractor's operations until compliance with the Engineer's directive for remedial action, based on but not limited to the following reasons:

1. The Contractor's operations are not in compliance with the Delaware MUTCD, the specifications or the Plans.
2. The Contractor's operations have been deemed unsafe by the Traffic Safety Engineer or District Safety Officer.

Materials and Construction Methods:

The Contractor shall submit a Temporary Traffic Control Plan (TTCP) or a Letter of Intent to use the Plan recommended Delaware MUTCD Case Diagram(s) at or prior to the pre-construction meeting. The Contractor shall submit the TTCP for all Contractor and subcontractor work to be performed on the project for the Department's approval before the start of work.

When specified by a note in the Plans, the Contractor shall be required to have an American Traffic Safety Services Association (ATSSA) certified Traffic Control Supervisor on the project. The authorized designee must be assigned adequate authority, by the Contractor, to ensure compliance with the requirements of the Delaware MUTCD and provide remedial action when deemed necessary by the Traffic Safety Engineer or the District Safety Officer. The ATSSA certified Traffic Control Supervisor's sole responsibility shall be the maintenance of traffic throughout the project. This responsibility shall include, but is not limited to, the installation, operations, maintenance and service of temporary traffic control devices. Also required is the daily maintenance of a log to record maintenance of traffic activities, i.e., number and location of temporary traffic control devices; and times of installation, changes and repairs to temporary traffic control devices. The ATSSA Traffic Control Supervisor shall serve as the liaison with the Engineer concerning the Contractor's maintenance of traffic. The name, contact number and certification for the designated Traffic Control Supervisor shall be submitted at or prior to the pre-construction meeting. The cost of the ATSSA certified Traffic Control Supervisor shall be incidental to this item.

Temporary traffic control devices shall be maintained in good condition in accordance with the brochure entitled "Quality Guidelines for Temporary Traffic Control Devices", published by the American Traffic Safety Services Association (ATSSA). Any temporary traffic control devices that do not meet the quality guidelines shall be removed and replaced with acceptable devices. Failure to comply will result in work stoppage with time charges continuing to be assessed.

Any existing signs that conflict with any temporary or permanent construction signs shall be covered as needed or as directed by the Engineer. The cost for temporarily covering conflicting signs shall be incidental to this item.

Access to all transit stops located within the project limits shall be maintained unless otherwise directed by the Plans or the Engineer. Maintaining access shall include maintaining an area for the transit vehicle and also an accessible path for pedestrians to safely access the transit stop.

The Contractor shall notify the Engineer, in writing, no less than fourteen (14) calendar days prior to the start of any detour(s) and road closures. The Engineer will notify the following entities:

- Local 911 Center
- Local School Districts
- Local Post Offices
- DelDOT's Transportation Management Center (TMC)
- Town Managers
- Local Police
- DelDOT's Public Relations
- Delaware Transit Corporation (DTC)

Immediately prior to the implementation of any lane or road closures, the Engineer shall notify the DelDOT TMC at (302) 659-4600. Notifications shall also be provided when the closures are lifted. The Engineer shall notify TMC and the District Safety Officer if any lane closures cannot be removed prior to the end of the allowable work hours.

The Contractor shall notify the local 911 center if access to a fire hydrant is temporarily restricted. The Contractor shall provide written confirmation to the Engineer that the local 911 center has been notified.

If a detour is required during any part or the entire period of this Contract, an approved detour plan shall be obtained from the Department's Traffic Safety Section. All signs, barricades and other temporary traffic control devices required as part of the approved detour plan shall be installed and maintained by the Contractor on the route that is closed and on the detour route. Road closures without an approved detour plan shall not be allowed. If a road is closed without an approved detour plan, the Contractor's operations shall be stopped immediately.

The Contractor shall provide and maintain ingress and egress for each property abutting the construction area and each property located between the diversion points of any detour and the actual construction site. Construction activities which may temporarily or otherwise interfere with property access shall be coordinated in advance with the affected property owners.

The Contractor shall conduct construction operations in a manner which will minimize delays to traffic, and shall meet the following requirements:

1. If work is being performed within 200 feet in any direction of an intersection that is controlled by a traffic signal, the flagger(s) shall direct the flow of traffic in concert with the traffic signals in construction areas to avoid queuing, unless active work prohibits such action. The flagger shall direct traffic to prevent traffic from queuing through an intersection (i.e., blocking an intersection). Only a Traffic Officer may direct traffic against the operation of a traffic signal and only until the operation occurring within the intersection is completed.
2. When a lane adjacent to an open lane is closed to travel, the temporary traffic control devices shall be set 2 feet (0.61 m) into the closed lane from the edge of the open lane, unless an uncured patch exists or actual work is being performed closer to the open lane with minimum restriction to traffic.
3. Except for "buffer lanes" on high volume and/or high speed roadways, lanes shall not be closed unless construction activity requiring lane closure is taking place, or will take place within the next hour. Lanes shall be reopened immediately upon completion of the work. Moving operations will require the lane closures be shortened as the work progresses and as traffic conditions warrant to minimize the length of the closure. The Contractor shall conduct construction operations in a manner so as to minimize disruption to traffic during peak hours and periods of heavy flow. The

Department reserves the right to stop or change the Contractor's operations, if in the opinion of the Engineer, such operations are unnecessary at that time or the operations are unnecessarily impeding traffic.

4. Work in the vicinity of traffic signals, shall be scheduled to minimize the time during which the signal is operated without detectors, and prior approval from the Engineer shall be required. TMC shall be notified in advance of cutting a loop detector, and be immediately notified once the loop detector has been reinstalled. The Contractor shall provide sufficient advance notice of the loop detector work with the Engineer to ensure the aforementioned requirements are met.

It is required that all temporary traffic control work and related items shall either be performed entirely by the Contractor's own organization, or totally subcontracted. Maintenance of equipment shall not be subject to this requirement.

Any deficiencies related to temporary traffic control that are reported to the Contractor in writing shall be corrected within 24 hours or as directed by the Engineer. Failure to comply will result in non-payment for those devices that are found to be deficient for the duration of the deficiency. Serious deficiencies that are not corrected immediately shall result in suspension of work until items identified are brought back into compliance.

At the end of each day's work, the Contractor shall correct all pavement edge drop-offs in accordance with Table 6G-1 in the Delaware MUTCD. This corrective work shall be accomplished with Temporary Roadway Material (TRM) unless an alternate method is specified in the Plans. All ruts and potholes shall be filled with TRM as soon as possible but no later than the end of each work day. Placement and Payment of TRM shall be completed in accordance with Section 402 of the Standard Specifications. If temporary elimination of a drop-off hazard cannot be accomplished, then the area should be properly marked and protected with temporary traffic control devices such as temporary barricades, warning signs, flashing lights, etc. as required by Section 6G.21 of the Delaware MUTCD.

All open trench excavation accessible by vehicular traffic must be backfilled prior to the end of each working day. Steel plates shall not be used except in emergency situations and only with prior written approval from the Engineer unless otherwise directed by the Plans.

The Contractor shall submit, at or prior to the preconstruction meeting, detailed drawings including but not limited to existing striping lengths, lane and shoulder widths, turn lane lengths, locations of stop bars, turn arrows, crosswalks and railroad crossings. The drawings shall depict the existing pavement markings for each project location. These drawings will be reviewed by the Department's Traffic Section to determine the need for modification(s) for compliance with the Delaware MUTCD. Temporary pavement markings, on the final pavement surface, shall match the Plan dimensions and layout or the approved drawings of the permanent markings in compliance with Section 3 of the Delaware MUTCD. All conflicting or errant striping shall be removed as directed by the Engineer in compliance with the specifications for Item 748530 (Removal of Pavement Striping).

At the end of each day's operation and before traffic is returned to unrestricted roadway use, temporary striping shall be utilized when the existing pavement is milled and hot mix will not be placed the same day or more than a single course of hot mix is to be placed or permanent roadway striping cannot be placed on the same day as the placement of the final course of hot mix. Placement of temporary striping shall receive prior approval from the Engineer and the contractor shall apply temporary pavement markings in accordance with the requirements of Section 748 of Delaware Standard specifications and the Delaware MUTCD. Payment for temporary pavement striping shall be made at the unit price bid for item 748 - Temporary Striping. Payment for final striping will be included in the applicable striping item.

The Contractor shall have temporary striping/delineating materials (such as raised markers, tape, and other approved materials) available at the job site for verification by the Department prior to starting the hot-mix paving operation on roads to be immediately opened to traffic. These materials shall be used by the Contractor for temporary markings if he/she fails to apply temporary marking paint, etc., as required by the Delaware MUTCD. No paving operations on roads to be immediately opened to traffic will be allowed unless such verification has been made for the availability of the materials at the job site.

Travel lane and ramp closings on multilane highways and Interstates shall not be permitted during the following holiday periods:

- December 24 through December 27 (Christmas Day)
- December 31 through January 3 (New Years Day)
- Friday prior to Easter through Easter Sunday
- Thursday prior to Memorial Day through the Tuesday following Memorial Day
- Dover International Speedway Race Weekends (Thursday prior to the race event through the day after the race event)
- July 3 through July 5 (Independence Day)
- Thursday prior to Labor Day through the Tuesday following Labor Day
- Wednesday prior to Thanksgiving Day through the Monday following Thanksgiving Day

Additional time restrictions may apply as noted in the project plans or as directed by the Engineer. Any requests to waive any restrictions must be made in writing to the Engineer for review and approval. A copy of the request shall be provided to the District Safety Officer for review.

Certification:

Temporary traffic control devices used on all highways open to the public in this State shall conform to the Delaware MUTCD. All devices shall be crashworthy in accordance with the National Cooperative Highway Research Program (NCHRP) Report 350, the memorandum issued August 28, 1998 by The USDOT Federal Highway Administration, and/or in accordance with the latest edition of the Manual for Assessing Safety Hardware (MASH), published by the American Association of State Highway and Transportation Officials (AASHTO).

The Contractor shall submit certification for temporary traffic control devices or vendors used specifically on this project at or prior to the pre-construction meeting.

Certification of compliance with NCHRP report 350 and/or MASH is required for the following categories of temporary traffic control devices:

Category I contains small and lightweight channelizing and delineating control devices which includes cones, tubular markers, flexible delineator post and drums, all without any accessories or attachments.

Category II includes temporary traffic control devices that are not expected to produce significant vehicular velocity changes to impacting vehicles. These devices which shall weigh 45 kg or less, include Type I, II and III barricades, portable sign supports with signs, and intrusion alarms. Also included are drums, cones, and vertical panels with accessories or attachments.

Category III includes temporary traffic control devices that are expected to cause significant vehicular velocity changes to impacting vehicles. These devices which weigh more than 45 kg include temporary barrier, temporary impact attenuators, and truck-mounted attenuators.

Category IV includes portable or trailer-mounted devices such as arrow panels, variable message signs, temporary traffic signals and temporary area lighting.

For Category I devices, the manufacturer or Contractor may self-certify that the devices meet the NCHRP-350 and/or MASH criteria. The Contractor shall supply the Federal Highway Administration's NCHRP-350 and/or MASH acceptance letter for each type of device that falls under Category II and III devices.

Basis of Payment:

Payment will be made at the Lump Sum price for "Maintenance of Traffic", for which price and payment constitutes full compensation for all maintenance of traffic activities accepted by the Engineer, which shall include the cost of furnishing and relocating permanent and temporary traffic control signs, traffic cones or drums, submission of temporary traffic control plan(s), submission of existing pavement marking drawings, submission of all required certifications, labor, equipment and incidentals necessary to complete the item. Payment to furnish and maintain other temporary traffic control devices including but not limited to Portable P.C.C. Safety Barrier, Truck Mounted Attenuators, Portable Changeable Message Signs, Arrow Panels and Portable Light Assemblies will be made at the contract unit price for each item.

NOTE

If the Contractor does not complete the Contract work within the Contract completion time (including approved extension time), the Contractor shall be responsible for providing the necessary temporary traffic control devices that are required to complete any remaining work. The costs of such temporary traffic control shall be borne by the Contractor. No additional payment will be made to the Contractor to maintain traffic in accordance with the Delaware MUTCD, contract plans and specifications. Temporary traffic control items include, but not be limited to, warning lights, warning signs, barricades, plastic drums, P.C.C. safety barrier, flaggers, traffic officers, arrow panels, message boards, and portable impact attenuators.

6/21/2011



STATE OF DELAWARE
DEPARTMENT OF TRANSPORTATION
800 BAY ROAD
P.O. BOX 778
DOVER, DELAWARE 19903

JENNIFER COHAN
SECRETARY

UTILITY STATEMENT
December 2, 2015
STATE CONTRACT # T2016-061-07
F.A.P. # NONE
PAVEMENT & REHABILITATION,
NORTH VII, 2016
NEW CASTLE COUNTY

Location: Ogletown Road from Bituminous Concrete/PCC joint east of Route 4 to end of Concrete Median before Marrows Road.

The following utility companies maintain facilities within the project limits:

AT&T Transmission
Cavalier Telephone
Comcast Cable
Delmarva Power & Light, Electric Distribution
Delmarva Power & Light, Gas
Fibertech
New Castle County Special Services
United Water
Verizon Delaware, LLC

Utility adjustments and/or relocations shall be performed as narrated, but are not limited to the following:

New Castle County Special Services

The New Castle County Special Services maintains facilities within the project limits with no anticipated impacts.

Relocations and/or adjustments of NCC sewer facilities shall be performed by the State's contractor in accordance with the respective agencies' standard specifications as directed by the District Engineer. The State contractor shall notify NCC Engineering a minimum of seven (7) calendar days in advance of the State contractor performing any necessary facility adjustments.

Delmarva Power maintains 2", 6" and 8" plastic and steel high pressure gas mains and 16" steel transmission gas mains throughout the project limits. The existing manholes will need adjustment with the proposed paving. The State contractor must use care when working in these areas. The State contractor shall notify Delmarva Power-Gas a minimum of seven (7) calendar days in advance so that the utility company can perform any necessary facility adjustments.

Verizon maintains fiber and copper communication systems throughout the project limits including underground vaults with manhole lids within the roadway. The Contractor must use care when working in these areas. The State contractor shall notify Verizon a minimum of seven (7) calendar days in advance so that the utility company can perform any necessary facility adjustments.

Del Dot maintains fiber, lighting and/or signal systems throughout the project limits. The Contractor must use care when working in these areas. Any adjustments to Del DOT facilities shall be performed by the State's contractor in accordance with the Standard Specifications as directed by the District Engineer.

Outside of the companies and facilities discussed above, no additional utility relocation involvement is anticipated. Should any conflicts be encountered during construction requiring adjustment and/or relocation the necessary relocation work shall be accomplished by the respective agencies, as directed by the District Engineer. The State contractor shall coordinate any potential conflicts with utility companies and provide adequate notice prior to performing work. Any adjustments and/or relocations of municipally owned sewer or water facilities shall be performed by the State's contractor in accordance with the respective agencies' standard specifications as directed by the District Engineer.

General Notes

- 1. The Contractor's attention is directed to Section 105.09 Utilities, Delaware Standard Specifications, August 2001. The Contractor shall contact Miss Utility (1-800-282-8555) two working days prior to any excavation. The Contractor is responsible for the support and protection of all utilities when excavating. The Contractor is responsible for ensuring proper clearances, including safety clearances, from overhead utilities for construction equipment. The Contractor is advised to check the site for access purposes for his equipment and, if necessary, make arrangements directly with the utility companies for field adjustments for adequate clearances.**
- 2. The information shown in the Contract Documents, including the Utility Statement and the Utility Schedule contained herein, concerning the location, type and size of existing and proposed utilities, their locations, and construction timing has been compiled by the preparer based on information furnished by each of the involved Utility Companies. It shall be the responsibility of the State's Contractor to verify all information and coordinate with the Utility Companies prior to and during construction, as specified in Section 105.09 of the Standard Specifications.**
- 3. It is understood and agreed that the Contractor has considered in his bid all permanent and temporary utility appurtenances in their present and relocated positions as shown on the plans or described in the Utility Statement or are readily discernible and that no additional compensation will be allowed for any delays, inconvenience, or damage due to any interference from the utility facilities and appurtenances or the operation of moving them, except that the Contractor may be granted an equitable extension of time.**

4. Coordination and cooperation among the Utility Companies and the State's Contractor are of prime importance. Therefore, the Contractor is directed to contact the following Utility Company representatives with any questions regarding this work prior to submitting bids and work schedules. Proposed work schedules should reflect the Utility Companies' proposed relocations. The Utility Companies do not work on weekends or legal holidays.

Ed McCalley	AT&T Transmission	484-682-8240
Angel M. Collazo	Delmarva Power & Light, Elec. Dist.	302-454-4370
Theodore F. Waugh	Delmarva Power, Gas Engineering	302-429-3706
David C. Clark	NC County Dept. of Special Services	302-395-5705
Steve Mosher	Comcast Cablevision of Delmarva Inc.	610-466-1509
George Zang	Verizon Delaware, LLC	302-422-1238
Steve Drake	Fibertech Networks	585-743-1736
Harry Sheppard	Cavalier Telephone	302-224-7121
John Licht	United Water	302-633-5905

5. As outlined in Chapter 3 of the DelDOT Utilities Manual, individual utility companies are responsible for obtaining all required permits from municipal, State and federal government agencies and railroads. This includes but is not limited to water quality permits/DNREC Water Quality Certification, DNREC Subaqueous Lands/Wetlands permits, DNREC Coastal Zone Consistency Certification, County Floodplain permits (New Castle County only), U.S. Coast Guard permits, US Army Corps 404 permits, sediment and erosion permits, and railroad crossing permits.
6. Individual utility companies are required to restore any areas disturbed in conjunction with their relocation work. If an area is disturbed by a utility company and is not properly restored, the Department may have the highway contractor perform the necessary restoration. Any additional costs incurred as a result will be forwarded to the utility company.

DIVISION OF TRANSPORTATION SOLUTIONS



 UTILITY COORDINATOR

2 Dec 2015

 DATE

STATE OF DELAWARE
DEPARTMENT OF TRANSPORTATION
PO BOX 778
DOVER, DELAWARE 19903

CERTIFICATE OF RIGHT-OF-WAY STATUS

STATE PROJECT NO. T201606107

F.A.P. NO. N/A for R/W

PAVEMENT & REHABILITATION, NORTH VII, 2016

NEW CASTLE COUNTY

Certificate of Right-of-Way Status – 100%

Status - LEVEL 1

As required by 23 CFR, Part 635, and other pertinent Federal and State regulations or laws, the following certifications are hereby made in reference to this highway project:

All necessary real property interests have been acquired in accordance with current FHWA/State directives covering the acquisition of real property; and,

All necessary rights-of-way, including control of access rights when pertinent, have been acquired including legal and physical possession; and,

All project rights of way are currently available in accordance with the project right-of-way plans; and,

Any residential displaced individuals or families have been relocated to decent, safe and sanitary housing, or adequate replacement housing has been made available in accordance with the provisions of the current Federal Highway Administration (FHWA) directive(s) covering the administration of the Highway Relocation Assistance Program; and,

All occupants have vacated the lands and improvements; and,

The State has physical possession and the right to remove, salvage, or demolish any improvements acquired as part of this project, and enter on all land.

RIGHT OF WAY SECTION



Robert Cunningham
Chief of Right of Way

December 8, 2015



STATE OF DELAWARE
DEPARTMENT OF TRANSPORTATION
800 BAY ROAD
P.O. BOX 778
DOVER, DELAWARE 19903

JENNIFER COHAN
SECRETARY

December 18, 2015

ENVIRONMENTAL REQUIREMENTS

FOR
State Contract No. T201606107
Federal Aid No.: N/A

Contract Title: Pavement and Rehabilitation, North VII, 2016

In accordance with the procedural provisions for implementing the National Environmental Policy Act of 1969, as amended, the referenced project has been processed through the Department's Environmental Review Procedures and has been classified as a Level D/ Class II Action.

Due to the nature of the proposed construction activities, permits are not required for this project. However, the following construction requirements and special provisions have been developed to minimize and mitigate impact to the surrounding environs. These requirements by DelDOT not specified within the contract, but listed below, are the responsibility of the contractor and are subject to risk of shut down at the contractor's expense if not followed.

GENERAL REQUIREMENTS:

1. All construction debris, excavated material, brush, rocks, and refuse incidental to such work shall be placed either on shore above the influence of flood waters or on some suitable dumping ground.
2. That effort shall be made to keep construction debris from entering adjacent waterways or wetlands. Any debris that enters those areas shall be removed immediately.
3. The disposal of trees, brush, and other debris in any stream corridor, wetland, surface water, or drainage area is prohibited.
4. Wetlands are located within the limits of the project. All work must be completed within the paved roadway and may not enter the vegetated areas alongside the road.



5. DeIDOT Environmental Studies Section (302) 760-2264 must be notified if there are any changes to the project methods, footprint, materials, or designs, to allow the Department to coordinate with the appropriate resource agencies (COE, DNREC, and SHPO), for approval.



STATE OF DELAWARE
DEPARTMENT OF TRANSPORTATION
 800 BAY ROAD
 P.O. BOX 778
 DOVER, DELAWARE 19903

JENNIFER COHAN
 SECRETARY

RAILROAD STATEMENT

For

State Contract No.: T201606107

Federal Aid No.:

Project Title: Pavement and Rehabilitation, North VII, 2016

The following railroad companies maintain facilities within the contract limits:


- | | |
|--|---|
| <input type="checkbox"/> Amtrak | <input type="checkbox"/> Maryland & Delaware |
| <input type="checkbox"/> CSX | <input type="checkbox"/> Norfolk Southern |
| <input type="checkbox"/> Delaware Coast Line | <input type="checkbox"/> Wilmington & Western |
| <input type="checkbox"/> East Penn | <input checked="" type="checkbox"/> None |

DOT Inventory No.: _____ No. Trains/Day: _____ Passenger Trains (Y / N): _____

In accordance with 23 CFR 635, herein is the railroad statement of coordination (check one):

- No Railroad involvement.
- Railroad Agreement unnecessary but railroad flagging required. The contractor shall follow requirements stated in the DeIDOT Maintenance of Railroad Traffic Item in the Special Provisions. Contractor shall coordinate railroad flagging with DeIDOT's Railroad Program Manager at (302) 760-2183.
- Railroad Agreement required. The necessary railroad agreement, attached, is complete and fully executed. Railroad related work to be undertaken and completed as required for proper coordination with physical construction schedules. The Contractor shall follow requirements stated in the DeIDOT Maintenance of Railroad Traffic Item in the Special Provisions. Contractor shall coordinate railroad flagging with DeIDOT's Railroad Program Manager at (302) 760-2183.

Approved As To Form:

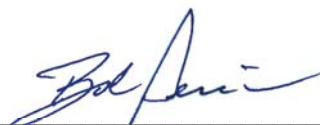

 Robert A. Perrine
 DeIDOT Railroad Program Manager

11/18/15

 DATE

BID PROPOSAL FORMS

CONTRACT T201606107.01

CONTRACT ID: T201606107.01 PROJECT(S): T201606107

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS

SECTION 0001 Category 0001

0010	202000 EXCAVATION AND EMBANKMENT	865.000				
		CY				
0020	211002 REMOVAL OF STRUCTURES AND OBSTRUCTIONS (GUARDRAIL)	1350.000				
		LF				
0030	302005 GRADED AGGREGATE BASE COURSE, TYPE B	1370.000				
		TON				
0040	401696 ENTRANCE, DRIVEWAY AND INTERSECTING STREET PAVING SURCHARGE	1142.000				
		TON				
0050	401755 RECYCLED ASPHALT PAVEMENT MILLINGS FOR ROADWAY EDGE	40.000				
		TON				
0060	401823 BITUMINOUS CONCRETE, SUPERPAVE, BITUMINOUS CONCRETE BASE COURSE, 160 GYRATIONS, PG 64-22, PATCHING	480.000				
		TON				
0070	401830 BITUMINOUS CONCRETE, SUPERPAVE, TYPE C, 160 GYRATIONS, PG 70-22 (NON-CARBONATE STONE)	3574.000				
		TON				
0080	402000 BITUMINOUS CONCRETE AND/OR COLD-LAID BITUMINOUS CONCRETE (TRM)	70.000				
		TON				

CONTRACT ID: T201606107.01 PROJECT(S): T201606107

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0090	406001 BITUMINOUS CONCRETE PATCHING	8000.000 SYIN				
0100	501534 INTERFACE JOINT SEALING REPAIR	180.000 LF				
0110	503001 PATCHING P.C.C. PAVEMENT, 6' TO 15', TYPE A	375.000 SY				
0120	503002 PATCHING P.C.C. PAVEMENT GREATER THAN 15' TO 100', TYPE B	1500.000 SY				
0130	503006 DOWEL BARS	850.000 EACH				
0140	503501 CRACK AND JOINT SEALING LESS THAN 3/4" WIDE	65000.000 LF				
0150	503502 CRACK AND JOINT SEALING 3/4" TO 1 3/4" WIDE	3250.000 LF				
0160	503503 PATCHING CONCRETE	2500.000 SYIN		5.65000		14125.00
0170	503517 P.C.C. PATCHING, PARTIAL DEPTH	250.000 SYIN				
0180	602629 CRACK SEALING BRIDGE DECKS, APPROACH SLABS, SIDEWALK, ETC.	400.000 LF				

CONTRACT ID: T201606107.01 PROJECT(S): T201606107

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0190	701011 PORTLAND CEMENT CONCRETE CURB, TYPE 2	760.000 LF				
0200	701032 CURB OPENING, 4' OPENING	2.000 EACH				
0210	705001 P.C.C. SIDEWALK, 4"	3900.000 SF				
0220	705002 P.C.C. SIDEWALK, 6"	900.000 SF				
0230	705007 SIDEWALK SURFACE DETECTABLE WARNING SYSTEM	60.000 SF				
0240	705008 CURB RAMP, TYPE 1	150.000 SF				
0250	705009 CURB RAMP, TYPE 2, 3, AND/OR 4	350.000 SF				
0260	705010 CURB RAMP, TYPE 5	50.000 SF				
0270	705524 DECTABLE WARNINGS RETROFIT	40.000 SF				
0280	710001 ADJUSTING AND REPAIRING EXISTING DRAINAGE INLET	7.000 EACH				
0290	712020 RIPRAP, R-4	20.000 TON				

CANNOT BE USED FOR BIDDING

CONTRACT ID: T201606107.01 PROJECT(S): T201606107

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0300	713003 GEOTEXTILES, RIPRAP	50.000 SY				
0310	720050 GALVANIZED STEEL BEAM GUARDRAIL, TYPE 1-31	1663.000 LF				
0320	720052 GALVANIZED STEEL BEAM GUARDRAIL, TYPE 3-31	5069.000 LF				
0330	720585 GUARDRAIL END TREATMENT ATTENUATOR, TYPE 1-31	2.000 EACH				
0340	720588 GUARDRAIL END TREATMENT ATTENUATOR, TYPE 3-31	15.000 EACH				
0350	725001 GUARDRAIL TO BARRIER CONNECTION (EXIT TYPE 31)	4.000 EACH				
0360	725002 GUARDRAIL TO BARRIER CONNECTION, APPROACH TYPE 1-31	4.000 EACH				
0370	743003 ARROWPANELS, TYPE C	200.000 EADY				
0380	743004 FURNISH AND MAINTAIN PORTABLE CHANGEABLE MESSAGE SIGN	20.000 EADY				
0390	743005 FURNISH AND MAINTAIN PORTABLE LIGHT ASSEMBLY	500.000 EADY				


CANNOT BE USED FOR BIDDING

CONTRACT ID: T201606107.01 PROJECT(S): T201606107

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0400	743007 TRAFFIC OFFICERS	1280.000	75.00000		96000.00	
		hour				
0410	743010 FURNISH AND MAINTAIN TRUCK MOUNTED ATTENUATOR, TYPE II	100.000				
		each				
0420	743050 FLAGGER, NEW CASTLE COUNTY, STATE	2500.000				
		hour				
0430	743062 FLAGGER, NEW CASTLE COUNTY, STATE, OVERTIME	250.000				
		hour				
0440	744544 ADJUST OR REPAIR EXISTING CONDUIT JUNCTION WELL	2.000				
		each				
0450	746924 FURNISH & INSTALL LOOP WIRE 1-CONDUCTOR #14 AWG ENCASED IN 1/4" FLEXIBLE TUBING IN A LOOP SAWCUT	730.000				
		LF				
0460	748015 PERMANENT PAVEMENT STRIPING, SYMBOL/LEGEND ALKYD-THERMOPLAST IC	7503.000				
		SF				
0470	748019 TEMPORARY MARKINGS, PAINT, 4"	42700.000				
		LF				
0480	748026 TEMPORARY MARKINGS, PAINT SYMBOL/LEGEND	9532.000				
		SF				

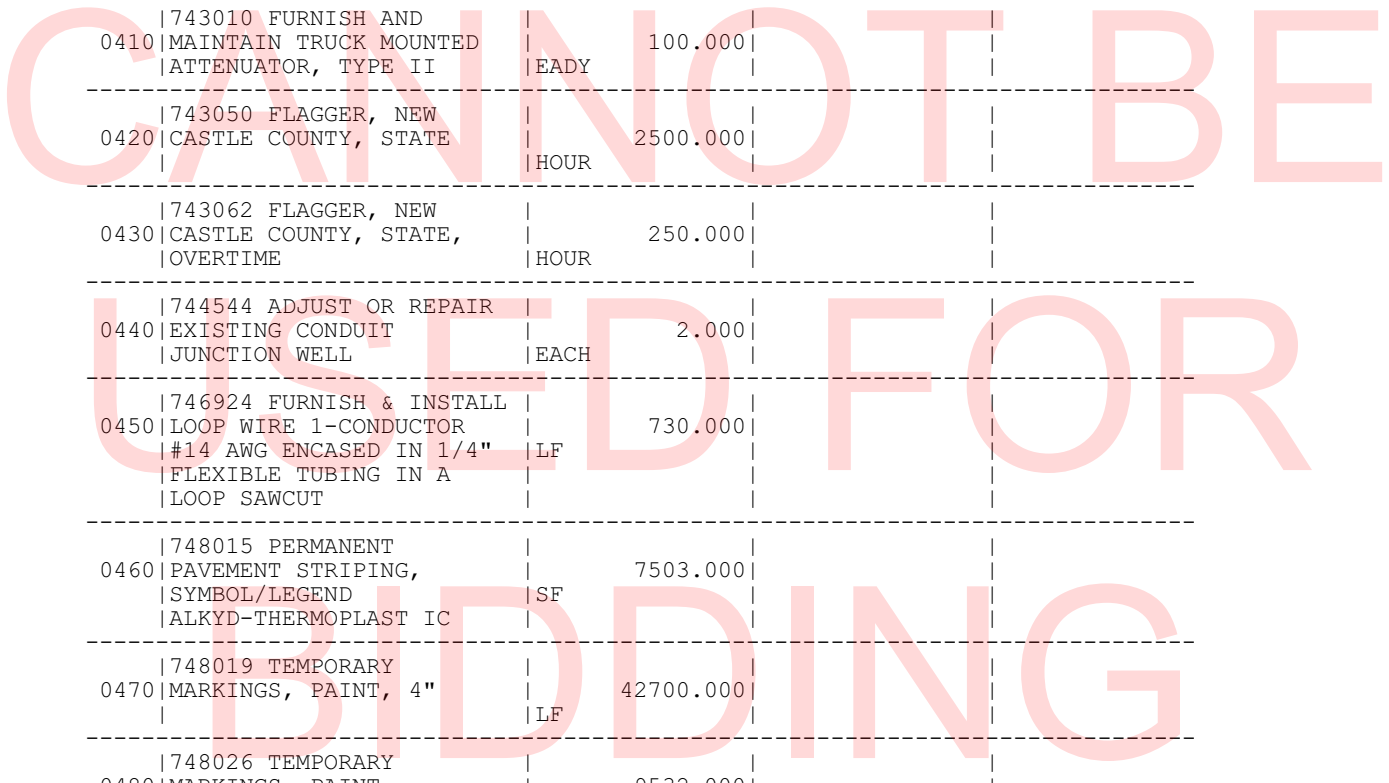

CONTRACT ID: T201606107.01

PROJECT(S): T201606107

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0490	748027 PERMANENT PAVEMENT STRIPING, ALKYD-THERMOPLASTIC, 12"	210.000 LF				
0500	748033 PERMANENT PAVEMENT STRIPING, ALKYD-THERMOPLASTIC, 5"	40.000 LF				
0510	748502 RAISED/RECESSED PAVEMENT MARKER	103.000 EACH				
0520	748513 RETROREFLECTIVE PREFORMED PATTERNEDMARKINGS, 12"	310.000 LF				
0530	748529 RETROREFLECTIVE PREFORMED PATTERNEDMARKINGS, SYMBOL/LEGEND	4916.000 SF				
0540	748530 REMOVAL OF PAVEMENT STRIPING	5204.000 SF				
0550	748548 PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/YELLOW, 5"	81510.000 LF				
0560	748549 PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/YELLOW, 10"	6630.000 LF				

CONTRACT ID: T201606107.01 PROJECT(S): T201606107

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0570	748553 PREFORMED RETROREFLECTIVE THERMOPLASTIC PAVEMENT MARKINGS, BIKE SYMBOL	14.000 EACH				
0580	748557 PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 3"	23110.000 LF				
0590	748559 PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 5"	5770.000 LF				
0600	748566 RETROREFLECTIVE PREFORMED PATTERNED MARKINGS, 8"	140.000 LF				
0610	748568 PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 9"	10610.000 LF				
0620	748569 PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 14"	820.000 LF				
0630	749687 INSTALLATION OR REMOVAL OF TRAFFIC SIGN(S) ON SINGLE SIGN POST	246.000 EACH				
0640	749688 INSTALLATION OF 4" DIAMETER HOLE, LESS THAN OR EQUAL TO 6" DEPTH	14.000 EACH				
0650	749690 INSTALLATION OR REMOVAL OF TRAFFIC SIGNS ON MULTIPLE SIGN POSTS	247.000 SF				

CONTRACT ID: T201606107.01 PROJECT(S): T201606107

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0660	750000 ADJUST WATER VALVE BOXES	3.000 EACH				
0670	758000 REMOVAL OF EXISTING PORTLAND CEMENT CONCRETE PAVEMENT, CURB, SIDEWALK, ETC.	850.000 SY				
0680	760012 RUMBLE STRIPS, BIKE-FRIENDLY, HOT-MIX	1900.000 LF				
0690	760507 PROFILE MILLING, BITUMINOUS CONCRETE	53750.000 SYIN				
0700	762001 SAW CUTTING, BITUMINOUS CONCRETE	5680.000 LF				
0710	762002 SAW CUTTING, CONCRETE, FULL DEPTH	175.000 LF				
0720	763000 INITIAL EXPENSE	LUMP		LUMP		
0730	763621 CONSTRUCTION ENGINEERING, REHABILITATION	15.000 HOUR				
0740	763643 MAINTENANCE OF TRAFFIC, ALL INCLUSIVE	LUMP		LUMP		
0750	905004 INLET SEDIMENT CONTROL, DRAINAGE INLET	93.000 EACH				

CANNOT BE USED FOR BIDDING

CONTRACT ID: T201606107.01

PROJECT(S): T201606107

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0760	908001 TOPSOIL (TON)	490.000 TON				
0770	908014 PERMANENT GRASS SEEDING, DRY GROUND	3200.000 SY				
0780	908020 EROSION CONTROL BLANKET MULCH	240.000 SY				
SECTION 0001 TOTAL						
TOTAL BID						

CANNOT BE USED FOR BIDDING

**AFFIDAVIT
OF
EMPLOYEE DRUG TESTING PROGRAM**

4104 Regulations for the Drug Testing of Contractor and Subcontractor Employees Working on Large Public Works Projects requires that Contractors and Subcontractors implement a program of mandatory drug testing for Employees who work on Large Public Works Contracts funded all or in part with public funds.

We hereby certify that we have in place or will implement during the entire term of the contract a Mandatory Drug Testing Program for our employees on the jobsite that complies with this regulation:

Contractor/Subcontractor Name: _____

Contractor/Subcontractor Address: _____

Authorized Representative (typed or printed): _____

Authorized Representative (signature): _____

Title: _____

Sworn to and Subscribed before me this _____ day of _____ 20____.

My Commission expires _____ . NOTARY PUBLIC _____.

THIS PAGE MUST BE SIGNED AND NOTARIZED

CERTIFICATION
Contract No. T201606107.01

The undersigned bidder, _____
whose address is _____
and telephone number is _____ hereby certifies the following:

I/We have carefully examined the location of the proposed work, the proposed plans and specifications, and will be bound, upon award of this contract by the Department of Transportation, to execute in accordance with such award, a contract with necessary surety bond, of which contract this proposal and said plans and specifications shall be a part, to provide all necessary machinery, tools, labor and other means of construction, and to do all the work and to furnish all the materials necessary to perform and complete the said contract within the time and as required in accordance with the requirements of the Department of Transportation, and at the unit prices for the various items as listed on the preceding pages.

The foregoing quantities are considered to be approximate only and are given as the basis for comparison of bids. The Department of Transportation may increase or decrease the amount of any item or portion of the work as may be deemed necessary or expedient. Any such increase or decrease in the quantity for any item will not be regarded as a sufficient ground for an increase or decrease in the unit prices, nor in the time allowed for the completion of the work, except as provided in the contract.

Accompanying this proposal is a surety bond or a security of the bidder assigned to the Department of Transportation, for at least ten (10) percentum of total amount of the proposal, which deposit is to be forfeited as liquidated damages in case this proposal is accepted, and the undersigned shall fail to execute a contract with necessary bond, when required, for the performance of said contract with the Department of Transportation, under the conditions of this proposal, within twenty (20) days after date of official notice of the award of the contract as provided in the requirement and specifications hereto attached; otherwise said deposit is to be returned to the undersigned.

I/We are licensed, or have initiated the license application as required by Section 2502, Chapter 25, Title 30, of the Delaware Code.

By submission of this proposal, each bidder and each person signing on behalf of any bidder, certifies as to its own organization, under penalty of perjury, that to the best of each signer's knowledge and belief:

1. The prices in this proposal have been arrived at independently without collusion, consultation, communication, or Agreement with any other bidder or with any competitor for the purpose of restricting competition.
2. Unless required by law, the prices which have been quoted in this proposal have not been knowingly disclosed and will not knowingly be disclosed by the bidder, directly or indirectly, to any other bidder or competitor prior to the opening of proposals.
3. No attempt has been made or will be made by the bidder to induce any other person, partnership, or corporation to submit or not to submit a proposal for the purpose of restricting competition.

I/We acknowledge receipt and incorporation of addenda to this proposal as follows:

No.	Date	No.	Date	No.	Date	No.	Date	No.	Date
-----	------	-----	------	-----	------	-----	------	-----	------

BIDDERS MUST ACKNOWLEDGE RECEIPT OF ALL ADDENDA

MUST INSERT DATE OF FINAL QUESTIONS AND ANSWERS ON WEBSITE: _____



AFFIRMATION:

Within the past five (5) years, has your firm, any affiliate, any predecessor company or entity, owner, Director, officer, partner or proprietor been the subject of a Federal, State, Local government suspension or debarment?

YES _____ NO _____ if yes, please explain _____

Sealed and dated this _____ day of _____ in the year of our Lord two thousand _____ (20____).

Name of Bidder (Organization)

Corporate
Seal

By: _____

Authorized Signature


Attest _____

Title

SWORN TO AND SUBSCRIBED BEFORE ME this _____ day of _____, 20____.

Notary
Seal

Notary

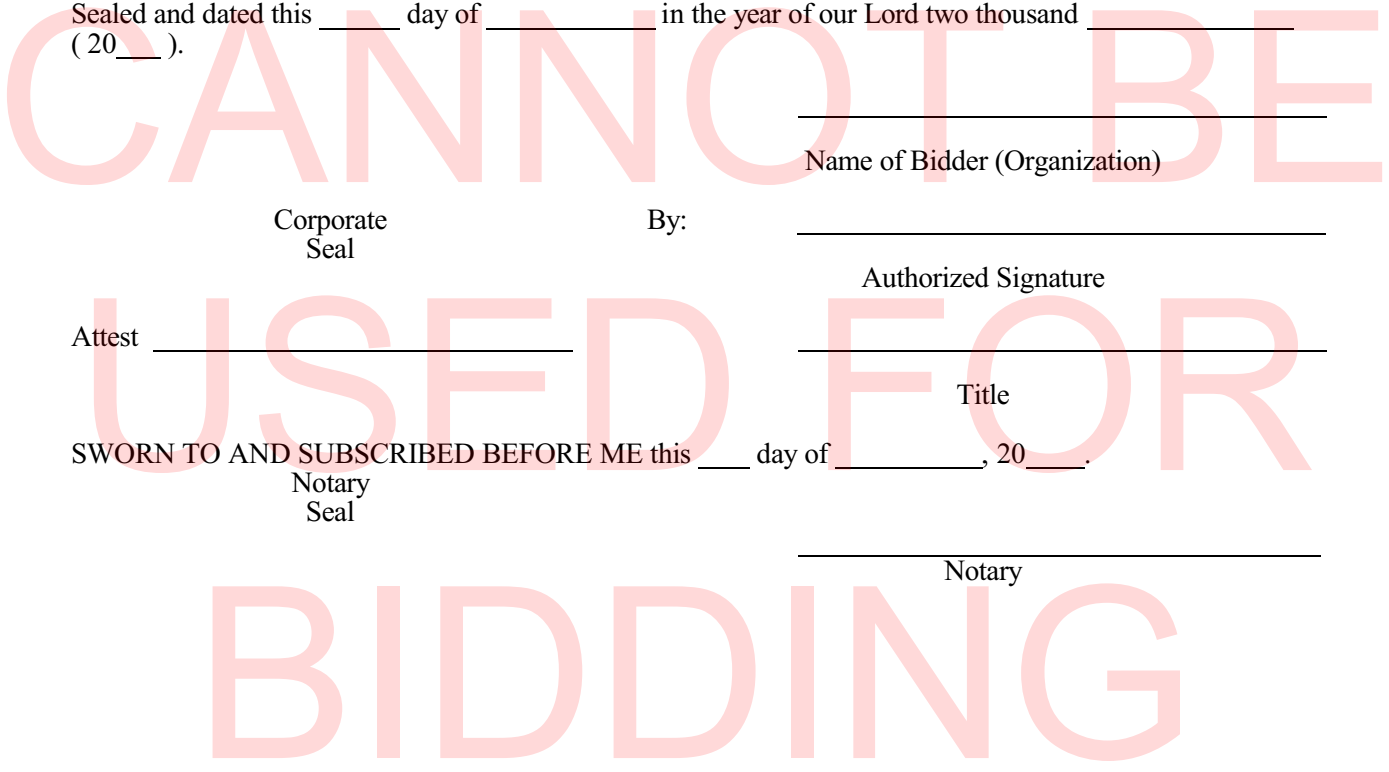

BID BOND

TO ACCOMPANY PROPOSAL
(Not necessary if security is used)

KNOW ALL MEN BY THESE PRESENTS That: _____

of _____ in the County of _____ and State of _____
as **Principal**, and _____ of _____ in the County of _____
and State of _____ as **Surety**, legally authorized to do business in the
State of Delaware ("**State**"), are held and firmly bound unto the **State** in the sum of _____
Dollars (\$ _____), or _____ percent not to exceed _____
Dollars (\$ _____) of amount of bid on Contract
No. T201606107.01 , to be paid to the **State** for the use and benefit of its Department of Transportation
("**DelDOT**") for which payment well and truly to be made, we do bind ourselves, our and each of our heirs,
executors, administrators, and successors, jointly and severally for and in the whole firmly by these presents.

NOW THE CONDITION OF THIS OBLIGATION IS SUCH That if the above bounden
Principal who has submitted to the **DelDOT** a certain proposal to enter into this contract for the furnishing
of certain materiel and/or services within the **State**, shall be awarded this Contract, and if said **Principal**
shall well and truly enter into and execute this Contract as may be required by the terms of this Contract and
approved by the **DelDOT**, this Contract to be entered into within twenty days after the date of official notice
of the award thereof in accordance with the terms of said proposal, then this obligation shall be void or else
to be and remain in full force and virtue.

Sealed with _____ seal and dated this _____ day of _____ in the year of our Lord
two thousand and _____ (20____).

SEALED, AND DELIVERED IN THE
presence of

Corporate
Seal

Name of Bidder (Organization)

By: _____
Authorized Signature

Attest _____

Title

Name of Surety

Witness: _____

By: _____

Title