

STATE OF DELAWARE

This Copy is for information only.
You must request a CD from
DeIDOT in order to bid.



DEPARTMENT OF TRANSPORTATION

BID PROPOSAL

for

CONTRACT T201606108.01

PAVEMENT AND REHABILITATION, NORTH VIII, 2016

NEW CASTLE COUNTY

ADVERTISEMENT DATE: June 17, 2019

COMPLETION TIME: 310 Calendar Days

SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION
DELAWARE DEPARTMENT OF TRANSPORTATION
AUGUST 2016

Bids will be received in the Bidder's Room at the Delaware Department of Transportation's Administration Building, 800 Bay Road, Dover, Delaware prior to 2:00 P.M. local time July 16, 2019

Contract No. T201606108.01

**PAVEMENT AND REHABILITATION, NORTH VIII, 2016
NEW CASTLE COUNTY**

GENERAL DESCRIPTION

LOCATION

These improvements are located in NEW CASTLE County more specifically shown on the Location Map(s) of the enclosed Plans.

DESCRIPTION

The improvements consist of furnishing all labor and materials for PAVEMENT AND REHABILITATION, NORTH VIII, 2016, and other incidental construction in accordance with the location, notes and details shown on the plans and as directed by the Engineer.

COMPLETION TIME

All work on this contract must be complete within 310 Calendar Days. It is the Department's intent to issue a Notice to Proceed such that work starts on or about September 9, 2019.

PROSPECTIVE BIDDERS NOTES:

1. BIDDERS MUST BE REGISTERED with DelDOT and request a cd of the official plans and specifications in order to submit a bid. Contact DelDOT at dot-ask@delaware.gov, or (302) 760-2031. Bids will be received in the Bidder's Room at the Delaware Department of Transportation's Administration Building, 800 Bay Road, Dover, Delaware prior to 2:00 P.M. local time July 16, 2019 unless changed via addendum.
2. QUESTIONS regarding this project are to be e-mailed to dot-ask@delaware.gov no less than six business days prior to the bid opening date in order to receive a response. Please include T201606108.01 in the subject line. Responses to inquiries are posted on-line at <http://www.bids.delaware.gov>.
3. PREQUALIFICATION REQUIREMENT - 29 Del.C. §6962 (c)(12)(a) requires DelDOT to include a performance-based rating system for contractors. The Performance Rating for each Contractor shall be used as a prequalification to bid at the time of bid. Refer to Contract '**General Notices**' for details. ***NEW***
4. **THE BID PROPOSAL software used by DelDOT has changed. We now use Bid Express.** This new software is an updated version of the previous software used and operates similarly. The cd you request from DelDOT contains the Bid Express file and its installation file. Bidders are to use the cd provided to enter their bid amounts into the Bid Express file. The Bid Express bid file must be printed and submitted in paper form along with the electronic bid file and other required documents prior to the Bid due date and time. (DelDOT is not utilizing web based electronic bidding for this project).
5. SURETY BOND - Each proposal must be accompanied by a deposit of either surety bond or security for a sum equal to at least 10% of the bid.
6. DRUG TESTING - Regulation 4104; The state Office of Management and Budget has developed regulations that require Contractors and Subcontractors to implement a program of mandatory drug testing for Employees who work on Large Public Works Contracts funded all or in part with public funds pursuant to 29 Del.C. §6908(a)(6). **Refer to the full REVISED requirements at the following link:** http://regulations.delaware.gov/register/december2017/final/21_DE_Reg_503_12-01-17.htm

Note a few of the Drug Testing requirements;

- * At bid submission - Each bidder must submit with the bid a single signed affidavit certifying that the bidder and its subcontractors has in place or will implement during the entire term of the contract a Mandatory Drug Testing Program that complies with the regulation, *the form is attached*;
- * At least two business days prior to contract execution - The awarded Contractor shall provide to DelDOT copies of the Employee Drug Testing Program for the Contractor, and any other listed Subcontractors;

* Subcontractors - Contractors that employ Subcontractors on the job site may do so only after submitting a copy of the Subcontractor's Employee Drug Testing Program along with the standard required subcontractor information. A Subcontractor shall not commence work until **DeIDOT** has approved the subcontractor in writing;

* Penalties for non-compliance are specified in the regulation.

7. No RETAINAGE will be withheld on this contract unless through the Prequalification Requirements.
8. EXTERNAL COMPLAINT PROCEDURE can be viewed on DeIDOT's Website [here](#), or you may request a copy by calling (302) 760-2555.
9. REMINDER; A copy of your firm's Delaware Business License must be submitted with your bid.
10. SECTION 106.06 BUY AMERICA Contract Requirement in the Delaware Standard Specifications for Road and Bridge Construction, August, 2016 does not apply to this contract.
11. AUGUST 2016 STANDARD SPECIFICATIONS apply to this contract. The Contractor shall make himself aware of any revisions and corrections (Supplemental Specifications, if any) and apply them to the applicable item(s) of this contract. The 2016 Standard Specifications can be [viewed here](#).
- 11a. FLATWORK CONCRETE TECHNICIAN CERTIFICATION TRAINING:
Section 501.03, 503.03, 505.03, 610.03, 701.03 and 702.03 of the 2016 Standard Specifications require contractor's to provide an American Concrete Institute (ACI) or National Ready Mix Concrete Association (NRMCA) certified concrete flatwork technician to supervise all finishing of flatwork concrete. Concrete flatwork certification will be effective starting on June 1, 2018.
12. **Additional Insurance Requirements:**
See additional insurance requirements found in Provision 801501-Maintenance of Railroad Traffic (CSXT), paragraph XV, Insurance Requirements, as well as paragraph XVII, Required Insurance for Other Activities.

**STATE OF DELAWARE
CONSTRUCTION ITEMS UNITS OF MEASURE**

English Code	English Description	Multiply By	Metric Code	Metric Description	Suggested CEC Metric Code
ACRE	Acre	0.4047	ha	Hectare	HECTARE
BAG	Bag	N/A	Bag	Bag	BAG
C.F.	Cubic Foot	0.02832	m ³	Cubic Meter	M3
C.Y.	Cubic Yard	0.7646	m ³	Cubic Meter	M3
EA-DY	Each Day	N/A	EA-DY	Each Day	EA-DY
EA-MO	Each Month	N/A	EA-MO	Each Month	EA-MO
EA/NT	Each Night	N/A	EA-NT	Each Night	EA/NT
EACH	Each	N/A	EA	Each	EACH
GAL	Gallon	3.785	L	Liter	L
HOUR	Hour	N/A	h	Hour	HOUR
INCH	Inch	25.4	mm	Millimeter	MM
L.F.	Linear Foot	0.3048	m	Linear Meter	L.M.
L.S.	Lump Sum	N/A	L.S.	Lump Sum	L.S.
LA-MI	Lane Mile	1.609	LA-km	Lane-Kilometer	LA-KM
LB	Pound	0.4536	kg	Kilogram	KG
MFBM	Thousand Feet of Board Measure	2.3597	m ³	Cubic Meter	M3
MGAL	Thousand Gallons	3.785	kL	Kiloliter	KL
MILE	Mile	1.609	km	Kilometer	KM
S.F.	Square Foot	0.0929	m ²	Square Meter	M2
S.Y.	Square Yard	0.8361	m ²	Square Meter	M2
SY-IN	Square Yard-Inch	0.8495	m ² -25 mm	Square Meter-25 Millimeter	M2-25 MM
TON	Ton	.9072	t	Metric Ton (1000kg)	TON
N.A.*	Kip	4.448	kN	Kilonewton	N.A.*
N.A.*	Thousand Pounds per Square Inch	6.895	MPa	Megapascal	N.A.*

*Not used for units of measurement for payment.

TABLE OF CONTENTS

GENERAL DESCRIPTION..... i
 LOCATION..... i
 DESCRIPTION..... i
 COMPLETION TIME..... i
 PROSPECTIVE BIDDERS NOTES..... i
 CONSTRUCTION ITEMS UNITS OF MEASURE..... iii

GENERAL NOTICES..... 1
 SPECIFICATIONS..... 1
 CLARIFICATIONS..... 1
 ATTESTING TO NON-COLLUSION..... 1
 QUANTITIES..... 1
 PREQUALIFICATION REQUIREMENT..... 1
 PREFERENCE FOR DELAWARE LABOR..... 1
 EQUALITY OF EMPLOYMENT OPPORTUNITY ON PUBLIC WORKS..... 2
 TAX CLEARANCE..... 2
 LICENSE..... 2
 DIFFERING SITE CONDITIONS..... 2
 RIGHT TO AUDIT..... 3

PREVAILING WAGES... 3
 STATE WAGE RATES..... 5

SUPPLEMENTAL SPECIFICATIONS..... 6

SPECIAL PROVISIONS..... 7
 CONSTRUCTION ITEM NUMBERS..... 8
 401502 - ASPHALT CEMENT COST ADJUSTMENT..... 9
 401580 - Ride Quality of Bituminous Pavement..... 10
 401696 – ENTRANCE, DRIVEWAY AND INTERSECTING STREET PAVING SURCHARGE..... 13
 401699 - QUALITY CONTROL/QUALITY ASSURANCE OF BITUMINOUS CONCRETE..... 14
 503503 - PATCHING CONCRETE..... 28
 602502 - CONVERTING EXISTING CATCH BASIN TO MANHOLE..... 29
 705504 - BRICK AND/OR BLOCK SIDEWALK..... 30
 705506 - BRICK AND/OR BLOCK ROADWAY..... 30
 705505 - RESET STONE/BRICK SIDEWALK AND/OR STONE/BRICK ROADWAY..... 32
 711500 - ADJUST AND REPAIR EXISTING SANITARY MANHOLE..... 33
 763501 - CONSTRUCTION ENGINEERING..... 34
 801500 - MAINTENANCE OF TRAFFIC - ALL INCLUSIVE..... 41
 801501 - MAINTENANCE OF RAILROAD TRAFFIC (CSXT)..... 46
 831501 - FURNISH AND INSTALL 4" SCHEDULE 80 PVC CONDUIT (OPEN CUT)..... 53
 831503 - FURNISH AND INSTALL 2-1/2" SCHEDULE 80 PVC CONDUIT (OPEN CUT)..... 53
 831512 - FURNISH AND INSTALL 1" SCHEDULE 80 PVC CONDUIT (TRENCH)..... 53
 831514 - FURNISH AND INSTALL 2-1/2" SCHEDULE 80 PVC CONDUIT (TRENCH)..... 53
 831515 - FURNISH AND INSTALL 3" SCHEDULE 80 PVC CONDUIT (TRENCH)..... 53
 831516 - FURNISH AND INSTALL 4" SCHEDULE 80 PVC CONDUIT (TRENCH)..... 53
 831522 - FURNISH AND INSTALL 1" GALVANIZED STEEL CONDUIT (TRENCH)..... 53
 831523 - FURNISH AND INSTALL 2" GALVANIZED STEEL CONDUIT (TRENCH)..... 53
 831538 - FURNISH AND INSTALL 2" GALVANIZED STEEL CONDUIT (ON STRUCTURE)
 & INSTALL SECOND AND SUBSEQUENT ADDITIONAL 3" SCHEDULE 80 PVC
 CONDUITS IN TRENCH OR OPEN CUT..... 53
 831574 - FURNISH & INSTALL SECOND AND SUBSEQUENT ADDITIONAL 4" SCHEDULE 80
 PVC CONDUITS IN TRENCH OR OPEN CUT..... 53

UTILITY STATEMENT..... 57

RIGHT OF WAY CERTIFICATE..... 67

ENVIRONMENTAL STATEMENT..... [68](#)
RAILROAD STATEMENT. [69](#)
BID PROPOSAL FORMS. [70](#)
DRUG TESTING AFFIDAVIT.. [81](#)
CERTIFICATION. [82](#)
BID BOND.. [84](#)

GENERAL NOTICES

SPECIFICATIONS:

The specifications entitled "Standard Specifications for Road and Bridge Construction, August, 2016", hereinafter referred to as the Standard Specifications, and Supplemental Specifications, the Special Provisions, notes on the Plans, this Bid Proposal, and any addenda thereto shall govern the work to be performed under this contract. The Specifications and Supplemental Specifications can be [viewed here](#).

CLARIFICATIONS:

Under any Section or Item included in the Contract, the Contractor shall be aware that when requirements, responsibilities, and furnishing of materials are outlined in the details and notes on the Plans and in the paragraphs preceding the "Basis of Payment" paragraph in the Standard Specifications or Special Provisions, no interpretation shall be made that such stipulations are excluded because reiteration is not made in the "Basis of Payment" paragraph.

ATTESTING TO NON-COLLUSION:

The Department requires as a condition precedent to acceptance of bids a sworn statement executed by, or on behalf of, the person, firm, association, or corporation to whom such contract is to be awarded, certifying that such person, firm, association, or corporation has not, either directly or indirectly, entered into any agreement, participated in any collusion, or otherwise taken any action in restraint of free competitive bidding in connection with such contract. The form for this sworn statement is included in the proposal and must be properly executed in order to have the bid considered.

QUANTITIES:

The quantities shown are for comparison of bids only. The Department may increase or decrease any quantity or quantities without penalty or change in the bid price.

PREQUALIFICATION REQUIREMENT

29 Del.C. §6962 (c)(12)(a) requires a Department of Transportation project, excluding a Community ^{NEW} Transportation Fund or municipal street aid contract, to include a performance-based rating system. At the time of bid, the Performance Rating for each Contractor shall be used as a prequalification to bid.

Bidders with Performance Rating scores equal to or greater than 85% shall be permitted to bid. Bidders with scores of less than 85% who comply with the retainage requirements of 29 Del.C. §6962 shall be permitted to bid provided the *Agreement to Accept Retainage* (located on the Certification Page) is executed and submitted with the bid. Lack of an executed *Agreement to Accept Retainage* will result in the rejection of the bid by the Department. Successful bidders awarded Department contracts who have no performance history within the last five (5) years will be assigned a provisional Performance Rating of 85% at the date of advertisement.

Notification of Performance Rating. The Department shall post publicly the Performance Rating for all Contractors on the Department's [website](#). DelDOT will complete performance-based evaluations on the construction company contracted by the Department to build the project (the "Contractor"). Provisions to appeal Performance Ratings are described in the regulations. The regulations are set forth in Section 2408 of Title 2, Delaware Administrative Code, found [here](#).

PREFERENCE FOR DELAWARE LABOR:

Delaware Code, Title 29, Chapter 69, Section 6962, Paragraph (d), Subsection (4)b:

"In the construction of all public works for the State or any political subdivision thereof, or by firms contracting with the State or any political subdivision thereof, preference in employment of laborers, workmen or mechanics shall be given to bona fide legal citizens of the State who have established citizenship by residence of at least 90 days in the State. Each public works contract for the construction of public works for the State or any political subdivision thereof shall contain a stipulation that any

person, company or corporation who violates this section shall pay a penalty to the Secretary of Finance equal to the amount of compensation paid to any person in violation of this section."

EQUALITY OF EMPLOYMENT OPPORTUNITY ON PUBLIC WORKS:

Delaware Code, Title 29, Chapter 69, Section 6962, Paragraph (d), Subsection (7) states;

- a. As a condition of the awarding of any contract for public works financed in whole or in part by State appropriation, such contracts shall include the following provisions:

During the performance of this contract, the contractor agrees as follows:

1. The contractor will not discriminate against any employee or applicant for employment because of race, creed, color, sex, sexual orientation, gender identity or national origin. The contractor will take positive steps to ensure that applicants are employed and that employees are treated during employment without regard to their race, creed, color, sex, sexual orientation, gender identity or national origin. Such action shall include, but not be limited to, the following: employment, upgrading, demotion or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship. The contractor agrees to post in conspicuous places available to employees and applicants for employment notices to be provided by the contracting agency setting forth this nondiscrimination clause.
2. The contractor will, in all solicitations or advertisements for employees placed by or on behalf of the contractor, state that all qualified applicants will receive consideration for employment without regard to race, creed, color, sex, sexual orientation, gender identity or national origin.
3. The contractor will ensure employees receive equal pay for equal work, without regard to sex. Employee pay differential is acceptable if pursuant to a seniority system, a merit system, a system which measures earnings by quantity or quality of production, or if the differential is based on any other factor other than sex.

TAX CLEARANCE:

As payments to each vendor or contractor aggregate \$2,000, the Division of Accounting will report such vendor or contractor to the Division of Revenue, who will then check the vendor or contractor's compliance with tax requirements and take such further action as may be necessary to insure compliance.

LICENSE:

A person desiring to engage in business in this State as a contractor shall obtain a license upon making application to the Division of Revenue.

CONTRACTOR / SUBCONTRACTOR LICENSE: 29 DEL. C. §6967:

(b) No agency shall accept a proposal for a public works contract unless such contractor has provided a proper and current copy of its occupational and/or business license, as required by Title 30, to such agency.

(c) Any contractor that enters a public works contract must provide to the agency to which it is contracting, within 30 days of entering such public works contract, copies of all occupational and business licenses of subcontractors and/or independent contractors that will perform work for such public works contract. However, if a subcontractor or independent contractor is hired or contracted more than 20 days after the contractor entered the public works contract the occupational or business license of such subcontractor or independent contractor shall be provided to the agency within 10 days of being contracted or hired.

DIFFERING SITE CONDITIONS,

SUSPENSIONS OF WORK and SIGNIFICANT CHANGES IN THE CHARACTER OF WORK:

Differing site conditions: During the progress of the work, if subsurface or latent physical conditions are encountered at the site differing materially from those indicated in the contract or if unknown physical conditions of an unusual nature, differing materially from those ordinarily encountered and generally recognized as inherent in the work provided for in the contract are encountered at the site, the party discovering such conditions shall promptly notify the other party in writing of the specific differing conditions before they are disturbed and before the affected work is performed.

Upon written notification, the engineer will investigate the conditions, and if he/she determines that the conditions materially differ and cause an increase or decrease in the cost or time required for the performance of any work under the contract, an adjustment, excluding loss of anticipated profits, will be made and the

contract modified in writing accordingly. The engineer will notify the contractor of his/her determination whether or not an adjustment of the contract is warranted.

No contract adjustment which results in a benefit to the contractor will be allowed unless the contractor has provided the required written notice.

No contract adjustment will be allowed under their clause for any effects caused on unchanged work.

Suspensions of work ordered by the engineer: If the performance of all or any portion of the work is suspended or delayed by the engineer in writing for an unreasonable period of time (not originally anticipated, customary or inherent to the construction industry) and the contractor believes that additional compensation and/or contract time is due as a result of such suspension or delay, the contractor shall submit to the engineer in writing a request for adjustment within 7 calendar days of receipt of the notice to resume work. The request shall set forth the reasons and support for such adjustment.

Upon receipt, the engineer will evaluate the contractor's request. If the engineer agrees that the cost and/or time required for the performance of the contract has increased as a result of such suspension and the suspension was caused by conditions beyond the control of and not the fault of the contractor, its suppliers, or subcontractors at any approved tier, and not caused by weather, the engineer will make an adjustment (excluding profit) and modify the contract in writing accordingly. The engineer will notify the contractor of his/her determination whether or not an adjustment of the contract is warranted.

No contract adjustment will be allowed unless the contractor has submitted the request for adjustment within the time prescribed.

No contract adjustment will be allowed under this clause to the extent that performance would have been suspended or delayed by any other cause, or for which an adjustment is provided for or excluded under any other term or condition of this contract.

Significant changes in the character of work: The engineer reserves the right to make, in writing, at any time during the work, such changes in quantities and such alterations in the work as are necessary to satisfactorily complete the project. Such changes in quantities and alterations shall not invalidate the contract nor release the surety, and the contractor agrees to perform the work as altered.

If the alterations or changes in quantities significantly change the character of the work under the contract, whether or not changed by any such different quantities or alterations, an adjustment, excluding loss of anticipated profits, will be made to the contract. The basis for the adjustment shall be agreed upon prior to the performance of the work. If a basis cannot be agreed upon, then an adjustment will be made either for or against the contractor in such amount as the engineer may determine to be fair and equitable.

The term "significant change" shall be construed to apply only to the following circumstances:

- (A) When the character of the work as altered differs materially in kind or nature from that involved or included in the original proposed construction or
- (B) When a major item of work, as defined elsewhere in the contract, is increased in excess of 125 percent or decreased below 75 percent of the original contract quantity. Any allowance for an increase in quantity shall apply only to that portion in excess of 125 percent of original contract item quantity, or in case of a decrease below 75 percent, to the actual amount of work performed.

RIGHT TO AUDIT

The Department shall have the right to audit the books and records of the contractor or any subcontractor under this contract or subcontract to the extent that the books and records relate to the performance of the contract or subcontract. The books and records shall be maintained by the contractor for a period of 3 years from the date of final payment under the prime contract and by the subcontractor for a period of 3 years from the date of final payment under the subcontract (29 Del.C. §6930)

PREVAILING WAGES

Included in this proposal are the minimum wages to be paid various classes of laborers and mechanics as determined by the Department of Labor of the State of Delaware in accordance with Title 29 Del.C. §6960, relating to wages and the regulations implementing that Section.

REQUIREMENT BY DEPARTMENT OF LABOR FOR SWORN PAYROLL INFORMATION

Title 29 Del.C. §6960 stipulates;

(b) Every contract based upon these specifications shall contain a stipulation that the employer shall pay all mechanics and laborers employed directly upon the site of the work, unconditionally and not less often than once a week and without subsequent deduction or rebate on any account, the full amounts accrued at time of payment, computed at wage rates not less than those stated in the specifications, regardless of any contractual relationship which may be alleged to exist between the employer and such laborers and mechanics. The specifications shall further stipulate that the scale of wages to be paid shall be posted by the employer in a prominent and easily accessible place at the site of the work, and that there may be withheld from the employer so much of accrued payments as may be considered necessary by the Department of Labor to pay to laborers and mechanics employed by the employer the difference between the rates of wages required by the contract to be paid laborers and mechanics on the work and rates of wages received by such laborers and mechanics to be remitted to the Department of Labor for distribution upon resolution of any claims.

(c) Every contract based upon these specifications shall contain a stipulation that sworn payroll information, as required by the Department of Labor, be furnished weekly. The Department of Labor shall keep and maintain the sworn payroll information for a period of 6 months from the last day of the work week covered by the payroll.

Bidders are specifically directed to note the Department of Labor's prevailing wage regulations implementing §6960 relating to the effective date of the wage rates, at Section 6.3, which in relevant part states:

"Public agencies (covered by the provisions of 29 Del.C. §6960) are required to use the rates which are in effect on the date of the publication of specifications for a given project. In the event that a contract is not executed within one hundred twenty (120) days from the date the specifications were published, the rates in effect at the time of the execution of the contract shall be the applicable rates for the project."

Contractor may contact:

Department of Labor, Division of Industrial Affairs, 4425 N. Market Street, Wilmington, DE 19802
Telephone (302) 761-8200

STATE OF DELAWARE
DEPARTMENT OF LABOR
DIVISION OF INDUSTRIAL AFFAIRS
OFFICE OF LABOR LAW ENFORCEMENT
PHONE: (302) 761-8200


Mailing Address:
4425 North Market Street
3rd Floor
Wilmington, DE 19802

Located at:
4425 North Market Street
3rd Floor
Wilmington, DE 19802

PREVAILING WAGES FOR HIGHWAY CONSTRUCTION EFFECTIVE MARCH 15, 2019

CLASSIFICATION	NEW CASTLE	KENT	SUSSEX
BRICKLAYERS	55.89	55.89	55.89
CARPENTERS	55.95	55.63	44.22
CEMENT FINISHERS	35.48	35.70	28.39
ELECTRICAL LINE WORKERS	29.40	47.49	23.24
ELECTRICIANS	70.49	70.49	70.49
IRON WORKERS	65.24	26.10	27.72
LABORERS	45.30	41.69	40.93
MILLWRIGHTS	17.62	17.10	14.76
PAINTERS	71.29	71.29	71.29
PILEDRIVERS	72.65	25.98	29.47
POWER EQUIPMENT OPERATORS	67.07	43.32	39.68
SHEET METAL WORKERS	24.89	22.21	20.12
TRUCK DRIVERS	37.52	30.88	37.62

CERTIFIED: 06/13/2019

BY: 
ADMINISTRATOR, OFFICE OF LABOR LAW ENFORCEMENT

NOTE: THESE RATES ARE PROMULGATED AND ENFORCED PURSUANT TO THE PREVAILING WAGE REGULATIONS ADOPTED BY THE DEPARTMENT OF LABOR ON APRIL 3, 1992.

CLASSIFICATIONS OF WORKERS ARE DETERMINED BY THE DEPARTMENT OF LABOR. FOR ASSISTANCE IN CLASSIFYING WORKERS, OR FOR A COPY OF THE REGULATIONS OR CLASSIFICATIONS, PHONE 302-761-8200

NON-REGISTERED APPRENTICES MUST BE PAID THE MECHANIC'S RATE.

PROJECT: T201606108.01 Pavement and Rehabilitation, North VIII, 2016, NCC, New Castle County

SUPPLEMENTAL SPECIFICATIONS TO THE STANDARD SPECIFICATIONS

**EFFECTIVE AS OF THE ADVERTISEMENT
DATE OF THIS PROPOSAL
AND INCLUDED BY REFERENCE**

**The Supplemental Specifications can be viewed and printed from
the Department's Website.**

To access the Website;

- in your internet browser, enter; <https://www.deldot.gov>
- under 'BUSINESS', Click; 'Publications'
- scroll down under 'MANUALS' and Click; "Standard Specifications"
- be sure and choose the correct Standard Specification year; 2001 or 2016
- choose the latest revision prior to the date of this advertisement

The full Website Link is;

https://www.deldot.gov/Publications/manuals/standard_specifications/index.shtml

Copies of the Supplemental Specifications can be printed from the Website.

The Contractor shall make himself aware of these revisions and corrections (Supplemental Specifications), and apply them to the applicable item(s) of this contract.

SPECIAL PROVISIONS

CONSTRUCTION ITEM NUMBERS

All construction pay items are assigned a six (6) digit number, shown as Item Number on the Plans and/or in the Special Provisions, and shall be interpreted in accordance with the following:

Standard Item Number:

The first three digits of the construction item numbers indicates the Section number as described in the Standard Specifications, and all applicable requirements of the Section shall remain effective unless otherwise modified by the Special Provisions. The last three digits of the construction item identifies the item by sequential number under that Section. A comprehensive list of construction item numbers are listed in the Standard Specifications. Additions to this list will be made as required.

Special Provisions Item Number:

The first three digits of the construction items, covered under Special Provisions, indicates the applicable Section number of the Standard Specifications, and shall be governed fully by the requirements of the Special Provisions. The last three digit of the items covered under Special Provisions identifies the item by sequential number.

Examples

Standard Item Number - 202000 Excavation and Embankment

202 Indicates Section Number

000 Indicates Sequential Number

Special Provision Item Number - 202500 Grading and Reshaping Roadway

202 Indicates Section Number

500 Indicates Sequential Number

401502 - ASPHALT CEMENT COST ADJUSTMENT

For Sections 304, 401, 402, 403, 404, and 405, payments to the Contractor shall be adjusted to reflect increases or decreases in the Delaware Posted Asphalt Cement Price when compared to the Project Asphalt Cement Base Price, as defined in these Special Provisions.

The Delaware Posted Asphalt Cement Price will be issued monthly by the Department and will be the industry posted price for Asphalt Cement, F.O.B. Philadelphia, Pennsylvania. The link for the [posting is here](#).

The Project Asphalt Cement Base Price will be the Delaware Posted Asphalt Cement Price in effect on the date of advertisement.

All deviations of the Delaware Posted Asphalt Cement Price from the Project Asphalt Cement Base Price are eligible for cost adjustment. No minimum increases or decreases or corresponding percentages are required to qualify for cost adjustment.

Actual quantity of asphalt cement qualifying for any Asphalt Cement Cost Adjustment will be computed using the weight of eligible asphalt that is shown on the QA/QC pay sheets as a percentage for the delivered material.

If the mix was not inspected and no QA/QC pay sheet was generated, then the asphalt percentage will be obtained from the job mix formula for that mix ID.

The asphalt percentage eligible for cost adjustment shall only be the virgin asphalt cement added to the mix.

There shall be no separate payment per ton cost of asphalt cement. That cost shall be included in the various unit prices bid per ton for those bid items that contain asphalt cement (mentioned above).

The Asphalt cement cost adjustment will be calculated on grade PG 64-22 asphalt regardless of the actual grade of asphalt used. The Project Asphalt Cement Base Price per ton for the project will be the Delaware Posted Asphalt Cement Price in effect on the date of project advertisement.

If the Contractor exceeds the authorized allotted completion time, the price of asphalt cement on the last authorized allotted work day, shall be the prices used for cost adjustment during the time liquidated damages are assessed. However, if the industry posted price for asphalt cement goes down, the asphalt-cement cost shall be adjusted downward accordingly.

NOTE:

Application of Asphalt Cement Cost Adjustment requirements as indicated above shall apply only to those contracts involving items related to bituminous base and pavements, and with bitumen, having a total of 1,000 tons or more of hot-mix bid quantity in case of Sections 401, 402 and 403; and 15,000 gallons or more in case of Sections 304, 404 and 405.

5/05/15

401580 - Ride Quality of Bituminous Pavement

Description:

This specification outlines requirements for an acceptable ride surface in addition to requirements established in DelDOT Standard Specifications. The Contractor is responsible for providing smoothness characteristics that meet these requirements. The Contractor is responsible for providing equipment, maintenance of traffic (MOT) as required by the Delaware MUTCD, and performing testing in accordance to this specification. All costs for testing and MOT are incidental to this item. Both the International Roughness Index (IRI) and deviations located within a 10' straightedge are used to characterize smoothness in this Special Provision.

Definitions:

Class 1 Project - a project that consists of full depth construction. Full depth construction is considered to be when contract documents or modifications provide opportunity for preparation of the subgrade prior to paving.

Class 2 Project - a project that consists of a minimum of two smoothness opportunities.

Class 3 Project - a project that consists of one smoothness opportunity.

Deviation - a hump or depression that exceeds defined tolerances.

Smoothness Opportunity - a smoothness opportunity is considered to be any of the following; roadway milling, placement of a leveling course, in-place recycling, or placement of a lift of bituminous concrete. The final wearing surface is considered one smoothness opportunity.

Equipment:

The Contractor must have a 10' straightedge available during all paving operations.

The Contractor must also have a high speed or lightweight inertial profiling system that meets requirements of AASHTO M328 capable of collecting data in both wheelpaths simultaneously.

Prior to the start of corrective actions, the Contractor must provide to the Engineer:

1. Manufacturer, Make, and Model of the test system
2. Equipment Owner,
3. Relevant Certifications,
4. Manufacturer Calibration Procedures, and
5. Relevant Operator Training information.

Testing:

The Contractor is responsible for testing the pavement surface using an approved inertial profiler in accordance to manufacturer and AASHTO R57 from the start of paving limits to the end of pavement limits. Testing must be performed 3 times in each lane paved in the direction of traffic flow. Testing must be performed within seven (7) days of completion of project paving operations in each location.

The Contractor is responsible for providing information relative to locations that are to be excluded from calculation of the International Roughness Index. These areas must still meet 10' straightedge requirements.

Areas that are to be tested but will be removed prior to IRI analysis are:

1. 50 feet prior to the first bridge deck expansion joint and 50 feet after the last expansion joint if a bridge deck is excluded from smoothness operations.
2. 50' longitudinally from the center of an existing obstruction within the test area such as a manhole, water main, or catch basin that impedes paving operations.

3. 50' longitudinally from transverse joints that separate it from existing pavement not included on this contract.

Areas that are not to be profiled but are still subject to 10' straightedge requirements are:

1. Shoulder areas
2. Parking lots
3. Ramps, Streets, or Acceleration / Deceleration lanes less than 1000' in length.

Submission Requirements:

Test results must be submitted to the Engineer within five working days of completion of testing. Results not received within the allotted time frame will be assessed a charge of \$1,000.00 per day at the discretion of the Engineer.

The Contractor is required to submit summary table IRI reports from their test equipment for 1 run for each lane and direction of paving. This report must also include:

1. Profiling Company Name
2. Date of Test
3. Contract Number
4. Location Description
5. Testing Personnel

The Contractor is required to submit ERD files for each of the 3 tests run in each lane and direction of paving to the Engineer for analysis.

The Contractor must provide to the Engineer written documentation indicating the start and end of bridges and the center of obstructions relative to the stationing used on the testing that are not subject to IRI analysis.

Acceptance and Payment:

Acceptance of the final pavement will be based on Engineer calculated IRI values using ProVAL software upon removal of allowable areas of exemption and the number of deviations found in the pavement surface.

The IRI measurements will be calculated in 0.1 mile (528 foot) sections for payment purposes. The average value of the three test runs will be used and the average value will be rounded to the nearest tenth.

Payments for each section will be based on estimated tonnage calculated from plan thickness and widths using the average maximum specific gravity ("Rice") for all surface mix used at that location.

Deviations equal to or in excess of 0.25" in 10' are to be corrected at the Contractor's expense or will have a discount charge of \$200.00 per deviation.

$$\text{Estimated Tonnage} = [L * W * T] * \text{Rice} * 62.4 \text{ (lb/ft}^3\text{)} * (0.0005 \text{ tons} / 12 \text{ in.})$$

Where: L = Length Segment (ft.)
W = Lane Width (ft.)
T = Plan Thickness (in.)

$$\text{IRI Incentive / Disincentive} = \text{Estimated Tonnage} * \text{UP} * (\text{PA}-100)/100$$

Where: UP = Contract Unit Price (Dollars)
PA = Pay Adjustment (Table A)

The total pay adjustment for paving work performed on each location is:

$$(\sum \text{IRI adj for each section}) - \text{Total Deviations} * 200$$

It is possible to receive incentive for IRI measurements and a discount charge for excessive deviations on the same project. If a 528' section has an IRI value resulting in a deduction of at least 84% of the section pay, the deviation discount charge for that section is disregarded and the IRI discount charge is the only action taken for that section.

Table A: Payment Adjustments for IRI	
Class 1	
IRI per 0.1 mile Segment (in./mi.)	Pay Adjustment
50	103%
> 50 and < 145	100+ 0.2(65- IRI)
145	84%
Class 2	
IRI per 0.1 mile Segment (in./mi.)	Pay Adjustment
60	106%
> 60 and < 170	100+ 0.2(90- IRI)
170	84%

Correction to the paving surface, such as diamond grinding with approved equipment, patching, or other measures may be taken at the Contractor's expense and at the Engineers discretion to correct pavement surfaces assessed a discount charge. The Engineer may require corrective actions including remove & replace if the deviation discount charge exceeds 50% of the cost of materials or the IRI pay adjustment is 84%. Deviations must be corrected if it is determined that they are at a height or depth that may create a safety concern.

4/10/2019

401696 – ENTRANCE, DRIVEWAY AND INTERSECTING STREET PAVING SURCHARGE

Description:

To compensate for work associated with paving the tie-ins at entrances, driveways and intersecting streets when such work cannot be completed as part of the mainline (roadway, auxiliary lanes, shoulder) paving operation. The surcharge limits will extend from the outermost roadway element to the point of tie-in as directed by the Engineer with the following exceptions.

No Surcharge will be paid:

1. When the tie-in does not exceed three feet from the outermost roadway element.
2. For paving any portion of a tie-in which exceeds 100 feet from the outermost roadway element. The entire tie-in section will be performed under normal paving operations.
3. When the intersecting street is to be paved under the same Contract.
4. For paving of auxiliary lanes and crossovers in the median of divided highways.

Method of Measurement:

The quantity of entrance, driveway and intersecting street paving surcharge will be measured as the actual number of tons of bituminous concrete placed and accepted in entrances, driveways and intersecting streets as described in this item.

Basis of Payment:

The quantity of entrance, driveway and intersecting street paving surcharge will be paid for at the Contract unit price per ton. Price and payment will constitute full compensation for the additional labor and equipment costs involved with the reduced production associated with such work.

10/12/17

401699 - QUALITY CONTROL/QUALITY ASSURANCE OF BITUMINOUS CONCRETE

.01 Description

This item shall govern the Quality Assurance Testing for supplying bituminous asphalt plant materials and constructing bituminous asphalt pavements and the calculation for incentives and disincentives for materials and construction. The Engineer will evaluate all materials and construction for acceptance. The procedures for acceptance are described in this Section. Include the costs for all materials, labor, equipment, tools, and incidentals necessary to meet the requirements of this specification in the bid price per ton for the bituminous asphalt. Payment to the Contractor for the bituminous asphalt item(s) will be based on the Contract price per ton and the pay adjustments described in this specification.

.02 Bituminous Concrete Production – Quality Acceptance

(a) Material Production - Tests and Evaluations.

All acceptance tests shall be performed by qualified technicians at qualified laboratories following AASHTO or DelDOT procedures, and shall be evaluated using Quality Level Analysis. The Engineer will conduct acceptance tests. The Engineer will directly base acceptance on the acceptance test results, the asphalt cement quality, the Contractor's QC Plan work, and the comparisons of the acceptance test results to the QC test results. The Engineer may elect to utilize test results of the Contractor in some situations toward judging acceptance.

Supply and capture samples, as directed by the Engineer under the purview of the Engineer from delivery trucks before the trucks leave the production plant. Hand samples to the Engineer to be marked accordingly. The sample shall represent the material produced by the Contractor, and shall be of sufficient size to allow the Engineer to complete all required acceptance tests. The Engineer will direct the Contractor when to capture these samples, on a statistically random, unbiased basis, established before production begins each day based upon the anticipated production tonnage. The captured sample shall be from the Engineer specified delivery truck. The Contractor may visually inspect the specified delivery load during sampling and elect to reject the load. If the contractor elects to reject the specified delivery truck, each subsequent load will be inspected until a visually acceptable load is produced for acceptance testing. All visually rejected loads shall not be sent to a Department project.

The first sample of the production day will be randomly generated by the Engineer between loads 0 and 12 (0-250 tons). Subsequent samples will be randomly generated by the Engineer on 500-ton sub-lots for the production day. Samples not retrieved in accordance with the Contractor's QC plan will be deemed unacceptable and may be a basis for rejection of material produced. Parallel tests or dispute resolution tests will only be performed on material captured at the same time and location as the acceptance test sample. Parallel test samples or Dispute Resolution samples will be created by splitting a large sample or obtaining multiple samples that equally represent the material. The Engineer will perform all splitting and handling of material after it is obtained by the Contractor.

The Contractor may retain dispute resolution samples or perform parallel tests with the Engineer on any acceptance sample.

The Engineer will evaluate and accept the material on a lot basis. All the material within a lot shall have the same JMF (mixture ID). The lot size shall be targeted for 2000 tons or a maximum period of three days, whichever is reached first. If the 2000th ton target lot size is achieved during a production day, the lot size shall extend to the end of that production day. The Contractor may interrupt the production of one JMF in order to produce different material; this type of interruption will not alter the determination of the size or limits of material represented by a lot. The Engineer will evaluate each lot on a subplot basis. The size for each subplot shall be 100 to 500 tons and testing for the sub lots will be completed on a daily basis. For each subplot, the Engineer will evaluate one sample.

The target size of sub-lots within each lot, except for the first sample of the production day, is equal-sized 500 ton sub lots and will be based upon anticipated production, however, more or fewer sublots, with differing sizes, may result due to the production schedule and conditions. If the actual production is less than anticipated, and it's determined a sample will not be obtained (based upon the anticipated tonnage), a new sample location will be determined on a statistically random, unbiased basis based upon the new actual

production. If the actual production is going to be 50 tons or greater over the anticipated sub lot production, a new sample location will be determined on a statistically random, unbiased basis based upon the new actual production. The Engineer will combine the evaluation and test results for all of the applicable sublots in order to evaluate each individual lot.

If the Engineer is present, and the quantity exceeds 25 tons, a statistically random sample will be used for analysis. When the anticipated production is less than 100 tons and greater than 25 tons, and the Engineer is not present, the contractor shall randomly select a sample using the Engineer's random location program. The captured sample shall be placed in a suitable box, marked to the attention of the Engineer, and submitted to the Engineer for testing. A box sample shall also be obtained by the contractor at the same time and will be used as the Dispute Resolution sample if requested by the Engineer. The Contractor shall also obtain one liquid asphalt sample (1 pint) per grade of asphalt used per day and properly label it with all pertinent information.

The Engineer will conduct the following tests in order to characterize the material for the pavement compaction quality and to judge acceptance and the pay adjustment for the material:

- AASHTO T312 - Preparing and Determining the Density of Hot Mix Asphalt (HMA) Specimens by Means of the Superpave Gyratory Compactor
- AASHTO T166, Method C (Rapid Method) - Bulk Specific Gravity of Compacted Hot Mix Asphalt (HMA) Using Saturated Surface Dry Specimens
- AASHTO T308 - Determining the Asphalt Binder Content of Hot Mix Asphalt (HMA) by the Ignition Method
- AASHTO T30 - Mechanical Analysis of Extracted Aggregate
- AASHTO T209 - Theoretical Maximum Specific Gravity and Density of Hot Mix Asphalt (HMA)
- ASTM D7227 - Standard Practice for Rapid Drying of Compacted Asphalt Specimens using Vacuum Drying Apparatus

(b) Pavement Construction - Tests and Evaluations.

The Engineer will directly base acceptance on the compaction acceptance test results, and on the inspection of the construction, the Contractor's QC Plan work, ride smoothness as referenced in the contract documents, lift thickness as referenced in the contract documents, joint quality as referenced in the contract documents, surface texture as referenced in the contract documents, and possibly the comparisons of the acceptance test results to the independent test results. For the compaction acceptance testing, the Engineer will sample the work on a statistically random basis, and will test and evaluate the work based on daily production.

Notify the Engineer of any locations within that road segment that may not be suitable to achieve minimum (93%) compaction due to existing conditions prior to paving the road segment. Schedule and hold a meeting in the field with the Engineer in order to discuss all areas that may potentially be applicable to Table 5a before paving starts. Areas that will be considered for Table 5a will be investigated in accordance to the method described in Appendix B. If this meeting is not held prior to paving, no areas will be considered for Table 5a. Areas of allowable exemptions that will not be cored include the following: partial-depth patch areas, driveway entrances, paving locations of less than 100 tons, areas around manholes and driveway entrances, and areas of paving that are under 400 feet in continuous total length and/or 5 feet in width.

The exempt areas around manholes will be a maximum of 4 feet transversely on either side from the center of the manhole, and 20 feet longitudinally on either side from the center of the manhole. The exempt areas around driveway entrances shall be the entire width of the driveway, and 3 feet from the edge of the longitudinal joint next to the driveway. Areas of exemption that will be cored for informational purposes only include: areas where the mat thickness is less than three times the nominal maximum aggregate size as directed by the Engineer, violations of Section 401.08 in the Standard Specifications as directed by the Engineer, and areas shown to contain questionable subgrade properties as proven by substantial yielding under a fully legally loaded truck. Failure to obtain core samples in these areas will result in zero payment for compaction regardless of the exempt status.

The Engineer will evaluate and accept the compaction work on a daily basis. Payment for the compaction will be calculated by using the material production lots as referenced in **.02 Acceptance Plan (a) Material Production - B Tests and Evaluation** and analyzing the compaction results over the individual days covered in the material production lot. The compaction results will be combined with the material results to obtain a payment for this item.

The minimum size of a compaction lot shall be 100 tons. If the compaction lot is between 101 and 1000 tons, the Engineer shall randomly determine four compaction acceptance test locations. If the compaction lot is between 1001 and 1500 tons, the Engineer shall randomly determine six compaction acceptance test locations. If the compaction lot is between 1501 and 2000 tons, the Engineer shall randomly determine eight compaction acceptance test locations. If the compaction lot is greater than 2000 tons, the Engineer shall randomly determine two compaction acceptance test locations per 500 tons.

If a randomly selected area falls within an Engineer approved exemption area, the Engineer will select one more randomly generated location to be tested per the requirements of this Specification. If that cannot be accomplished, or if an entire location has been declared exempt, the compaction testing shall be performed as per these Specifications but a note will be added to the results that the location was an Engineer approved exempt location.

Testing locations will be a minimum of 1.0 feet from the newly placed longitudinal joint and 50 feet from a new transverse joint.

Cut one six (6) inch diameter core through the full lift depth at the exact location marked by the Engineer. Cores submitted that are not from the location designated by the Engineer will not be tested and will be paid at zero pay.

Notify the Engineer prior to starting paving operations with approximate tonnage to be placed. The Contractor is then responsible for notifying the appropriate Engineer test personnel within 12 hours of material placement. The Engineer will mark core locations within 24 hours of notification. After determination of locations, the Contractor shall complete testing within two operational days of the locations being marked. If the cores are not cut within two operational days, the area in question will be paid at zero pay for compaction testing.

Provide any traffic control required for the structural number investigation, sampling, and testing work at no additional cost to the Department.

Commence coring of the pavement after the pavement has cooled to a temperature of 140°F or less. Cut each core with care in order to prevent damaging the core. Damaged cores will not be tested. Label each core with contract number, date of construction, and number XX of XX upon removal from the roadway Place cores in a 6-inch diameter plastic concrete cylinder mold or approved substitute for protection. Separate cores in the same cylinder mold with paper. Attach a completed QC test record for the represented area with the corresponding cores. The Engineer will also complete a test record for areas tested for the QA report and provide to Materials & Research. Deliver the cores to the Engineer for testing, processing, and report distribution at the end of each production day.

Repair core holes per Appendix A, Repairing Core Holes in Bituminous Asphalt Pavements. Core holes shall be filled immediately. Failure to repair core holes at the time of coring will result in zero pay for compaction testing for the area in question.

The Engineer will conduct the following tests on the applicable portion of the cores in order to evaluate their quality:

- AASHTO T166, Method C (Rapid Method) – Bulk Specific Gravity of Compacted Hot Mix Asphalt (HMA) Using Saturated Surface Dry Specimens
- AASHTO T209 - Theoretical Maximum Specific Gravity and Density of Hot Mix Asphalt
- ASTM D7227 - Standard Practice for Rapid Drying of Compacted Asphalt Specimens using Vacuum Drying Apparatus

The Engineer will use the average of the last five test values of the same JMF (mixture ID) material at the production plant in order to calculate the average theoretical maximum specific gravity of the cores. The average will be based on the production days test results and as many test results needed from previous days

production to have an average of five samples. If there are less than five values available, the Engineer will use the JMF design value in addition to the available values to calculate the average theoretical maximum specific gravity.

.03 Payment and Pay Adjustment Factors.

The Engineer will determine pay adjustments for the bituminous asphalt item(s) in accordance with this specification. The Engineer will determine a pay adjustment factor for the material produced and a pay adjustment factor for the pavement construction. Pay adjustments for material and construction will be calculated independently. When the pay adjustment calculation for either material or construction falls to zero payment per tables 4, 5, or 5a, the maximum pay adjustment for the other factor will not exceed 100.

Pay Adjustment factors will only be calculated on in place material. Removed material will not be used in payment adjustment calculations.

Material Production Pay Adjustments will be calculated based upon 70% of the contract unit price and calculated according to section .03(a) of this specification. Pavement construction Pay Adjustments will be calculated based upon 30% of the contract unit price and calculated according to section .03(b) of this specification.

(a) Material Production - Pay Adjustment.

Calculate the material pay adjustment by evaluating the production material based on the following parameters:

Table 2 - Material Parameter Weight Factors		
Material Parameter	Single Test Tolerance (+/-)	Weight Factor
Asphalt Content	0.4	0.30
#8 Sieve (>=19.0 mm)	7.0	0.30
#8 Sieve (<=12.5 mm)	5.0	0.30
#200 Sieve (0.075mm Sieve)	2.0	0.30
Air Voids (4.0% Target)	2.0	0.10

Using the JMF target value, the single test tolerance (from Table 2), and the test values, the Engineer will use the following steps to determine the material pay adjustment factor for each lot of material:

1. For each parameter, calculate the mean value and the standard deviation of the test values for the lot to the nearest 0.1 unit.
2. For each parameter, calculate the Upper Quality Index (QU):

$$QU = ((\text{JMF target}) + (\text{single test tolerance}) - (\text{mean value})) / (\text{standard deviation}).$$
3. For each parameter, calculate the Lower Quality Index (QL):

$$QL = ((\text{mean value}) - (\text{JMF target}) + (\text{single test tolerance})) / (\text{standard deviation}).$$
4. For each parameter, locate the values for the Upper Payment Limit (PU) and the Lower Payment Limit (PL) from Table 3 - Quality Level Analysis by the Standard Deviation Method. (Use the column for “n” representing the number of sublots in the lot. Use the closest value on the table when the exact value is not listed).
5. Calculate the PWL for each parameter from the values located in the previous step:

$$PWL = PU + PL - 100.$$
6. Calculate each parameter’s contribution to the payment adjustment by multiplying its PWL by the weight factor shown in Table 2 for that parameter.
7. Add the calculated adjustments of all the parameters together to determine the Composite PWL for the lot.
8. From Table 4, locate the value of the Pay Adjustment Factor corresponding to the calculated PWL. When all properties of a single test are within the single test tolerance of Table 2, Pay

Adjustment factors shall be determined by Column B. When any property of a single test is outside of the Single Test Tolerance parameters defined in Table 2, the Material Pay Adjustment factor shall be determined by Column C.

9. For each lot, determine the final material price adjustment:

Final Material Pay Adjustment =

(Lot Quantity) x (Item Bid Price) x (Pay Adjustment Factor) x 70%. This final pay calculation will be paid to the cent.

In lieu of being assessed a pay adjustment penalty, the Contractor may choose to remove and replace the material at no additional cost to the Department. When the PWL of any material parameter in Table 2 is below 60, the Engineer may require the removal and replacement of the material at no additional cost to the Department. Test results on removed material shall not be used in calculation of future PWL calculations for Mixture ID.

The test results from the Engineer on production that is less than 100 tons will be combined with the two most recently completed Engineer tests with the same Mixture ID to calculate payment for the lot encompassing the single test. If that cannot be accomplished, the approved JMF will be used to calculate payment for the lot encompassing the single test. Payment for previously closed lots will not be affected by the analysis.

When a sample is outside of the allowable single test tolerance for any Materials criteria in Table 2, that sample will be isolated. For payment purposes, the test result of the out of acceptable tolerance sample will be combined with the two previous acceptable samples of the same JMF and analyzed per this specification. The material that is considered out of the acceptable tolerance will only include the material within the represented sub-lot (i.e., a maximum of 500 tons). If the previous acceptable test result is from the previous production day, only the material produced on the second production day will be considered out of tolerance. All future sub lots will not include the isolated test. The pay factors for the out of tolerance sample lot will be calculated using column C of table 4.

If, during production, a QA sample test result does not meet the acceptable tolerances and the Contractors QC sample duplicates the QA sample test result, the Contractor can make an appropriate change to the mixture (within the JMF boundaries), and request to have that sample further isolated. After the Contractor has made appropriate changes, the Contractor will visually inspect each produced load. The first visually acceptable load will be sampled and tested. If that sample test result shows compliance with the specifications, the material that is considered out of the acceptable tolerance will include the material from the previous acceptable test result to the third load after the initially sampled and tested sample. If the sample does not meet the specification requirements, the Engineer will no longer accept material. Production may resume when changes have been made and an acceptable sample and test result is obtained.

Table 3 - Quality Level Analysis by the Standard Deviation Method							
PU or PL	QU and QL for "n" Samples						
	n = 3	n = 4	n = 5	n = 6	n = 7	n = 8	n = 9
100	1.16	1.50	1.79	2.03	2.23	2.39	2.53
99	-	1.47	1.67	1.80	1.89	1.95	2.00
98	1.15	1.44	1.60	1.70	1.76	1.81	1.84
97	-	1.41	1.54	1.62	1.67	1.70	1.72
96	1.14	1.38	1.49	1.55	1.59	1.61	1.63
95	-	1.35	1.44	1.49	1.52	1.54	1.55
94	1.13	1.32	1.39	1.43	1.46	1.47	1.48
93	-	1.29	1.35	1.38	1.40	1.41	1.42
92	1.12	1.26	1.31	1.33	1.35	1.36	1.36
91	1.11	1.23	1.27	1.29	1.30	1.30	1.31
90	1.10	1.20	1.23	1.24	1.25	1.25	1.26
89	1.09	1.17	1.19	1.20	1.20	1.21	1.21

88	1.07	1.14	1.15	1.16	1.16	1.16	1.17
87	1.06	1.11	1.12	1.12	1.12	1.12	1.12
86	1.04	1.08	1.08	1.08	1.08	1.08	1.08
85	1.03	1.05	1.05	1.04	1.04	1.04	1.04
84	1.01	1.02	1.01	1.01	1.00	1.00	1.00
83	1.00	0.99	0.98	0.97	0.97	0.96	0.96
82	0.97	0.96	0.95	0.94	0.93	0.93	0.93
81	0.96	0.93	0.91	0.90	0.90	0.89	0.89
80	0.93	0.90	0.88	0.87	0.86	0.86	0.86
79	0.91	0.87	0.85	0.84	0.83	0.82	0.82
78	0.89	0.84	0.82	0.80	0.80	0.79	0.79
77	0.87	0.81	0.78	0.77	0.76	0.76	0.76
76	0.84	0.78	0.75	0.74	0.73	0.73	0.72
75	0.82	0.75	0.72	0.71	0.70	0.70	0.69
74	0.79	0.72	0.69	0.68	0.67	0.66	0.66
73	0.75	0.69	0.66	0.65	0.64	0.63	0.63
72	0.74	0.66	0.63	0.62	0.61	0.60	0.60
71	0.71	0.63	0.60	0.59	0.58	0.57	0.57
70	0.68	0.60	0.57	0.56	0.55	0.55	0.54
69	0.65	0.57	0.54	0.53	0.52	0.52	0.51
68	0.62	0.54	0.51	0.50	0.49	0.49	0.48
67	0.59	0.51	0.47	0.47	0.46	0.46	0.46
66	0.56	0.48	0.45	0.44	0.44	0.43	0.43
65	0.52	0.45	0.43	0.41	0.41	0.40	0.40
64	0.49	0.42	0.40	0.39	0.38	0.38	0.37
63	0.46	0.39	0.37	0.36	0.35	0.35	0.35
62	0.43	0.36	0.34	0.33	0.32	0.32	0.32

Table 3 - Quality Level Analysis by the Standard Deviation Method							
PU or PL	QU and QL for "n" Samples						
	n = 3	n = 4	n = 5	n = 6	n = 7	n = 8	n = 9
61	0.39	0.33	0.31	0.30	0.30	0.29	0.29
60	0.36	0.30	0.28	0.27	0.27	0.27	0.26
59	0.32	0.27	0.25	0.25	0.24	0.24	0.24

Table 4 - PWL Pay Adjustment Factors		
PWL	Pay Adjustment Factor (%) Column B	Pay Adjustment Factor (%) Column C
100	+5	0
99	+4	-1
98	+3	-2
97	+2	-3
96	+1	-4

95	0	-5
94	-1	-6
93	-2	-7
92	-3	-8
91	-4	-9
PWL<91	PWL - 100	PWL - 100

(b) Pavement Construction - Pay Adjustments.

The Engineer will determine the pavement construction pay adjustment by evaluating the construction of the pavement, based on the following parameter:

- Degree of compaction of the in-place material

Using the test values for the cores, the Engineer will use the following steps to determine the pavement construction pay adjustment for each lot of work.

1. Calculate the core bulk specific gravity values from the subplot tests values, to the nearest 0.001 unit. Obtain the Theoretical maximum Specific Gravity values from the corresponding laboratory subplot tests.
2. Calculate the Degree of Compaction:
Degree of Compaction =
((Core Bulk Specific Gravity) / (Theoretical Maximum Specific Gravity)) x 100% recorded to the nearest 0.1%.
3. The average compaction for the sublots shall be averaged together for the compaction level of the lot. The lots compaction test level shall be averaged and recorded to the nearest whole percent.
4. Locate the value of the Payment Adjustment Factor corresponding to the calculated degree of compaction from Table 5 or Table 5a.
5. Determine the pavement construction price adjustment by using the following formula:
Construction Pay adjustment = (Lot Quantity) x (Bid Price) x (Pay Adjustment Factor) x 30%.

Degree of Compaction (%)	Range	Pay Adjustment Factor (%)
>= 97.0	>= 96.75	-100*
96.5	96.26 – 96.74	-5
96.0	95.75 – 96.25	-3
95.5	95.26 – 95.74	-2
95.0	94.75 – 95.25	0
94.5	94.26 – 94.74	0
94.0	93.75 – 94.25	1

93.5	93.26 – 93.74	3
93.0	92.75 – 93.25	5
92.5	92.26 – 92.74	3
92.0	91.75 – 92.25	0
91.5	91.26 – 91.74	0
91.0	90.75 – 91.25	-5
90.5	90.26 – 90.74	-15
90.0	89.75 – 90.25	-20
89.5	89.26 – 89.74	-25
89.0	88.75 – 89.25	-30
88.5	88.26 – 88.74	-50
≤88.0	≤88.25	-100*

* or remove and replace it at Engineer's discretion

Table 5A: Compaction Price Adjustment Other¹ Locations		
Degree of Compaction	Range	Pay Adjustment Factor (%)
≥ 97.0	≥ 96.75	-100*
96.5	96.26 – 96.74	-5
96.0	95.75 – 96.25	-3
95.5	95.26 – 95.74	-2
95.0	94.75 – 95.25	0
94.5	94.26 – 94.74	0
94.0	93.75 – 94.25	0
93.5	93.26 – 93.74	1
93.0	92.75 – 93.25	3
92.5	92.26 – 92.74	1
92.0	91.75 – 92.25	0
91.5	91.26 – 91.74	0
91.0	90.75 – 91.25	0
90.5	90.26 – 90.74	0
90.0	89.75 – 90.25	0
89.5	89.26 – 89.74	0
89.0	88.75 – 89.25	-1
88.5	88.26 – 88.74	-3

88.0	87.75 – 88.25	-5
87.5	87.26 – 87.74	-10
87.0	86.75 – 87.25	-15
86.5	86.26 – 86.74	-20
86.0	85.75 – 86.25	-25
85.5	85.26 – 85.74	-30
85.0	84.75 – 85.25	-40
84.5	84.26 – 84.74	-50
=< 84.0	=<84.25	-100*

* or remove and replace at Engineer's discretion

¹ This chart is to be used for areas where the structural value of the area to be paved is less than 1.75 as determined by the Engineer. See Appendix B - Method for Obtaining Cores for Determination of Roadway Structure. This chart is applicable to rehabilitation work only; full depth construction will not be considered for Table 5a.

.04 Dispute Resolution.

Disputes or questions about any test result shall be brought to the attention of the Contractor and the Engineer within two operational days of reported test results. The following dispute resolution procedures will be used.

The Engineer and the Contractor will review the sample quality, the test method, the laboratory equipment, and the laboratory technician. If these factors are not the cause of the dispute, a third party dispute resolution will be used.

Third party resolution testing can be performed at either another Contractor's laboratory, the Engineer's laboratory, or an independent accredited laboratory. Unless otherwise mutually agreed upon by DAPA and the Engineer, the Engineer's qualified laboratory in Dover and qualified personnel shall conduct the necessary testing for third party Dispute Resolution after the Engineer has provided reasonable notice to allow the Contractor to witness this testing.

When disputes over production testing occur, the samples used for Dispute Resolution testing will be those samples the properly captured, labeled, and stored, as described in the second paragraph of the section of these specifications titled **.02 Acceptance Plan, (a) Material Production - Tests and Evaluations**. If no samples are available, the original testing results will be used for payment calculations.

Dispute Resolution samples for air void content will be heated by a microwave oven.

If there is a discrepancy between the Engineer's acceptance test result and the Contractor's test result, the Contractor may ask for the Dispute Resolution sample to be tested. The Contractor may request up to two dispute resolution samples be tested per calendar year without charge. Any additional Dispute Resolution samples run at the Contractors request where the results substantiate the acceptance test result will be assessed a fee of \$125. Any additional Dispute Resolution samples that substantiate the Contractors test result will not be assessed the fee.

When disputes over compaction core test results occur, the Engineer's acceptance core will be used for the dispute resolution sample. The Contractor will be advised on when the testing will occur as referenced above to witness the testing. The results of the dispute resolution testing shall replace all of the applicable disputed test results for payment purposes.

Appendix A - Repairing Core Holes in Bituminous Asphalt Pavement

Description.

This appendix describes the procedure required to repair core holes in a bituminous concrete pavement.

Materials and Equipment.

The following material shall be available to complete this work:

- Patch Material - DelDOT approved High Performance Cold Patch material shall be used.

The following equipment shall be available to complete this work:

- Sponge or other absorbent material - Used to extract water from the hole.
- Compaction Hammer - mechanical (electrical, pneumatic, or gasoline driven) tamping device with a flat, circular tamping face smaller than 6 inches in diameter.

Construction Method.

After core removal from the hole, remove all excess water from within the hole, and prevent water from re-entering the hole.

Place the patch material in lifts no greater than 3 inches and compact with mechanical tamping device. If the hole is deeper than 3 inches, use two lifts of approximately equal depths so that optimum compaction is achieved. Make sure that the patch surface matches the grade of the existing roadway. Make every effort to achieve the greatest possible compaction

Performance Requirements.

The Engineer will judge the patch on the following basis:

- The patch shall be well compacted
- The patch surface shall match the grade of the surrounding roadway surface.

Basis of Payment.

No measurement or payment will be made for the patching work. The Contractor must gain the Engineer's acceptance of the patching work before the Engineer will accept the material represented by the core.

Appendix B - Method for Obtaining Cores for Determination of Roadway Structure

The Contractor is responsible for obtaining cores in areas that they propose are eligible for compaction price adjustments according to Table 5a in this specification. Table 5a is not applicable for new full-depth pavement box construction. Cores submitted for this process shall be obtained according to the following process.

1. Contact Materials & Research (M&R) personnel to determine if information about the area is already available. If M&R has already obtained cores in the location that is being investigated, the contractor may opt to use the laboratory information for the investigation and not core the area on their own.
2. If M&R does not have information concerning the section of the roadway, the contractor needs to contact M&R to arrange for verification of coring operations. Arrangements shall be made to allow for an individual from M&R to be on the site when the cores are obtained. Cores will be turned over to M&R for evaluation.
3. The Contractor is responsible for providing all traffic control and repairing core holes in accordance to 401699 Appendix A - Repairing Core Holes in Bituminous Asphalt Pavements.
4. Cores are to be taken throughout the entire project for the area in question. Cores will be spaced, from the start of the project in increments determined based on field and project specifics. Cores will be evenly distributed throughout the project location. The cores will be taken in the center of the lane in question.
5. Additional cores may be taken at other locations, if surface conditions indicate that there may be a substantial difference in the underlying section. The location of these cores should be documented and submitted to M&R.
6. Cores shall be full depth and include underlying materials. If there is a stone base included in the pavement section, at a minimum 1 core must have information concerning the thickness of the base. This is determined by augering to the subgrade surface.
7. The calculations used to determine the structural capacity of the roadway is as follows. If the contractor finds, upon starting the coring process, that the areas are of greater thickness than applicable to Table 5a, they may terminate the coring process on their own and retract the request.

Structural Number Calculations

Each pavement box material is assigned a structural coefficient based upon AASHTO design guides. The structural coefficient is used to determine the total strength of the pavement section.

Materials used in older pavement sections are assigned lower structural coefficients to compensate for aging of the materials. The coefficients used to determine the structural number of an existing pavement are:

Existing Material	Structural Coefficient
HMA	0.32
Asphalt Treated Base	0.26
Soil Cement	0.16
Surface Treatment (Tar & Chip)	0.10
GABC	0.14
Concrete	0 - 0.7*

* The Structural Coefficient of Concrete is dependent upon the condition of the concrete. Compressive strengths & ASR analysis are used to determine condition - contact the Engineer if this situation arises.

Newly placed materials use a different set of structural coefficients. They are as follows:

New Material	Structural Coefficient
HMA	0.40
Asphalt Treated Base (BCBC)	0.32
Soil Cement	0.20
GABC	0.14

Example:

Location includes placement of a 1.25" Type C overlay on 2.25" Type B. Existing roadway is cored and is shown to consist of 2" HMA on 7" GABC.

Calculation:

For the Type B lift the calculation would be:

Existing HMA	2 * 0.32	=	0.64
GABC	7 * 0.14	=	0.98
			<hr/>
			1.62

For the Type C lift the calculation would be:

Newly Placed B	2.25 * 0.4	=	0.90
Existing HMA	2 * 0.32	=	0.64
GABC	7 * 0.14	=	0.98
			<hr/>
			2.52

11/3/14

503503 - PATCHING CONCRETE

Description:

This item consists of furnishing and placing Portland Cement Concrete, conforming to the requirements of Section 503 of the Standard Specifications and/or as modified herein under this Contract. After removal of the existing P.C.C. pavement, if the base material is unsuitable or washed out, the unsuitable material shall be excavated and the void replaced with the same concrete used in the patch area. This additional depth shall not exceed 6" from the bottom of the existing P.C.C. Pavement. Excessive moisture remaining after excavation, shall require construction of a pipe underdrain system, when directed by the Engineer and as shown on the Plans. All excavation below the bottom of existing pavement shall be paid for under the item "Undercut Excavation, Patching".

This item may also be used in areas of composite pavements (hot-mix over concrete) if the Contractor elects to pour concrete patch flush with existing hot-mix pavement to eliminate grade differential. This additional depth shall be as directed by the Engineer, but shall not exceed 6" in depth.

Method of Measurement:

The quantity of concrete patching will be measured as the actual number of square yards per inch of thickness of additional thickness either above or below the existing concrete pavement. The area measured shall be the square yards on the surface of the base course and the depth measured in inches from either top or bottom of the original P.C.C. pavement as determined from the adjacent pavement. The depth shall be as directed by the Engineer, but shall not exceed 6" in measurement or payment.

Basis of Payment:

The quantity of concrete patching will be paid for at the Contract fixed price of \$5.65 per square yard per inch of thickness. Price and payment will constitute full compensation for furnishing and placing additional depth of concrete as described above, for all labor, tools, equipment, and incidentals to complete the item.

NOTE

Also, under the items 503001 - Patching P.C.C. Pavement, 6" to 15", Type A and 503002 - Patching P.C.C. Pavement, Greater than 15" to 100", Type B, the Contractor shall be paid for the additional thickness of concrete actually poured in the field above the thickness specified on the P.C.C. Patching Plans at a fixed rate of \$5.65 per square yard per inch of thickness.

4/07/17

602502 - CONVERTING EXISTING CATCH BASIN TO MANHOLE

Description:

This work consist of furnishing all materials, and constructing a manhole from an existing catch basin in accordance with the locations, notes and details shown on the Plans, and as directed by the Engineer.

Materials and Construction Methods:

Materials and construction methods shall conform to the applicable requirements of Section 602 of the Standard Specifications, and as specified on the Plans.

Portland Cement Concrete shall meet the requirements of Class B, Section 1022 of the Standard Specifications.

Method of Measurement:

The quantity of catch basins converted to manholes will be measured as the number of catch basins converted to manholes and accepted.

Basis of Payment:

The quantity of catch basins converted to manholes will be paid for at the Contract unit price per each. Price and payment will constitute full compensation for constructing the manhole from the existing catch basin, for all materials including reinforcing steel, cover & frames and for all labor, equipment, tools, and incidentals necessary to complete the item. The cost for salvaging and delivering gratings to the location as specified on the Plans shall be included in the unit price bid for the item.

4/9/2018

705504 - BRICK AND/OR BLOCK SIDEWALK
705506 - BRICK AND/OR BLOCK ROADWAY

Description:

This work consists of furnishing all materials and constructing brick and/or block sidewalk/roadway in accordance with these specifications and in reasonably close conformity with the lines, grades, dimensions, and notes on the Plans and as established by the Engineer.

Materials:

The brick/block, referred to as "pavers" elsewhere in this special provision, shall be the shape, style, size and color as specified on the Plans.

1. If the pavers specified are concrete unit pavers, they shall have an average compressive strength of 8000 psi (55 MPa) with no single paver having a compressive strength less than 7200 psi (52 MPa) at the time of delivery to the project. The pigment loading shall be a minimum of 3% and the pigmentation shall be uniform throughout the paver.

2. If the pavers specified are clay brick, the pavers shall meet the requirements of ASTM C902, Class SX, Type I.

In cases of existing sidewalk, the new pavers shall match the existing bricks in material, color and size, unless noted otherwise on the Plans.

If the Plans are silent regarding pavers, the Contractor shall supply clay brick in a color approved by the Engineer.

Sample pavers shall be submitted for approval and if requested by the Engineer, 3' x 3' (0.9 m x 0.9 m) sample panels shall be constructed for approval.

The edge restraint system shall be as specified on the Plans or as recommended by the paver manufacturer, whichever is stronger.

Sand for bedding shall conform to the requirements of Section 804 - Fine Aggregate.

Sand for filling joints shall conform to the requirements of Section 818 - Mortar Sand.

Portland Cement Concrete for sidewalk shall conform to the requirements of Section 812, Class B.

Expansion for sidewalk shall conform to the requirements of Subsection 808.06.

The asphalt setting bed for roadway shall be as recommended by the paver manufacturer.

Construction Methods:

Place concrete for sidewalk to depths shown on plans and construct in accordance with Section 705 of the Standard Specifications.

Install the edge restraint system on the approved base as shown on the Plans where existing conditions do not provide edge restraint.

Spread a leveling course of bedding sand 1 to 1 1/2 inches (25 to 38 mm) thick, taking care that moisture is constant and the density is loose until the unit pavers are set and compacted. Place a material such as geotextile, or other approved material at curb joints to prevent sand from bleeding through.

Place pavers in patterns as designated on the Plans. If a joint spacing is not noted on the Plans, place the pavers with a tight joint. Select pavers from 4 or more cubes to blend color and texture variations. Do not use pavers with chips, cracks, discolorations, or other defects. Cut pavers with a motor driven masonry wet

saw to provide clean, sharp, unchipped edges. Cut pavers to fit pattern specified and to neatly fit adjoining material.

Vibrate the pavers into the sand leveling course with a low amplitude plate vibrator capable of a 3,500 to 5,000 pound (1,600 to 2,300 kg) compaction force. Perform at least 3 passes across paving with vibrator. Protect paver face and edges by spreading a cushion of sand over the surface. Be careful not to destroy edges.

Spread dry sand and fill joints immediately after vibrating the pavers into leveling course. Brush and vibrate sand until joints are completely filled, then remove excess sand.

Prior to acceptance, any pavers that are chipped, broken, stained, or damaged shall be replaced at the contractor's expense.

Method of Measurement:

The quantity of brick and/or block paving will be measured as the number of square feet (square meters) of sidewalk and/or roadway completed in-place and accepted.

Basis of Payment:

The quantity of brick and/or block paving will be paid for at the Contract unit price per square foot (square meter). Price and payment will constitute full compensation for excavation, furnishing and installing portland cement concrete, expansion material, brick pavers, restraint system, bedding sand, asphalt setting bed, geotextile and sand for filling joints and for all labor, equipment, tools, and incidentals necessary to complete the work.

5/29/2019

705505 - RESET STONE/BRICK SIDEWALK AND/OR STONE/BRICK ROADWAY

Description:

This work consists of removing and resetting the existing stone/brick sidewalk and/or roadway in accordance with details, notes on the Plans and as directed by the Engineer.

Materials and Construction Method:

The stone/brick blocks from the existing sidewalks and/or roadway shall be removed, cleaned and stored for later use. Sand and/or mortar required for setting the stones/bricks shall comply with the applicable requirements of Section 610 of the Standard Specifications.

The installation pattern and spacing of stones/bricks shall match the existing sidewalk and/or roadway setting, unless otherwise specified on the Plans. The stones/bricks shall be set on an approved compacted foundation with 2" (50 mm) of sand over it. Joint filler material (sand or mortar) shall be compatible with the original sidewalk and/or roadway. Portland Cement Concrete base shall conform to the requirements of Section 812, Class B.

After completion of stone/brick setting, the sidewalk and/or roadway surface area shall be thoroughly cleaned of mortar and/or as applicable to the contract.

Method of Measurement:

The quantity of stone/brick sidewalk and/or roadway reset will be measured as the number of square feet (square meters) measured at the surface of the sidewalk and/or roadway, reset and accepted.

Basis of Payment:

The quantity of stone/brick sidewalk and/or roadway reset will be paid for at the Contract unit price per square foot (square meter). Price and payment will constitute full compensation for removal, storage and cleaning of stones/bricks, furnishing and installing all materials including Portland cement concrete, expansion material, restraint system, bedding sand, asphalt setting bed; resetting and cleaning the sidewalk and/or roadway, disposal of discarded materials, for all labor, tools, equipment, and all necessary incidentals to complete the work. The cost of providing replacement stone/brick for those which are damaged is incidental to this item.

5/29/19

711500 - ADJUST AND REPAIR EXISTING SANITARY MANHOLE

Description:

This work consists of adjusting and repairing existing sanitary manholes in accordance with notes and details on the Plans and as directed by the Engineer.

Materials and Construction Methods:

Materials and construction methods shall conform to the applicable requirements of Section 711 of the Standard Specifications, and the Standard Specifications of the owner of the sewer system. If there is a conflict between the Department's Specifications and the Specifications of the owner, the latter will prevail.

Method of Measurement and Basis of Payment:

The method of measurement and basis of payment for the item shall be made in accordance with Subsections 711.04 and 711.05 of the Standard Specifications.

1/4/17

763501 - CONSTRUCTION ENGINEERING

Description:

This work consists of construction lay out including; stakes, lines and grades as specified below. Subsection 105.10 Construction Stakes, Lines and Grades of the Standard Specifications is voided.

Based on contract plans and information provided by the Engineer, the Contractor shall stake out right-of-way and easements lines, limits of construction and wetlands, slopes, profile grades, drainage system, centerline or offset lines, benchmarks, structure working points and any additional points to complete the project.

The Engineer will only establish the following:

- (a) Original and final cross-sections for borrow pits.
- (b) Final cross-sections: Top and bottom pay limit elevations for all excavation bid items that are not field measured by Construction inspection personnel. The Contractor shall notify the Engineer when these pay limit elevations are ready and allow for a minimum of two calendar days for the Engineer to obtain the information.
- (c) Line and grade for extra work added on to the project plans.

Equipment. The Contractor shall use adequate equipment/instruments in a good working order. He/she shall provide written certification that the equipment/instrument has been calibrated and is within manufacturer's tolerance. The certification shall be dated a maximum of 9 months before the start of construction. The Contractor shall renew the certification a minimum of every 9 months. The equipment/instrument shall have a minimum measuring accuracy of $[3\text{mm}+2\text{ppm}\times\text{D}]$ and an angle accuracy of up to 2.0 arc seconds or 0.6 milligons. If the Contractor chooses to use GPS technology in construction stakeout, the Contractor shall provide the Engineer with a GPS rover and Automatic Level for the duration of the contract. The GPS rover shall be in good working condition and of similar make and model used by the Contractor. The Contractor shall provide up to 8 hours of formal training on the Contractor's GPS system to a maximum of four Engineer's appointees (DELDOT Construction Inspectors). At the end of the contract, the Engineer will return the GPS rover to the Contractor. If any of the equipment/instruments are found to be out of adjustment or inadequate to perform its function, such instrument or equipment shall be immediately replaced by the Contractor to the satisfaction of the Engineer. Choosing to use GPS technology does not give the contractor authority to use machine control.- Construction Engineering (GPS) Machine Control Grading shall only be used if noted in the General Notes in the plan set outlining the available files that will be provided to the Contractor and "the Release for delivery of documents in electronic form to a contractor" are signed by all parties prior to delivery of any electronic files. Only files designated in the General Notes shall be provided to the contractor. If machine control grading is allowed on the project see the "machine control" section of this specification. GPS technology and machine control technology shall not be used in the construction of bridges.

Engineering/Survey Staff. The Contractor shall provide and have available for the project an adequate engineering staff that is competent and experienced to set lines and grades needed to construct the project. The engineering personnel required to perform the work outlined herein shall have experience and ability compatible with the magnitude and scope of the project. Additionally, the Contractor shall employ an engineer or surveyor licensed in the State of Delaware to be responsible for the quality and accuracy of the work done by the engineering staff. When individuals or firms other than the Contractor perform any professional services under this item, that work shall not be subject to the sub contracting requirements of Subsection 108.01 of the Standard Specifications. The Contractor shall assume full responsibility for any errors and/or omissions in the work of the engineering staff described herein. If construction errors are caused due to erroneous work done under Construction Engineering the Contractor accepts full responsibility, no matter when the error is discovered. Consideration will not be given for any extension of contract time or additional compensation due to delays, corrective work, or additional work that may result from faulty and erroneous construction stakeout, surveying, and engineering required by this specification.

Construction Methods:

Performance Requirements:

- (a) Construction Engineering shall include establishing the survey points and survey centerlines; finding, referencing, offsetting the project control points; running a horizontal and vertical circuit to verify the precision of given control points. Establishing plan coordinates and elevation marks for culverts, slopes, subbase, subsurface drains, paving, subgrade, retaining walls, and any other stakes required for control lines and grades; and setting vertical control elevations, such as footings, caps, bridge seats and deck screed. The Contractor shall be responsible for the preservation of the Department's project control points and benchmarks. The Contractor shall establish and preserve any temporary control points (traverse points or benchmarks) needed for construction. Any project control points (traverse points) or benchmarks conflicting with construction of the project shall be relocated by the Contractor. The Contractor as directed by the Engineer must replace any or all stakes that are destroyed at any time during the life of the contract. The Contractor shall re-establish centerline points and stationing prior to final cross-sections by the Engineer. The Vertical Control error of closure shall not exceed 0.035 ft times. The Horizontal Control precision ratio shall have a minimum precision of 1:20,000 feet of distance traversed prior to adjustment.
- (b) The Contractor shall perform construction centerline layout of all roadways, ramps and connections, etc. from project control points set by the Engineer. The Contractor using the profiles and typical sections provided in the plans shall calculate proposed grades at the edge of pavement or verify information shown on Grades and Geometric sheets.
- (c) The Contractor shall advise the Engineer of any horizontal or vertical alignment revisions needed to establish smooth transitions to existing facilities. The Contractor must immediately bring to the attention of the Engineer any potential drainage problem within the project limits. The Engineer must approve any proposed variation in profile, width or cross slope.
- (d) The Contractor shall establish the working points, centerlines of bearings on bridge abutments and on piers, mark the location of anchor bolts to be installed, check the elevation of bearing surfaces before and after they are ground and set anchor bolts at their exact elevation and alignment as per Contract Plans. Before completion of the fabrication of beams for bridge superstructures, the Contractor shall verify by accurate field measurements the locations both vertically and horizontally of all bearings and shall assume full responsibility for fabricated beams fitting and bearing as constructed. After beam erection and concurrently with the Department project surveyors or their designated representative, the Contractor shall survey top of beam elevations at a maximum of 10-ft stations and compute screed grades. These shall be submitted to the Engineer for review and approval before the stay in place forms are set. Construction stakes and other reference control marks shall be set at sufficiently frequent intervals to assure that all components of the structure are constructed in accordance with the lines and grades shown on the plans.
The Contractor will be responsible for all structure alignment control, grade control and all necessary calculations to establish and set these controls.
- (e) The Contractor, using contract plans, shall investigate proposed construction for possible conflicts with existing and proposed utilities. The Contractor shall then report such conflicts to the Engineer for resolution. All stakes for utility relocations, which will be performed by others, after the Notice to Proceed has been given to the Contractor, shall be paid for under item 763597 - Utility Construction Engineering.
- (f) The Contractor shall be responsible for the staking of all sidewalk and curb ramp grades in accordance with the plans and the Departments Standard Construction Details. The Contractor shall review the stakeout with the Engineer prior to construction. The Engineer must approve any deviation from plans, Department Standard Construction Details and Specifications in writing. The Contractor shall be responsible for any corrective actions resulting from problems created by adjustments if they fail to obtain such approval.
- (g) If wetland areas are involved and specifically defined on the Plans the following shall apply:
 - i. It is the intent of these provisions to alert the Contractor, that he/she shall not damage or destroy wetland areas, which exist beyond the construction limits. These provisions will be

- strictly enforced and the Contractor shall advise his/her personnel and those of any Subcontractor of the importance of these provisions.
- ii. All clearing operations and delineation of wetlands areas shall be performed in accordance with these Special Provisions. Before any clearing operation commences the Contractor shall demarcate wetlands at the Limits of Construction throughout the entire project as shown on the Plans labeled as Limits of Construction or Wetland Delineation to the satisfaction of the Engineer.
 - iii. The material to be used for flagging the limits of construction shall be orange vinyl material with the wording "Wetland Boundary" printed thereon. In wooded areas, the flagging shall be tied on the trees, at approximate 20-foot intervals through wetland areas. In open field and yard areas that have been identified as wetlands, 6 foot posts shall be driven into the ground at approximate 50-foot intervals and tied with the flagging. The flagging shall extend approximately 12 inches in length beyond the post. Posts shall be oak with cross sectional dimensions of 1 ½ inches to 2 inches by 1 ½ inches to 2 inches or ¼ inch rebar.
 - iv. If the flagging has been destroyed and the Engineer determines that its use is still required, the Contractor shall reflag the area at no cost to the Department. If the Contractor, after notification by the Engineer that replacement flagging is needed, does not replace the destroyed flagging within 48 hours, the Engineer may proceed to have the area reflagged. The cost of the reflagging by the Engineer will be charged to the Contractor and deducted from any monies due under the Contract.
 - v. At the completion of construction, the Contractor shall remove all posts and flagging.
 - vi. The Contractor shall be responsible for any damages to wetlands located beyond the construction limits, which occurs from his/her operations during the life of the Contract. The Contractor shall restore all temporarily disturbed wetland areas to their preconstruction conditions. This includes restoring bank elevations, streambed and wetland surface contours and wetlands vegetation disturbed or destroyed. The expense for this restoration shall be borne solely by the Contractor.

(h) Whenever the Engineer will be recording data for establishment of pay limits, the Contractor will be invited to obtain the data jointly with the Engineer's Survey Crew(s) in order to agree with the information. If the Contractor's representative is not able to obtain the same data, then the information obtained by the Engineer shall be considered the information to be used in computing the quantities in question.

Submittals. All computations necessary to establish the exact position of all work from the control points shall be made and preserved by the Contractor. All computations, survey notes, electronic files, and other records necessary to accomplish the work shall be made available to the Department in a neat and organized manner at any time as directed by the Engineer. The Engineer may check all or any portion of the stakeout survey work or notes made by the Contractor and any necessary correction to the work shall be made as soon as possible. The Contractor shall furnish the Engineer with such assistance as may be required for checking all lines, grades, and measurements established by the Contractor and necessary for the execution of the work. Such checking by the Engineer shall not relieve the Contractor of his/her responsibility for the accuracy or completeness of the work. Copies of all notes must be furnished to the engineer at the completion of the project.

The Contractor shall submit any of the following at the Engineer's request:

- (a) Proposed method of recording information in field books to ensure clarity and adequacy.
- (b) A printout of horizontal control verification, as well as coordinates, differences and error of closure for all reestablished or temporary Control Points.
- (c) A printout of vertical control verification, with benchmark location elevation and differences from plan elevation.
- (d) Sketch of location of newly referenced horizontal control, with text printout of coordinates, method of reference and field notes associated with referencing control - traverse closure report.
- (e) Description of newly established benchmarks with location, elevation and closed loop survey field notes - bench closure report
- (f) All updated electronic and manuscript survey records.
- (g) Stakeout plan for each structure and culvert.
- (h) Computations for buildups over beams, screed grades and overhang form elevations.

- (i) A report showing differences between supplied baseline coordinates and field obtained coordinates, including a list of preliminary input data.
- (j) Any proposed plan alteration to rectify a construction stakeout error, including design calculations, narrative and sealed drawings.
- (k) Baseline for each borrows pit location.
- (l) Detailed sketch of proposed overhead ground mounted signs or signals showing obstructions that may interfere with their installation.
- (m) Copies of cut sheets.

Machine Control Grading

This Section of the specification shall only be used if machine control is authorized for use on the project.

Description:

This specification contains the requirements for grading operations utilizing Global Positioning Systems (GPS).

Use of this procedure and equipment is intended for grading the subgrade surface; it is not intended for the use in constructing final surface grades.

The Contractor may use any manufacturer's GPS machine control equipment and system that results in achieving the grading requirements outlined in section 202 of the standard specifications. The Contractor shall convert the electronic data provided by the Department into the format required by their system. The Department will only provide the information outlined in this document and no additional electronic data will be provided.

The Contractor shall perform at least one 500 foot test section with the selected GPS system to demonstrate that the Contractor has the capabilities, knowledge, equipment, and experience to properly operate the system and meet acceptable tolerances. The engineer will evaluate and make the determination as to whether additional 500 foot test sections are required. If the Contractor fails to demonstrate this ability to the satisfaction of the Department, the Contractor shall construct the project using conventional surveying and staking methods.

Materials:

All equipment required to perform GPS machine control grading, including equipment needed by DeIDOT to verify the work, shall be provided by the Contractor and shall be able to generate end results that are in accordance with the requirements of Division 200 - EARTHWORK of the Standard Specifications.

Construction:

A. DeIDOT Responsibilities:

1. The Department will set initial vertical and horizontal control points in the field for the project as indicated in the contract documents, (plans set). If the Contractor needs to establish new control points they shall be traversed from existing control points and verified to be accurate by conventional surveying techniques.
2. The Department will provide the project specific localized coordinate system.
3. The Department will provide data in an electronic format to the Contractor as indicated in the General Notes.
 - a. The information provided shall not be considered a representation of actual conditions to be encountered during construction. Furnishing this information does

not relieve the Contractor from the responsibility of making an investigation of conditions to be encountered including, but not limited to site visits, and basing the bid on information obtained from these investigations, and the professional interpretations and judgments of the Contractor. The Contractor shall assume the risk of error if the information is used for any purpose for which the information is not intended.

- b. Any assumption the Contractor makes from this electronic information shall be at their risk. If the Contractor chooses to develop their own digital terrain model the Contractor shall be fully responsible for all cost, liability, accuracy and delays.
- c. The Department will develop and provide electronic data to the Contractor for their use as part of the contract documents in a format as indicated in the General

Notes. The Contractor shall independently ensure that the electronic data will function in their machine control grading system.

- 4. The Files that are provided were originally created with the computer software applications MicroStation (CADD software) and INROADS (civil engineering software). The data files will be provided in the native formats and other software formats described below. The contractor shall perform necessary conversion of the files for their selected grade control equipment. The Department will furnish the Contractor with the following electronic files:

- a. CAD files
 - i. Inroads -Existing digital terrain model (.DTM)
 - ii. Inroads -Proposed digital terrain model (.DTM)
 - iii. Microstation -Proposed surface elements - triangles
- b. Alignment Data Files:
 - i. ASCII Format

- 5. The Engineer shall perform spot checks of the Contractor's machine control grading results, surveying calculations, records, field procedures, and actual staking. If the Engineer determines that the work is not being performed in a manner that will assure accurate results, the Engineer may order the Contractor to redo such work to the requirements of the contract documents, and in addition, may require the Contractor to use conventional surveying and staking, both at no additional cost to the Department.

B. Contractor's Responsibilities

- 1. The Contractor shall provide the Engineer with a GPS rover and Automatic Level, for use during the duration of the contract. At the end of the contract, the GPS rover and Automatic Level will be returned to the Contractor. The Contractor shall provide a total of 8 hours of formal training on the Contractor's GPS machine control system to the Engineer and up to three additional Department appointees per rover.
- 2. The Contractor shall review and apply the data provided by the Department to perform GPS machine control grading.
- 3. The Contractor shall bear all costs, including but not limited to the cost of actual reconstruction of work, that may be incurred due to application of GPS machine control grading techniques. Grade elevation errors and associated corrections including quantity adjustments resulting from the contractor's use of GPS machine control shall be at no cost to the Department.
- 4. The Contractor shall convert the electronic data provided by the Department into a format compatible with their system.
- 5. The Contractor's manipulation of the electronic data provided by the Department shall be performed at their own risk.

6. The Contractor shall check and if necessary, recalibrate their GPS machine control system at the beginning of each workday in accordance with the manufacturer's recommendations, or more frequently as needed to meet the requirements of the project.
7. The Contractor shall meet the accuracy requirements as detailed in the Standard Specifications.
8. The Contractor shall establish secondary control points at appropriate intervals and at locations along the length of the project. These points shall be outside the project limits and/or where work is performed. These points shall be at intervals not to exceed 1000 feet. The horizontal position of these points shall be determined by conventional survey traverse and adjustments from the original baseline control points. The conventional traverse shall meet or exceed the Department's Standards. The elevation of these control points shall be established using differential leveling from the project benchmarks, forming a closed loop. A copy of all new control point information including closure report shall be provided and approved by the Engineer prior to construction activities. The Contractor shall be responsible for all errors resulting from their efforts and shall correct deficiencies to the satisfaction of the Engineer and at no additional cost to the Department.
9. The Contractor shall provide stakes at all alignment control points, at every 500 foot stationing, and where required for coordination activities involving environmental agencies and utility companies at the Contractor's expense. Work that is done solely for utility companies and that is beyond the work performed under item 763501 - Construction shall follow and be paid for under item 763597 -Utility Construction Engineering.
10. The Contractor shall at a minimum set hubs at the top of finished grade at all hinge points on the cross section at 500 foot intervals on the main line and at least 4 cross sections on side roads and ramps as directed by the engineer or as shown on the plans. Placement of a minimum of 4 control points outside the limits of disturbance for the excavation of borrow pits, Stormwater Management Ponds, wetland mitigation sites etc. These control points shall be established using conventional survey methods for use by the Engineer to check the accuracy of the construction.
11. The Contractor shall preserve all reference points and monuments that are identified and established by the Engineer for the project. If the Contractor fails to preserve these items the Contractor shall reestablish them at no additional cost to the Department.
12. The Contractor shall provide control points and conventional grades stakes at critical points such as, but not limited to, PC's, PT's, superelevation points, and other critical points required for the construction of drainage and roadway structures.
13. No less than 2 weeks before the scheduled preconstruction meeting, the Contractor shall submit to the Engineer for review a written machine control grading work plan which shall include the equipment type, control software manufacturer and version, and proposed location of the local GPS base station used for broadcasting differential correction data to rover units.
14. The Contractor shall follow the guidelines set forth in the "Geometric Geodetic Accuracy Standards and Specifications for Using GPS Relative Positioning Techniques" and follow a minimum of Second Order Class 1, (2-I) classification standards.

Automated equipment operations have a high reliance on accurate control networks from which to take measurements, establish positions, and verify locations and features. Therefore, a strong contract control network in the field which is the same or is strongly integrated with the project control used during the design of the contract is essential to the successful use of this technology with the proposed Digital Terrain Model (DTM). Consistent and well designed site calibration for all machine control operations (as described below under Contract Control Plan) are required to ensure the quality of the contract deliverables. The Contract Control Plan is intended to document which horizontal and vertical control will be held for these operations. Continued incorporation of the Base Station(s) as identified in the Contract Control Plan is essential to maintaining the integrity of positional locations and elevations of features. The Contract Control Plan shall be submitted to the Department for review and approval by the Departments Survey Section 3 weeks prior

to the start of any machine control work. The Contractor shall operate and maintain all elements of the Machine Grade Control continuously once the operations begin until otherwise approved by the Engineer.

Contract Control Plan:

The Contractor shall develop and submit a Contract Control Plan for all contracts which use Machine Control Grading. Contract control includes all primary and secondary horizontal and vertical control which will be used for the construction contract. Upon the Contractor's completion of the initial survey reconnaissance and control verification, but prior to beginning primary field operations, the Contractor shall submit a Contract Control Plan document (signed and sealed by the Delaware licensed Land Surveyor or Delaware Professional Engineer who oversees its preparation) for acceptance by the Engineer, which shall include the following:

1. A control network diagram of all existing horizontal and vertical control recovered in the field as contract control.
2. Include a summary of the calculated closures of the existing control network, and which control has been determined to have been disturbed or out of tolerance from its original positioning.
3. An explanation of which horizontal and vertical control points will be held for construction purposes. If necessary include all adjustments which may have been made to achieve required closures.
4. An explanation of what horizontal and vertical control (including base stations) was set to accomplish the required stakeout or automated machine operation. Include how the position of these new control points was determined.
5. Describe the proposed method and technique (technology and quality control) for utilizing the control to establish the existing and/or proposed feature location and to verify the completed feature location and/or measured quantity.
6. A listing of the horizontal and vertical datums to be used and the combined factor to be used to account for ellipsoidal reduction factor and grid scale factor.
7. If the Contractor chooses to use machine control as a method of measuring and controlling excavation, fill, material placement or grading operations as a method of measuring and controlling excavation, fill, material placement or grading operations, the Contractor Control Plan shall include the method by which the automated machine guidance system will initially be site calibrated to both the horizontal and vertical contract control, and shall describe the method and frequency of the calibration to ensure consistent positional results.
8. Issues with equipment including inconsistent satellite reception of signals to operate the GPS machine control system will not result in adjustment to the "Basis of Payment" for any construction items or be justification for granting contract time extension.

Method of Measurement:

The quantity of Construction Engineering will not be measured.

Basis of Payment:

Payment will be made at the Lump Sum price bid for the item "Construction Engineering". The price bid shall include the cost of furnishing all labor, equipment, instruments, stakes and other material necessary to satisfactorily complete the work as herein described under this item for all roads and structures that are a part of the contract. Adjustment in payment will be made for the deletion or addition of work not shown in the contract documents.

Monthly payment will be made under this item in proportion to the amount of work done as determined by the Engineer.

2/28/2018

801500 - MAINTENANCE OF TRAFFIC - ALL INCLUSIVE

Description:

This item shall consist of furnishing, installing, maintaining and/or relocating the necessary temporary traffic control devices used to maintain vehicular, bicycle and pedestrian traffic, including persons with disabilities in accordance with the Americans with Disabilities Act, as amended. All work shall be performed in a manner that will provide reasonably safe passage with the least practicable obstruction to all users, including vehicular, bicycle and pedestrian traffic.

All requirements of the Delaware Manual on Uniform Traffic Control Devices (MUTCD), Part 6, herein referred to as the Delaware MUTCD. (latest edition with all revisions made up to the date of Advertisement of this project) shall apply for all temporary traffic control devices. Any, and all, control, direction, management and maintenance of traffic shall be performed in accordance with the requirements of the Delaware MUTCD, notes on the Plans, this specification, and as directed by the Engineer.

The Contractor shall be aware that the Case Diagrams and safety measures outlined in the Delaware MUTCD are for common construction situations and modifications may be warranted based on the complexity of the job. The Contractor shall submit justification for modifications to the Temporary Traffic Control Plan (TTCP) to the Engineer for approval prior to implementation.

The Department reserves the right to impose additional restrictions, as needed, for the operational movement and safety of the traveling public. The Department reserves the right to suspend the Contractor's operations until compliance with the Engineer's directive for remedial action, based on but not limited to the following reasons:

1. The Contractor's operations are not in compliance with the Delaware MUTCD, the specifications or the Plans.
2. The Contractor's operations have been deemed unsafe by the Traffic Safety Engineer or District Safety Officer.

Materials and Construction Methods:

The Contractor shall submit a Temporary Traffic Control Plan (TTCP) or a Letter of Intent to use the Plan recommended Delaware MUTCD Case Diagram(s) at or prior to the pre-construction meeting. The Contractor shall submit the TTCP for all Contractor and subcontractor work to be performed on the project for the Department's approval before the start of work.

When specified by a note in the Plans, the Contractor shall be required to have an American Traffic Safety Services Association (ATSSA) certified Traffic Control Supervisor on the project. The authorized designee must be assigned adequate authority, by the Contractor, to ensure compliance with the requirements of the Delaware MUTCD and provide remedial action when deemed necessary by the Traffic Safety Engineer or the District Safety Officer. The ATSSA certified Traffic Control Supervisor's sole responsibility shall be the maintenance of traffic throughout the project. This responsibility shall include, but is not limited to, the installation, operations, maintenance and service of temporary traffic control devices. Also required is the daily maintenance of a log to record maintenance of traffic activities, i.e., number and location of temporary traffic control devices; and times of installation, changes and repairs to temporary traffic control devices. The ATSSA Traffic Control Supervisor shall serve as the liaison with the Engineer concerning the Contractor's maintenance of traffic. The name, contact number and certification for the designated Traffic Control Supervisor shall be submitted at or prior to the pre-construction meeting. The cost of the ATSSA certified Traffic Control Supervisor shall be incidental to this item.

Temporary traffic control devices shall be maintained in good condition in accordance with the brochure entitled "Quality Guidelines for Temporary Traffic Control Devices", published by the American Traffic Safety Services Association (ATSSA). Any temporary traffic control devices that do not meet the quality guidelines shall be removed and replaced with acceptable devices. Failure to comply will result in work stoppage with time charges continuing to be assessed.

Any existing signs that conflict with any temporary or permanent construction signs shall be covered as needed or as directed by the Engineer. The cost for temporarily covering conflicting signs shall be incidental to this item.

Access to all transit stops located within the project limits shall be maintained unless otherwise directed by the Plans or the Engineer. Maintaining access shall include maintaining an area for the transit vehicle and also an accessible path for pedestrians to safely access the transit stop.

The Contractor shall notify the Engineer, in writing, no less than fourteen (14) calendar days prior to the start of any detour(s) and road closures. The Engineer will notify the following entities:

- Local 911 Center
- Local School Districts
- Local Post Offices
- DelDOT's Transportation Management Center (TMC)
- Town Managers
- Local Police
- DelDOT's Public Relations
- Delaware Transit Corporation (DTC)

Immediately prior to the implementation of any lane or road closures, the Engineer shall notify the DelDOT TMC at (302) 659-4600. Notifications shall also be provided when the closures are lifted. The Engineer shall notify TMC and the District Safety Officer if any lane closures cannot be removed prior to the end of the allowable work hours.

The Contractor shall notify the local 911 center if access to a fire hydrant is temporarily restricted. The Contractor shall provide written confirmation to the Engineer that the local 911 center has been notified.

If a detour is required during any part or the entire period of this Contract, an approved detour plan shall be obtained from the Department's Traffic Safety Section. All signs, barricades and other temporary traffic control devices required as part of the approved detour plan shall be installed and maintained by the Contractor on the route that is closed and on the detour route. Road closures without an approved detour plan shall not be allowed. If a road is closed without an approved detour plan, the Contractor's operations shall be stopped immediately.

The Contractor shall provide and maintain ingress and egress for each property abutting the construction area and each property located between the diversion points of any detour and the actual construction site. Construction activities which may temporarily or otherwise interfere with property access shall be coordinated in advance with the affected property owners.

The Contractor shall conduct construction operations in a manner which will minimize delays to traffic, and shall meet the following requirements:

1. If work is being performed within 200 feet in any direction of an intersection that is controlled by a traffic signal, the flagger(s) shall direct the flow of traffic in concert with the traffic signals in construction areas to avoid queuing, unless active work prohibits such action. The flagger shall direct traffic to prevent traffic from queuing through an intersection (i.e., blocking an intersection). Only a Traffic Officer may direct traffic against the operation of a traffic signal and only until the operation occurring within the intersection is completed.
2. When a lane adjacent to an open lane is closed to travel, the temporary traffic control devices shall be set 2 feet (0.61 m) into the closed lane from the edge of the open lane, unless an uncured patch exists or actual work is being performed closer to the open lane with minimum restriction to traffic.
3. Except for "buffer lanes" on high volume and/or high speed roadways, lanes shall not be closed unless construction activity requiring lane closure is taking place, or will take place within the next hour. Lanes shall be reopened immediately upon completion of the work. Moving operations will require the lane closures be shortened as the work progresses and as traffic conditions warrant to minimize the length of the closure. The Contractor shall conduct construction operations in a manner so as to minimize disruption to traffic during

peak hours and periods of heavy flow. The Department reserves the right to stop or change the Contractor's operations, if in the opinion of the Engineer, such operations are unnecessary at that time or the operations are unnecessarily impeding traffic.

4. Work in the vicinity of traffic signals, shall be scheduled to minimize the time during which the signal is operated without detectors, and prior approval from the Engineer shall be required. TMC shall be notified in advance of cutting a loop detector, and be immediately notified once the loop detector has been reinstalled. The Contractor shall provide sufficient advance notice of the loop detector work with the Engineer to ensure the aforementioned requirements are met.

It is required that all temporary traffic control work and related items shall either be performed entirely by the Contractor's own organization, or totally subcontracted. Maintenance of equipment shall not be subject to this requirement.

Any deficiencies related to temporary traffic control that are reported to the Contractor in writing shall be corrected within 24 hours or as directed by the Engineer. Failure to comply will result in non-payment for those devices that are found to be deficient for the duration of the deficiency. Serious deficiencies that are not corrected immediately shall result in suspension of work until items identified are brought back into compliance.

At the end of each day's work, the Contractor shall correct all pavement edge drop-offs in accordance with Table 6G-1 in the Delaware MUTCD. This corrective work shall be accomplished with Temporary Roadway Material (TRM) unless an alternate method is specified in the Plans. All ruts and potholes shall be filled with TRM as soon as possible but no later than the end of each work day. Placement and Payment of TRM shall be completed in accordance with Section 403 of the Standard Specifications. If temporary elimination of a drop-off hazard cannot be accomplished, then the area should be properly marked and protected with temporary traffic control devices such as temporary barricades, warning signs, flashing lights, etc. as required by Section 6G.21 of the Delaware MUTCD.

All open trench excavation accessible by vehicular traffic must be backfilled prior to the end of each working day. Steel plates shall not be used except in emergency situations and only with prior written approval from the Engineer unless otherwise directed by the Plans.

The Contractor shall submit, at or prior to the preconstruction meeting, detailed drawings including but not limited to existing striping lengths, lane and shoulder widths, turn lane lengths, locations of stop bars, turn arrows, crosswalks and railroad crossings. The drawings shall depict the existing pavement markings for each project location. These drawings will be reviewed by the Department's Traffic Section to determine the need for modification(s) for compliance with the Delaware MUTCD. Temporary pavement markings, on the final pavement surface, shall match the Plan dimensions and layout or the approved drawings of the permanent markings in compliance with Section 3 of the Delaware MUTCD. All conflicting or errant striping shall be removed as directed by the Engineer in compliance with the specifications for Item 817031 - Removal of Pavement Striping.

At the end of each day's operation and before traffic is returned to unrestricted roadway use, temporary striping shall be utilized when the existing pavement is milled and hot mix will not be placed the same day or more than a single course of hot mix is to be placed or permanent roadway striping cannot be placed on the same day as the placement of the final course of hot mix. Placement of temporary striping shall receive prior approval from the Engineer and the contractor shall apply temporary pavement markings in accordance with the requirements of Section 817 of Delaware Standard specifications and the Delaware MUTCD. Payment for temporary pavement striping shall be made at the unit price bid for item 817 - Temporary Striping. Payment for final striping will be included in the applicable striping item.

The Contractor shall have temporary striping/delineating materials (such as raised markers, tape, and other approved materials) available at the job site for verification by the Department prior to starting the hot-mix paving operation on roads to be immediately opened to traffic. These materials shall be used by the Contractor for temporary markings if he/she fails to apply temporary marking paint, etc., as required by the Delaware MUTCD. No paving operations on roads to be immediately opened to traffic will be allowed unless such verification has been made for the availability of the materials at the job site.

Travel lane and ramp closings on multilane highways and Interstates shall not be permitted during the following holiday periods:

- December 24 through December 27 (Christmas Day)
- December 31 through January 3 (New Years Day)
- Friday prior to Easter through Easter Sunday
- Thursday prior to Memorial Day through the Tuesday following Memorial Day
- Dover International Speedway Race Weekends (Thursday prior to the race event through the day after the race event)
- July 3 through July 5 (Independence Day)
- Thursday prior to Labor Day through the Tuesday following Labor Day
- Wednesday prior to Thanksgiving Day through the Monday following Thanksgiving Day

Additional time restrictions may apply as noted in the project plans or as directed by the Engineer. Any requests to waive any restrictions must be made in writing to the Engineer for review and approval. A copy of the request shall be provided to the District Safety Officer for review.

Certification:

Temporary traffic control devices used on all highways open to the public in this State shall conform to the Delaware MUTCD. All devices shall be crashworthy in accordance with the National Cooperative Highway Research Program (NCHRP) Report 350, the memorandum issued August 28, 1998 by The USDOT Federal Highway Administration, and/or in accordance with the latest edition of the Manual for Assessing Safety Hardware (MASH), published by the American Association of State Highway and Transportation Officials (AASHTO).

The Contractor shall submit certification for temporary traffic control devices or vendors used specifically on this project at or prior to the pre-construction meeting.

Certification of compliance with NCHRP report 350 and/or MASH is required for the following categories of temporary traffic control devices:

Category I contains small and lightweight channelizing and delineating control devices which includes cones, tubular markers, flexible delineator post and drums, all without any accessories or attachments.

Category II includes temporary traffic control devices that are not expected to produce significant vehicular velocity changes to impacting vehicles. These devices which shall weigh 100 pounds or less, include Type I, II and III barricades, portable sign supports with signs, and intrusion alarms. Also included are drums, cones, and vertical panels with accessories or attachments.

Category III includes temporary traffic control devices that are expected to cause significant vehicular velocity changes to impacting vehicles. These devices which weigh more than 100 pounds include temporary barrier, temporary impact attenuators, and truck-mounted attenuators.

Category IV includes portable or trailer-mounted devices such as arrow panels, variable message signs, temporary traffic signals and temporary area lighting.

For Category I devices, the manufacturer or Contractor may self-certify that the devices meet the NCHRP-350 and/or MASH criteria. The Contractor shall supply the Federal Highway Administration's NCHRP-350 and/or MASH acceptance letter for each type of device that falls under Category II and III devices.

Basis of Payment:

Payment will be made at the Lump Sum price for "Maintenance of Traffic", for which price and payment constitutes full compensation for all maintenance of traffic activities accepted by the Engineer, which shall include the cost of furnishing and relocating permanent and temporary traffic control signs, traffic cones or drums, submission of temporary traffic control plan(s), submission of existing pavement marking drawings, submission of all required certifications, labor, equipment and incidentals necessary to complete the item. Payment to furnish and maintain other temporary traffic control devices including but not limited to Portable

P.C.C. Safety Barrier, Truck Mounted Attenuators, Portable Changeable Message Signs, Arrow Panels and Portable Light Assemblies will be made at the contract unit price for each item.

NOTE

If the Contractor does not complete the Contract work within the Contract completion time (including approved extension time), the Contractor shall be responsible for providing the necessary temporary traffic control devices that are required to complete any remaining work. The costs of such temporary traffic control shall be borne by the Contractor. No additional payment will be made to the Contractor to maintain traffic in accordance with the Delaware MUTCD, contract plans and specifications. Temporary traffic control items include, but not be limited to, warning lights, warning signs, barricades, plastic drums, P.C.C. safety barrier, flaggers, traffic officers, arrow panels, message boards, and portable impact attenuators.

10/5/16

801501 - MAINTENANCE OF RAILROAD TRAFFIC (CSXT)

DEFINITIONS

For the purpose of this Contract, the following terms, names, titles, and/or aberrations refer to the following:

1. The terms Railroad, CSXT, and CSX shall mean CSX Transportation, Inc.
2. The terms DelDOT, State, Department, Agency, Owner of Contract shall mean the Delaware Department of Transportation.
3. The term Contractor shall mean the successful awarded Contractor which the Delaware Department of Transportation has entered into an agreement and/or contract with to improve, add to, or otherwise use property(s), facilities, or improvements of the Railroad.
4. The terms Agreement or Construction Agreement shall mean the fully executed and signed "Construction Agreement" between CSXT and DelDOT. The Agreement shall list the explanations of the approval process, conduct of work, cost and reimbursement procedures, payment terms, etc. relative to this Contract. The Agreement may contain attached "Exhibits", as necessary, to fully explain all requirements relating to this work.

I. AUTHORITY OF CSXT ENGINEER

- A. The CSXT Representative shall have final authority in all matters affecting the safe maintenance of CSXT operations and CSXT property, and his or her approval shall be obtained by the Agency or its Contractor for methods of construction to avoid interference with CSXT operations and CSXT property and all other matters contemplated by the Agreement and these Special Provisions.

II. INTERFERENCE WITH CSXT OPERATIONS

- A. Agency or its Contractor shall arrange and conduct its work so that there will be no interference with CSXT operations, including train, signal, telephone and telegraphic services, or damage to CSXT's property, or to poles, wires, and other facilities of tenants on CSXT's Property or right-of-way. Agency or its Contractor shall store materials so as to prevent trespassers from causing damage to trains, or CSXT Property. Whenever work is likely to affect the operations or safety of trains, the method of doing such Work shall first be submitted to the CSXT Representative for approval, but such approval shall not relieve Agency or its Contractor from liability in connection with such Work.
- B. If conditions arising from or in connection with the Project require that immediate and unusual provisions be made to protect train operation or CSXT's property, Agency or its Contractor shall make such provision. If the CSXT Representative determines that such provision is insufficient, CSXT may, at the expense of Agency or its Contractor, require or provide such provision as may be deemed necessary, or cause the Work to cease immediately.

III. NOTICE OF STARTING WORK

- A. Agency or its Contractor shall not commence any work on CSXT Property or rights-of-way until it has complied with the following conditions:
 1. Notify CSXT in writing of the date that it intends to commence Work on the Project. Such notice must be received by CSXT at least ten business days in advance of the date Agency or its Contractor proposes to begin Work on CSXT property. The notice must refer to fully executed and signed "Construction Agreement" (see II.A.4 above) by date. If flagging service is required, such notice shall be submitted at

least thirty (30) business days in advance of the date scheduled to commence the Work.

2. Obtain authorization from CSXT Representative to begin Work on CSXT property, such authorization to include an outline of specific conditions with which it must comply.
3. Obtain from CSXT the names, addresses and telephone numbers of CSXT's personnel who must receive notice under provisions in the Agreement. Where more than one individual is designated, the area of responsibility of each shall be specified.

IV. WORK FOR THE BENEFIT OF THE CONTRACTOR

- A. No temporary or permanent changes to wire lines or other facilities (other than third party fiber optic cable transmission systems) on CSXT property that are considered necessary to the Work are anticipated or shown on the Plans. If any such changes are, or become, necessary in the opinion of CSXT or Agency, such changes will be covered by appropriate revisions to the Plans and by preparation of a force account estimate. Such force account estimate may be initiated by either CSXT or Agency, but must be approved by both CSXT and Agency. Agency or Contractor shall be responsible for arranging for the relocation of the third party fiber optic cable transmission systems, at no cost or expense to CSXT.
- B. Should Agency or Contractor desire any changes in addition to the above, then it shall make separate arrangements with CSXT for such changes to be accomplished at the Agency or Contractor's expense.

V. HAUL ACROSS RAILROAD

- A. If Agency or Contractor desires access across CSXT property or tracks at other than an existing and open public road crossing in or incident to construction of the Project, the Agency or Contractor must first obtain the permission of CSXT and shall execute a license agreement or right of entry satisfactory to CSXT, wherein Agency or Contractor agrees to bear all cost and liabilities related to such access.
- B. Agency and Contractor shall not cross CSXT's property and tracks with its vehicles or equipment of any kind or character, except at such crossings as may be permitted pursuant to this section.

VI. COOPERATION AND DELAYS

- A. Agency or Contractor shall arrange a schedule with CSXT for accomplishing stage construction involving work by CSXT. In arranging its schedule, Agency or Contractor shall ascertain, from CSXT, the lead time required for assembling crews and materials and shall make due allowance therefore.
- B. Agency or Contractor may not charge any costs or submit any claims against CSXT for hindrance or delay caused by railroad traffic; work done by CSXT or other delay incident to or necessary for safe maintenance of railroad traffic; or for any delays due to compliance with these Special Provisions.
- C. Agency and Contractor shall cooperate with others participating in the construction of the Project to the end that all work may be carried on to the best advantage.
- D. Agency and Contractor understand and agree that CSXT does not assume any responsibility for work performed by others in connection of the Project. Agency and Contractor further understand and agree that they shall have no claim whatsoever against CSXT for any inconvenience, delay or additional cost incurred by Agency or Contractor on account of operations by others.

VII. STORAGE OF MATERIALS EQUIPMENT

- A. Agency and Contractor shall not store their materials or equipment on CSXT's property or where they may potentially interfere with CSXT's operations, unless Agency or Contractor has received CSXT Representative's prior written permission. Agency and Contractor understand and agree that CSXT will not be liable for any damage to such materials and equipment from any cause and that CSXT may move, or require Agency or Contractor to move, such material and equipment at Agency's or Contractor's sole expense. To minimize the possibility of damage to the railroad tracks resulting from the unauthorized use of equipment, all grading or other construction equipment that is left parked near the tracks unattended by watchmen shall be immobilized to the extent feasible so that it cannot be moved by unauthorized persons.

Construction Methods:

VIII. CONSTRUCTION PROCEDURES

A. General

1. Construction work on CSXT property shall be subject to CSXT's inspection and approval.
2. Construction work on CSXT property shall be in accord with CSXT's written outline of specific conditions and with these Special Provisions.
3. Contractor shall observe the terms and rules of the CSXT Safe Way manual, which Agency and Contractor shall be required to obtain from CSXT, and in accord with any other instruction furnished by CSXT or CSXT's Representative.

B. Blasting

1. Agency or Contractor shall obtain CSXT Representative's and Agency Representative's prior written approval for use of explosives on or adjacent to CSXT property. If permission for use of explosives is granted, Agency or Contractor must comply with the following:
 - a. Blasting shall be done with light charges under the direct supervision of a responsible officer or employee of Agency or Contractor.
 - b. Electric donating fuses shall not be used because of the possibility of premature explosion resulting from operation of two-way train radios.
 - c. No blasting shall be done without the presence of an authorized representative of CSXT. At least 30 days' advance notice to CSXT Representative and any flagging that CSXT may require.
 - d. Agency or Contractor must have at the Project site adequate equipment, labor and materials, and allow sufficient time, to
 - i. Clean up (At Contractor's expense) debris resulting from blasting without any delay to trains; and
 - ii. Correct (at Contractor's expense) any track misalignment or other damage to CSXT's property resulting from the blasting; as directed by CSXT Representative, without delay to trains. If Contractor's actions result in delay of any trains, including Amtrak passenger trains, the Contractor shall bear the entire cost thereof.
 - e. Contractor shall not store explosives on CSXT property.

2. CSXT Representative will
 - a. Determine the approximate location of trains and advise Agency and Contractor of the appropriate amount of time available for the blasting operation and clean-up.
 - b. Have the authority to order discontinuance of blasting if, in their opinion, blasting is too hazardous or is not in accord with these Special Provisions.

IX. MAINTENANCE OF DITCHES ADJACENT TO CSXT TRACKS

- A. The Contractor shall maintain all ditches and drainage structures free of silt or other obstruction that may result from their operations. Contractor shall provide erosion control measures during construction and use methods that accord with applicable state standard specifications for road and bridge construction, including either:

1. Silt Fence;
2. Hay or straw barrier;
3. Berm or temporary ditches;
4. Sediment basin;
5. Aggregate checks; and
6. Channel lining.

All such maintenance and repair of damages due to Contractor's operations shall be performed at Contractor's expense.

X. FLAGGING/INSPECTION SERVICE

- A. CSXT has sole authority to determine the need for flagging required to protect its operations and property. In general, flagging protection will be required whenever Agency or Contractor or their equipment are, or are likely to be, working within fifty (50) feet of live track or other track clearances specified by CSXT, or over tracks.
- B. Agency shall reimburse CSXT directly for all costs of flagging that is required on account of construction within CSXT property shown in the Plans, or that is covered by an approved plan revision, supplemental agreement or change order.
- C. Agency or Contractor shall give a minimum of 30 days' advance notice to CSXT Representative for anticipated need for flagging service. No work shall be undertaken until the flag person(s) is/are at the job site. If it is necessary for CSXT to advertise a flagging job for bid, it may take up to 90-days to obtain this service, and CSXT shall not be liable for the cost of delays attributable to obtaining such service.
- D. CSXT shall have the right to assign an individual to the site of the Project to perform inspection service whenever, in the opinion of CSXT Representative, such inspection may be necessary. Agency shall reimburse CSXT for the costs incurred by CSXT for such inspection service. Inspection service shall not relieve Agency or Contractor from liability for its Work.
- E. CSXT shall render invoices for, and Agency shall pay for, the actual pay rate of the flag persons and inspectors used, plus standard additives, whether that amount is above or below the rate provided in the Estimate. If the rate of pay that is to be used for inspector or flagging service is changed before the work is started or during the progress of the work, whether by law or agreement between CSXT and its employees, or if the tax rates on labor are changed, bills will be rendered by CSXT and paid by Agency using the new rates. Agency and Contractor shall perform their operations that require flagging protection or inspection service in such a manner and sequence that the cost of such will be as economical as possible.

XI. UTILITY FACILITIES ON CSXT PROPERTY

- A. Agency shall arrange, upon approval from CSXT, to have any utility facilities on or over CSXT Property changed as may be necessary to provide clearances for the proposed trackage.

XII. CLEAN-UP

- A. Contractor, upon completion of the Project, shall remove from CSXT's Property any temporary grade crossings, any temporary erosion control measures used to control drainage, all machinery, equipment, surplus materials, falsework, rubbish, or temporary buildings belonging to Agency or Contractor. Contractor, upon completion of the Project, shall leave CSXT Property in neat condition, satisfactory to CSXT Representative.

XIII. FAILURE TO COMPLY

- A. If Agency or Contractor violate or fail to comply with any of the requirement of the Special Provisions, (a) CSXT may require Agency and/or Contractor to vacate CSXT Property; and (b) CSXT may withhold monies due Agency and/or Contractor; and (c) CSXT may cure such failure and the Agency and/or Contractor shall reimburse CSXT for the cost of curing such failure. Any such orders shall remain in effect until the Contractor has remedied the situation to the satisfaction of CSXT.

XV. INSURANCE REQUIREMENTS

A. Insurance Policies:

1. Company and Contractor, if and to the extent that either is performing work on or about CSXT's property, shall procure and maintain the following insurance policies:
 - a. Commercial General Liability coverage at their sole cost and expense with limits of not less than \$5,000,000 in combined single limits for bodily injury and/or property damage per occurrence, and such policies shall name CSXT as an additional insured.
 - b. Statutory Worker's Compensation and Employers Liability Insurance with limits of not less than \$1,000,000 which insurance must contain a waiver of subrogation against CSXT and its affiliates (if permitted by state law).
 - c. Commercial Automobile Liability Insurance with limits of not less than \$1,000,000 combined single limit for bodily injury and/or property damage per occurrence. Such policies shall name CSXT as an additional insured.
 - d. Railroad protective liability insurance with limits of not less than \$5,000,000 combined single limits for bodily injury and/or property damage per occurrence and an aggregate annual limit of \$10,000,000. The insurance shall satisfy the following additional requirements:
 - i. The Railroad Protective Insurance Policy must be on the ISO/RIMA Form of Railroad Protective Insurance –Insurance Services Office (ISO) Form CG 00 35.
 - ii. CSX Transportation must be the named insured on the Railroad Protective Liability Insurance Policy. The address should be listed as:

CSX Transportation, Inc.
500 Water Street – C907
Jacksonville, FL 32202
 - iii. Name and Address of Contractor and Agency must be shown on the Declarations page.
 - iv. Description of operations must appear on the Declarations page and must match the Project description, including project or contract identification numbers.

- v. Authorized endorsements must include the Pollution Exclusion Amendment – CG 28 31, unless using form CG 00 35 version 96 and later.
- vi. Authorized endorsements may include:
 - 1) Broad Form Nuclear Exclusion – IL 00 21.
 - 2) 30-day Advance Notice of Non-renewal or Cancellation.
 - 3) Required State Cancellation Endorsement.
 - 4) Quick Reference or Index – CL/IL 240.
- vii. Authorized endorsements may not include:
 - 1) A Pollution Exclusion Endorsement except CG 28 31.
 - 2) A Punitive or Exemplary Damages Exclusion.
 - 3) A “Common Policy Conditions” Endorsement.
 - 4) Any endorsement that is not named in Section XV.A.d.v or XV.A.d.vi above.
 - 5) Policies that contain any type of deductible.
- viii. All insurance companies must be A. M. Best rated A- and Class VII or better.
- ix. Such additional or different insurance as CSXT may require.

XVI. ADDITIONAL TERMS

- A. Contractor must submit its original Railroad Protective Liability policy, Certificates of Insurance and all notices and correspondence regarding the insurance policies to:

insurancedocuments@csx.com
- B. Neither Contractor, Company and/or Agency may begin work on the Project until it has received CSXT’s written approval of the required insurance policies.

XVII. REQUIRED INSURANCE FOR OTHER ACTIVITIES

- A. CSXT requires different insurance requirements for other activities along its Right-of-Way, including, but not limited to, passenger train operations. The contractor shall obtain any information in response to other required insurance directly from CSXT if any additional insurance shall be required including, but not limited to, type, endorsements, limits, additional named insured, etc.

Basis of Payment:

- A. Railroad traffic maintenance as herein required shall be paid for at the Contract lump sum price bid for "Maintenance of Railroad Traffic (CSXT)" as shown in the Proposal, for CSX Transportation, Inc., which price and payment shall include all costs of maintaining Railroad traffic during the life of the Contract, all incidental costs imposed by the Railroad on the Contractor due to operations and activities, except Protective Services (which will be paid directly to the Railroad by the State). The requirements include also, but are not limited to, furnishing and hauling all materials; for Railroad Protective Liability Insurance or other required Insurance not normally held in force by the contractor, as required in these Special Provisions; for clean-up and restoration of railroad site, for any cost incidental to or arising from the need to meet any or all requirements outlined herein; and for all materials, labor, tools, equipment, appurtenances, and incidentals necessary to complete the item.
- B. Payment for the Railroad Protective Liability Insurance requirements and all other required Insurance not normally held in force by the contractor shall be made under this Item. All other Insurances (such

as, but not limited to, auto, etc.) required for this Contract shall be considered incidental to the Contract.

NOTES:

- A. As stated above in this specification, DeIDOT will pay the Railroad directly for protective services required for this project. Should deviation from the sequence of construction plan by the Contractor result in additional costs for protective services than the method and sequence of construction originally shown in the Plans, then that additional cost shall be deducted from monies due the Contractor unless prior permission was obtained from DeIDOT to revise the original method.
- B. Should the Railroad find the Contractor is or has been working within distances that violate existing restrictions or instructions given by the Railroad's authorized representative or performs work that has not been scheduled with the Railroad's authorized representative, an additional flagman or flagmen may be required until that phase or stage of the project has been completed or until such time as the Contractor follows accepted and approved prior instructions. If such additional flagging requirements are imposed by the Railroad because of the Contractor's negligence or willful disregard of Railroad requirements, the Contractor will be held responsible for the extra cost involved.
- C. Time charges for flagging services provided, but not needed for legitimate pursuit of construction will be recorded and other flagging charges due to the willful disregard of Railroad requirements or restrictions will be deducted from monies due the Contractor.

6/3/19

- 831501 - FURNISH AND INSTALL 4" SCHEDULE 80 PVC CONDUIT (OPEN CUT)**
- 831503 - FURNISH AND INSTALL 2-1/2" SCHEDULE 80 PVC CONDUIT (OPEN CUT)**
- 831512 - FURNISH AND INSTALL 1" SCHEDULE 80 PVC CONDUIT (TRENCH)**
- 831514 - FURNISH AND INSTALL 2-1/2" SCHEDULE 80 PVC CONDUIT (TRENCH)**
- 831515 - FURNISH AND INSTALL 3" SCHEDULE 80 PVC CONDUIT (TRENCH)**
- 831516 - FURNISH AND INSTALL 4" SCHEDULE 80 PVC CONDUIT (TRENCH)**
- 831522 - FURNISH AND INSTALL 1" GALVANIZED STEEL CONDUIT (TRENCH)**
- 831523 - FURNISH AND INSTALL 2" GALVANIZED STEEL CONDUIT (TRENCH)**
- 831538 - FURNISH AND INSTALL 2" GALVANIZED STEEL CONDUIT (ON STRUCTURE)**
& INSTALL SECOND AND SUBSEQUENT ADDITIONAL 3" SCHEDULE 80 PVC CONDUITS
IN TRENCH OR OPEN CUT
- 831574 - FURNISH & INSTALL SECOND AND SUBSEQUENT ADDITIONAL 4" SCHEDULE**
80 PVC CONDUITS IN TRENCH OR OPEN CUT

Description:

This work consists of furnishing and installing a conduit or shield, of the type and size required and as specified in the contract documents or as directed by the Engineer.

Materials:

All conduits shall be UL listed.

HDPE Conduit - 2" and 4" diameter, high density polyethylene (HDPE) SDR-13.5, smooth wall conduit with permanently pre-lubricated lining, meeting ASTM D2447, ASTM D3035 and NEMA TC7 specifications.

PVC Conduit - 4", 3", 2-1/2", 2" or 1" diameter, schedule 80 rigid polyvinyl chloride (PVC) conduit, meeting Commercial Standard CS-272-65 (PVC), ASTM D-1785 and U.C. Standard 651 specifications.

Galvanized Steel Conduit - 4", 3", 2-1/2", 2", 1-1/2" or 1" diameter, rigid galvanized steel conduit meeting National Electric Code 2002, Article 344.

HDPE Conduit to PVC Conduit Coupling - Galvanized steel meeting Commercial Standard CS-272-65 (PVC), ASTM D-1785 and U.C. Standard 651 specifications

Flexible Metallic-Liquidtight Conduit - meets National Electric Code 2002, Article 350

Weatherhead for galvanized or PVC conduit - material shall match the adjoining conduit

Insulated grounding bushing with knockouts - meet or exceed UL 514 B

Condulets for conduit sizes - material shall match the adjoining conduit

Anchors - A 307, Galvanized per A 153

One hole conduit hangers - Steel City Series 6H or 6H-B, CADDY CD3B Rigid Conduit Hanger, or approved equal

End caps - material shall match the adjoining conduit

LONG sweep sections for conduit sizes - material shall match the adjoining conduit, and shall be manufactured 90 degree sweeping bends.

Construction Methods:

General Installation Requirements -

The Department has the right to reject any installation method proposed for a given work site. PVC shall not be installed under existing pavement unless it is on a continuous roll or with the Engineer's written approval.

Conduit installed underground shall be installed in a straight line between terminal points. In straight runs, junction well spacing shall be no more than 600 feet for fiber optic conduit or no more than 300 feet for copper in conduit, or as directed by the Engineer. If bends are required during installation, they must be manufactured sweeping bends. The Engineer will be consulted before any bends are installed to ensure that the proper arc is provided.

Underground conduit shall have a minimum cover as measured from the finished grade of 24 inches and a maximum cover of 48 inches. The opening shall be filled half way with the cover material, and tamped down firmly before filling in the remainder of the opening. Additional lifts shall be used as required to install the metallic warning tape at the specified depth. All cover material shall be free of rocks, debris, vegetation or other deleterious material that may damage the conduit. An underground utility warning tape shall be installed as specified in this section and the remainder of the fill shall be added, tamping down the top layer.

Conduit not terminated to a base or in a junction well shall be terminated 2 feet beyond the edge of the pavement unless otherwise directed by the Engineer, and properly capped. Tape is NOT an approved method. Conduit shall not extend more than 3 inches inside a junction well. See Standard Construction Details or applicable Plan Details for typical methods of termination.

All underground conduits shall be marked in the ground with a metallic warning tape. The marking tape shall be buried directly above the conduit run that it identifies, at a depth of approximately 12 inches below final grade. The tape identifying ALL conduits shall be at least 6 inches wide, and have a minimum thickness of 3 mils and 500 percent elongation.

The color of the metallic warning tape identifying fiber optic cable should be bright orange (preferably AULCC orange), and shall read "WARNING - OPTICAL CABLE" or other wording approved by the Engineer that conveys the same message. The color of the tape identifying all other cables shall be bright red, and shall read "WARNING -BURIED ELECTRIC BELOW" or other wording approved by the Engineer that conveys the same message.

Using conduit tools, rigid metallic conduit shall be cut, reamed, and threaded. The thread length shall be as necessary to ensure that the sections of conduits when screwed into a coupling and tightened correctly will butt together and the joint will be watertight. A three-piece threaded union, as approved by the Engineer, shall be used to join two threaded lengths of conduit in the case where a standard coupling will not work. A threaded union shall not be used in a conduit run that is to be driven. At no time is a threadless coupling or a split-bolt coupling to be used for direct buried conduit.

All lengths of HDPE conduit shall be connected with irreversible fusion couplings. Mechanical and removable couplings will not be accepted.

All lengths of PVC conduit shall be connected by one conduit end fitting inside the flared end of the other conduit section. If this is not possible, then a coupling may be used. Regardless of how connection is made, all joints shall be sealed with the appropriate epoxy to ensure that the two conduit pieces bond to one another to form a solid waterproof link. Using conduit tools, the conduit shall be cut and prepared. If approved by the Engineer, a coupler module may be used where conduit segments do not align properly to allow the flared end of one conduit segment to mate with the normal end of the other segment.

Sealed end caps (with knockouts if empty) shall be placed on the ends of all conduits, after compressed air has been used to clear all foreign matter.

If not already pre-installed by the manufacturer, a polyester or polypropylene pulling rope or tape (fish wire) with a minimum rated strength of 1250 pounds shall be installed in each conduit for future use. In instances where the Contractor installs the cable, the fish wire may be eliminated.

All PVC and HDPE conduits shall have a continuous metallic trace wire installed for the entire length of the conduit run for all fiber installations.

Generally, Item No. 908020 - Erosion Control Blanket Mulch in the Department's 2016 Standard Specifications would be used to stabilize slopes that are 2:1 or flatter. For slopes that are steeper than 2:1 and/or receive a moderate amount of concentrated flow, Item No. 908021 - Turf Reinforcement Matting, Type 1 in the Department's 2016 Standard Specifications would be used for slope stabilization. However, if required Contractor shall refer to DelDOT's Erosion and Sediment Control Manual for the placement of steep slope stabilization.

Installation of Conduit Under Existing Pavement, Directional Bore -

Directional bore shall be used for installation of conduits under existing pavement with a conduit diameter not less than 1-1/2". The size of a bore shall not exceed the outside diameter of the conduit by more than 1 inch. If it does, cement grout shall be pumped into the void. Only HDPE and/or Galvanized Steel conduit may be installed by Directional Bore methods.

Installation of Conduit Under Existing Pavement, Open Cut -

Installation by sawcutting the full pavement depth and removing the existing pavement with an excavator or by hand methods, shall be used only for conduits not less than 1-1/2" diameter. The Engineer must first approve all open cutting of roadways. The width and length of open cut and patch restoration materials shall be as shown on the plan details. The Contractor shall be responsible for the removal of all cut pavement and surplus excavation, and for the replacement and correction of any damaged pavement outside the sawcut limits after the conduit(s) are installed. Asphalt pavement, concrete, base course, sawcutting, and/or borrow from an outside source as required to restore the roadway will be paid for separately under their respective bid items.

Installation of Conduit Under Existing Pavement, Unpaved Trench -

Trenching or other approved method shall be used for installation of conduit in unpaved trench or under new pavement. Backfill in conduit trenches shall be compacted thoroughly as it is being placed. At the discretion of the Engineer, sod, that must be removed for the placement of conduit, shall be removed either by the use of an approved sod cutter and then replaced, or 6 inches of topsoil shall be placed and the surface seeded in accordance with Section 734001 - Seeding. In areas where new pavement is to be placed or in areas where total reconstruction is taking place, sodding or seeding may not be required by the Engineer. Sodding and/or topsoil from an outside source if required will be paid for separately under their respective bid items. Seeding is considered incidental to the conduit item.

Installation of Conduit on Structure -

Conduit installed on structure shall consist of drilling anchors into concrete, brick, stone, steel or wood and mounting the conduit with the proper clamps or hangers. The conduit shall be attached to the structure by use of one-hole conduit hangers and approved anchors not more than 36 inches apart. Any 90-degree turns in the conduit run shall be accomplished by placing the proper size and type manufactured sweeping bends for the application needed.

Installation of Additional Conduit in Trench or Open Cut Pavement:

In the case of slotted or trenched installations, the Contractor shall install additional conduits at the same time as the initial installation. The Engineer shall indicate the quantity of conduits to be installed during a build. Additional conduits may be stacked one on top of the other, side by side or in a matrix. The orientation shall be at the Contractor's discretion, but conduits shall not twist around one another or be allowed to deviate from straight line paths except in the case of bend installations. Conduits installed at the same time in the same trench or slot shall remain oriented the same in relation to one another throughout the conduit run.

Installation of Additional Conduits in Directional Bore:

In the case of a directional bore that more than one conduit shall be installed, the Contractor shall, at the same time as the initial installation, install one (1) or more additional conduits. The Engineer shall

indicate the quantity of conduits to be installed during a build. The additional conduits may be stacked one on top of the other, side by side or in a matrix. The orientation shall be at the Contractors discretion, but conduits shall not twist around one another or be allowed to deviate from straight line paths except in the case of a gentle bend. Conduits installed at the same time, in the same bore shall remain oriented in the same relation to one another throughout the conduit run.

Method of Measurement:

The quantity of conduit furnished and installed as specified, shall be measured as the number of linear feet of conduit furnished, installed as specified, complete in place, and accepted.

The length of each conduit installed under existing pavement by a directional bore or by open cutting the pavement shall be measured along the path of the bore or open cut, from the point that cannot be trenched to the point that trenching can resume.

The length of any conduit that is reduced or divided (with a junction well or conduit body) shall be measured as part of the larger conduit.

Basis of Payment:

The quantity of conduit will be paid for at the Contract unit price per linear foot. Price and payment shall include full compensation for all materials, and labor, topsoil and seed if needed, and incidentals necessary to complete the item. Payment for all necessary couplings shall be incidental to the price of the conduit. For conduit installed by Directional Bore, the linear foot payment also includes excavation and backfilling for Bore Equipment, placing the conduit, caps if required, and all other requirements and incidentals listed in the body of this specification.

For conduit installed by Open Cutting existing pavement, the linear foot payment also includes excavating, backfilling, placing the conduit, disposal of excess materials, and all other requirements and incidentals listed in the body of this specification.

For conduit installed in an Unpaved Trench, the linear foot payment also includes excavating, removal of sod if required, backfilling, placing the conduit, disposal of excess materials, replacing excavated on-site sod if required, seeding if required, and all other requirements and incidentals listed in the body of this specification. Sod and/or topsoil furnished from an outside source, will be paid for separately.

For conduit installed on a structure, the linear foot payment also includes furnishing and installing anchors and hangers, removal of excess materials, and all other requirements and incidentals listed in the body of this specification.

4/12/2018



STATE OF DELAWARE
DEPARTMENT OF TRANSPORTATION
800 BAY ROAD
P.O. BOX 778
DOVER, DELAWARE 19903

JENNIFER COHAN
SECRETARY

15 JANUARY, 2019
STATE CONTRACT #T201606108
F.A.P. # NONE
PROJECT ID#16-06108
Pavement and Rehabilitation, North VIII, 2016
NEW CASTLE COUNTY

Location:

Maryland Avenue from Augustine Street (Newport) to MLK Jr Boulevard (Wilmington).

Scope of Work:

Mill and pave Maryland Ave. roadway patching. ADA curb ramps, curb and drainage repairs, utility adjustments, and pavement markings.

The following utility companies may own and/or maintain facilities within the project limits:

ARTESIAN WATER COMPANY
AT&T TRANSMISSION
CAVALIER TELEPHONE
COMCAST
DELMARVA POWER – ELECTRIC
DELMARVA POWER - GAS
FIBERTECH
MCI TELECOMMUNICATIONS
NEW CASTLE COUNTY DEPT. OF SPECIAL SERVICES
QWEST COMMUNICATIONS
SUEZ WATER DELAWARE INC.
VERIZON DELAWARE INC.
ZAYO

Utility adjustments and/or relocations shall be performed as narrated, but are not limited to the following:

ARTESIAN WATER COMPANY:

Artesian Water maintains underground water facilities within the project limits with no anticipated impacts with the exception of water valve risers within the paving area. The Contractor must use care when working in these areas. The State Contractor is not permitted to draw water from any hydrant for any use, without the written permission of the Artesian Water Company and proper metering and backflow prevention equipment in place. Any adjustments, including valve risers, to Artesian Water Company facilities shall be performed by the utility after a fourteen (14) calendar day notice from the State Contractor. The time to complete any relocations/adjustments will depend on the nature of the work.

No working/existing Artesian Water Company facilities can be taken out of service. These facilities will remain in place and active during the duration of this contract.

AT&T TRANSMISSION:

AT&T maintains aerial and underground facilities within the project limits with no apparent conflicts. The contractor must use care when working in these underground areas as well as overhead cable crossing.

Any relocations/adjustments to any existing aerial/underground lines shall be arranged, if necessary, with AT&T, by the State Contractor, during the construction of the project. Should any adjustments to AT&T telecommunication facilities be needed they shall be made by AT&T with a minimum of fourteen (14) calendar days in advance given to AT&T by the State Contractor. The time to complete any relocations/adjustments will depend on the nature of the work.

No working/existing AT&T facilities can be taken out of service. These facilities will remain in place and active during the duration of this contract.

CAVALIER TELEPHONE:

Cavalier Telephone Mid-Atlantic LLC (DBA-Windstream) maintains aerial and underground facilities within the project limits with no apparent conflicts. The contractor must use care when working in these underground areas as well as overhead cable crossing.

Any relocations/adjustments to any existing aerial/underground lines shall be arranged, if necessary, with Windstream, by the State Contractor, during the construction of the project. Should any adjustments to Windstream telecommunication facilities be needed they shall be made by Windstream with a minimum of fourteen (14) calendar days in advance given to Windstream by the State Contractor. The time to complete any relocations/adjustments will depend on the nature of the work.

No working/existing Windstream facilities can be taken out of service. These facilities will remain in place and active during the duration of this contract.

T201606108

Pavement and Rehabilitation, North VIII, 2016
Maryland Avenue

COMCAST CABLE OF NEW CASTLE COUNTY:

Comcast maintains aerial and underground facilities within the project limits with no apparent conflicts. The contractor must use care when working in these underground areas as well as overhead cable crossing.

Any relocations/adjustments to any existing aerial/underground lines shall be arranged, if necessary, with Comcast, by the State Contractor, during the construction of the project. Should any adjustments to Comcast telecommunication facilities be needed they shall be made by Comcast with a minimum of fourteen (14) calendar days in advance given to Comcast by the State Contractor. The time to complete any relocations/adjustments will depend on the nature of the work.

No working/existing Comcast facilities can be taken out of service.

These facilities will remain in place and active during the duration of this contract.

DELMARVA POWER – ELECTRIC:

Delaware Power - Electric maintains aerial and underground electric facilities within the project limits. Delmarva Power - electric does not anticipate any conflicts with its existing facilities. Should any conflicts be encountered during construction requiring adjustment and/or relocation to the aforementioned utility's existing facilities, the necessary relocation work shall be accomplished by the respective company's forces, as directed by the Engineer.

Delmarva Power has a written requirement regarding working near overhead power lines.

Customer/Contractor Acknowledgement: Performing Work within Dangerous Proximity of High Voltage Lines:

“You are hereby notified by Delmarva Power that NO work can be performed within dangerous proximity to Delmarva's overhead lines and that you are required by law to comply with applicable OSHA regulations and the applicable state High Voltage Safety Act. Performance of any activity or causing any person, equipment or things to come within dangerous proximity of Delmarva's overhead lines creates an extreme risk of severe injury or death. You are further notified that no activities may be conducted within dangerous proximity of Delmarva's overhead lines until mutually agreeable measures to prevent contact with overhead lines have been reached with Delmarva and Delmarva has provided you with written authorization to perform the activities.

Additionally any work involving the use of a crane with intentions to remain outside of dangerous proximity, but within 20 feet of the Company's overhead lines, requires an Encroachment Prevention Plan in order to satisfy OSHA”

Outages of these lines are not anticipated or scheduled and it is the State Contractor's responsibility and cost to arrange with DP&L for any outage requests. DP&L will determine if these outages can be accommodated, including coordination regarding power to emergency sirens, and there are no guarantees that outages will be provided.

For exact location of electric facilities, please contact Miss Utility at (800) 282-8555.

No working/existing Delmarva Power Electric facilities can be taken out of service.

These facilities will remain in place and active during the duration of this contract.

DELMARVA POWER – GAS:

Delmarva Power maintains plastic and steel high pressure gas mains with service laterals, throughout the project limits. No relocations are anticipated.

Gas manholes and gas valve risers will require adjustment during paving. The Contractor must use care when working in these areas. Any adjustments, including valve risers, to Delmarva Power-Gas facilities shall be performed by the utility after a minimum of fourteen (14) calendar day notice from the State Contractor. The time to complete any relocations/adjustments will depend on the nature of the work.

No working/existing Delmarva Power Gas facilities can be taken out of service.

These facilities will remain in place and active during the duration of this contract.

Report a Gas Leak and Other Emergencies: 1-302-454-0317.

FIBERTECH:

Fibertech (Crown Castle) maintains aerial and underground facilities within the project limits with no apparent conflicts. The contractor must use care when working in these underground areas as well as overhead cable crossing.

Any relocations/adjustments to any existing aerial/underground lines shall be arranged, if necessary, with Fibertech, by the State Contractor, during the construction of the project. Should any adjustments to Fibertech telecommunication facilities be needed they shall be made by Fibertech with a minimum of fourteen (14) calendar days in advance given to Fibertech by the State Contractor. The time to complete any relocations/adjustments will depend on the nature of the work.

No working/existing Fibertech facilities can be taken out of service.

These facilities will remain in place and active during the duration of this contract.

MCI TELECOMMUNICATIONS:

MCI maintains aerial and underground facilities within the project limits with no apparent conflicts. The contractor must use care when working in these underground areas as well as overhead cable crossing.

Any relocations/adjustments to any existing aerial/underground lines shall be arranged, if necessary, with MCI by the State Contractor, during the construction of the project. Should any adjustments to MCI telecommunication facilities be needed they shall be made by MCI with a minimum of fourteen (14) calendar days in advance given to MCI by the State Contractor. The time to complete any relocations/adjustments will depend on the nature of the work.

No working/existing MCI facilities can be taken out of service.

These facilities will remain in place and active during the duration of this contract.

NEW CASTLE COUNTY DEPT. OF SPECIAL SERVICES:

New Castle County Department of Special Services maintains underground facilities within the limits of the project with no apparent conflicts.

The State Contractor shall adjust all NCC Sewer manhole frame and lids as directed by the engineer. Any other relocations/adjustments to any existing underground facilities shall be arranged, if necessary, with the owners and performed by the state's contractor during the construction of the project. The time to complete any additional relocations/adjustments will depend on the nature of the work.

No working/existing New Castle County facilities can be taken out of service.

These facilities will remain in place and active during the duration of this contract.

QWEST COMMUNICATIONS:

Qwest Communications maintains aerial and underground facilities within the project limits with no apparent conflicts. The contractor must use care when working in these underground areas as well as overhead cable crossing.

Any relocations/adjustments to any existing aerial/underground lines shall be arranged, if necessary, with Qwest by the State Contractor, during the construction of the project. Should any adjustments to Qwest telecommunication facilities be needed they shall be made by Qwest with a minimum of twenty one (21) calendar days in advance given to Qwest by the State Contractor. The time to complete any relocations/adjustments will depend on the nature of the work.

No working/existing Qwest facilities can be taken out of service.

These facilities will remain in place and active during the duration of this contract.

SUEZ WATER:

Suez maintains underground facilities within the limits of the project with no apparent conflicts. Any relocations/adjustments to any existing underground facilities, including water valve risers, shall be arranged, if necessary, with Suez Water by the State Contractor, and performed by the utility during the construction of the project. The time to complete any additional relocations / adjustments will depend on the nature of the work.

No working/existing Suez facilities can be taken out of service.

These facilities will remain in place and active during the duration of this contract.

Suez Water Customer Service Center phone number (800) 668-0856.

VERIZON DELAWARE:

Verizon maintains aerial and underground facilities within the project limits with no apparent conflicts. The contractor must use care when working in these underground areas as well as overhead cable crossing. There are Verizon manhole frames and covers in the roadway and sidewalk areas that will require elevation adjustments.

Any relocations/adjustments to any existing aerial/underground lines shall be arranged, if necessary, with Verizon by the State Contractor, during the construction of the project. Should any adjustments to Verizon telecommunication facilities be needed they shall be made by Verizon with a minimum of twenty one (21) calendar days in advance given to Verizon by the State Contractor. The time to complete any relocations/adjustments will depend on the nature of the work.

No working/existing Verizon facilities can be taken out of service.

These facilities will remain in place and active during the duration of this contract.

For exact location of electric facilities, please contact Miss Utility at (800) 282-8555.

ZAYO:

Zayo Communications maintains aerial and underground facilities within the project limits with no apparent conflicts. The contractor must use care when working in these underground areas as well as overhead cable crossing.

Any relocations/adjustments to any existing aerial/underground lines shall be arranged, if necessary, with Zayo by the State Contractor, during the construction of the project. Should any adjustments to Zayo telecommunication facilities be needed they shall be made by Zayo with a minimum of twenty one (21) calendar days in advance given to Zayo by the State Contractor. The time to complete any relocations/adjustments will depend on the nature of the work.

No working/existing Zayo facilities can be taken out of service.

These facilities will remain in place and active during the duration of this contract.

General Utility Notes

Outside of the companies and facilities discussed above, no additional utility involvement is anticipated. Should any conflicts be encountered as a result of the contractor's means and methods during construction requiring adjustment and/or relocation, the necessary relocation work shall be accomplished by the respective utility company and funded by the State's Contractor as directed by the District Engineer. The State Contractor shall coordinate any potential conflicts with utility companies and provide adequate notice prior to performing work.

Any utility conflicts that are not readily discernable shall be coordinated by the State Contractor once the conflict is recognized. The time to complete any relocations/adjustments found to be necessary during construction of the highway project will depend on the nature of the work. Once the State's contractor has given the Utility the advance notice required above, it is the responsibility of the State's contractor to have the work area prepared and accessible for the Utility to perform the tasks listed above. If the site conditions are not ready and the state contractor has given notice to the utility on when the work is to be accomplished, the State's Contractor shall be responsible for any extra cost incurred by the utility company and the State Contractor shall also be responsible for any time delays. Between when the required notice is

T201606108

Pavement and Rehabilitation, North VIII, 2016
Maryland Avenue

given to the Utility and when the work is performed and completed, the coordination and scheduling of the Utility is the sole responsibility of the State's Contractor. All costs related to the coordination and scheduling of the utilities is incidental to the contract.

Any adjustments and/or relocations of municipally or county owned sewer or water facilities shall be performed by the State's Contractor in accordance with the respective agency's standard specifications as directed by the District Engineer. The State contractor shall coordinate any potential conflicts of municipally or county owned sewer or water facilities with facility owners and provide adequate notice to the municipally or county and to the District Engineer prior to performing work.

General Notes

1. The Contractor's attention is directed to Section 105.09 Utilities, Delaware Standard Specifications, August 2016. The Contractor shall contact Miss Utility (1-800-282-8555) two working days prior to any excavation. The Contractor is responsible for the support and protection of all utilities when excavating. The Contractor is responsible for ensuring proper clearances, including safety clearances, from overhead utilities for construction equipment. The Contractor is advised to check the site for access and operating purposes for his equipment and, if necessary, make arrangements directly with the utility companies for field adjustments for adequate clearances.
2. The information shown in the Contract Documents, including the Utility Statement and the Utility Schedule contained herein, concerning the location, type and size of existing and proposed utilities, their locations, and construction timing has been compiled by the preparer based on information furnished by each of the involved Utility Companies. It shall be the responsibility of the State's Contractor to verify all information and coordinate with the Utility Companies prior to and during construction, as specified in Section 105.09 of the Standard Specifications.
3. It is understood and agreed that the Contractor has considered in his bid all permanent and temporary utility appurtenances in their present and relocated positions as shown on the plans or described in the Utility Statement or are readily discernible and that no additional compensation will be allowed for any delays, inconvenience, or damage due to any interference from the utility facilities and appurtenances or the operation of moving them, except that the Contractor may be granted an equitable extension of time unless the delay is caused by the Contractor's delay in having the site conditions ready for the utility relocation work after the Contractor has provided the advance notice that the site conditions would be ready for the utility relocation work. The contractor's means and method of construction are not taken into account when known utility conflicts are

T201606108

Pavement and Rehabilitation, North VIII, 2016
Maryland Avenue

identified. If the Contractor's means and method of construction create a utility conflict the Utility Statement will prevail in discussions with the utility and the Contractor. The State's Contractor shall be responsible for any costs associated with any temporary outages; holding, bracing and shielding of utility facilities; temporary relocations; or permanent relocations that are not specifically identified in this utility statement or shown in the contract plan set.

4. Coordination and cooperation among the Utility Companies and the State's Contractor are of prime importance. Therefore, the Contractor is directed to contact the following Utility Company representatives with any questions regarding this work prior to submitting bids and work schedules. Proposed work schedules should reflect the Utility Companies' proposed relocations. The Utility Companies do not work on weekends, nights or legal holidays.

NAME	COMPANY	<u>E-MAIL</u>	PHONE NUMBER
Wayne Tyler	Artesian Water Co.	wtyler@artesianwater.com	302 453-6987
Louis Marello	AT & T Corporation	lmarello@att.com	914 397-3744
Jay Everly	TREC Group Inc (for AT&T)	jay@trecgroup.com	610 328-6465
Knol McRae	Comcast	Knol_mcr@comcast.com	302 661-4462
Keith Allridge	AMERICOMM Cable Engineering (for Comcast)	Keith@americomm-llc.com	717 713-7586
James Bunting	DelDOT Traffic	Jim.bunting@state.de.us	302 760-4814
Angel Collazo	Delmarva Power – Electric	Angel.collazo@delmarva.com	302 454-4370
Kristin Stistin	Delmarva Power – Gas	Kristin.Stanfill@delmarva.com	302 429-3364
Bill Muehlberger	Fibertech Networks	bmuehlberger@fibertech.com	585 362-0019
John Alessandrini	MCI	john.alessandrini@verizonbusiness.com	610 337-6707
Dave Clark	New Castle County Dept. of Spec. Services	dclark@nccde.org	302 395-5357

NAME	COMPANY	<u>E-MAIL</u>	PHONE NUMBER
Dan Netta	New Castle County Dept. of Spec. Services	dnetta@nccde.org	302 395-5817
George McElvain	Quest Communications	George.McElvain@CenturyLink.com	303 992-9931
Ted Harris	SUEZ Water	ted.harris@unitedwater.com	302 633-5905 x 316
George Zang	Verizon Delaware	George.w.zang@verizon.com	302 422-1238
Chris Ricciuti	ZAYO	chris.ricciuti@zayo.com	484 696-3903

5. As outlined in Chapter 3 of the DeIDOT Utilities Manual, individual utility companies are responsible for obtaining all required permits from municipal, State and federal government agencies and railroads. This includes but is not limited to water quality permits/DNREC Water Quality Certification, DNREC Subaqueous Lands/Wetlands permits, DNREC Coastal Zone Consistency Certification, County Floodplain permits (New Castle County only), U.S. Coast Guard permits, US Army Corps 404 permits, sediment and erosion permits, and railroad crossing permits.
6. Individual utility companies are required to restore any areas disturbed in conjunction with their relocation work. If an area is disturbed by a utility company and is not properly restored, the Department may have the State's Contractor perform the necessary restoration. Any additional costs incurred as a result will be forwarded to the utility company.
7. 16 Del. C. § 7405B requires notification to and mutually agreeable measures from the public utility operating the electric line for any person intending to carry on any function, activity, work or operation within dangerous proximity of any high voltage overhead electric lines. All contractors/other utilities must also maintain a minimum distance of 10'- 0" from all overhead energized lines. Additional clearance may be required from high voltage transmission lines.
8. Any existing facilities that are comprised of hazardous materials will be removed by the Utility Company unless otherwise outlined in the contract documents or language above. Any existing facilities containing hazardous materials will be purged by the Utility Company unless otherwise outlined in the contract documents or language above.
9. In conjunction with bid preparation and prior to starting work, the State's Contractor shall confirm with all respective Utility Companies noted in this Utility Statement to have

advance utility relocations that the advance relocations have in fact been accomplished as summarized herein.

DIVISION OF TRANSPORTATION SOLUTIONS

Chuck Ferguson

UTILITY COORDINATOR
Chuck.ferguson@state.de.us

10 January 2019

DATE

**STATE OF DELAWARE
DEPARTMENT OF TRANSPORTATION
PO BOX 778
DOVER, DELAWARE 19903**

CERTIFICATE OF RIGHT-OF-WAY STATUS

STATE PROJECT NO. T201606108

F.A.P. NO. N/A for R/W

**PAVE & REHABILITATION, NORTH VIII
(MARYLAND AVENUE) 2016**

**LOCATION #1 – MARYLAND AVE FROM END OF DIVIDED STATUS
EAST OF ST. AUGUSTINE ST – MLK BLVD**

**NEW CASTLE COUNTY
(Updated)**

Certificate of Right-of-Way Status – 100%

Level 1

As required by 23 CFR, Part 635, and other pertinent Federal and State regulations or laws, the following certifications are hereby made in reference to this highway project:

All project construction or work shall be performed within existing rights of way and permanent easements; and,

All necessary real property interests, including control of access rights when pertinent, were acquired as part of previous highway projects, and include legal and physical possession; and,

This project does not cause any persons to be displaced as defined in 49 CFR, Part 24; and,

The State has the right to remove, salvage, or demolish any improvements or personal property that may be located within project limits.

RIGHT OF WAY SECTION



**James Pappas
Acting Chief, Right of Way**

March 17, 2016

REVSIED DATE: December 13, 2018 (Updated)



STATE OF DELAWARE
DEPARTMENT OF TRANSPORTATION
800 BAY ROAD
P.O. BOX 778
DOVER, DELAWARE 19903

JENNIFER COHAN
SECRETARY

August 23, 2018

ENVIRONMENTAL REQUIREMENTS

FOR
State Contract No. T201606108
Federal Aid No.: N/A

Contract Title: Pavement & Rehabilitation, North VIII, 2016

Due to the nature of the proposed construction activities, permits are not required for this project. However, the following construction requirements and special provisions have been developed to minimize and mitigate impact to the surrounding environs. These requirements by DelDOT, not specified within the contract, are listed below. These requirements are the responsibility of the contractor and are subject to risk of shut down at the contractor's expense if not followed.

GENERAL REQUIREMENTS:

1. All construction debris, excavated material, brush, rocks, and refuse incidental to such work shall be placed either on shore above the influence of flood waters or on some suitable dumping ground.
2. That effort shall be made to keep construction debris from entering adjacent waterways or wetlands. Any debris that enters those areas shall be removed immediately.
3. All work will take place within existing right-of-way. No signal work will be considered as part of this location.
4. The disposal of trees, brush, and other debris in any stream corridor, wetland, surface water, or drainage area is prohibited.
5. DelDOT Environmental Studies Section must be notified ((302)760-2264) if there are any changes to the project methods, footprint, materials, or designs, to allow the Department to coordinate with the appropriate resource agencies (COE, DNREC, and SHPO), for approval.



BID PROPOSAL FORMS

CONTRACT T201606108.01

UNLESS OTHERWISE DIRECTED, SUBMIT ALL FOLLOWING PAGES TO:

DEPARTMENT OF TRANSPORTATION
BIDDERS ROOM
800 BAY ROAD
DOVER, DELAWARE 19901

Identify the following on the outside of the sealed envelope:
- Contract Number T201606108.01
- Name of Contractor

CONTRACT ID: T201606108.01 PROJECT(S): T201606108

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS

SECTION 0001 Category 0001

0010	201000 CLEARING AND GRUBBING	LUMP		LUMP		
0020	202000 EXCAVATION AND EMBANKMENT	2751.000 CY				
0030	209006 BORROW, TYPE F	268.000 CY				
0040	211000 REMOVAL OF STRUCTURES AND OBSTRUCTIONS	LUMP		LUMP		
0050	211001 REMOVAL OF PORTLAND CEMENT CONCRETE PAVEMENT, CURB AND SIDEWALK	6034.000 SY				
0060	301002 GRADED AGGREGATE BASE COURSE, TYPE B, PATCHING	591.000 CY				
0070	301003 GRADED AGGREGATE BASE COURSE, TYPE B	120.000 TON				
0080	401029 SUPERPAVE TYPE C, PG 64-22, PATCHING	302.000 TON				
0090	401030 SUPERPAVE TYPE B, PG 64-22, PATCHING	375.000 TON				

CONTRACT ID: T201606108.01 PROJECT(S): T201606108

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0100	401031 SUPERPAVE TYPE BCBC, PG 64-22, PATCHING	1867.000 TON				
0110	401046 SUPERPAVE TYPE C, PG 76-22 (NON-CARBONATE STONE)	12350.000 TON				
0120	401696 ENTRANCE, DRIVEWAY, AND INTERSECTING STREET PAVING SURCHARGE	1000.000 TON				
0130	402000 BITUMINOUS CONCRETE PATCHING	21600.000 SYIN				
0140	403000 BITUMINOUS CONCRETE AND/OR COLD-LAID BITUMINOUS (TRM) CONCRETE	150.000 TON				
0150	503503 PATCHING CONCRETE	155.000 SYIN	5.65000		875.75	
0160	601032 REINFORCED CONCRETE PIPE, 15", CLASS IV	36.000 LF				
0170	602003 DRAINAGE INLET, 34" X 24"	14.000 EACH				
0180	602005 DRAINAGE INLET, 48" X 48"	1.000 EACH				
0190	602012 DRAINAGE INLET, SPECIAL	1.000 EACH				

CONTRACT ID: T201606108.01 PROJECT(S): T201606108

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0200	602065 JUNCTION BOX, SPECIAL	32.000 EACH				
0210	602100 REPLACE DRAINAGE INLET GRATE(S)	43.000 EACH				
0220	602101 REPLACE DRAINAGE INLET FRAME(S)	43.000 EACH				
0230	602130 ADJUSTING AND REPAIRING EXISTING DRAINAGE INLET	48.000 EACH				
0240	602131 ADJUSTING AND REPAIRING EXISTING DOUBLE DRAINAGE INLET	4.000 EACH				
0250	602132 ADJUSTING AND REPAIRING EXISTING MANHOLE	69.000 EACH				
0260	602502 CONVERTING EXISTING CATCH BASIN TO MANHOLE	11.000 EACH				
0270	701011 PORTLAND CEMENT CONCRETE CURB, TYPE 1-4	267.000 LF				
0280	701012 PORTLAND CEMENT CONCRETE CURB, TYPE 1-6	8470.000 LF				
0290	701013 PORTLAND CEMENT CONCRETE CURB, TYPE 1-8	869.000 LF				

CONTRACT ID: T201606108.01 PROJECT(S): T201606108

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0300	701014 PORTLAND CEMENT CONCRETE CURB, TYPE 2	122.000 LF				
0310	701017 INTEGRAL PORTLAND CEMENT CONCRETE CURB AND GUTTER, TYPE 1-6	116.000 LF				
0320	701018 INTEGRAL PORTLAND CEMENT CONCRETE CURB AND GUTTER, TYPE 1-8	10.000 LF				
0330	701022 INTEGRAL PORTLAND CEMENT CONCRETE CURB AND GUTTER, TYPE 3-6	48.000 LF				
0340	702000 TRIANGULAR CHANNELIZING ISLANDS	1167.000 SF				
0350	705001 PORTLAND CEMENT CONCRETE SIDEWALK, 4"	33697.000 SF				
0360	705002 PORTLAND CEMENT CONCRETE SIDEWALK, 6"	18926.000 SF				
0370	705005 PORTLAND CEMENT CONCRETE SIDEWALK, 8"	236.000 SF				
0380	705007 SIDEWALK SURFACE DETECTABLE WARNING SYSTEM	2085.000 SF				
0390	705504 BRICK AND/OR BLOCK SIDEWALK	278.000 SF				

CONTRACT ID: T201606108.01 PROJECT(S): T201606108

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0400	705505 REST STONE/BRICK SIDEWALK AND/OR STONE/BRICK ROADWAY	2644.000 SF				
0410	705506 BRICK AND/OR BLOCK ROADWAY	498.000 SF				
0420	710001 ADJUST WATER SERVICES	5.000 EACH				
0430	710002 ADJUST WATER VALVE BOXES	138.000 EACH				
0440	711500 ADJUST AND REPAIR EXISTING SANITARY MANHOLE	80.000 EACH				
0450	727030 FENCE RELOCATION	15.000 LF				
0460	760006 RUMBLE STRIPS, BITUMINOUS PAVEMENT	240.000 LF				
0470	760010 PAVEMENT MILLING, BITUMINOUS CONCRETE PAVEMENT	212200.000 SYIN				
0480	762000 SAW CUTTING, BITUMINOUS CONCRETE	12448.000 LF				
0490	762001 SAW CUTTING, CONCRETE, FULL DEPTH	3810.000 LF				

CONTRACT ID: T201606108.01 PROJECT(S): T201606108

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0500	763000 INITIAL EXPENSE/DE-MOBILIZATION	LUMP	LUMP			
0510	763501 CONSTRUCTION ENGINEERING	LUMP	LUMP			
0520	801500 MAINTENANCE OF TRAFFIC, ALL INCLUSIVE	LUMP	LUMP			
0530	801501 MAINTENANCE OF RAILROAD TRAFFIC	LUMP	LUMP			
0540	803001 FURNISH AND MAINTAIN PORTABLE CHANGEABLE MESSAGE SIGN	EADY 200.000				
0550	806001 TRAFFIC OFFICERS	2600.000 HOUR	75.00000		195000.00	
0560	808002 FURNISH AND MAINTAIN TRUCK MOUNTED ATTENUATOR, TYPE II	EADY 275.000				
0570	811001 FLAGGER, NEW CASTLE COUNTY STATE	7600.000 HOUR				
0580	811013 FLAGGER, NEW CASTLE COUNTY, STATE, OVERTIME	760.000 HOUR				
0590	817002 PERMANENT PAVEMENT STRIPING, SYMBOL/LEGEND, ALKYD-THERMOPLASTIC	SF 29000.000				

CONTRACT ID: T201606108.01 PROJECT(S): T201606108

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0600	817003 TEMPORARY MARKINGS, PAINT, 4"	156000.000 LF				
0610	817004 TEMPORARY MARKINGS, PAINT, SYMBOL/LEGEND	58000.000 SF				
0620	817005 PERMANENT PAVEMENT STRIPING, ALKYD-THERMOPLASTIC, 5"	940.000 LF				
0630	817006 PERMANENT PAVEMENT STRIPING, ALKYD-THERMOPLASTIC, 12"	370.000 LF				
0640	817013 PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/YELLOW, 5"	78000.000 LF				
0650	817014 PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/YELLOW, 10"	500.000 LF				
0660	817015 PREFORMED RETROREFLECTIVE THERMOPLASTIC MARKINGS, BIKE SYMBOL	55.000 EACH				
0670	817019 PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 5"	50.000 LF				
0680	817024 PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 9"	50.000 LF				

CONTRACT ID: T201606108.01 PROJECT(S): T201606108

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0690	817031 REMOVAL OF PAVEMENT STRIPING	300.000 SF				
0700	819016 INSTALLATION OF 4" DIAMETER HOLE, LESS THAN OR EQUAL TO 6" DEPTH	32.000 EACH				
0710	819018 INSTALLATION OR REMOVAL OF TRAFFIC SIGN(S) ON SINGLE SIGN POST	414.000 EACH				
0720	825001 TUBULAR MARKERS	28.000 EACH				
0730	830001 CONDUIT JUNCTION WELL, TYPE 1, 20" X 20" PRECAST CONCRETE	20.000 EACH				
0740	830002 CONDUIT JUNCTION WELL, TYPE 4, 20" X 42-1/2" PRECAST CONCRETE	3.000 EACH				
0750	830008 ADJUST OR REPAIR EXISTING CONDUIT JUNCTION WELL	50.000 EACH				
0760	831501 FURNISH AND INSTALL 4" SCHEDULE 80 PVC CONDUIT (OPEN CUT)	1360.000 LF				
0770	831503 FURNISH AND INSTALL 2-1/2" SCHEDULE 80 PVC CONDUIT (OPEN CUT)	30.000 LF				

CONTRACT ID: T201606108.01 PROJECT(S): T201606108

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0780	831512 FURNISH AND INSTALL 1" SCHEDULE 80 PVC CONDUIT (TRENCH)	345.000 LF				
0790	831514 FURNISH AND INSTALL 2-1/2" SCHEDULE 80 PVC CONDUIT (TRENCH)	405.000 LF				
0800	831515 FURNISH AND INSTALL 3" SCHEDULE 80 PVC CONDUIT (TRENCH)	50.000 LF				
0810	831516 FURNISH AND INSTALL 4" SCHEDULE 80 PVC CONDUIT (TRENCH)	715.000 LF				
0820	831522 FURNISH AND INSTALL 1" GALVANIZED STEEL CONDUIT (TRENCH)	20.000 LF				
0830	831523 FURNISH AND INSTALL 2" GALVANIZED CONDUIT (TRENCH)	240.000 LF				
0840	831538 FURNISH AND INSTALL 2" GALVANIZED STEEL CONDUIT (ON STRUCTURE)	40.000 LF				
0850	831574 FURNISH AND INSTALL SECOND AND SUBSEQUENT ADDITIONAL 4" SCHEDULE 80 PVC CONDUIT IN TRENCH OR OPEN CUT	260.000 LF				
0860	833001 BONDING AND GROUNDING EXISTING JUNCTION WELL	24.000 EACH				

CONTRACT ID: T201606108.01 PROJECT(S): T201606108

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0870	834001 POLE BASE, TYPE 3	3.000 EACH				
0880	834004 POLE BASE, TYPE 3C	2.000 EACH				
0890	834005 POLE BASE, TYPE 4A	25.000 EACH				
0900	834006 POLE BASE, TYPE 6	4.000 EACH				
0910	835003 CABINET BASE TYPE P	4.000 EACH				
0920	846001 FURNISH AND INSTALL LOOP WIRE 1-CONDUCTOR #14 AWG ENCASED IN 1/4" FLEXIBLE TUBING IN A LOOP SAWCUT	7545.000 LF				
0930	905004 INLET SEDIMENT CONTROL, DRAINAGE INLET	125.000 EACH				
0940	905005 INLET SEDIMENT CONTROL, CURB INLET	15.000 EACH				
0950	908004 TOPSOIL, 6" DEPTH	475.000 SY				
0960	908016 PERMANENT GRASS SEEDING, SUBDIVISION	475.000 SY				
	SECTION 0001 TOTAL					
	TOTAL BID					



**AFFIDAVIT
OF
EMPLOYEE DRUG TESTING PROGRAM**

4104 Regulations for the Drug Testing of Contractor and Subcontractor Employees Working on Large Public Works Projects requires that Contractors and Subcontractors implement a program of mandatory drug testing for Employees who work on Large Public Works Contracts funded all or in part with public funds.

We hereby certify that we have in place or will implement during the entire term of the contract a Mandatory Drug Testing Program for our employees on the jobsite, including subcontractors, that complies with this regulation:

Contractor Name: _____

Contractor Address: _____

Authorized Representative (typed or printed): _____

Authorized Representative (signature): _____

Title: _____

Sworn to and Subscribed before me this _____ day of _____ 20____.

My Commission expires _____ . NOTARY PUBLIC _____.

THIS PAGE MUST BE SIGNED, NOTARIZED, AND RETURNED WITH YOUR BID.

(This form is required from the prime contractor only, not required from subcontractors)

CERTIFICATION
Contract No. T201606108.01

The undersigned bidder, _____
whose address is _____
and telephone number is _____ hereby certifies the following:

I/We have carefully examined the location of the proposed work, the proposed plans and specifications, and will be bound, upon award of this contract by the Department of Transportation, to execute in accordance with such award, a contract with necessary surety bond, of which contract this proposal and said plans and specifications shall be a part, to provide all necessary machinery, tools, labor and other means of construction, and to do all the work and to furnish all the materials necessary to perform and complete the said contract within the time and as required in accordance with the requirements of the Department of Transportation, and at the unit prices for the various items as listed on the preceding pages.

The foregoing quantities are considered to be approximate only and are given as the basis for comparison of bids. The Department of Transportation may increase or decrease the amount of any item or portion of the work as may be deemed necessary or expedient. Any such increase or decrease in the quantity for any item will not be regarded as a sufficient ground for an increase or decrease in the unit prices, nor in the time allowed for the completion of the work, except as provided in the contract.

Accompanying this proposal is a surety bond or a security of the bidder assigned to the Department of Transportation, for at least ten (10) percentum of total amount of the proposal, which deposit is to be forfeited as liquidated damages in case this proposal is accepted, and the undersigned shall fail to execute a contract with necessary bond, when required, for the performance of said contract with the Department of Transportation, under the conditions of this proposal, within twenty (20) days after date of official notice of the award of the contract as provided in the requirement and specifications hereto attached; otherwise said deposit is to be returned to the undersigned.

I/We are licensed, or have initiated the license application as required by Section 2502, Chapter 25, Title 30, of the Delaware Code.

By submission of this proposal, each bidder and each person signing on behalf of any bidder, certifies as to its own organization, under penalty of perjury, that to the best of each signer's knowledge and belief:

1. The prices in this proposal have been arrived at independently without collusion, consultation, communication, or Agreement with any other bidder or with any competitor for the purpose of restricting competition.
2. Unless required by law, the prices which have been quoted in this proposal have not been knowingly disclosed and will not knowingly be disclosed by the bidder, directly or indirectly, to any other bidder or competitor prior to the opening of proposals.
3. No attempt has been made or will be made by the bidder to induce any other person, partnership, or corporation to submit or not to submit a proposal for the purpose of restricting competition.

I/We acknowledge receipt and incorporation of addenda to this proposal as follows:

No.	Date								
_____	_____	_____	_____	_____	_____	_____	_____	_____	_____

BIDDERS MUST ACKNOWLEDGE RECEIPT OF ALL ADDENDA

MUST INSERT DATE OF FINAL QUESTIONS AND ANSWERS ON WEBSITE: _____



AFFIRMATION:

Within the past five (5) years, has your firm, any affiliate, any predecessor company or entity, owner, Director, officer, partner or proprietor been the subject of a Federal, State, Local government suspension or debarment?

YES _____ NO _____ if yes, please explain _____

Agreement to Accept Retainage

"Bidder acknowledges that if its Performance-Based Rating as defined in 29 Del.C. §6962 and section 2408 NEW of Title 2 of Delaware's Administrative Code is below the required minimum threshold, as a condition to bid, Bidder acknowledges, consents and agrees to the Department withholding retainage of up to 5% from the monies due at the time of each progress payment under the contract."

Sealed and dated this _____ day of _____ in the year of our Lord two thousand _____ (20____).

Name of Bidder (Organization)

Corporate
Seal

By: _____

Authorized Signature


Attest _____

Title

SWORN TO AND SUBSCRIBED BEFORE ME this _____ day of _____, 20____.

Notary
Seal

Notary

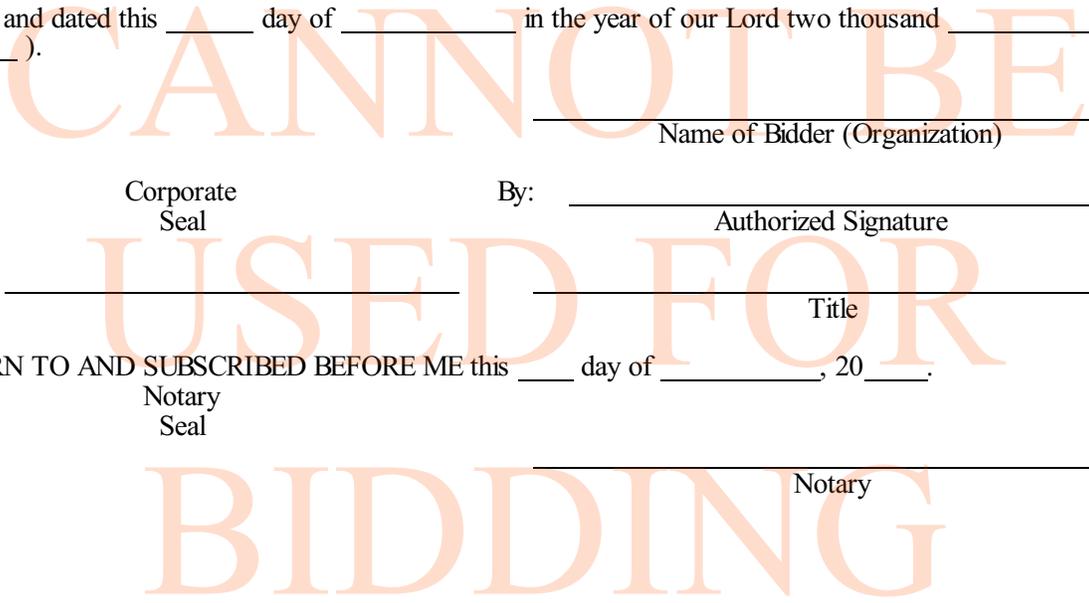

BID BOND

TO ACCOMPANY PROPOSAL
(Not necessary if security is used)

KNOW ALL MEN BY THESE PRESENTS That: _____
of _____ in the County of _____ and State of _____
as **Principal**, and _____ of _____ in the County of _____
and State of _____ as **Surety**, legally authorized to do business in the
State of Delaware ("**State**"), are held and firmly bound unto the **State** in the sum of _____
Dollars (\$ _____), or _____ percent not to exceed _____
Dollars (\$ _____) of amount of bid on Contract
No. T201606108.01, to be paid to the **State** for the use and benefit of its Department of Transportation
("**DelDOT**") for which payment well and truly to be made, we do bind ourselves, our and each of our heirs,
executors, administrators, and successors, jointly and severally for and in the whole firmly by these presents.

NOW THE CONDITION OF THIS OBLIGATION IS SUCH That if the above bounden **Principal** who
has submitted to the **DelDOT** a certain proposal to enter into this contract for the furnishing of certain
materiel and/or services within the **State**, shall be awarded this Contract, and if said **Principal** shall well and
truly enter into and execute this Contract as may be required by the terms of this Contract and approved by
the **DelDOT**, this Contract to be entered into within twenty days after the date of official notice of the award
thereof in accordance with the terms of said proposal, then this obligation shall be void or else to be and
remain in full force and virtue.

Sealed with _____ seal and dated this _____ day of _____ in the year of our Lord
two thousand and _____ (20__).

SEALED, AND DELIVERED IN THE
presence of

Name of Bidder (Organization)

Corporate
Seal

By: _____
Authorized Signature

Attest _____
Title

Name of **Surety**

Witness: _____ By: _____
Title