



STATE OF DELAWARE
DEPARTMENT OF TRANSPORTATION
800 BAY ROAD
P.O. Box 778
DOVER, DELAWARE 19903

JENNIFER COHAN
SECRETARY

VIA WEBSITE POSTING

June 15, 2017

Contract No. T201680102.02
Magnolia Truck Wash
Kent County

Ladies and Gentlemen:

Enclosed is Addendum No. 3 for the referenced contract consisting of the following:

1. The date for the receipt of bids has been moved to Tuesday, **June 27, 2017**, at 2:00 p.m.
2. The Bid Proposal Cover, revised, to be substituted for the same page in the Proposal.
3. One (1) page, Appendix A, Section 099600-High Performance Coatings, paragraph 3.7 B, Steel Substructures, paragraph A and B, revised, to be substituted for the same page in the Proposal.
4. One (1) page, Plan Sheet 17, revised, to be substituted for the same page in the Proposal.

Please note the revisions listed above and submit your bid based upon this information.

Sincerely,

~signature on file~

Robert A. Kovacs
Competitively Bid Contracts Coordinator
Delaware Department of Transportation

STATE OF DELAWARE



DEPARTMENT OF TRANSPORTATION

BID PROPOSAL

for

CONTRACT T201680102.02

MAGNOLIA TRUCK WASH

RE-ADVERTISEMENT

This Contract Was Previously Advertised & Not Awarded

KENT COUNTY

ADVERTISEMENT DATE: May 15, 2017

**PROSPECTIVE BIDDERS ARE ADVISED THAT THERE WILL BE A PRE-BID MEETING THURSDAY
JUNE 1, 2017 AT 2:00 P.M. IN THE DelDOT ADMINISTRATION BUILDING,
800 BAY ROAD, DOVER, DELAWARE, 19903.**

COMPLETION TIME: 271 Calendar Days

SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION
DELAWARE DEPARTMENT OF TRANSPORTATION
AUGUST 2016


Bids will be received in the Bidder's Room at the Delaware Department of Transportation's Administration Building, 800 Bay Road, Dover, Delaware until 2:00 P.M. local time ~~June 20, 2017~~ **June 27, 2017**

- a. Prime Coat: ~~Epoxy~~ Zinc-Rich Primer, as recommended in writing by topcoat manufacturer.
- b. Intermediate Coat: ~~Polyurethane, two-component, pigmented,~~ Epoxy, High-Build, low gloss, MPI #108, as recommended in writing by topcoat manufacturer. ~~(Gloss Level 6), MPI #72.~~
- c. Topcoat: Polyurethane, two-component, pigmented, gloss (Gloss Level 6), MPI #72.
 - 1) PPG Architectural; Pitthane Ultra Gloss
 - 2) Sherwin Williams; Acrolon 218 HS
 - 3) Approved Equal

END OF SECTION 099600

Q:\SMD\120995_017_Magnolia_Maintenance\CADD\ARCHITECTURAL\12-0995-017b Magnolia Facility Wash Bay ReDesign.rvt

\$DATE_USERS

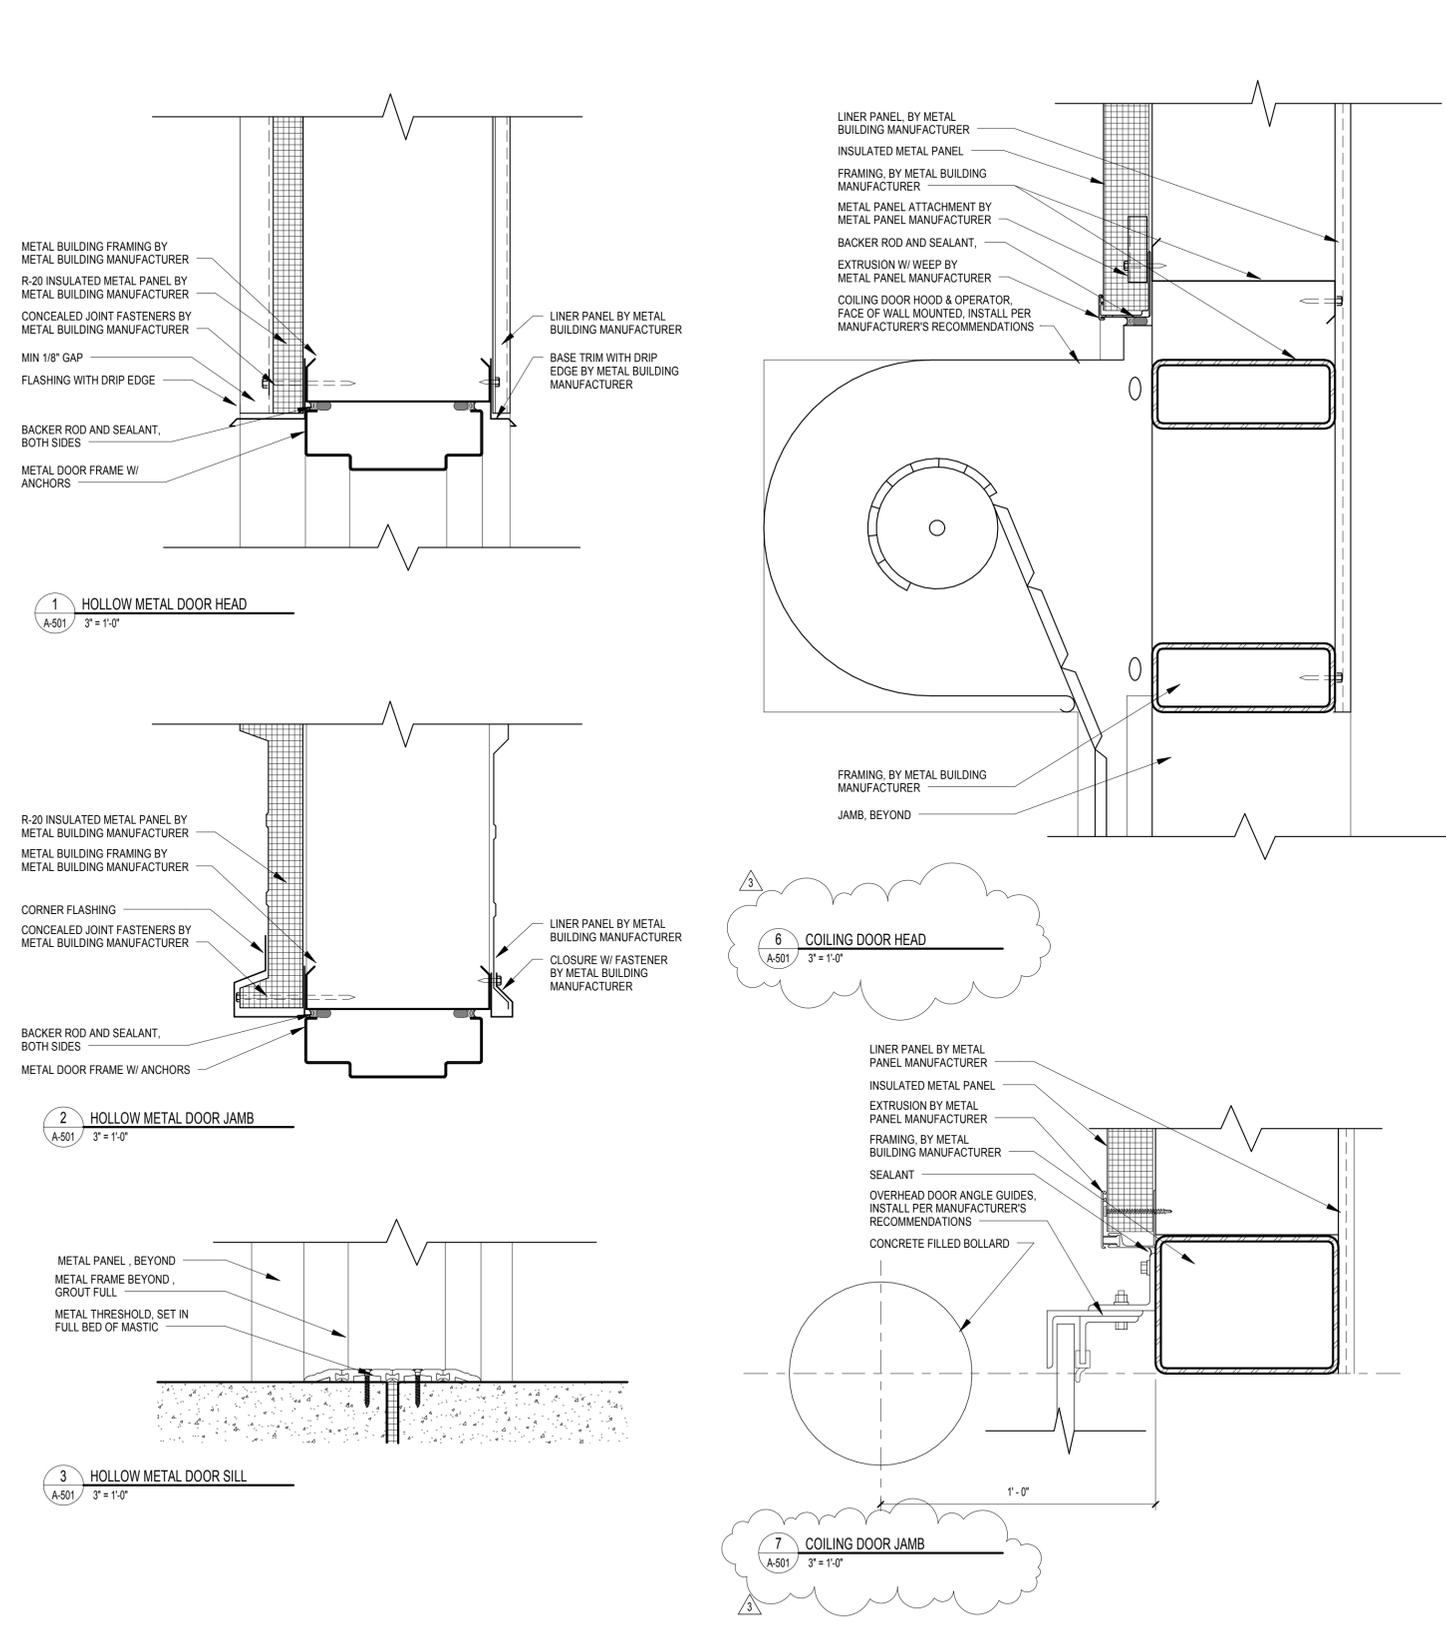

DOOR SCHEDULE																
MARK	DOOR			FRAME												
	WIDTH	HEIGHT	THK	TYPE	MATL	LOUVER		ELEV	MATL	DEPTH	DETAIL HEAD	DETAIL JAMB	DETAIL SILL	FIRE RATING	HARDWARE SET	NOTES
FINISH FLOOR																
101a	3' - 0"	7' - 0"	1 3/4"	F	HM	--	--	1	HM	7 3/4"	1/A-801	2/A-801	3/A-801	--	1	
101b	16' - 0"	16' - 0"	3/4"	OH	STL	--	--	--	STL	--	--	--	--	--	--	
101c	16' - 0"	16' - 0"	3/4"	OH	STL	--	--	--	STL	--	--	--	--	--	--	
102a	3' - 0"	7' - 0"	1 3/4"	F	HM	--	--	1	HM	5 3/4"	1/A-801	2/A-801	3/A-801	--	2	
102b	3' - 0"	7' - 0"	1 3/4"	F	HM	--	--	1	HM	5 3/4"	1/A-801	2/A-801	3/A-801	--	2	
102c	8' - 0"	10' - 0"	3/4"	OH	STL	--	--	--	STL	--	--	--	--	--	--	
102d	3' - 0"	7' - 0"	1 3/4"	F	HM	--	--	1	HM	7 3/4"	1/A-801	2/A-801	3/A-801	--	1	
102e	3' - 0"	7' - 0"	1 3/4"	F	HM	--	--	1	HM	7 3/4"	1/A-801	2/A-801	3/A-801	--	1	

DOOR TYPES:

1. LOCATE DOOR/FRAME MARKS ON SCHEDULES. READ UP FOR CONSTRUCTION, READ ACROSS FOR ADDITIONAL INFORMATION ON TYPE, RATING, ETC.

2. ALL FRAME MARKS SHOWN ON SCHEDULES MAY NOT HAVE BEEN USED.

3. SEE DOOR SIZE SCHEDULE FOR SIZE OF DOORS & OPENINGS FOR FRAMES. ALL DOORS SHALL BE 7'-0" HIGH AND 1 3/4" THICK UNLESS NOTED OTHERWISE.

4. SEE DOOR & FRAME TYPES FOR ELEVATIONS OF EACH TYPE INDICATED.

5. ALL DOOR FRAMES SHALL BE FLUSH W/ WALL CONSTRUCTION UNLESS WALL CONSTRUCTION EXCEEDS 8" (IF WALL EXCEEDS 8" USE 7 3/4" FRAME DEPTH UNLESS NOTED OTHERWISE.)

6. GROUT ALL HOLLOW METAL FRAMES SOLID WHEN IN CONTACT W/ CONCRETE CONSTRUCTION.

7. ALL EXTERIOR HOLLOW METAL FRAMES AND ALL EXTERIOR HOLLOW METAL DOORS SHALL BE GALVANIZED.

8. REFERENCE SPECIFICATION SECTION '087100 - DOOR HARDWARE' FOR DOOR HARDWARE SETS.

DOOR FRAME TYPES:

1. HOLLOW METAL FRAME

LOUVER SCHEDULE

MARK	WIDTH	HEIGHT	SILL ELEV ABOVE FF
L1	32"	30"	17'-6"
L2	24"	24"	18'-0"
L3	10"	10"	7'-4"

PROVIDE GREENHECK ESD-403 DRAINABLE BLADE LOUVER OR EQUIVALENT

ROOM FINISH SCHEDULE															
NO	ROOM NAME	FLOOR			WALLS				CEILING		COMMENTS				
		MAT'L	FIN	BASE	NORTH	EAST	SOUTH	WEST	MAT'L	FIN					
101	WASH BAY	CONCRETE	EPOXY	EPOXY	LINER	FACTORY	LINER	FACTORY	LINER	FACTORY	LINER	FACTORY	LINER	FACTORY	
102	EQUIPMENT ROOM	CONCRETE	EPOXY	EPOXY	LINER	FACTORY	LINER	FACTORY	LINER	FACTORY	LINER	FACTORY	LINER	FACTORY	

