

STATE OF DELAWARE

**This Copy is for information only.
You must request a CD from
DeIDOT in order to bid.**



DEPARTMENT OF TRANSPORTATION

BID PROPOSAL

for

CONTRACT T201906105.01

PAVEMENT & REHABILITATION NORTH V,
CITY OF WILMINGTON 11TH ST

NEW CASTLE COUNTY

ADVERTISEMENT DATE: March 4, 2019

COMPLETION TIME: 140 Calendar Days

SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION
DELAWARE DEPARTMENT OF TRANSPORTATION
AUGUST 2016

Bids will be received in the Bidder's Room at the Delaware Department of Transportation's Administration Building, 800 Bay Road, Dover, Delaware prior to 2:00 P.M. local time April 2, 2019

Contract No.T201906105.01

**PAVEMENT & REHABILITATION NORTH V, CITY OF WILMINGTON 11TH ST
NEW CASTLE COUNTY**

GENERAL DESCRIPTION

LOCATION

These improvements are located in NEW CASTLE County more specifically shown on the Location Map(s) of the enclosed Plans.

DESCRIPTION

The improvements consist of furnishing all labor and materials for Pavement & Rehabilitation North V, City of Wilmington 11th St., and other incidental construction in accordance with the location, notes and details shown on the plans and as directed by the Engineer.

COMPLETION TIME

All work on this contract must be complete within 140 Calendar Days. It is the Department's intent to issue a Notice to Proceed such that work starts on or about May 13, 2019.

PROSPECTIVE BIDDERS NOTES:

1. BIDDERS MUST BE REGISTERED with DelDOT and request a cd of the official plans and specifications in order to submit a bid. Contact DelDOT at dot-ask@state.de.us, or (302) 760-2031. Bids will be received in the Bidder's Room at the Delaware Department of Transportation's Administration Building, 800 Bay Road, Dover, Delaware prior to 2:00 P.M. local time April 2, 2019 unless changed via addendum.
2. QUESTIONS regarding this project are to be e-mailed to dot-ask@state.de.us no less than six business days prior to the bid opening date in order to receive a response. Please include T201906105.01 in the subject line. Responses to inquiries are posted on-line at <http://www.bids.delaware.gov>.
3. PREQUALIFICATION REQUIREMENT - 29 Del.C. §6962 (12)(a) requires DelDOT to include a performance-based rating system for contractors. The Performance Rating for each Contractor shall be **NEW** used as a prequalification to bid at the time of bid. Refer to Contract '**General Notices**' for details.
4. THE BID PROPOSAL incorporates a cd containing **Expedite, version 5.9a** and its installation file. Bidders are to use the cd provided to enter their bid amounts into the Expedite file. The Expedite bid file must be printed and submitted in paper form along with the cd and other required documents prior to the Bid due date and time.
5. SURETY BOND - Each proposal must be accompanied by a deposit of either surety bond or security for a sum equal to at least 10% of the bid.
6. DRUG TESTING - Regulation 4104; The state Office of Management and Budget has developed regulations that require Contractors and Subcontractors to implement a program of mandatory drug testing for Employees who work on Large Public Works Contracts funded all or in part with public funds pursuant to 29 Del.C. §6908(a)(6). Refer to the full REVISED requirements at the following link: <http://regulations.delaware.gov/register/december2017/final/21 DE Reg 503 12-01-17.htm>

Note a few of the requirements;

- * At bid submission - Each bidder must submit with the bid a single signed affidavit certifying that the bidder and its subcontractors has in place or will implement during the entire term of the contract a Mandatory Drug Testing Program that complies with the regulation, *the form is attached*;
- * At least two business days prior to contract execution - The awarded Contractor shall provide to DelDOT copies of the Employee Drug Testing Program for the Contractor, and any other listed Subcontractors;

* Subcontractors - Contractors that employ Subcontractors on the job site may do so only after submitting a copy of the Subcontractor's Employee Drug Testing Program along with the standard required subcontractor information. A Subcontractor shall not commence work until **DeIDOT** has approved the subcontractor in writing;

* Penalties for non-compliance are specified in the regulation.

7. No RETAINAGE will be withheld on this contract unless through the Prequalification Requirements.
8. EXTERNAL COMPLAINT PROCEDURE can be viewed on DeIDOT's Website [here](#), or you may request a copy by calling (302) 760-2555.
9. REMINDER; A copy of your firm's Delaware Business License must be submitted with your bid.
10. SECTION 106.06 BUY AMERICA Contract Requirement in the Delaware Standard Specifications for Road and Bridge Construction, August, 2016 does not apply to this contract.
11. AUGUST 2016 STANDARD SPECIFICATIONS apply to this contract. The Contractor shall make himself aware of any revisions and corrections (Supplemental Specifications, if any) and apply them to the applicable item(s) of this contract. The 2016 Standard Specifications can be [viewed here](#).
- 11a. FLATWORK CONCRETE TECHNICIAN CERTIFICATION TRAINING:
Section 501.03, 503.03, 505.03, 610.03, 701.03 and 702.03 of the 2016 Standard Specifications require contractor's to provide an American Concrete Institute (ACI) or National Ready Mix Concrete Association (NRMCA) certified concrete flatwork technician to supervise all finishing of flatwork concrete. Concrete flatwork certification will be effective starting on June 1, 2018.
12. Contractor shall indemnify and save harmless the CITY OF WILMINGTON, in addition to the STATE, from all suits, actions, or claims pursuant to the State of Delaware, Department of Transportation, Standard Specifications dated August 2016, as amended, which are hereby incorporated herein.

**STATE OF DELAWARE
CONSTRUCTION ITEMS UNITS OF MEASURE**

English Code	English Description	Multiply By	Metric Code	Metric Description	Suggested CEC Metric Code
ACRE	Acre	0.4047	ha	Hectare	HECTARE
BAG	Bag	N/A	Bag	Bag	BAG
C.F.	Cubic Foot	0.02832	m ³	Cubic Meter	M3
C.Y.	Cubic Yard	0.7646	m ³	Cubic Meter	M3
EA-DY	Each Day	N/A	EA-DY	Each Day	EA-DY
EA-MO	Each Month	N/A	EA-MO	Each Month	EA-MO
EA/NT	Each Night	N/A	EA-NT	Each Night	EA/NT
EACH	Each	N/A	EA	Each	EACH
GAL	Gallon	3.785	L	Liter	L
HOUR	Hour	N/A	h	Hour	HOUR
INCH	Inch	25.4	mm	Millimeter	MM
L.F.	Linear Foot	0.3048	m	Linear Meter	L.M.
L.S.	Lump Sum	N/A	L.S.	Lump Sum	L.S.
LA-MI	Lane Mile	1.609	LA-km	Lane-Kilometer	LA-KM
LB	Pound	0.4536	kg	Kilogram	KG
MFBM	Thousand Feet of Board Measure	2.3597	m ³	Cubic Meter	M3
MGAL	Thousand Gallons	3.785	kL	Kiloliter	KL
MILE	Mile	1.609	km	Kilometer	KM
S.F.	Square Foot	0.0929	m ²	Square Meter	M2
S.Y.	Square Yard	0.8361	m ²	Square Meter	M2
SY-IN	Square Yard-Inch	0.8495	m ² -25 mm	Square Meter-25 Millimeter	M2-25 MM
TON	Ton	.9072	t	Metric Ton (1000kg)	TON
N.A.*	Kip	4.448	kN	Kilonewton	N.A.*
N.A.*	Thousand Pounds per Square Inch	6.895	MPa	Megapascal	N.A.*

*Not used for units of measurement for payment.

TABLE OF CONTENTS

GENERAL DESCRIPTION..... i
 LOCATION..... i
 DESCRIPTION..... i
 COMPLETION TIME..... i
 PROSPECTIVE BIDDERS NOTES..... i
 CONSTRUCTION ITEMS UNITS OF MEASURE..... iii

GENERAL NOTICES..... 1
 SPECIFICATIONS..... 1
 CLARIFICATIONS..... 1
 ATTESTING TO NON-COLLUSION..... 1
 QUANTITIES..... 1
 PREQUALIFICATION REQUIREMENT..... 1
 PREFERENCE FOR DELAWARE LABOR..... 1
 EQUALITY OF EMPLOYMENT OPPORTUNITY ON PUBLIC WORKS..... 2
 TAX CLEARANCE..... 2
 LICENSE..... 2
 DIFFERING SITE CONDITIONS..... 2
 RIGHT TO AUDIT..... 3

PREVAILING WAGES..... 3
 STATE WAGE RATES..... 5

SUPPLEMENTAL SPECIFICATIONS..... 6

SPECIAL PROVISIONS..... 7
 CONSTRUCTION ITEM NUMBERS..... 8
 401502 - ASPHALT CEMENT COST ADJUSTMENT..... 9
 401580 – RIDE QUALITY OF HOT-MIX PAVEMENT..... 10
 401696 – ENTRANCE, DRIVEWAY AND INTERSECTING STREET PAVING SURCHARGE..... 15
 401699 - QUALITY CONTROL/QUALITY ASSURANCE OF BITUMINOUS CONCRETE.... 16
 503503 - PATCHING CONCRETE..... 30
 701502 - STONE CURB..... 31
 701503 - CURVED STONE CURB..... 31
 705506 - BRICK AND/OR BLOCK ROADWAY..... 32
 705505 - RESET STONE/BRICK SIDEWALK AND/OR STONE/BRICK ROADWAY..... 34
 763621 - CONSTRUCTION ENGINEERING, REHABILITATION..... 35
 801500 - MAINTENANCE OF TRAFFIC - ALL INCLUSIVE..... 37
 831514 - FURNISH AND INSTALL 2-1/2" SCHEDULE 80 PVC CONDUIT (TRENCH)..... 42
 831515 - FURNISH AND INSTALL 3" SCHEDULE 80 PVC CONDUIT (TRENCH)..... 42
 831516 - FURNISH AND INSTALL 4" SCHEDULE 80 PVC CONDUIT (TRENCH)..... 42
 831523 - FURNISH AND INSTALL 2" GALVANIZED STEEL CONDUIT (TRENCH)..... 42
 831533 - FURNISH AND INSTALL 2" GALVANIZED STEEL CONDUIT (OPEN CUT)..... 42
 831542 - FURNISH AND INSTALL 2" HDPE SDR-13.5 CONDUIT (BORE)..... 42
 831544 - FURNISH AND INSTALL 3" HDPE SDR-13.5 CONDUIT (BORE)..... 42
 831545 - FURNISH AND INSTALL 4" HDPE SDR-13.5 CONDUIT (BORE)..... 42
 831574 - FURNISH & INSTALL SECOND AND SUBSEQUENT ADDITIONAL 4" SCHEDULE 80 PVC CONDUITS IN TRENCH OR OPEN CUT..... 42
 831578 - FURNISH & INSTALL SECOND AND SUBSEQUENT ADDITIONAL 4" HDPE 13.5 SDR CONDUIT IN DIRECTIONAL BORE..... 42
 834501 - PARTIAL REMOVAL OF CONCRETE POLE BASES & CABINET FOUNDATIONS..... 46

UTILITY STATEMENT..... 47

RIGHT OF WAY CERTIFICATE..... 53

ENVIRONMENTAL STATEMENT..... 54

RAILROAD STATEMENT. [55](#)

BID PROPOSAL FORMS. [56](#)

DRUG TESTING AFFIDAVIT. [67](#)

CERTIFICATION..... [68](#)

BID BOND. [70](#)

GENERAL NOTICES

SPECIFICATIONS:

The specifications entitled "Standard Specifications for Road and Bridge Construction, August, 2016", hereinafter referred to as the Standard Specifications, and Supplemental Specifications, the Special Provisions, notes on the Plans, this Bid Proposal, and any addenda thereto shall govern the work to be performed under this contract. The Specifications and Supplemental Specifications can be [viewed here](#).

CLARIFICATIONS:

Under any Section or Item included in the Contract, the Contractor shall be aware that when requirements, responsibilities, and furnishing of materials are outlined in the details and notes on the Plans and in the paragraphs preceding the "Basis of Payment" paragraph in the Standard Specifications or Special Provisions, no interpretation shall be made that such stipulations are excluded because reiteration is not made in the "Basis of Payment" paragraph.

ATTESTING TO NON-COLLUSION:

The Department requires as a condition precedent to acceptance of bids a sworn statement executed by, or on behalf of, the person, firm, association, or corporation to whom such contract is to be awarded, certifying that such person, firm, association, or corporation has not, either directly or indirectly, entered into any agreement, participated in any collusion, or otherwise taken any action in restraint of free competitive bidding in connection with such contract. The form for this sworn statement is included in the proposal and must be properly executed in order to have the bid considered.

QUANTITIES:

The quantities shown are for comparison of bids only. The Department may increase or decrease any quantity or quantities without penalty or change in the bid price.

PREQUALIFICATION REQUIREMENT

29 Del.C. §6962 (12)(a) requires a Department of Transportation project, excluding a Community ^{NEW} Transportation Fund or municipal street aid contract, to include a performance-based rating system. At the time of bid, the Performance Rating for each Contractor shall be used as a prequalification to bid.

Bidders with Performance Rating scores equal to or greater than 85% shall be permitted to bid. Bidders with scores of less than 85% who comply with the retainage requirements of 29 Del.C. §6962 shall be permitted to bid provided the *Agreement to Accept Retainage* (located on the Certification Page) is executed and submitted with the bid. Lack of an executed *Agreement to Accept Retainage* will result in the rejection of the bid by the Department. Successful bidders awarded Department contracts who have no performance history within the last five (5) years will be assigned a provisional Performance Rating of 85% at the date of advertisement.

Notification of Performance Rating. The Department shall post publicly the Performance Rating for all Contractors on the Department's [website](#). DelDOT will complete performance-based evaluations on the construction company contracted by the Department to build the project (the "Contractor"). Provisions to appeal Performance Ratings are described in the regulations. The regulations are set forth in Section 2408 of Title 2, Delaware Administrative Code, found [here](#).

PREFERENCE FOR DELAWARE LABOR:

Delaware Code, Title 29, Chapter 69, Section 6962, Paragraph (d), Subsection (4)b:

"In the construction of all public works for the State or any political subdivision thereof, or by firms contracting with the State or any political subdivision thereof, preference in employment of laborers, workmen or mechanics shall be given to bona fide legal citizens of the State who have established citizenship by residence of at least 90 days in the State. Each public works contract for the construction of public works for the State or any political subdivision thereof shall contain a stipulation that any

person, company or corporation who violates this section shall pay a penalty to the Secretary of Finance equal to the amount of compensation paid to any person in violation of this section."

EQUALITY OF EMPLOYMENT OPPORTUNITY ON PUBLIC WORKS:

Delaware Code, Title 29, Chapter 69, Section 6962, Paragraph (d), Subsection (7) states;

- a. As a condition of the awarding of any contract for public works financed in whole or in part by State appropriation, such contracts shall include the following provisions:

During the performance of this contract, the contractor agrees as follows:

1. The contractor will not discriminate against any employee or applicant for employment because of race, creed, color, sex, sexual orientation, gender identity or national origin. The contractor will take positive steps to ensure that applicants are employed and that employees are treated during employment without regard to their race, creed, color, sex, sexual orientation, gender identity or national origin. Such action shall include, but not be limited to, the following: employment, upgrading, demotion or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship. The contractor agrees to post in conspicuous places available to employees and applicants for employment notices to be provided by the contracting agency setting forth this nondiscrimination clause.
2. The contractor will, in all solicitations or advertisements for employees placed by or on behalf of the contractor, state that all qualified applicants will receive consideration for employment without regard to race, creed, color, sex, sexual orientation, gender identity or national origin.
3. The contractor will ensure employees receive equal pay for equal work, without regard to sex. Employee pay differential is acceptable if pursuant to a seniority system, a merit system, a system which measures earnings by quantity or quality of production, or if the differential is based on any other factor other than sex.

TAX CLEARANCE:

As payments to each vendor or contractor aggregate \$2,000, the Division of Accounting will report such vendor or contractor to the Division of Revenue, who will then check the vendor or contractor's compliance with tax requirements and take such further action as may be necessary to insure compliance.

LICENSE:

A person desiring to engage in business in this State as a contractor shall obtain a license upon making application to the Division of Revenue.

CONTRACTOR / SUBCONTRACTOR LICENSE: 29 DEL. C. §6967:

(b) No agency shall accept a proposal for a public works contract unless such contractor has provided a proper and current copy of its occupational and/or business license, as required by Title 30, to such agency.

(c) Any contractor that enters a public works contract must provide to the agency to which it is contracting, within 30 days of entering such public works contract, copies of all occupational and business licenses of subcontractors and/or independent contractors that will perform work for such public works contract. However, if a subcontractor or independent contractor is hired or contracted more than 20 days after the contractor entered the public works contract the occupational or business license of such subcontractor or independent contractor shall be provided to the agency within 10 days of being contracted or hired.

DIFFERING SITE CONDITIONS,

SUSPENSIONS OF WORK and SIGNIFICANT CHANGES IN THE CHARACTER OF WORK:

Differing site conditions: During the progress of the work, if subsurface or latent physical conditions are encountered at the site differing materially from those indicated in the contract or if unknown physical conditions of an unusual nature, differing materially from those ordinarily encountered and generally recognized as inherent in the work provided for in the contract are encountered at the site, the party discovering such conditions shall promptly notify the other party in writing of the specific differing conditions before they are disturbed and before the affected work is performed.

Upon written notification, the engineer will investigate the conditions, and if he/she determines that the conditions materially differ and cause an increase or decrease in the cost or time required for the performance of any work under the contract, an adjustment, excluding loss of anticipated profits, will be made and the

contract modified in writing accordingly. The engineer will notify the contractor of his/her determination whether or not an adjustment of the contract is warranted.

No contract adjustment which results in a benefit to the contractor will be allowed unless the contractor has provided the required written notice.

No contract adjustment will be allowed under their clause for any effects caused on unchanged work.

Suspensions of work ordered by the engineer: If the performance of all or any portion of the work is suspended or delayed by the engineer in writing for an unreasonable period of time (not originally anticipated, customary or inherent to the construction industry) and the contractor believes that additional compensation and/or contract time is due as a result of such suspension or delay, the contractor shall submit to the engineer in writing a request for adjustment within 7 calendar days of receipt of the notice to resume work. The request shall set forth the reasons and support for such adjustment.

Upon receipt, the engineer will evaluate the contractor's request. If the engineer agrees that the cost and/or time required for the performance of the contract has increased as a result of such suspension and the suspension was caused by conditions beyond the control of and not the fault of the contractor, its suppliers, or subcontractors at any approved tier, and not caused by weather, the engineer will make an adjustment (excluding profit) and modify the contract in writing accordingly. The engineer will notify the contractor of his/her determination whether or not an adjustment of the contract is warranted.

No contract adjustment will be allowed unless the contractor has submitted the request for adjustment within the time prescribed.

No contract adjustment will be allowed under this clause to the extent that performance would have been suspended or delayed by any other cause, or for which an adjustment is provided for or excluded under any other term or condition of this contract.

Significant changes in the character of work: The engineer reserves the right to make, in writing, at any time during the work, such changes in quantities and such alterations in the work as are necessary to satisfactorily complete the project. Such changes in quantities and alterations shall not invalidate the contract nor release the surety, and the contractor agrees to perform the work as altered.

If the alterations or changes in quantities significantly change the character of the work under the contract, whether or not changed by any such different quantities or alterations, an adjustment, excluding loss of anticipated profits, will be made to the contract. The basis for the adjustment shall be agreed upon prior to the performance of the work. If a basis cannot be agreed upon, then an adjustment will be made either for or against the contractor in such amount as the engineer may determine to be fair and equitable.

The term "significant change" shall be construed to apply only to the following circumstances:

- (A) When the character of the work as altered differs materially in kind or nature from that involved or included in the original proposed construction or
- (B) When a major item of work, as defined elsewhere in the contract, is increased in excess of 125 percent or decreased below 75 percent of the original contract quantity. Any allowance for an increase in quantity shall apply only to that portion in excess of 125 percent of original contract item quantity, or in case of a decrease below 75 percent, to the actual amount of work performed.

RIGHT TO AUDIT

The Department shall have the right to audit the books and records of the contractor or any subcontractor under this contract or subcontract to the extent that the books and records relate to the performance of the contract or subcontract. The books and records shall be maintained by the contractor for a period of 3 years from the date of final payment under the prime contract and by the subcontractor for a period of 3 years from the date of final payment under the subcontract (29 Del.C. §6930)

PREVAILING WAGES

Included in this proposal are the minimum wages to be paid various classes of laborers and mechanics as determined by the Department of Labor of the State of Delaware in accordance with Title 29 Del.C. §6960, relating to wages and the regulations implementing that Section.

REQUIREMENT BY DEPARTMENT OF LABOR FOR SWORN PAYROLL INFORMATION

Title 29 Del.C. §6960 stipulates;

(b) Every contract based upon these specifications shall contain a stipulation that the employer shall pay all mechanics and laborers employed directly upon the site of the work, unconditionally and not less often than once a week and without subsequent deduction or rebate on any account, the full amounts accrued at time of payment, computed at wage rates not less than those stated in the specifications, regardless of any contractual relationship which may be alleged to exist between the employer and such laborers and mechanics. The specifications shall further stipulate that the scale of wages to be paid shall be posted by the employer in a prominent and easily accessible place at the site of the work, and that there may be withheld from the employer so much of accrued payments as may be considered necessary by the Department of Labor to pay to laborers and mechanics employed by the employer the difference between the rates of wages required by the contract to be paid laborers and mechanics on the work and rates of wages received by such laborers and mechanics to be remitted to the Department of Labor for distribution upon resolution of any claims.

(c) Every contract based upon these specifications shall contain a stipulation that sworn payroll information, as required by the Department of Labor, be furnished weekly. The Department of Labor shall keep and maintain the sworn payroll information for a period of 6 months from the last day of the work week covered by the payroll.

Bidders are specifically directed to note the Department of Labor's prevailing wage regulations implementing §6960 relating to the effective date of the wage rates, at Section 6.3, which in relevant part states:

"Public agencies (covered by the provisions of 29 Del.C. §6960) are required to use the rates which are in effect on the date of the publication of specifications for a given project. In the event that a contract is not executed within one hundred twenty (120) days from the date the specifications were published, the rates in effect at the time of the execution of the contract shall be the applicable rates for the project."

Contractor may contact:

Department of Labor, Division of Industrial Affairs, 4425 N. Market Street, Wilmington, DE 19802
Telephone (302) 761-8200

STATE OF DELAWARE
DEPARTMENT OF LABOR
DIVISION OF INDUSTRIAL AFFAIRS
OFFICE OF LABOR LAW ENFORCEMENT
PHONE: (302) 761-8200

Mailing Address:
4425 North Market Street
3rd Floor
Wilmington, DE 19802

Located at:
4425 North Market Street
3rd Floor
Wilmington, DE 19802

PREVAILING WAGES FOR HIGHWAY CONSTRUCTION EFFECTIVE MARCH 15, 2018

CLASSIFICATION	NEW CASTLE	KENT	SUSSEX
BRICKLAYERS	53.89	53.89	53.89
CARPENTERS	54.62	54.81	43.57
CEMENT FINISHERS	34.63	34.85	27.71
ELECTRICAL LINE WORKERS	24.02	46.36	22.69
ELECTRICIANS	68.70	68.70	68.70
IRON WORKERS	63.68	25.48	27.06
LABORERS	43.30	40.70	39.95
MILLWRIGHTS	17.20	16.69	14.41
PAINTERS	68.79	68.79	68.79
PILEDRIVERS	70.92	25.36	28.77
POWER EQUIPMENT OPERATORS	45.46	42.29	38.73
SHEET METAL WORKERS	24.30	21.68	19.64
TRUCK DRIVERS	36.49	30.14	36.72

CERTIFIED: 2/20/2019

BY: Michael Hopf for Julie Petroff
ADMINISTRATOR, OFFICE OF LABOR LAW ENFORCEMENT

NOTE: THESE RATES ARE PROMULGATED AND ENFORCED PURSUANT TO THE PREVAILING WAGE REGULATIONS ADOPTED BY THE DEPARTMENT OF LABOR ON APRIL 3, 1992.

CLASSIFICATIONS OF WORKERS ARE DETERMINED BY THE DEPARTMENT OF LABOR. FOR ASSISTANCE IN CLASSIFYING WORKERS, OR FOR A COPY OF THE REGULATIONS OR CLASSIFICATIONS, PHONE 302 761 8200

NON-REGISTERED APPRENTICES MUST BE PAID THE MECHANIC'S RATE.

PROJECT: T201906105.01 Pavement and Rehabilitation North V City of Wilmington 11 th S, New Castle County

SUPPLEMENTAL SPECIFICATIONS TO THE STANDARD SPECIFICATIONS

**EFFECTIVE AS OF THE ADVERTISEMENT
DATE OF THIS PROPOSAL
AND INCLUDED BY REFERENCE**

**The Supplemental Specifications can be viewed and printed from
the Department's Website.**

To access the Website;

- in your internet browser, enter; <https://www.deldot.gov>
- under 'BUSINESS', Click; 'Publications'
- scroll down under 'MANUALS' and Click; "Standard Specifications"
- be sure and choose the correct Standard Specification year; 2001 or 2016
- choose the latest revision prior to the date of this advertisement

The full Website Link is;

https://www.deldot.gov/Publications/manuals/standard_specifications/index.shtml

Copies of the Supplemental Specifications can be printed from the Website.

The Contractor shall make himself aware of these revisions and corrections (Supplemental Specifications), and apply them to the applicable item(s) of this contract.

SPECIAL PROVISIONS

CONSTRUCTION ITEM NUMBERS

All construction pay items are assigned a six (6) digit number, shown as Item Number on the Plans and/or in the Special Provisions, and shall be interpreted in accordance with the following:

Standard Item Number:

The first three digits of the construction item numbers indicates the Section number as described in the Standard Specifications, and all applicable requirements of the Section shall remain effective unless otherwise modified by the Special Provisions. The last three digits of the construction item identifies the item by sequential number under that Section. A comprehensive list of construction item numbers are listed in the Standard Specifications. Additions to this list will be made as required.

Special Provisions Item Number:

The first three digits of the construction items, covered under Special Provisions, indicates the applicable Section number of the Standard Specifications, and shall be governed fully by the requirements of the Special Provisions. The last three digit of the items covered under Special Provisions identifies the item by sequential number.

Examples

Standard Item Number - 202000 Excavation and Embankment

202 Indicates Section Number

000 Indicates Sequential Number

Special Provision Item Number - 202500 Grading and Reshaping Roadway

202 Indicates Section Number

500 Indicates Sequential Number

401502 - ASPHALT CEMENT COST ADJUSTMENT

For Sections 304, 401, 402, 403, 404, and 405, payments to the Contractor shall be adjusted to reflect increases or decreases in the Delaware Posted Asphalt Cement Price when compared to the Project Asphalt Cement Base Price, as defined in these Special Provisions.

The Delaware Posted Asphalt Cement Price will be issued monthly by the Department and will be the industry posted price for Asphalt Cement, F.O.B. Philadelphia, Pennsylvania. The link for the [posting is here](#).

The Project Asphalt Cement Base Price will be the Delaware Posted Asphalt Cement Price in effect on the date of advertisement.

All deviations of the Delaware Posted Asphalt Cement Price from the Project Asphalt Cement Base Price are eligible for cost adjustment. No minimum increases or decreases or corresponding percentages are required to qualify for cost adjustment.

Actual quantity of asphalt cement qualifying for any Asphalt Cement Cost Adjustment will be computed using the weight of eligible asphalt that is shown on the QA/QC pay sheets as a percentage for the delivered material.

If the mix was not inspected and no QA/QC pay sheet was generated, then the asphalt percentage will be obtained from the job mix formula for that mix ID.

The asphalt percentage eligible for cost adjustment shall only be the virgin asphalt cement added to the mix.

There shall be no separate payment per ton cost of asphalt cement. That cost shall be included in the various unit prices bid per ton for those bid items that contain asphalt cement (mentioned above).

The Asphalt cement cost adjustment will be calculated on grade PG 64-22 asphalt regardless of the actual grade of asphalt used. The Project Asphalt Cement Base Price per ton for the project will be the Delaware Posted Asphalt Cement Price in effect on the date of project advertisement.

If the Contractor exceeds the authorized allotted completion time, the price of asphalt cement on the last authorized allotted work day, shall be the prices used for cost adjustment during the time liquidated damages are assessed. However, if the industry posted price for asphalt cement goes down, the asphalt-cement cost shall be adjusted downward accordingly.

NOTE:

Application of Asphalt Cement Cost Adjustment requirements as indicated above shall apply only to those contracts involving items related to bituminous base and pavements, and with bitumen, having a total of 1,000 tons or more of hot-mix bid quantity in case of Sections 401, 402 and 403; and 15,000 gallons or more in case of Sections 304, 404 and 405.

5/05/15

401580 – RIDE QUALITY OF HOT-MIX PAVEMENT

Description:

The purpose of this Special Provision is to modify Standard Specification Section 401.13 to change the method of determining an acceptable riding surface. This Special Provision replaces the entire existing wording in Section 401.13.

The Contractor shall be responsible for providing smoothness characteristics that will meet the requirements of the Contract. The Contractor shall be responsible for providing equipment, maintenance of traffic (MOT) as required by the Delaware MUTCD, and performing testing in accordance to the processes and procedures set forth in this Special Provision. All costs for testing and MOT shall be incidental to this item. Both the International Roughness Index (IRI) and deviations located within a 10' straightedge are used to characterize smoothness in this Special Provision.

Definitions:

Class 1 Project - a project that is full depth construction based on contract documents and document modifications.

Class 2 Project - a project in which a minimum of two smoothness opportunities are performed based on contract documents and document modifications.

Class 3 Project - a project that only one smoothness opportunity is performed based on contract documents and document modifications.

Deviation – a hump or depression found to exceed the tolerances defined in this Special Provision within a 10' straightedge.

ERD File – a file storing numbers in tabular form for plotting and processing purposes. The ERD file format was developed by the Engineering Research Division of the University of Michigan Transportation Institute (UMTRI).

Full Depth Construction – a project that consists of a hot mix asphalt wearing surface placed on a hot-mix asphalt base / binder course or Portland cement concrete, on an aggregate or asphalt / cement stabilized base structure on existing or prepared subgrade materials or borrow.

Inertial Profiler – a high speed or lightweight device used to measure the pavement profile with an accelerometer to form an inertial reference and a height sensor to measure pavement height relative to that reference.

International Roughness Index (IRI) – a statistic, based on computations from a measured longitudinal profile using a quarter-car simulation, calculated to represent the amount of roughness in a pavement surface.

Rolling Ten Foot Straightedge - a rigid 10' straightedge mounted to measurement wheels and used to indicate both high and low deviations.

Smoothness Opportunity – a smoothness opportunity is roadway milling, placement of a leveling course, in place recycling, or placement of a lift of Hot Mix Asphalt. Full depth reclamation is not considered in this Special Provision as a smoothness opportunity. The final wearing surface is considered one smoothness opportunity.

Equipment:

The Contractor shall have available, at all times during paving operations, an approved 10' straightedge. The Contractor shall also have available a high speed or lightweight inertial profiling system meeting the standards set forth in AASHTO MP-11 that is capable of collecting data in both wheelpaths simultaneously. Data collected using the inertial profiling system shall be used to calculate

both IRI and deviation locations using on-board computer software. Deviations, as defined in this Special Provision, shall be calculated using a rolling 10' straight edge simulation program capable of isolating deviations greater than or equal to 0.25" in 10'. If software is not available to calculate the parameters for a rolling 10' straight edge simulation, the Contractor may be permitted to use, at the Engineer's discretion, a rolling 10' straightedge capable of isolating deviations greater than or equal to 0.25" in 10'.

Documentation Required

Prior to the start of corrective actions (milling, overlaying, recycling, etc.), the Contractor shall provide to the Engineer:

1. Manufacturer, Make, and Model of the test system,
2. Equipment Owner,
3. Relevant Certifications,
4. Manufacturer Calibration Procedures, and
5. Relevant Operator Training information.

Testing cannot take place until the Engineer has received this information and provided approval of the proposed test equipment and MOT plan.

Calibration

Prior to testing, the Contractor shall verify that the inertial profiling equipment is calibrated by following the manufacturer's calibration procedure in the presence of the Engineer. Vertical and longitudinal calibrations shall be performed. The Engineer will provide calibration blocks for the Contractor's use at the time of calibration. If the equipment does not pass the calibration procedure, it will not be permitted for use.

Testing:

Testing of the pavement surface includes measurement and calculation of the IRI parameters and deviations in the longitudinal direction. The Contractor shall notify the Engineer at least three (3) working days prior to data collection for both initial and final testing.

Transverse Deviations / Cross Slope

After final rolling and at the Engineer's discretion, the Contractor shall test the surface of each lift and the final wearing surface for deviations in the transverse direction. The Contractor shall have available at all times, and use appropriately, an approved 10' straightedge to be placed perpendicular to the centerline for checking cross slope. Deviations in the transverse direction shall not equal or exceed 0.25". The discount charge for deviations in the transverse direction is described in Section 'Acceptance and Payment' of this Special Provision. Deviations in the transverse direction shall require corrective actions or will be assessed a deviation discount charge at the discretion of the Engineer.

General Testing Requirements for IRI Data Collection

Data used for calculation of the IRI shall be measured in each wheel path using an approved inertial profiling system. Data collected for IRI calculation shall have longitudinal spacing no greater than 6 inches. Wavelengths exceeding 300 feet shall be removed using long wavelength filters. The International Roughness Index shall be calculated using this data and reported in 0.1 mile (528 foot) segments. Three (3) passes shall be made in each lane and direction requiring testing. The filename given to the data set shall include the contract number, the location number, the lane tested and direction tested. For example, the Eastbound left lane of Contract XX-XXX-XX, Location 1, run 3 shall be named:

XXXXXXXXLoc1LEBr3

Testing shall be performed within seven (7) days of the completion of project paving operations. Areas not subject to IRI testing for all Classes of projects include:

1. 50 feet before the first bridge deck expansion joint to 50 feet after the last expansion joint if the bridge deck is excluded from the HMA overlay.
2. 20 feet longitudinally from the center of an existing obstruction located and visible in the pavement surface such as a manhole or water main. Obstructions located within the test area shall be noted as an event on report printouts using an automated event marking system and should be removed from the calculations prior to report submission.
3. Shoulders, short acceleration and deceleration lanes, and turn lanes less than 1000 feet in length, and median crossovers.

Testing shall be performed in accordance to the following procedures.

1. Clean the roadway path to be measured of all debris and other loose material. Ensure that the roadway surface is dry and free of any standing water.
2. Locate the start of the project limits and mark them to enable automatic start sensors to be activated.
3. Locate the end of the project limits and mark them to enable automatic stop sensors to be activated.
4. Locate any obstructions in the wheelpath / test area and mark them with reflective tape to enable automatic event marking.
5. Establish a pre-test length (150' or the manufacturer's recommended pre-test length, whichever is greater) prior to the start of the project limits.
6. Position the left wheelpath sensor three feet (3') from the left edge marking of each lane tested.
7. Attain a test speed that is within the manufacturers recommendations for the equipment and maintain that test speed throughout the test.

Provide the Department the plot of one profile trace per tested lane and a summary report containing IRI values for each of the three test runs performed in each direction.

Initial Testing, IRI

The original surface for Class 3 projects shall be tested at no cost to the Department prior to performance of any smoothness opportunities in accordance to the methods and parameters in Section 'General Testing Requirements for IRI Data Collection'. Class 1 and Class 2 projects do not require initial testing. Results from initial testing for Class 3 projects shall be submitted to the Engineer within five (5) working days of test completion in the format specified by the Engineer. Results not received within the allotted time frame will be assessed a charge of \$1,000.00 per day at the Engineer's discretion. Three (3) measurements shall be taken for each lane required to meet this Special Provision. No paving shall be permitted until the Contractor has performed initial testing to the satisfaction of the Engineer.

Final Testing

The final surface, after all smoothness operations have been completed, shall be tested in accordance to Section 'General Testing Requirements for IRI Data Collection'. Results of final testing for all projects shall be submitted to the Engineer within five (5) working days of test completion in the format specified by the Engineer. Results not received within the allotted time frame will be assessed a charge of \$1,000.00 per day at the Engineer's discretion. Three measurements shall be taken for each lane to meet the requirements of this Special Provision.

Final Testing for Excessive Deviations

All paved areas, whether subject to IRI testing or not, must be tested to locate deviations in each wheelpath in the longitudinal direction and in the transverse direction. A deviation is considered to be a hump or depression greater than or equal to 0.25" within 10'. Longitudinal deviations shall be located using data collected by an inertial profiling system and processed through a rolling 10'-straightedge simulation, a rolling 10' straightedge, or a rigid 10' straightedge. Transverse deviations shall be located using a rigid 10' straightedge at the discretion of the Engineer. Testing shall be performed within seven (7) days of the completion of paving.

Quality Assurance Testing:

If the Engineer chooses to perform comparison testing, the Contractor shall provide a lane closure at no cost to the Engineer. The length of the lane closure shall be determined for each project location based on site conditions. The minimum closure shall be 0.25 mile and the maximum closure shall be 1 mile. The lane closure shall be at either end of the project limits and will be determined on a project basis at the Engineer's discretion.

If comparison testing indicates a difference greater than 6 in/mi in IRI measurements per 0.1-mile section, the Contractor and Engineer shall work to resolve the differences. If the differences cannot be resolved the equipment will be rejected for use on the project and all data collected to that point will be deemed invalid for that contract. At that point, the Contractor shall propose an alternative piece of testing equipment for use.

Data Reporting:

Test results shall be provided to the Department within five (5) working days of the completion of testing. Results not received within the allotted time frame will be assessed a charge of \$1,000.00 per day at the discretion of the Engineer.

The Department recognizes that inertial profiler manufacturers use different formats for reporting capabilities. Printouts on 8 ½" by 11" paper or strip charts are acceptable.

Data collected using the inertial profiling system shall be provided to the Engineer with the following information clearly displayed on the printout:

1. Profiling Company Name
2. Date of Paving
3. Date of Test
4. Parameters used in the calculation
5. Data file name
6. Testing Personnel

A printout of the pavement profile is required for one (1) of the three (3) runs for each lane and direction tested. A summary chart may be submitted for the remaining test runs. If excessive deviations are calculated using inertial profiling data runs submitted for IRI analysis a summary chart shall be submitted as well. The summary chart shall include the station and wheelpath for deviation reporting. If excessive deviations are manually determined (using a rolling ten-foot straightedge or rigid 10' straightedge), the Engineer will be present during testing and will record the data on site.

Inertial profiling systems have the capability of producing ERD files. An ERD file is requested for each run performed and can be submitted electronically (via email) or on external media (CD). More information about the format of ERD files can be obtained through the Engineer.

Acceptance and Payment:

Acceptance of the final pavement will be based on the results of IRI values and the number of deviations. A section that has an IRI value greater than 100.0 in/mi will require corrective actions. Deviations equal to or in excess of 0.25" in 10' shall be corrected at no expense to the Engineer or have a discount charge of \$200.00 per deviation assessed at the discretion of the Engineer.

An IRI number in inches per mile will be used for each 0.1-mile (528 foot) section as the basis for payment of the surface courses designated by each contract. The average value of the three test runs will be used as the IRI value for payment. Payments for each section will be based on estimated tonnage calculated from plan thickness and widths using the average maximum specific gravity ("Rice") value for all surface mix used at that location. If the plan does not indicate the travel lane width, a default value of 12' will be used. The formula used for tonnage estimation is:

$$\text{Estimated Tonnage} = [(L * W * T) * \text{Rice} * 62.4 \text{ (lb/ft}^3\text{)} * (0.0005 \text{ tons/12 in)}]$$

where: L = Length Segment (ft.)

W = Width Lane (ft.)
 T = Plan Thickness (in.)

The percentage of improvement for Class 3 projects will be calculated using the following equation:

$$\% \text{ Improvement} = [(Initial \ IRI - Final \ IRI) / Initial \ IRI] * 100$$

The applicable pay adjustments for IRI will be taken from Table A (Class 1 and 2 Projects) and Table B (Class 3 Projects)

$$IRI \ Bonus / \ Penalty = Estimated \ Tonnage * UP * (PA - 100) / 100$$

where: UP = Contract Hot Mix Unit Price (Dollars)
 PA = Pay Adjustment (Percent)

The total pay adjustment for paving work performed on each location will be:

$$(\sum \ IRI \ Adj \ for \ each \ section) - Total \ Deviations * 200$$

It will be possible to receive bonus for IRI measurements and a discount charge for excessive deviations on the same project. If a 528' section has an IRI value resulting in a deduction of at least 30% of the section pay (i.e. IRI >100 in/mi), the deviation discount charge for that section is disregarded and the IRI discount charge is the only action taken for that section.

Table A: Payment Adjustments for Class 1 and Class 2 Projects

IRI per 0.1 mile Section (in./mi.)	Payment Adjustments	
	Class 1	Class 2
40.0 and under	103	104
40.1 - 55.0	101	102
55.1 - 65.0	100	101
65.1 - 75.0	99	100
75.1 - 100.0	96	97
>100	70	70

Class 3 projects will be paid based on the percent improvement for each 528' section from the average of the three initial profile traces taken prior to any work action as shown in the Table B.

Table B: Payment Adjustments for Class 3 projects

Percent Improvement from Initial test	Payment Adjustments for Class 3 Projects
> 60.0%	103
45.1 - 60.0%	102
25.1 - 45.0%	101
0 - 25.0%	100
<0%	70

Corrections to the paving surface, such as diamond grinding with approved equipment, patching, or other measures may be taken at the Contractor's expense and at the Engineer's discretion to correct pavement surfaces assessed a discount charge. Areas corrected using these methods will not be eligible for bonus payment, but may be assessed a charge based on the resulting surface after correction. The Engineer reserves the right to require corrective actions such as remove & replace or diamond grinding if the must correct discount charge exceeds 50% of the cost of materials or the IRI exceeds 100 in/mi. The Engineer may also require corrective actions if the deviations are at a height or depth which will create a safety concern on the roadway.

401696 – ENTRANCE, DRIVEWAY AND INTERSECTING STREET PAVING SURCHARGE

Description:

To compensate for work associated with paving the tie-ins at entrances, driveways and intersecting streets when such work cannot be completed as part of the mainline (roadway, auxiliary lanes, shoulder) paving operation. The surcharge limits will extend from the outermost roadway element to the point of tie-in as directed by the Engineer with the following exceptions.

No Surcharge will be paid:

1. When the tie-in does not exceed three feet from the outermost roadway element.
2. For paving any portion of a tie-in which exceeds 100 feet from the outermost roadway element. The entire tie-in section will be performed under normal paving operations.
3. When the intersecting street is to be paved under the same Contract.
4. For paving of auxiliary lanes and crossovers in the median of divided highways.

Method of Measurement:

The quantity of entrance, driveway and intersecting street paving surcharge will be measured as the actual number of tons of bituminous concrete placed and accepted in entrances, driveways and intersecting streets as described in this item.

Basis of Payment:

The quantity of entrance, driveway and intersecting street paving surcharge will be paid for at the Contract unit price per ton. Price and payment will constitute full compensation for the additional labor and equipment costs involved with the reduced production associated with such work.

10/12/17

401699 - QUALITY CONTROL/QUALITY ASSURANCE OF BITUMINOUS CONCRETE

.01 Description

This item shall govern the Quality Assurance Testing for supplying bituminous asphalt plant materials and constructing bituminous asphalt pavements and the calculation for incentives and disincentives for materials and construction. The Engineer will evaluate all materials and construction for acceptance. The procedures for acceptance are described in this Section. Include the costs for all materials, labor, equipment, tools, and incidentals necessary to meet the requirements of this specification in the bid price per ton for the bituminous asphalt. Payment to the Contractor for the bituminous asphalt item(s) will be based on the Contract price per ton and the pay adjustments described in this specification.

.02 Bituminous Concrete Production – Quality Acceptance

(a) Material Production - Tests and Evaluations.

All acceptance tests shall be performed by qualified technicians at qualified laboratories following AASHTO or DelDOT procedures, and shall be evaluated using Quality Level Analysis. The Engineer will conduct acceptance tests. The Engineer will directly base acceptance on the acceptance test results, the asphalt cement quality, the Contractor's QC Plan work, and the comparisons of the acceptance test results to the QC test results. The Engineer may elect to utilize test results of the Contractor in some situations toward judging acceptance.

Supply and capture samples, as directed by the Engineer under the purview of the Engineer from delivery trucks before the trucks leave the production plant. Hand samples to the Engineer to be marked accordingly. The sample shall represent the material produced by the Contractor, and shall be of sufficient size to allow the Engineer to complete all required acceptance tests. The Engineer will direct the Contractor when to capture these samples, on a statistically random, unbiased basis, established before production begins each day based upon the anticipated production tonnage. The captured sample shall be from the Engineer specified delivery truck. The Contractor may visually inspect the specified delivery load during sampling and elect to reject the load. If the contractor elects to reject the specified delivery truck, each subsequent load will be inspected until a visually acceptable load is produced for acceptance testing. All visually rejected loads shall not be sent to a Department project.

The first sample of the production day will be randomly generated by the Engineer between loads 0 and 12 (0-250 tons). Subsequent samples will be randomly generated by the Engineer on 500-ton sublots for the production day. Samples not retrieved in accordance with the Contractor's QC plan will be deemed unacceptable and may be a basis for rejection of material produced. Parallel tests or dispute resolution tests will only be performed on material captured at the same time and location as the acceptance test sample. Parallel test samples or Dispute Resolution samples will be created by splitting a large sample or obtaining multiple samples that equally represent the material. The Engineer will perform all splitting and handling of material after it is obtained by the Contractor.

The Contractor may retain dispute resolution samples or perform parallel tests with the Engineer on any acceptance sample.

The Engineer will evaluate and accept the material on a lot basis. All the material within a lot shall have the same JMF (mixture ID). The lot size shall be targeted for 2000 tons or a maximum period of three days, whichever is reached first. If the 2000th ton target lot size is achieved during a production day, the lot size shall extend to the end of that production day. The Contractor may interrupt the production of one JMF in order to produce different material; this type of interruption will not alter the determination of the size or limits of material represented by a lot. The Engineer will evaluate each lot on a subplot basis. The size for each subplot shall be 100 to 500 tons and testing for the sub lots will be completed on a daily basis. For each subplot, the Engineer will evaluate one sample.

The target size of sub-lots within each lot, except for the first sample of the production day, is equal-sized 500 ton sub lots and will be based upon anticipated production, however, more or fewer sublots, with differing sizes, may result due to the production schedule and conditions. If the actual production is less than anticipated, and it's determined a sample will not be obtained (based upon the anticipated

tonnage), a new sample location will be determined on a statistically random, unbiased basis based upon the new actual production. If the actual production is going to be 50 tons or greater over the anticipated sub lot production, a new sample location will be determined on a statistically random, unbiased basis based upon the new actual production. The Engineer will combine the evaluation and test results for all of the applicable sublots in order to evaluate each individual lot.

If the Engineer is present, and the quantity exceeds 25 tons, a statistically random sample will be used for analysis. When the anticipated production is less than 100 tons and greater than 25 tons, and the Engineer is not present, the contractor shall randomly select a sample using the Engineer's random location program. The captured sample shall be placed in a suitable box, marked to the attention of the Engineer, and submitted to the Engineer for testing. A box sample shall also be obtained by the contractor at the same time and will be used as the Dispute Resolution sample if requested by the Engineer. The Contractor shall also obtain one liquid asphalt sample (1 pint) per grade of asphalt used per day and properly label it with all pertinent information.

The Engineer will conduct the following tests in order to characterize the material for the pavement compaction quality and to judge acceptance and the pay adjustment for the material:

- AASHTO T312 - Preparing and Determining the Density of Hot Mix Asphalt (HMA) Specimens by Means of the Superpave Gyrotory Compactor
- AASHTO T166, Method C (Rapid Method) - Bulk Specific Gravity of Compacted Hot Mix Asphalt (HMA) Using Saturated Surface Dry Specimens
- AASHTO T308 - Determining the Asphalt Binder Content of Hot Mix Asphalt (HMA) by the Ignition Method
- AASHTO T30 - Mechanical Analysis of Extracted Aggregate
- AASHTO T209 - Theoretical Maximum Specific Gravity and Density of Hot Mix Asphalt (HMA)
- ASTM D7227 - Standard Practice for Rapid Drying of Compacted Asphalt Specimens using Vacuum Drying Apparatus

(b) Pavement Construction - Tests and Evaluations.

The Engineer will directly base acceptance on the compaction acceptance test results, and on the inspection of the construction, the Contractor's QC Plan work, ride smoothness as referenced in the contract documents, lift thickness as referenced in the contract documents, joint quality as referenced in the contract documents, surface texture as referenced in the contract documents, and possibly the comparisons of the acceptance test results to the independent test results. For the compaction acceptance testing, the Engineer will sample the work on a statistically random basis, and will test and evaluate the work based on daily production.

Notify the Engineer of any locations within that road segment that may not be suitable to achieve minimum (93%) compaction due to existing conditions prior to paving the road segment. Schedule and hold a meeting in the field with the Engineer in order to discuss all areas that may potentially be applicable to Table 5a before paving starts. Areas that will be considered for Table 5a will be investigated in accordance to the method described in Appendix B. If this meeting is not held prior to paving, no areas will be considered for Table 5a. Areas of allowable exemptions that will not be cored include the following: partial-depth patch areas, driveway entrances, paving locations of less than 100 tons, areas around manholes and driveway entrances, and areas of paving that are under 400 feet in continuous total length and/or 5 feet in width.

The exempt areas around manholes will be a maximum of 4 feet transversely on either side from the center of the manhole, and 20 feet longitudinally on either side from the center of the manhole. The exempt areas around driveway entrances shall be the entire width of the driveway, and 3 feet from the edge of the longitudinal joint next to the driveway. Areas of exemption that will be cored for informational purposes only include: areas where the mat thickness is less than three times the nominal maximum aggregate size as directed by the Engineer, violations of Section 401.08 in the Standard Specifications as directed by the Engineer, and areas shown to contain questionable subgrade properties as proven by substantial yielding under a fully legally loaded truck. Failure to obtain core samples in these areas will result in zero payment for compaction regardless of the exempt status.

The Engineer will evaluate and accept the compaction work on a daily basis. Payment for the compaction will be calculated by using the material production lots as referenced in **.02 Acceptance Plan (a) Material Production - B Tests and Evaluation** and analyzing the compaction results over the individual days covered in the material production lot. The compaction results will be combined with the material results to obtain a payment for this item.

The minimum size of a compaction lot shall be 100 tons. If the compaction lot is between 101 and 1000 tons, the Engineer shall randomly determine four compaction acceptance test locations. If the compaction lot is between 1001 and 1500 tons, the Engineer shall randomly determine six compaction acceptance test locations. If the compaction lot is between 1501 and 2000 tons, the Engineer shall randomly determine eight compaction acceptance test locations. If the compaction lot is greater than 2000 tons, the Engineer shall randomly determine two compaction acceptance test locations per 500 tons.

If a randomly selected area falls within an Engineer approved exemption area, the Engineer will select one more randomly generated location to be tested per the requirements of this Specification. If that cannot be accomplished, or if an entire location has been declared exempt, the compaction testing shall be performed as per these Specifications but a note will be added to the results that the location was an Engineer approved exempt location.

Testing locations will be a minimum of 1.0 feet from the newly placed longitudinal joint and 50 feet from a new transverse joint.

Cut one six (6) inch diameter core through the full lift depth at the exact location marked by the Engineer. Cores submitted that are not from the location designated by the Engineer will not be tested and will be paid at zero pay.

Notify the Engineer prior to starting paving operations with approximate tonnage to be placed. The Contractor is then responsible for notifying the appropriate Engineer test personnel within 12 hours of material placement. The Engineer will mark core locations within 24 hours of notification. After determination of locations, the Contractor shall complete testing within two operational days of the locations being marked. If the cores are not cut within two operational days, the area in question will be paid at zero pay for compaction testing.

Provide any traffic control required for the structural number investigation, sampling, and testing work at no additional cost to the Department.

Commence coring of the pavement after the pavement has cooled to a temperature of 140°F or less. Cut each core with care in order to prevent damaging the core. Damaged cores will not be tested. Label each core with contract number, date of construction, and number XX of XX upon removal from the roadway. Place cores in a 6-inch diameter plastic concrete cylinder mold or approved substitute for protection. Separate cores in the same cylinder mold with paper. Attach a completed QC test record for the represented area with the corresponding cores. The Engineer will also complete a test record for areas tested for the QA report and provide to Materials & Research. Deliver the cores to the Engineer for testing, processing, and report distribution at the end of each production day.

Repair core holes per Appendix A, Repairing Core Holes in Bituminous Asphalt Pavements. Core holes shall be filled immediately. Failure to repair core holes at the time of coring will result in zero pay for compaction testing for the area in question.

The Engineer will conduct the following tests on the applicable portion of the cores in order to evaluate their quality:

- AASHTO T166, Method C (Rapid Method) – Bulk Specific Gravity of Compacted Hot Mix Asphalt (HMA) Using Saturated Surface Dry Specimens
- AASHTO T209 - Theoretical Maximum Specific Gravity and Density of Hot Mix Asphalt
- ASTM D7227 - Standard Practice for Rapid Drying of Compacted Asphalt Specimens using Vacuum Drying Apparatus

The Engineer will use the average of the last five test values of the same JMF (mixture ID) material at the production plant in order to calculate the average theoretical maximum specific gravity of the cores. The average will be based on the production days test results and as many test results needed from

previous days production to have an average of five samples. If there are less than five values available, the Engineer will use the JMF design value in addition to the available values to calculate the average theoretical maximum specific gravity.

.03 Payment and Pay Adjustment Factors.

The Engineer will determine pay adjustments for the bituminous asphalt item(s) in accordance with this specification. The Engineer will determine a pay adjustment factor for the material produced and a pay adjustment factor for the pavement construction. Pay adjustments for material and construction will be calculated independently. When the pay adjustment calculation for either material or construction falls to zero payment per tables 4, 5, or 5a, the maximum pay adjustment for the other factor will not exceed 100.

Pay Adjustment factors will only be calculated on in place material. Removed material will not be used in payment adjustment calculations.

Material Production Pay Adjustments will be calculated based upon 70% of the contract unit price and calculated according to section .03(a) of this specification. Pavement construction Pay Adjustments will be calculated based upon 30% of the contract unit price and calculated according to section .03(b) of this specification.

(a) Material Production - Pay Adjustment.

Calculate the material pay adjustment by evaluating the production material based on the following parameters:

Table 2 - Material Parameter Weight Factors		
Material Parameter	Single Test Tolerance (+/-)	Weight Factor
Asphalt Content	0.4	0.30
#8 Sieve (>=19.0 mm)	7.0	0.30
#8 Sieve (<=12.5 mm)	5.0	0.30
#200 Sieve (0.075mm Sieve)	2.0	0.30
Air Voids (4.0% Target)	2.0	0.10

Using the JMF target value, the single test tolerance (from Table 2), and the test values, the Engineer will use the following steps to determine the material pay adjustment factor for each lot of material:

1. For each parameter, calculate the mean value and the standard deviation of the test values for the lot to the nearest 0.1 unit.
2. For each parameter, calculate the Upper Quality Index (QU):
 $QU = ((JMF \text{ target}) + (\text{single test tolerance}) - (\text{mean value})) / (\text{standard deviation}).$
3. For each parameter, calculate the Lower Quality Index (QL):
 $QL = ((\text{mean value}) - (JMF \text{ target}) + (\text{single test tolerance})) / (\text{standard deviation}).$
4. For each parameter, locate the values for the Upper Payment Limit (PU) and the Lower Payment Limit (PL) from Table 3 - Quality Level Analysis by the Standard Deviation Method. (Use the column for “n” representing the number of sublots in the lot. Use the closest value on the table when the exact value is not listed).
5. Calculate the PWL for each parameter from the values located in the previous step:
 $PWL = PU + PL - 100.$
6. Calculate each parameter’s contribution to the payment adjustment by multiplying its PWL by the weight factor shown in Table 2 for that parameter.
7. Add the calculated adjustments of all the parameters together to determine the Composite PWL for the lot.

8. From Table 4, locate the value of the Pay Adjustment Factor corresponding to the calculated PWL. When all properties of a single test are within the single test tolerance of Table 2, Pay Adjustment factors shall be determined by Column B. When any property of a single test is outside of the Single Test Tolerance parameters defined in Table 2, the Material Pay Adjustment factor shall be determined by Column C
9. For each lot, determine the final material price adjustment:

Final Material Pay Adjustment =
 (Lot Quantity) x (Item Bid Price) x (Pay Adjustment Factor) x 70%. This final pay calculation will be paid to the cent.

In lieu of being assessed a pay adjustment penalty, the Contractor may choose to remove and replace the material at no additional cost to the Department. When the PWL of any material parameter in Table 2 is below 60, the Engineer may require the removal and replacement of the material at no additional cost to the Department. Test results on removed material shall not be used in calculation of future PWL calculations for Mixture ID.

The test results from the Engineer on production that is less than 100 tons will be combined with the two most recently completed Engineer tests with the same Mixture ID to calculate payment for the lot encompassing the single test. If that cannot be accomplished, the approved JMF will be used to calculate payment for the lot encompassing the single test. Payment for previously closed lots will not be affected by the analysis.

When a sample is outside of the allowable single test tolerance for any Materials criteria in Table 2, that sample will be isolated. For payment purposes, the test result of the out of acceptable tolerance sample will be combined with the two previous acceptable samples of the same JMF and analyzed per this specification. The material that is considered out of the acceptable tolerance will only include the material within the represented sub-lot (i.e., a maximum of 500 tons). If the previous acceptable test result is from the previous production day, only the material produced on the second production day will be considered out of tolerance. All future sub lots will not include the isolated test. The pay factors for the out of tolerance sample lot will be calculated using column C of table 4.

If, during production, a QA sample test result does not meet the acceptable tolerances and the Contractors QC sample duplicates the QA sample test result, the Contractor can make an appropriate change to the mixture (within the JMF boundaries), and request to have that sample further isolated. After the Contractor has made appropriate changes, the Contractor will visually inspect each produced load. The first visually acceptable load will be sampled and tested. If that sample test result shows compliance with the specifications, the material that is considered out of the acceptable tolerance will include the material from the previous acceptable test result to the third load after the initially sampled and tested sample. If the sample does not meet the specification requirements, the Engineer will no longer accept material. Production may resume when changes have been made and an acceptable sample and test result is obtained.

PU or PL	QU and QL for "n" Samples						
	n = 3	n = 4	n = 5	n = 6	n = 7	n = 8	n = 9
100	1.16	1.50	1.79	2.03	2.23	2.39	2.53
99	-	1.47	1.67	1.80	1.89	1.95	2.00
98	1.15	1.44	1.60	1.70	1.76	1.81	1.84
97	-	1.41	1.54	1.62	1.67	1.70	1.72
96	1.14	1.38	1.49	1.55	1.59	1.61	1.63
95	-	1.35	1.44	1.49	1.52	1.54	1.55
94	1.13	1.32	1.39	1.43	1.46	1.47	1.48
93	-	1.29	1.35	1.38	1.40	1.41	1.42
92	1.12	1.26	1.31	1.33	1.35	1.36	1.36
91	1.11	1.23	1.27	1.29	1.30	1.30	1.31

90	1.10	1.20	1.23	1.24	1.25	1.25	1.26
89	1.09	1.17	1.19	1.20	1.20	1.21	1.21
88	1.07	1.14	1.15	1.16	1.16	1.16	1.17
87	1.06	1.11	1.12	1.12	1.12	1.12	1.12
86	1.04	1.08	1.08	1.08	1.08	1.08	1.08
85	1.03	1.05	1.05	1.04	1.04	1.04	1.04
84	1.01	1.02	1.01	1.01	1.00	1.00	1.00
83	1.00	0.99	0.98	0.97	0.97	0.96	0.96
82	0.97	0.96	0.95	0.94	0.93	0.93	0.93
81	0.96	0.93	0.91	0.90	0.90	0.89	0.89
80	0.93	0.90	0.88	0.87	0.86	0.86	0.86
79	0.91	0.87	0.85	0.84	0.83	0.82	0.82
78	0.89	0.84	0.82	0.80	0.80	0.79	0.79
77	0.87	0.81	0.78	0.77	0.76	0.76	0.76
76	0.84	0.78	0.75	0.74	0.73	0.73	0.72
75	0.82	0.75	0.72	0.71	0.70	0.70	0.69
74	0.79	0.72	0.69	0.68	0.67	0.66	0.66
73	0.75	0.69	0.66	0.65	0.64	0.63	0.63
72	0.74	0.66	0.63	0.62	0.61	0.60	0.60
71	0.71	0.63	0.60	0.59	0.58	0.57	0.57
70	0.68	0.60	0.57	0.56	0.55	0.55	0.54
69	0.65	0.57	0.54	0.53	0.52	0.52	0.51
68	0.62	0.54	0.51	0.50	0.49	0.49	0.48
67	0.59	0.51	0.47	0.47	0.46	0.46	0.46
66	0.56	0.48	0.45	0.44	0.44	0.43	0.43
65	0.52	0.45	0.43	0.41	0.41	0.40	0.40
64	0.49	0.42	0.40	0.39	0.38	0.38	0.37
63	0.46	0.39	0.37	0.36	0.35	0.35	0.35
62	0.43	0.36	0.34	0.33	0.32	0.32	0.32

Table 3 - Quality Level Analysis by the Standard Deviation Method							
PU or PL	QU and QL for "n" Samples						
	n = 3	n = 4	n = 5	n = 6	n = 7	n = 8	n = 9
61	0.39	0.33	0.31	0.30	0.30	0.29	0.29
60	0.36	0.30	0.28	0.27	0.27	0.27	0.26
59	0.32	0.27	0.25	0.25	0.24	0.24	0.24

Table 4 - PWL Pay Adjustment Factors		
PWL	Pay Adjustment Factor (%) Column B	Pay Adjustment Factor (%) Column C
100	+5	0

99	+4	-1
98	+3	-2
97	+2	-3
96	+1	-4
95	0	-5
94	-1	-6
93	-2	-7
92	-3	-8
91	-4	-9
PWL<91	PWL - 100	PWL - 100

(b) Pavement Construction - Pay Adjustments.

The Engineer will determine the pavement construction pay adjustment by evaluating the construction of the pavement, based on the following parameter:

- Degree of compaction of the in-place material

Using the test values for the cores, the Engineer will use the following steps to determine the pavement construction pay adjustment for each lot of work. .

1. Calculate the core bulk specific gravity values from the subplot tests values, to the nearest 0.001 unit. Obtain the Theoretical maximum Specific Gravity values from the corresponding laboratory subplot tests.
2. Calculate the Degree of Compaction:
Degree of Compaction =
 $((\text{Core Bulk Specific Gravity}) / (\text{Theoretical Maximum Specific Gravity})) \times 100\%$ recorded to the nearest 0.1%.
3. The average compaction for the sublots shall be averaged together for the compaction level of the lot. The lots compaction test level shall be averaged and recorded to the nearest whole percent.
4. Locate the value of the Payment Adjustment Factor corresponding to the calculated degree of compaction from Table 5 or Table 5a.
5. Determine the pavement construction price adjustment by using the following formula:
Construction Pay adjustment = (Lot Quantity) x (Bid Price) x (Pay Adjustment Factor) x 30%.

Table 5: Compaction Price Adjustment Highway Locations		
Degree of Compaction (%)	Range	Pay Adjustment Factor (%)
>= 97.0	>= 96.75	-100*
96.5	96.26 – 96.74	-5
96.0	95.75 – 96.25	-3

95.5	95.26 – 95.74	-2
95.0	94.75 – 95.25	0
94.5	94.26 – 94.74	0
94.0	93.75 – 94.25	1
93.5	93.26 – 93.74	3
93.0	92.75 – 93.25	5
92.5	92.26 – 92.74	3
92.0	91.75 – 92.25	0
91.5	91.26 – 91.74	0
91.0	90.75 – 91.25	-5
90.5	90.26 – 90.74	-15
90.0	89.75 – 90.25	-20
89.5	89.26 – 89.74	-25
89.0	88.75 – 89.25	-30
88.5	88.26 – 88.74	-50
=<88.0	=<88.25	-100*

* or remove and replace it at Engineer's discretion

Table 5A: Compaction Price Adjustment Other¹ Locations		
Degree of Compaction	Range	Pay Adjustment Factor (%)
>= 97.0	>= 96.75	-100*
96.5	96.26 – 96.74	-5
96.0	95.75 – 96.25	-3
95.5	95.26 – 95.74	-2
95.0	94.75 – 95.25	0
94.5	94.26 – 94.74	0
94.0	93.75 – 94.25	0
93.5	93.26 – 93.74	1
93.0	92.75 – 93.25	3
92.5	92.26 – 92.74	1
92.0	91.75 – 92.25	0
91.5	91.26 – 91.74	0
91.0	90.75 – 91.25	0
90.5	90.26 – 90.74	0

90.0	89.75 – 90.25	0
89.5	89.26 – 89.74	0
89.0	88.75 – 89.25	-1
88.5	88.26 – 88.74	-3
88.0	87.75 – 88.25	-5
87.5	87.26 – 87.74	-10
87.0	86.75 – 87.25	-15
86.5	86.26 – 86.74	-20
86.0	85.75 – 86.25	-25
85.5	85.26 – 85.74	-30
85.0	84.75 – 85.25	-40
84.5	84.26 – 84.74	-50
=< 84.0	=<84.25	-100*

* or remove and replace at Engineer's discretion

¹ This chart is to be used for areas where the structural value of the area to be paved is less than 1.75 as determined by the Engineer. See Appendix B - Method for Obtaining Cores for Determination of Roadway Structure. This chart is applicable to rehabilitation work only; full depth construction will not be considered for Table 5a.

.04 Dispute Resolution.

Disputes or questions about any test result shall be brought to the attention of the Contractor and the Engineer within two operational days of reported test results. The following dispute resolution procedures will be used.

The Engineer and the Contractor will review the sample quality, the test method, the laboratory equipment, and the laboratory technician. If these factors are not the cause of the dispute, a third party dispute resolution will be used.

Third party resolution testing can be performed at either another Contractor’s laboratory, the Engineer’s laboratory, or an independent accredited laboratory. Unless otherwise mutually agreed upon by DAPA and the Engineer, the Engineer’s qualified laboratory in Dover and qualified personnel shall conduct the necessary testing for third party Dispute Resolution after the Engineer has provided reasonable notice to allow the Contractor to witness this testing.

When disputes over production testing occur, the samples used for Dispute Resolution testing will be those samples the properly captured, labeled, and stored, as described in the second paragraph of the section of these specifications titled **.02 Acceptance Plan, (a) Material Production - Tests and Evaluations**. If no samples are available, the original testing results will be used for payment calculations.

Dispute Resolution samples for air void content will be heated by a microwave oven.

If there is a discrepancy between the Engineer's acceptance test result and the Contractor's test result, the Contractor may ask for the Dispute Resolution sample to be tested. The Contractor may request up to two dispute resolution samples be tested per calendar year without charge. Any additional Dispute Resolution samples run at the Contractor's request where the results substantiate the acceptance test result will be assessed a fee of \$125. Any additional Dispute Resolution samples that substantiate the Contractor's test result will not be assessed the fee.

When disputes over compaction core test results occur, the Engineer's acceptance core will be used for the dispute resolution sample. The Contractor will be advised on when the testing will occur as referenced above to witness the testing.

The results of the dispute resolution testing shall replace all of the applicable disputed test results for payment purposes.

Appendix A - Repairing Core Holes in Bituminous Asphalt Pavement

Description.

This appendix describes the procedure required to repair core holes in a bituminous concrete pavement.

Materials and Equipment.

The following material shall be available to complete this work:

- Patch Material - DelDOT approved High Performance Cold Patch material shall be used.

The following equipment shall be available to complete this work:

- Sponge or other absorbent material - Used to extract water from the hole.
- Compaction Hammer - mechanical (electrical, pneumatic, or gasoline driven) tamping device with a flat, circular tamping face smaller than 6 inches in diameter. .

Construction Method.

After core removal from the hole, remove all excess water from within the hole, and prevent water from re-entering the hole.

Place the patch material in lifts no greater than 3 inches and compact with mechanical tamping device. If the hole is deeper than 3 inches, use two lifts of approximately equal depths so that optimum compaction is achieved. Make sure that the patch surface matches the grade of the existing roadway. Make every effort to achieve the greatest possible compaction

Performance Requirements.

The Engineer will judge the patch on the following basis:

- The patch shall be well compacted
- The patch surface shall match the grade of the surrounding roadway surface.

Basis of Payment.

No measurement or payment will be made for the patching work. The Contractor must gain the Engineer's acceptance of the patching work before the Engineer will accept the material represented by the core.

Appendix B - Method for Obtaining Cores for Determination of Roadway Structure

The Contractor is responsible for obtaining cores in areas that they propose are eligible for compaction price adjustments according to Table 5a in this specification. Table 5a is not applicable for new full-depth pavement box construction. Cores submitted for this process shall be obtained according to the following process.

1. Contact Materials & Research (M&R) personnel to determine if information about the area is already available. If M&R has already obtained cores in the location that is being investigated, the contractor may opt to use the laboratory information for the investigation and not core the area on their own.
2. If M&R does not have information concerning the section of the roadway, the contractor needs to contact M&R to arrange for verification of coring operations. Arrangements shall be made to allow for an individual from M&R to be on the site when the cores are obtained. Cores will be turned over to M&R for evaluation.
3. The Contractor is responsible for providing all traffic control and repairing core holes in accordance to 401699 Appendix A - Repairing Core Holes in Bituminous Asphalt Pavements.
4. Cores are to be taken throughout the entire project for the area in question. Cores will be spaced, from the start of the project in increments determined based on field and project specifics. Cores will be evenly distributed throughout the project location. The cores will be taken in the center of the lane in question.
5. Additional cores may be taken at other locations, if surface conditions indicate that there may be a substantial difference in the underlying section. The location of these cores should be documented and submitted to M&R.
6. Cores shall be full depth and include underlying materials. If there is a stone base included in the pavement section, at a minimum 1 core must have information concerning the thickness of the base. This is determined by augering to the subgrade surface.
7. The calculations used to determine the structural capacity of the roadway is as follows. If the contractor finds, upon starting the coring process, that the areas are of greater thickness than applicable to Table 5a, they may terminate the coring process on their own and retract the request.

Structural Number Calculations

Each pavement box material is assigned a structural coefficient based upon AASHTO design guides. The structural coefficient is used to determine the total strength of the pavement section.

Materials used in older pavement sections are assigned lower structural coefficients to compensate for aging of the materials. The coefficients used to determine the structural number of an existing pavement are:

Existing Material	Structural Coefficient
HMA	0.32
Asphalt Treated Base	0.26
Soil Cement	0.16
Surface Treatment (Tar & Chip)	0.10
GABC	0.14
Concrete	0 - 0.7*

* The Structural Coefficient of Concrete is dependent upon the condition of the concrete. Compressive strengths & ASR analysis are used to determine condition - contact the Engineer if this situation arises.

Newly placed materials use a different set of structural coefficients. They are as follows:

New Material	Structural Coefficient
HMA	0.40
Asphalt Treated Base (BCBC)	0.32
Soil Cement	0.20
GABC	0.14

Example:

Location includes placement of a 1.25" Type C overlay on 2.25" Type B. Existing roadway is cored and is shown to consist of 2" HMA on 7" GABC.

Calculation:

For the Type B lift the calculation would be:

Existing HMA	2 * 0.32	=	0.64
GABC	7 * 0.14	=	0.98
			<hr/>
			1.62

For the Type C lift the calculation would be:

Newly Placed B	2.25 * 0.4	=	0.90
Existing HMA	2 * 0.32	=	0.64
GABC	7 * 0.14	=	0.98
			<hr/>
			2.52

11/3/14

503503 - PATCHING CONCRETE

Description:

This item consists of furnishing and placing Portland Cement Concrete, conforming to the requirements of Section 503 of the Standard Specifications and/or as modified herein under this Contract. After removal of the existing P.C.C. pavement, if the base material is unsuitable or washed out, the unsuitable material shall be excavated and the void replaced with the same concrete used in the patch area. This additional depth shall not exceed 6 from the bottom of the existing P.C.C. Pavement. Excessive moisture remaining after excavation, shall require construction of a pipe underdrain system, when directed by the Engineer and as shown on the Plans. All excavation below the bottom of existing pavement shall be paid for under the item "Undercut Excavation, Patching".

This item may also be used in areas of composite pavements (hot-mix over concrete) if the Contractor elects to pour concrete patch flush with existing hot-mix pavement to eliminate grade differential. This additional depth shall be as directed by the Engineer, but shall not exceed 6" in depth.

Method of Measurement:

The quantity of concrete patching will be measured as the actual number of square yards per inch of thickness of additional thickness either above or below the existing concrete pavement. The area measured shall be the square yards on the surface of the base course and the depth measured in inches from either top or bottom of the original P.C.C. pavement as determined from the adjacent pavement. The depth shall be as directed by the Engineer, but shall not exceed 6" in measurement or payment.

Basis of Payment:

The quantity of concrete patching will be paid for at the Contract fixed price of \$5.65 per square yard per inch of thickness. Price and payment will constitute full compensation for furnishing and placing additional depth of concrete as described above, for all labor, tools, equipment, and incidentals to complete the item.

NOTE

Also, under the items 503001 - Patching P.C.C. Pavement, 6 to 15 , Type A and 503002 - Patching P.C.C. Pavement, Greater than 15 to 100 , Type B, the Contractor shall be paid for the additional thickness of concrete actually poured in the field above the thickness specified on the P.C.C. Patching Plans at a fixed rate of \$5.65 per square yard per inch of thickness.

4/07/17

701502 - STONE CURB
701503 - CURVED STONE CURB

Description:

This work consists of furnishing and installing stone curb in accordance with the details and notes shown on the Plans, and as directed by the Engineer.

Materials and Construction Methods:

The stone curb shall conform to the dimensions and description shown in the Plan notes and details. On Contracts where new stone curb is being placed with existing stone curb the new material shall match the existing in quality and color to the satisfaction of the Engineer.

Portland cement concrete for the work shall be Class C, and shall conform to the requirements of Section 1022 of the Standard Specifications. Mortar shall conform to the requirements of Section 619.

The stone curb shall be set in accordance with the details and at locations shown on the Plans and as directed by the Engineer. After setting the stone curb, it shall be thoroughly cleaned of all spots, concrete, mortar etc. to present a clean surface.

Method of Measurement:

The quantity of stone curb will be measured as the number of linear feet along the front face of the curb.

Basis of Payment:

The quantity of stone curb will be paid for at the Contract unit price per linear foot. Price and payment will constitute full compensation for furnishing all materials, excavation, setting the stone curb in concrete, backfilling, disposal of excess material, and for all labor, equipment, tools and incidentals necessary to complete the work.

7/25/2018

705504 - BRICK AND/OR BLOCK SIDEWALK
705506 - BRICK AND/OR BLOCK ROADWAY

Description:

This work consists of furnishing all materials and constructing brick and/or block sidewalk/roadway in accordance with these specifications and in reasonably close conformity with the lines, grades, dimensions, and notes on the Plans and as established by the Engineer.

Materials:

The brick/block, referred to as "pavers" elsewhere in this special provision, shall be the shape, style, size and color as specified on the Plans.

1. If the pavers specified are concrete unit pavers, they shall have an average compressive strength of 8000 psi (55 MPa) with no single paver having a compressive strength less than 7200 psi (52 MPa) at the time of delivery to the project. The pigment loading shall be a minimum of 3% and the pigmentation shall be uniform throughout the paver.
2. If the pavers specified are clay brick, the pavers shall meet the requirements of ASTM C902, Class SX, Type I.

In cases of existing sidewalk, the new pavers shall match the existing bricks in material, color and size, unless noted otherwise on the Plans.

If the Plans are silent regarding pavers, the Contractor shall supply clay brick in a color approved by the Engineer.

Sample pavers shall be submitted for approval and if requested by the Engineer, 3 x 3 (0.9 m x 0.9 m) sample panels shall be constructed for approval.

The edge restraint system shall be as specified on the Plans or as recommended by the paver manufacturer, whichever is stronger.

Sand for bedding shall conform to the requirements of Section 1003 - Fine Aggregate.

Portland Cement Concrete for sidewalk shall conform to the requirements of Section 1022, Class B.

Expansion for sidewalk shall conform to the requirements of Subsection 1042.

Construction Methods:

Place concrete for sidewalk to depths shown on plans and construct in accordance with Section 705 of the Standard Specifications.

Install the edge restraint system on the approved base as shown on the Plans where existing conditions do not provide edge restraint.

Spread a leveling course of bedding sand 1 to 1 1/2 inches (25 to 38 mm) thick, taking care that moisture is constant and the density is loose until the unit pavers are set and compacted. Place a material such as geotextile, or other approved material at curb joints to prevent sand from bleeding through.

Place pavers in patterns as designated on the Plans. If a joint spacing is not noted on the Plans, place the pavers with a tight joint. Select pavers from 4 or more cubes to blend color and texture variations. Do not use pavers with chips, cracks, discolorations, or other defects. Cut pavers with a motor driven masonry wet saw to provide clean, sharp, unchipped edges. Cut pavers to fit pattern specified and to neatly fit adjoining material.

Vibrate the pavers into the sand leveling course with a low amplitude plate vibrator capable of a 3,500 to 5,000 pound (1,600 to 2,300 kg) compaction force. Perform at least 3 passes across paving with

vibrator. Protect paver face and edges by spreading a cushion of sand over the surface. Be careful not to destroy edges.

Spread dry sand and fill joints immediately after vibrating the pavers into leveling course. Brush and vibrate sand until joints are completely filled, then remove excess sand.

Prior to acceptance, any pavers that are chipped, broken, stained, or damaged shall be replaced at the contractor's expense.

Method of Measurement:

The quantity of brick and/or block paving will be measured as the number of square feet (square meters) of sidewalk and/or roadway completed in-place and accepted.

Basis of Payment:

The quantity of brick and/or block paving will be paid for at the Contract unit price per square foot (square meter). Price and payment will constitute full compensation for excavation, furnishing and installing portland cement concrete, expansion material, brick pavers, restraint system, bedding sand, geotextile and sand for filling joints and for all labor, equipment, tools, and incidentals necessary to complete the work.

5/10/17

705505 - RESET STONE/BRICK SIDEWALK AND/OR STONE/BRICK ROADWAY

Description:

This work consists of removing and resetting the existing stone/brick sidewalk and/or roadway in accordance with details, notes on the Plans and as directed by the Engineer.

Materials and Construction Method:

The stone/brick blocks from the existing sidewalks and/or roadway shall be removed, cleaned and stored for later use. Sand and/or mortar required for setting the stones/bricks shall comply with the applicable requirements of Section 619 of the Standard Specifications.

The installation pattern and spacing of stones/bricks shall match the existing sidewalk and/or roadway setting, unless otherwise specified on the Plans. The stones/bricks shall be set on an approved compacted foundation with 2" of sand over it. Joint filler material (sand or mortar) shall be compatible with the original sidewalk and/or roadway.

After completion of stone/brick setting, the sidewalk and/or roadway surface area shall be thoroughly cleaned of mortar and/or as applicable to the contract.

Method of Measurement:

The quantity of stone/brick sidewalk and/or roadway reset will be measured as the number of square feet measured at the surface of the sidewalk and/or roadway, reset and accepted.

Basis of Payment:

The quantity of stone/brick sidewalk and/or roadway reset will be paid for at the Contract unit price per square foot. Price and payment will constitute full compensation for removal, storage and cleaning of stones/bricks, furnishing all materials, resetting and cleaning the sidewalk and/or roadway, disposal of discarded materials, for all labor, tools, equipment, and all necessary incidentals to complete the work. The cost of providing replacement stone/brick for those which are damaged is incidental to this item.

7/25/2018

763621 - CONSTRUCTION ENGINEERING, REHABILITATION

Description:

Collect survey information and provide layout as described in this provision and as noted on the Plans. Assume full responsibility for any errors and/or omissions in the work of all engineering staff employed.

Provide and have available for the project adequate engineering staff that is:

1. Competent and experienced to set lines and grades needed to construct the project;
2. Able to perform the work to the scope and magnitude outlined herein.

Construction Engineering functions and requirements:

1. Provide all necessary surveying equipment required for all engineering work on the project.
 - a. Check all equipment/instruments prior to use on the project.
 - b. Immediately replace or recalibrate equipment found to be out of adjustment or inadequate to perform its function to the satisfaction of the Engineer.
2. Perform all computations necessary to establish the exact position of the work from control points and preserve.
 - a. Maintain adequate workbooks of all computations survey notes and other records.
 - b. Make available to the Department, neat and legible, all computations, survey notes and other records necessary to accomplish the work.
3. Preliminary topographic survey for all proposed curb ramps locations identified in the Plans and the layout of grade information provided by the Engineer for curb ramp construction;
4. Obtain topographic information a minimum of 25' in each direction from the back of curb where the curb ramp is proposed;
 - a. Grades for the edge of pavement, gutter line (if applicable), top of curb, front and back edge of sidewalk, existing obstructions such as utility poles, junction wells, traffic poles and cabinets, manholes, valves, fire hydrants, drainage inlets, steps, retaining walls, building faces or other obstructions that are directly adjacent or within the proposed curb ramp limits.
 - b. Collect data in a format that is compatible with DelDOT Design Standards and submit to the Engineer for evaluation curb ramps that are located in areas with multiple obstructions, limited area, or other unique characteristics that require more detailed layout. The Engineer will provide the final grades for construction of these curb ramps.
3. Establish necessary grades to ensure all proposed curb ramps, roadways or ditches, installation of drainage structures, or other items of work as determined by the Engineer, have positive drainage;

Note:

Professional services performed under this item by individuals/firms other than the Contractor are not subject to the subcontracting requirements of Subsection 108.01 of the Standard Specifications.

Method of Measurement:

The quantity of Construction Engineering - Rehabilitation will be measured as the actual number of hours the Contractor's survey crew is in the field actively engaged in Construction Engineering – Rehabilitation Work.

Basis of Payment:

The quantity of Construction Engineering – Rehabilitation will be paid for at the Contract unit price per hour. Price and payment constitutes full compensation for furnishing all labor, equipment, instruments, stakes, and other material necessary to satisfactorily complete the work as herein described under this item.

3/16/17

801500 - MAINTENANCE OF TRAFFIC - ALL INCLUSIVE

Description:

This item shall consist of furnishing, installing, maintaining and/or relocating the necessary temporary traffic control devices used to maintain vehicular, bicycle and pedestrian traffic, including persons with disabilities in accordance with the Americans with Disabilities Act, as amended. All work shall be performed in a manner that will provide reasonably safe passage with the least practicable obstruction to all users, including vehicular, bicycle and pedestrian traffic.

All requirements of the Delaware Manual on Uniform Traffic Control Devices (MUTCD), Part 6, herein referred to as the Delaware MUTCD. (latest edition with all revisions made up to the date of Advertisement of this project) shall apply for all temporary traffic control devices. Any, and all, control, direction, management and maintenance of traffic shall be performed in accordance with the requirements of the Delaware MUTCD, notes on the Plans, this specification, and as directed by the Engineer.

The Contractor shall be aware that the Case Diagrams and safety measures outlined in the Delaware MUTCD are for common construction situations and modifications may be warranted based on the complexity of the job. The Contractor shall submit justification for modifications to the Temporary Traffic Control Plan (TTCP) to the Engineer for approval prior to implementation.

The Department reserves the right to impose additional restrictions, as needed, for the operational movement and safety of the traveling public. The Department reserves the right to suspend the Contractor's operations until compliance with the Engineer's directive for remedial action, based on but not limited to the following reasons:

1. The Contractor's operations are not in compliance with the Delaware MUTCD, the specifications or the Plans.
2. The Contractor's operations have been deemed unsafe by the Traffic Safety Engineer or District Safety Officer.

Materials and Construction Methods:

The Contractor shall submit a Temporary Traffic Control Plan (TTCP) or a Letter of Intent to use the Plan recommended Delaware MUTCD Case Diagram(s) at or prior to the pre-construction meeting. The Contractor shall submit the TTCP for all Contractor and subcontractor work to be performed on the project for the Department's approval before the start of work.

When specified by a note in the Plans, the Contractor shall be required to have an American Traffic Safety Services Association (ATSSA) certified Traffic Control Supervisor on the project. The authorized designee must be assigned adequate authority, by the Contractor, to ensure compliance with the requirements of the Delaware MUTCD and provide remedial action when deemed necessary by the Traffic Safety Engineer or the District Safety Officer. The ATSSA certified Traffic Control Supervisor's sole responsibility shall be the maintenance of traffic throughout the project. This responsibility shall include, but is not limited to, the installation, operations, maintenance and service of temporary traffic control devices. Also required is the daily maintenance of a log to record maintenance of traffic activities, i.e., number and location of temporary traffic control devices; and times of installation, changes and repairs to temporary traffic control devices. The ATSSA Traffic Control Supervisor shall serve as the liaison with the Engineer concerning the Contractor's maintenance of traffic. The name, contact number and certification for the designated Traffic Control Supervisor shall be submitted at or prior to the pre-construction meeting. The cost of the ATSSA certified Traffic Control Supervisor shall be incidental to this item.

Temporary traffic control devices shall be maintained in good condition in accordance with the brochure entitled "Quality Guidelines for Temporary Traffic Control Devices", published by the American Traffic Safety Services Association (ATSSA). Any temporary traffic control devices that do not meet the quality guidelines shall be removed and replaced with acceptable devices. Failure to comply will result in work stoppage with time charges continuing to be assessed.

Any existing signs that conflict with any temporary or permanent construction signs shall be covered as needed or as directed by the Engineer. The cost for temporarily covering conflicting signs shall be incidental to this item.

Access to all transit stops located within the project limits shall be maintained unless otherwise directed by the Plans or the Engineer. Maintaining access shall include maintaining an area for the transit vehicle and also an accessible path for pedestrians to safely access the transit stop.

The Contractor shall notify the Engineer, in writing, no less than fourteen (14) calendar days prior to the start of any detour(s) and road closures. The Engineer will notify the following entities:

- Local 911 Center
- Local School Districts
- Local Post Offices
- DelDOT's Transportation Management Center (TMC)
- Town Managers
- Local Police
- DelDOT's Public Relations
- Delaware Transit Corporation (DTC)

Immediately prior to the implementation of any lane or road closures, the Engineer shall notify the DelDOT TMC at (302) 659-4600. Notifications shall also be provided when the closures are lifted. The Engineer shall notify TMC and the District Safety Officer if any lane closures cannot be removed prior to the end of the allowable work hours.

The Contractor shall notify the local 911 center if access to a fire hydrant is temporarily restricted. The Contractor shall provide written confirmation to the Engineer that the local 911 center has been notified.

If a detour is required during any part or the entire period of this Contract, an approved detour plan shall be obtained from the Department's Traffic Safety Section. All signs, barricades and other temporary traffic control devices required as part of the approved detour plan shall be installed and maintained by the Contractor on the route that is closed and on the detour route. Road closures without an approved detour plan shall not be allowed. If a road is closed without an approved detour plan, the Contractor's operations shall be stopped immediately.

The Contractor shall provide and maintain ingress and egress for each property abutting the construction area and each property located between the diversion points of any detour and the actual construction site. Construction activities which may temporarily or otherwise interfere with property access shall be coordinated in advance with the affected property owners.

The Contractor shall conduct construction operations in a manner which will minimize delays to traffic, and shall meet the following requirements:

1. If work is being performed within 200 feet in any direction of an intersection that is controlled by a traffic signal, the flagger(s) shall direct the flow of traffic in concert with the traffic signals in construction areas to avoid queuing, unless active work prohibits such action. The flagger shall direct traffic to prevent traffic from queuing through an intersection (i.e., blocking an intersection). Only a Traffic Officer may direct traffic against the operation of a traffic signal and only until the operation occurring within the intersection is completed.
2. When a lane adjacent to an open lane is closed to travel, the temporary traffic control devices shall be set 2 feet (0.61 m) into the closed lane from the edge of the open lane, unless an uncured patch exists or actual work is being performed closer to the open lane with minimum restriction to traffic.
3. Except for "buffer lanes" on high volume and/or high speed roadways, lanes shall not be closed unless construction activity requiring lane closure is taking place, or will take place within the next hour. Lanes shall be reopened immediately upon completion of the work. Moving operations will require the lane closures be shortened as the work progresses and

as traffic conditions warrant to minimize the length of the closure. The Contractor shall conduct construction operations in a manner so as to minimize disruption to traffic during peak hours and periods of heavy flow. The Department reserves the right to stop or change the Contractor's operations, if in the opinion of the Engineer, such operations are unnecessary at that time or the operations are unnecessarily impeding traffic.

4. Work in the vicinity of traffic signals, shall be scheduled to minimize the time during which the signal is operated without detectors, and prior approval from the Engineer shall be required. TMC shall be notified in advance of cutting a loop detector, and be immediately notified once the loop detector has been reinstalled. The Contractor shall provide sufficient advance notice of the loop detector work with the Engineer to ensure the aforementioned requirements are met.

It is required that all temporary traffic control work and related items shall either be performed entirely by the Contractor's own organization, or totally subcontracted. Maintenance of equipment shall not be subject to this requirement.

Any deficiencies related to temporary traffic control that are reported to the Contractor in writing shall be corrected within 24 hours or as directed by the Engineer. Failure to comply will result in non-payment for those devices that are found to be deficient for the duration of the deficiency. Serious deficiencies that are not corrected immediately shall result in suspension of work until items identified are brought back into compliance.

At the end of each day's work, the Contractor shall correct all pavement edge drop-offs in accordance with Table 6G-1 in the Delaware MUTCD. This corrective work shall be accomplished with Temporary Roadway Material (TRM) unless an alternate method is specified in the Plans. All ruts and potholes shall be filled with TRM as soon as possible but no later than the end of each work day. Placement and Payment of TRM shall be completed in accordance with Section 403 of the Standard Specifications. If temporary elimination of a drop-off hazard cannot be accomplished, then the area should be properly marked and protected with temporary traffic control devices such as temporary barricades, warning signs, flashing lights, etc. as required by Section 6G.21 of the Delaware MUTCD.

All open trench excavation accessible by vehicular traffic must be backfilled prior to the end of each working day. Steel plates shall not be used except in emergency situations and only with prior written approval from the Engineer unless otherwise directed by the Plans.

The Contractor shall submit, at or prior to the preconstruction meeting, detailed drawings including but not limited to existing striping lengths, lane and shoulder widths, turn lane lengths, locations of stop bars, turn arrows, crosswalks and railroad crossings. The drawings shall depict the existing pavement markings for each project location. These drawings will be reviewed by the Department's Traffic Section to determine the need for modification(s) for compliance with the Delaware MUTCD. Temporary pavement markings, on the final pavement surface, shall match the Plan dimensions and layout or the approved drawings of the permanent markings in compliance with Section 3 of the Delaware MUTCD. All conflicting or errant striping shall be removed as directed by the Engineer in compliance with the specifications for Item 817031 - Removal of Pavement Striping.

At the end of each day's operation and before traffic is returned to unrestricted roadway use, temporary striping shall be utilized when the existing pavement is milled and hot mix will not be placed the same day or more than a single course of hot mix is to be placed or permanent roadway striping cannot be placed on the same day as the placement of the final course of hot mix. Placement of temporary striping shall receive prior approval from the Engineer and the contractor shall apply temporary pavement markings in accordance with the requirements of Section 817 of Delaware Standard specifications and the Delaware MUTCD. Payment for temporary pavement striping shall be made at the unit price bid for item 817 - Temporary Striping. Payment for final striping will be included in the applicable striping item.

The Contractor shall have temporary striping/delineating materials (such as raised markers, tape, and other approved materials) available at the job site for verification by the Department prior to starting the hot-mix paving operation on roads to be immediately opened to traffic. These materials shall be used by the Contractor for temporary markings if he/she fails to apply temporary marking paint, etc., as required

by the Delaware MUTCD. No paving operations on roads to be immediately opened to traffic will be allowed unless such verification has been made for the availability of the materials at the job site.

Travel lane and ramp closings on multilane highways and Interstates shall not be permitted during the following holiday periods:

- December 24 through December 27 (Christmas Day)
- December 31 through January 3 (New Years Day)
- Friday prior to Easter through Easter Sunday
- Thursday prior to Memorial Day through the Tuesday following Memorial Day
- Dover International Speedway Race Weekends (Thursday prior to the race event through the day after the race event)
- July 3 through July 5 (Independence Day)
- Thursday prior to Labor Day through the Tuesday following Labor Day
- Wednesday prior to Thanksgiving Day through the Monday following Thanksgiving Day

Additional time restrictions may apply as noted in the project plans or as directed by the Engineer. Any requests to waive any restrictions must be made in writing to the Engineer for review and approval. A copy of the request shall be provided to the District Safety Officer for review.

Certification:

Temporary traffic control devices used on all highways open to the public in this State shall conform to the Delaware MUTCD. All devices shall be crashworthy in accordance with the National Cooperative Highway Research Program (NCHRP) Report 350, the memorandum issued August 28, 1998 by The USDOT Federal Highway Administration, and/or in accordance with the latest edition of the Manual for Assessing Safety Hardware (MASH), published by the American Association of State Highway and Transportation Officials (AASHTO).

The Contractor shall submit certification for temporary traffic control devices or vendors used specifically on this project at or prior to the pre-construction meeting.

Certification of compliance with NCHRP report 350 and/or MASH is required for the following categories of temporary traffic control devices:

Category I contains small and lightweight channelizing and delineating control devices which includes cones, tubular markers, flexible delineator post and drums, all without any accessories or attachments.

Category II includes temporary traffic control devices that are not expected to produce significant vehicular velocity changes to impacting vehicles. These devices which shall weigh 100 pounds or less, include Type I, II and III barricades, portable sign supports with signs, and intrusion alarms. Also included are drums, cones, and vertical panels with accessories or attachments.

Category III includes temporary traffic control devices that are expected to cause significant vehicular velocity changes to impacting vehicles. These devices which weigh more than 100 pounds include temporary barrier, temporary impact attenuators, and truck-mounted attenuators.

Category IV includes portable or trailer-mounted devices such as arrow panels, variable message signs, temporary traffic signals and temporary area lighting.

For Category I devices, the manufacturer or Contractor may self-certify that the devices meet the NCHRP-350 and/or MASH criteria. The Contractor shall supply the Federal Highway Administration's NCHRP-350 and/or MASH acceptance letter for each type of device that falls under Category II and III devices.

Basis of Payment:

Payment will be made at the Lump Sum price for "Maintenance of Traffic", for which price and payment constitutes full compensation for all maintenance of traffic activities accepted by the Engineer, which shall include the cost of furnishing and relocating permanent and temporary traffic control signs,

traffic cones or drums, submission of temporary traffic control plan(s), submission of existing pavement marking drawings, submission of all required certifications, labor, equipment and incidentals necessary to complete the item. Payment to furnish and maintain other temporary traffic control devices including but not limited to Portable P.C.C. Safety Barrier, Truck Mounted Attenuators, Portable Changeable Message Signs, Arrow Panels and Portable Light Assemblies will be made at the contract unit price for each item.

NOTE

If the Contractor does not complete the Contract work within the Contract completion time (including approved extension time), the Contractor shall be responsible for providing the necessary temporary traffic control devices that are required to complete any remaining work. The costs of such temporary traffic control shall be borne by the Contractor. No additional payment will be made to the Contractor to maintain traffic in accordance with the Delaware MUTCD, contract plans and specifications. Temporary traffic control items include, but not be limited to, warning lights, warning signs, barricades, plastic drums, P.C.C. safety barrier, flaggers, traffic officers, arrow panels, message boards, and portable impact attenuators.

10/5/16

- 831503 - FURNISH AND INSTALL 2-1/2" SCHEDULE 80 PVC CONDUIT (OPEN CUT)**
- 831514 - FURNISH AND INSTALL 2-1/2" SCHEDULE 80 PVC CONDUIT (TRENCH)**
- 831515 - FURNISH AND INSTALL 3" SCHEDULE 80 PVC CONDUIT (TRENCH)**
- 831516 - FURNISH AND INSTALL 4" SCHEDULE 80 PVC CONDUIT (TRENCH)**
- 831523 - FURNISH AND INSTALL 2" GALVANIZED STEEL CONDUIT (TRENCH)**
- 831533 - FURNISH AND INSTALL 2" GALVANIZED STEEL CONDUIT (OPEN CUT)**
- 831542 - FURNISH AND INSTALL 2" HDPE SDR-13.5 CONDUIT (BORE)**
- 831544 - FURNISH AND INSTALL 3" HDPE SDR-13.5 CONDUIT (BORE)**
- 831545 - FURNISH AND INSTALL 4" HDPE SDR-13.5 CONDUIT (BORE)**
- 831574 - FURNISH & INSTALL SECOND AND SUBSEQUENT ADDITIONAL 4" SCHEDULE 80 PVC CONDUITS IN TRENCH OR OPEN CUT**
- 831578 - FURNISH & INSTALL SECOND AND SUBSEQUENT ADDITIONAL 4" HDPE 13.5 SDR CONDUIT IN DIRECTIONAL BORE**

Description:

This work consists of furnishing and installing a conduit or shield, of the type and size required and as specified in the contract documents or as directed by the Engineer.

Materials:

All conduits shall be UL listed.

HDPE Conduit - 2" and 4" diameter, high density polyethylene (HDPE) SDR-13.5, smooth wall conduit with permanently pre-lubricated lining, meeting ASTM D2447, ASTM D3035 and NEMA TC7 specifications.

PVC Conduit - 4", 3", 2-1/2", 2" or 1" diameter, schedule 80 rigid polyvinyl chloride (PVC) conduit, meeting Commercial Standard CS-272-65 (PVC), ASTM D-1785 and U.C. Standard 651 specifications.

Galvanized Steel Conduit - 4", 3", 2-1/2", 2", 1-1/2 or 1" diameter, rigid galvanized steel conduit meeting National Electric Code 2002, Article 344.

HDPE Conduit to PVC Conduit Coupling - Galvanized steel meeting Commercial Standard CS-272-65 (PVC), ASTM D-1785 and U.C. Standard 651 specifications

Flexible Metallic-Liquidtight Conduit - meets National Electric Code 2002, Article 350

Weatherhead for galvanized or PVC conduit - material shall match the adjoining conduit

Insulated grounding bushing with knockouts - meet or exceed UL 514 B

Condulets for conduit sizes - material shall match the adjoining conduit

Anchors - A 307, Galvanized per A 153

One hole conduit hangers - Steel City Series 6H or 6H-B, CADDY CD3B Rigid Conduit Hanger, or approved equal

End caps - material shall match the adjoining conduit

LONG sweep sections for conduit sizes - material shall match the adjoining conduit, and shall be manufactured 90 degree sweeping bends.

Construction Methods:

General Installation Requirements -

The Department has the right to reject any installation method proposed for a given work site. PVC shall not be installed under existing pavement unless it is on a continuous roll or with the Engineer's written approval.

Conduit installed underground shall be installed in a straight line between terminal points. In straight runs, junction well spacing shall be no more than 600 feet for fiber optic conduit or no more than 300 feet for copper in conduit, or as directed by the Engineer. If bends are required during installation, they must be manufactured sweeping bends. The Engineer will be consulted before any bends are installed to ensure that the proper arc is provided.

Underground conduit shall have a minimum cover as measured from the finished grade of 24 inches and a maximum cover of 48 inches. The opening shall be filled half way with the cover material, and tamped down firmly before filling in the remainder of the opening. Additional lifts shall be used as required to install the metallic warning tape at the specified depth. All cover material shall be free of rocks, debris, vegetation or other deleterious material that may damage the conduit. An underground utility warning tape shall be installed as specified in this section and the remainder of the fill shall be added, tamping down the top layer.

Conduit not terminated to a base or in a junction well shall be terminated 2 feet beyond the edge of the pavement unless otherwise directed by the Engineer, and properly capped. Tape is NOT an approved method. Conduit shall not extend more than 3 inches inside a junction well. See Standard Construction Details or applicable Plan Details for typical methods of termination.

All underground conduits shall be marked in the ground with a metallic warning tape. The marking tape shall be buried directly above the conduit run that it identifies, at a depth of approximately 12 inches below final grade. The tape identifying ALL conduits shall be at least 6 inches wide, and have a minimum thickness of 3 mils and 500 percent elongation.

The color of the metallic warning tape identifying fiber optic cable should be bright orange (preferably AULCC orange), and shall read "WARNING - OPTICAL CABLE" or other wording approved by the Engineer that conveys the same message. The color of the tape identifying all other cables shall be bright red, and shall read "WARNING -BURIED ELECTRIC BELOW" or other wording approved by the Engineer that conveys the same message.

Using conduit tools, rigid metallic conduit shall be cut, reamed, and threaded. The thread length shall be as necessary to ensure that the sections of conduits when screwed into a coupling and tightened correctly will butt together and the joint will be watertight. A three-piece threaded union, as approved by the Engineer, shall be used to join two threaded lengths of conduit in the case where a standard coupling will not work. A threaded union shall not be used in a conduit run that is to be driven. At no time is a threadless coupling or a split-bolt coupling to be used for direct buried conduit.

All lengths of HDPE conduit shall be connected with irreversible fusion couplings. Mechanical and removable couplings will not be accepted.

All lengths of PVC conduit shall be connected by one conduit end fitting inside the flared end of the other conduit section. If this is not possible, then a coupling may be used. Regardless of how connection is made, all joints shall be sealed with the appropriate epoxy to ensure that the two conduit pieces bond to one another to form a solid waterproof link. Using conduit tools, the conduit shall be cut and prepared. If approved by the Engineer, a coupler module may be used where conduit segments do not align properly to allow the flared end of one conduit segment to mate with the normal end of the other segment.

Sealed end caps (with knockouts if empty) shall be placed on the ends of all conduits, after compressed air has been used to clear all foreign matter.

If not already pre-installed by the manufacturer, a polyester or polypropylene pulling rope or tape (fish wire) with a minimum rated strength of 1250 pounds shall be installed in each conduit for future use. In instances where the Contractor installs the cable, the fish wire may be eliminated.

All PVC and HDPE conduits shall have a continuous metallic trace wire installed for the entire length of the conduit run for all fiber installations.

Generally, Item No. 908020 - Erosion Control Blanket Mulch in the Department's 2016 Standard Specifications would be used to stabilize slopes that are 2:1 or flatter. For slopes that are steeper than 2:1 and/or receive a moderate amount of concentrated flow, Item No. 908021 - Turf Reinforcement Matting, Type 1 in the Department's 2016 Standard Specifications would be used for slope stabilization. However, if required Contractor shall refer to DelDOT's Erosion and Sediment Control Manual for the placement of steep slope stabilization.

Installation of Conduit Under Existing Pavement, Directional Bore -

Directional bore shall be used for installation of conduits under existing pavement with a conduit diameter not less than 1-1/2". The size of a bore shall not exceed the outside diameter of the conduit by more than 1 inch. If it does, cement grout shall be pumped into the void. Only HDPE and/or Galvanized Steel conduit may be installed by Directional Bore methods.

Installation of Conduit Under Existing Pavement, Open Cut -

Installation by sawcutting the full pavement depth and removing the existing pavement with an excavator or by hand methods, shall be used only for conduits not less than 1-1/2" diameter. The Engineer must first approve all open cutting of roadways. The width and length of open cut and patch restoration materials shall be as shown on the plan details. The Contractor shall be responsible for the removal of all cut pavement and surplus excavation, and for the replacement and correction of any damaged pavement outside the sawcut limits after the conduit(s) are installed. Asphalt pavement, concrete, base course, sawcutting, and/or borrow from an outside source as required to restore the roadway will be paid for separately under their respective bid items.

Installation of Conduit Under Existing Pavement, Unpaved Trench -

Trenching or other approved method shall be used for installation of conduit in unpaved trench or under new pavement. Backfill in conduit trenches shall be compacted thoroughly as it is being placed. At the discretion of the Engineer, sod, that must be removed for the placement of conduit, shall be removed either by the use of an approved sod cutter and then replaced, or 6 inches of topsoil shall be placed and the surface seeded in accordance with Section 734001 - Seeding. In areas where new pavement is to be placed or in areas where total reconstruction is taking place, sodding or seeding may not be required by the Engineer. Sodding and/or topsoil from an outside source if required will be paid for separately under their respective bid items. Seeding is considered incidental to the conduit item.

Installation of Conduit on Structure -

Conduit installed on structure shall consist of drilling anchors into concrete, brick, stone, steel or wood and mounting the conduit with the proper clamps or hangers. The conduit shall be attached to the structure by use of one-hole conduit hangers and approved anchors not more than 36 inches apart. Any 90-degree turns in the conduit run shall be accomplished by placing the proper size and type manufactured sweeping bends for the application needed.

Installation of Additional Conduit in Trench or Open Cut Pavement:

In the case of slotted or trenched installations, the Contractor shall install additional conduits at the same time as the initial installation. The Engineer shall indicate the quantity of conduits to be installed during a build. Additional conduits may be stacked one on top of the other, side by side or in a matrix. The orientation shall be at the Contractor's discretion, but conduits shall not twist around one another or be allowed to deviate from straight line paths except in the case of bend installations. Conduits installed at the same time in the same trench or slot shall remain oriented the same in relation to one another throughout the conduit run.

Installation of Additional Conduits in Directional Bore:

In the case of a directional bore that more than one conduit shall be installed, the Contractor shall, at the same time as the initial installation, install one (1) or more additional conduits. The Engineer shall indicate the quantity of conduits to be installed during a build. The additional conduits may be stacked one on top of the other, side by side or in a matrix. The orientation shall be at the Contractors discretion, but conduits shall not twist around one another or be allowed to deviate from straight line paths except in

the case of a gentle bend. Conduits installed at the same time, in the same bore shall remain oriented in the same relation to one another throughout the conduit run.

Method of Measurement:

The quantity of conduit furnished and installed as specified, shall be measured as the number of linear feet of conduit furnished, installed as specified, complete in place, and accepted.

The length of each conduit installed under existing pavement by a directional bore or by open cutting the pavement shall be measured along the path of the bore or open cut, from the point that cannot be trenched to the point that trenching can resume.

The length of any conduit that is reduced or divided (with a junction well or conduit body) shall be measured as part of the larger conduit.

Basis of Payment:

The quantity of conduit will be paid for at the Contract unit price per linear foot. Price and payment shall include full compensation for all materials, and labor, topsoil and seed if needed, and incidentals necessary to complete the item. Payment for all necessary couplings shall be incidental to the price of the conduit.

For conduit installed by Directional Bore, the linear foot payment also includes excavation and backfilling for Bore Equipment, placing the conduit, caps if required, and all other requirements and incidentals listed in the body of this specification.

For conduit installed by Open Cutting existing pavement, the linear foot payment also includes excavating, backfilling, placing the conduit, disposal of excess materials, and all other requirements and incidentals listed in the body of this specification.

For conduit installed in an Unpaved Trench, the linear foot payment also includes excavating, removal of sod if required, backfilling, placing the conduit, disposal of excess materials, replacing excavated on-site sod if required, seeding if required, and all other requirements and incidentals listed in the body of this specification. Sod and/or topsoil furnished from an outside source, will be paid for separately.

For conduit installed on a structure, the linear foot payment also includes furnishing and installing anchors and hangers, removal of excess materials, and all other requirements and incidentals listed in the body of this specification.

4/12/2018

834501 - PARTIAL REMOVAL OF CONCRETE POLE BASES AND CABINET FOUNDATIONS

Description:

This work consists of the removal of concrete pole bases and concrete cabinet foundations.

Materials:

Equipment as required to remove concrete pole bases and concrete cabinet foundations.
Material as necessary to match the area surrounding the removed or graded masonry.

Construction Methods:

The masonry shall be removed to a depth of six inches below final grade.

Backfill remaining hole with material that matches the surrounding area in accordance with the appropriate items.

Method of Measurement:

The quantity of concrete will be measured as the number of cubic yards of concrete removed including anchor bolts, reinforcing bars, conduits and any other hardware within the concrete.

Concrete or other materials moved or removed which is not a part of the item being removed, shall not be measured for the purpose of payment under this item.

Basis of Payment:

The quantity of concrete will be paid for at the unit price per cubic yard. Price and payment will constitute full compensation for all labor, equipment, tools, and incidentals required to complete the work.

05/31/17



STATE OF DELAWARE
DEPARTMENT OF TRANSPORTATION
800 BAY ROAD
P.O. BOX 778
DOVER, DELAWARE 19903

JENNIFER COHAN
SECRETARY

12 SEPTEMBER, 2018
UTILITY STATEMENT
STATE CONTRACT # T201906105
F.A.P. # NONE
P6# 19-06105
PAVEMENT & REHABILITATION,
NORTH V, 2019
NEW CASTLE COUNTY,

LOCATION - 11th St (Wilmington) from Adams Street to Northeast Blvd

General Scope of work – 2" profile mill, bituminous concrete and PCC patching, 2" type C hot-mix, ADA/signal upgrades, and upgrades to pavement markings and signing.

The following utility companies may own and/or maintain facilities within the project limits:

AT&T TRANSMISSION
CITY OF WILMINGTON
COMCAST
CROWN CASTLE (FIBERTECH)
DELDOT
DELMARVA POWER
DELMARVA POWER GAS
MCI TELECOMMUNICATIONS
VERIZON
ZAYO

Utility adjustments and/or relocations shall be performed as narrated, but are not limited to the following:

AT&T TRANSMISSION –

AT&T Transmission owns and maintains aerial and underground facilities along 11th Street with no apparent conflicts. Any relocations/adjustments to any existing aerial/underground lines shall be arranged by the contractor, if necessary, with the utility owner during the construction of the project. The time to complete any relocations/adjustments will depend on the nature of the work. **No working/existing AT&T facilities can be taken out of service. These facilities will remain in place and active during the duration of this contract.**

CITY OF WILMINGTON – TRAFFIC SIGNALS, WATER & SEWER:

The City of Wilmington – Traffic Signals, maintains ITMS, and/or signal systems throughout the project limits. The Contractor must use care when working in these areas. Any adjustments to the City of Wilmington – Traffic Signals facilities shall be performed by the State's contractor in accordance with the Standard Specifications and City details as directed by the District Engineer. The contractor shall report any impacts to any vehicle detection system to the Traffic Management Center (TMC) (Cell #77) (24 HR 302-659-4600), 7 calendar days before any loop system is impacted by construction activities.

The City of Wilmington – Water, maintains a water main throughout this location with services. The Contractor must use care when working in these areas. There are water valve risers in the roadway and sidewalk that will require adjustment. Any adjustments to City of Wilmington valves facilities shall be performed by the contractor after a fourteen (14) calendar day notice from the contractor to the City of Wilmington.

The City of Wilmington -Sewer, maintains a sanitary sewer throughout this location with service laterals. The Contractor must use care when working in these areas. There are sewer cleanout risers and manholes in the roadway and sidewalk that will require adjustment. Any adjustments to City of Wilmington Sewer facilities shall be performed by the contractor after a fourteen (14) calendar day notice from the contractor to the City of Wilmington. **No working/existing City of Wilmington facilities can be taken out of service. These facilities will remain in place and active during the duration of this contract.**

COMCAST:

Comcast maintains overhead and underground facilities within this location. The contractor must use care when working in these underground areas as well as overhead cable crossings. Any adjustments to Comcast facilities shall be performed by the utility after a minimum of fourteen (14) calendar day notice from the contractor. The time to complete any relocations/adjustments will depend on the nature of the work.

No working/existing Comcast facilities can be taken out of service. These facilities will remain in place and active during the duration of this contract. Comcast emergency 24 hour hotline customer service: 1-800-934-6489.

Del DOT:

Del Dot maintains ITMS, fiber, lighting and/or signal systems throughout the project limits. The Contractor must use care when working in these areas. Any adjustments to Del DOT facilities

shall be performed by the State's contractor in accordance with the Standard Specifications as directed by the District Engineer. The contractor shall report any impacts to any vehicle detection system to the Traffic Management Center (TMC) (Cell #77) (24 HR 302-659-4600), 7 calendar days before the loop system is impacted by construction activities.

DELMARVA POWER GAS:

Delmarva Power-Gas maintains steel and plastic gas mains throughout this location with services. The Contractor must use care when working in these areas.

There are gas valve risers and manholes with-in the PCC sidewalk and roadway. Any adjustments to Delmarva Power-Gas facilities shall be performed by the utility after a seven (7) calendar day notice from the contractor.

No working/existing Delmarva Power-Gas facilities can be taken out of service. These facilities will remain in place and active during the duration of this contract.

DELMARVA POWER – ELECTRIC:

Delmarva Power maintains overhead and underground facilities within this location. The contractor must use care when working in these underground areas as well as overhead cable crossings. There are electric manholes with-in the PCC sidewalk and roadway. Any adjustments to Delmarva facilities shall be performed by the utility with fourteen (14) calendar day notice from the contractor.

No working/existing Delmarva facilities can be taken out of service. These facilities will remain in place and active during the duration of this contract. To report a downed wire, call 1-800-898-8042.

Delmarva Power has a written requirement regarding working near overhead power lines.

Customer/Contractor Acknowledgement

Performing Work within Dangerous Proximity of High Voltage Lines

“You are hereby notified by Delmarva Power that **NO** work can be performed at this location within dangerous proximity to Delmarva’s overhead lines and that you are required by law to comply with applicable OSHA regulations and the applicable state High Voltage Safety Act. Performance of any activity or causing any person, equipment or things to come within dangerous proximity of Delmarva’s overhead lines creates an extreme risk of severe injury or death. You are further notified that no activities may be conducted within dangerous proximity of Delmarva’s overhead lines until mutually agreeable measures to prevent contact with overhead lines have been reached with Delmarva and Delmarva has provided you with written authorization to perform the activities. Additionally any work involving the use of a crane with intentions to remain outside of dangerous proximity, but within 20 feet of the Company’s overhead lines, requires an Encroachment Prevention Plan in order to satisfy OSHA”

VERIZON:

Verizon maintains overhead and underground facilities within this location. The contractor must use care when working in these underground areas as well as overhead cable crossings. There are manholes with in the PCC sidewalk and roadway. Any adjustments to Verizon facilities shall be performed by the utility after fourteen (14) calendar notice from the contractor. The time to complete any relocations/adjustments will depend on the nature of the work.

No working/existing Verizon facilities can be taken out of service. These facilities will remain in place and active during the duration of this contract.

General Utility Notes

Outside of the companies and facilities discussed above, no additional utility involvement is anticipated. Should any conflicts be encountered as a result of the contractor's means and methods during construction requiring adjustment and/or relocation, the necessary relocation work shall be accomplished by the respective utility company and funded by the State's Contractor as directed by the District Engineer. The State Contractor shall coordinate any potential conflicts with utility companies and provide adequate notice prior to performing work.

Any utility conflicts that are not readily discernable shall be coordinated by the State Contractor once the conflict is recognized. The time to complete any relocations/adjustments found to be necessary during construction of the highway project will depend on the nature of the work. Once the State's contractor has given the Utility the advance notice required above, it is the responsibility of the State's contractor to have the work area prepared and accessible for the Utility to perform the tasks listed above. If the site conditions are not ready and the state contractor has given notice to the utility on when the work is to be accomplished, the State's Contractor shall be responsible for any extra cost incurred by the utility company and the State Contractor shall also be responsible for any time delays. Between when the required notice is given to the Utility and when the work is performed and completed, the coordination and scheduling of the Utility is the sole responsibility of the State's Contractor. All costs related to the coordination and scheduling of the utilities is incidental to the contract.

Any adjustments and/or relocations of municipally or county owned sewer or water facilities shall be performed by the State's Contractor in accordance with the respective agency's standard specifications as directed by the District Engineer. The State contractor shall coordinate any potential conflicts of municipally or county owned sewer or water facilities with facility owners and provide adequate notice to the municipally or county and to the District Engineer prior to performing work.

General Notes

1. The Contractor's attention is directed to Section 105.09 Utilities, Delaware Standard Specifications, August 2016. The Contractor shall contact Miss Utility (1-800-282-8555) two working days prior to any excavation. The Contractor is responsible for the support and protection of all utilities when excavating. The Contractor is responsible for ensuring proper clearances, including safety clearances, from overhead utilities for construction equipment. The Contractor is advised to check the site for access and operating purposes for his equipment and, if necessary, make arrangements directly with the utility companies for field adjustments for adequate clearances.
2. The information shown in the Contract Documents, including the Utility Statement and the Utility Schedule contained herein, concerning the location, type and size of existing and proposed utilities, their locations, and construction timing has been compiled by the preparer based on information furnished by each of the involved Utility Companies. It shall be the responsibility of the State's Contractor to verify all information and coordinate with the Utility Companies prior to and during construction, as specified in Section 105.09 of the Standard Specifications.

3. It is understood and agreed that the Contractor has considered in his bid all permanent and temporary utility appurtenances in their present and relocated positions as shown on the plans or described in the Utility Statement or are readily discernible and that no additional compensation will be allowed for any delays, inconvenience, or damage due to any interference from the utility facilities and appurtenances or the operation of moving them, except that the Contractor may be granted an equitable extension of time unless the delay is caused by the Contractor's delay in having the site conditions ready for the utility relocation work after the Contractor has provided the advance notice that the site conditions would be ready for the utility relocation work. The contractor's means and method of construction are not taken into account when known utility conflicts are identified. If the Contractor's means and method of construction create a utility conflict the Utility Statement will prevail in discussions with the utility and the Contractor. The State's Contractor shall be responsible for any costs associated with any temporary outages; holding, bracing and shielding of utility facilities; temporary relocations; or permanent relocations that are not specifically identified in this utility statement or shown in the contract plan set.

4. Coordination and cooperation among the Utility Companies and the State's Contractor are of prime importance. Therefore, the Contractor is directed to contact the following Utility Company representatives with any questions regarding this work prior to submitting bids and work schedules. Proposed work schedules should reflect the Utility Companies' proposed relocations. The Utility Companies do not work on weekends, nights or legal holidays.


NAME	COMPANY	PHONE	EMAIL
Louis Marello	AT&T	lmarello@att.com	914-397-3744
Joanne Liao	City of Wilmington – Water & Sewer	jliao@wilmingtonde.gov	302-576-3064
Brian A. Mitchell	City of Wilmington – Signals	bmittchell@WilmingtonDE.gov	302-576-3089
Keith Allridge	Comcast	keith@americomm-llc.com	717-776-1073
Knol McRae	Comcast	Knol_mcr@cable.comcast.com	302-661-4462
Crown Castle (Fibertech)	Bill Muehlberger	bmuehlberger@fibertech.com	585-362-0019
Angel Collazo	Delmarva Power Electric	Angel.collazo@delmarva.com	302-454-4370
Kristin Stanfil	Delmarva Power Gas	Kristin.stanfil@delmarva.com	302-429-3706
John Alessandrini	MCI	john.alessandrini@verizonbusiness.com	610-337-6707
George Zang	Verizon Delaware Inc	George.w.zang@verizon.com	302- 422-1238
Chris Ricciuti	AboveNet - DBA Zayo	chris.ricciuti@zayo.com	484-696-3903

5. As outlined in Chapter 3 of the DeIDOT Utilities Manual, individual utility companies are responsible for obtaining all required permits from municipal, State and federal government agencies and railroads. This includes but is not limited to water quality permits/DNREC Water Quality Certification, DNREC Subaqueous Lands/Wetlands permits, DNREC Coastal Zone Consistency Certification, County Floodplain permits (New Castle County only), U.S. Coast Guard permits, US Army Corps 404 permits, sediment and erosion permits, and railroad crossing permits.
6. Individual utility companies are required to restore any areas disturbed in conjunction with their relocation work. If an area is disturbed by a utility company and is not properly restored, the Department may have the State's Contractor perform the necessary restoration. Any additional costs incurred as a result will be forwarded to the utility company.
7. 16 Del. C. § 7405B requires notification to and mutually agreeable measures from the public utility operating the electric line for any person intending to carry on any function, activity, work or operation within dangerous proximity of any high voltage overhead electric lines. All contractors/other utilities must also maintain a minimum distance of 10'-0" from all overhead energized lines. Additional clearance may be required from high voltage transmission lines.
8. In conjunction with bid preparation and prior to starting work, the State's Contractor shall confirm with all respective Utility Companies noted in this Utility Statement to have advance utility relocations that the advance relocations have in fact been accomplished as summarized herein.
9. Any existing facilities that are comprised of hazardous materials will be removed by the Utility Company unless otherwise outlined in the contract documents or language above. Any existing facilities containing hazardous materials will be purged by the Utility Company unless otherwise outlined in the contract documents or language above.

DIVISION OF TRANSPORTATION SOLUTIONS



Delaware Department of Transportation
Utility Section
Chuck.Ferguson@state.de.us



Date

STATE OF DELAWARE
DEPARTMENT OF TRANSPORTATION
PO BOX 778
DOVER, DELAWARE 19903

CERTIFICATE OF RIGHT-OF-WAY STATUS

STATE PROJECT NO. T201906105

F.A.P. NO. N/A for R/W

PAVE & REHAB NORTH V, CITY OF WILMINGTON, 11TH STREET, 2019

NEW CASTLE COUNTY

Certificate of Right-of-Way Status – 100%

Level 1

As required by 23 CFR, Part 635, and other pertinent Federal and State regulations or laws, the following certifications are hereby made in reference to this highway project:


All project construction or work shall be performed within existing rights of way and permanent easements; and

All necessary real property interests, including control of access rights when pertinent, were acquired as part of previous highway projects, and include legal and physical possession; and,

This project does not cause any persons to be displaced as defined in 49 CFR, Part 24; and,

The State has the right to remove, salvage, or demolish any improvements or personal property that may be located within project limits.

RIGHT OF WAY SECTION

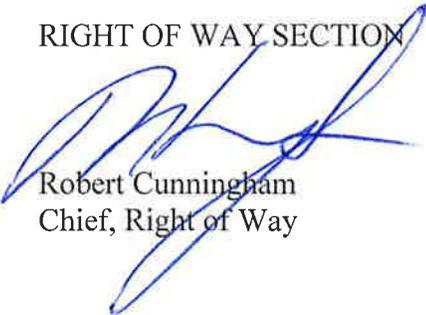

Robert Cunningham
Chief, Right of Way

August 15, 2018



STATE OF DELAWARE
DEPARTMENT OF TRANSPORTATION
800 BAY ROAD
P.O. BOX 778
DOVER, DELAWARE 19903

JENNIFER COHAN
SECRETARY

September 26, 2018

ENVIRONMENTAL REQUIREMENTS

FOR
State Contract No. T201906105
Federal Aid No.: N/A

Contract Title: Pavement and Rehabilitation, North V, City of Wilmington 11th St, 2019

Due to the nature of the proposed construction activities, permits are not required for this project. However, the following construction requirements and special provisions have been developed to minimize and mitigate impact to the surrounding environs. These requirements by DelDOT not specified within the contract, but listed below, are the responsibility of the contractor and are subject to risk of shut down at the contractor's expense if not followed.

GENERAL REQUIREMENTS:

1. All construction debris, excavated material, brush, rocks, and refuse incidental to such work shall be placed either on shore above the influence of flood waters or on some suitable dumping ground.
2. That effort shall be made to keep construction debris from entering adjacent waterways or wetlands. Any debris that enters those areas shall be removed immediately.
3. The disposal of trees, brush, and other debris in any stream corridor, wetland, surface water, or drainage area is prohibited.
4. DelDOT Environmental Studies Section (302) 760-2264 must be notified if there are any changes to the project methods, footprint, materials, or designs, to allow the Department to coordinate with the appropriate resource agencies (COE, DNREC, and SHPO), for approval.



STATE OF DELAWARE
 DEPARTMENT OF TRANSPORTATION
 800 BAY ROAD
 P.O. BOX 778
 DOVER, DELAWARE 19903

JENNIFER COHAN
 SECRETARY

RAILROAD STATEMENT

For

State Contract No.: T201906105

Federal Aid No.: N/A

Project Title: Pavement & Rehabilitation, North V, City of Wilmington 11th ST, 2019

The following railroad companies maintain facilities within the contract limits:

- | | |
|----------------------------------------------|-----------------------------------------------|
| <input type="checkbox"/> Amtrak | <input type="checkbox"/> Maryland & Delaware |
| <input type="checkbox"/> CSX | <input type="checkbox"/> Norfolk Southern |
| <input type="checkbox"/> Delaware Coast Line | <input type="checkbox"/> Wilmington & Western |
| <input type="checkbox"/> East Penn | <input checked="" type="checkbox"/> None |
| <input type="checkbox"/> Delmarva Central | |

DOT Inventory No.: N/A No. Trains/Day: N/A Passenger Trains (Y / N): N/A

In accordance with 23 CFR 635, herein is the railroad statement of coordination (check one):

- No Railroad involvement.

- Railroad Agreement unnecessary but railroad flagging required. The contractor shall follow requirements stated in the DelDOT Maintenance of Railroad Traffic Item in the Special Provisions. Contractor shall coordinate railroad flagging with DelDOT's Railroad Program Manager at (302) 760-2183.

- Railroad Agreement required. The necessary Railroad Agreement is pending. The Contractor cannot begin work until the Agreement is complete and fully executed. Railroad related work to be undertaken and completed as required for proper coordination with physical construction schedules. The Contractor shall follow requirements stated in the DelDOT Maintenance of Railroad Traffic Item in the Special Provisions. Contractor shall coordinate railroad flagging with DelDOT's Railroad Program Manager at (302) 760-2183.

Approved As To Form:



 Robert A. Perrine
 DelDOT Railroad Program Manager

30 July 18

 DATE

BID PROPOSAL FORMS

CONTRACT T201906105.01

UNLESS OTHERWISE DIRECTED, SUBMIT ALL FOLLOWING PAGES TO:

DEPARTMENT OF TRANSPORTATION
BIDDERS ROOM
800 BAY ROAD
DOVER, DELAWARE 19901

Identify the following on the outside of the sealed envelope:
- Contract Number T201906105.01
- Name of Contractor

CONTRACT ID: T201906105.01 PROJECT(S): T201906105

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS

SECTION 0001 Category 0001

0010	201000 CLEARING AND GRUBBING	LUMP		LUMP		
0020	202000 EXCAVATION AND EMBANKMENT	CY	767.000			
0030	209006 BORROW, TYPE F	CY	10.000			
0040	211000 REMOVAL OF STRUCTURES AND OBSTRUCTIONS	LUMP		LUMP		
0050	211001 REMOVAL OF PORTLAND CEMENT CONCRETE PAVEMENT, CURB AND SIDEWALK	SY	587.000			
0060	301002 GRADED AGGREGATE BASE COURSE, TYPE B, PATCHING	CY	273.000			
0070	301003 GRADED AGGREGATE BASE COURSE, TYPE B	TON	100.000			
0080	401029 SUPERPAVE TYPE C, PG 64-22, PATCHING	TON	140.000			
0090	401030 SUPERPAVE TYPE B, PG 64-22, PATCHING	TON	212.000			

CAN NOT BE
 USED FOR
 BIDDING

DELAWARE DEPARTMENT OF TRANSPORTATION
SCHEDULE OF ITEMS

PAGE: 2
DATE:

CONTRACT ID: T201906105.01 PROJECT(S): T201906105

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0100	401031 SUPERPAVE TYPE BCBC, PG 64-22, PATCHING	1253.000 TON				
0110	401044 SUPERPAVE TYPE C, PG 64-22 (NON-CARBONATE STONE)	3500.000 TON				
0120	401696 ENTRANCE, DRIVEWAY, AND INTERSECTING STREET PAVING SURCHARGE	400.000 TON				
0130	402000 BITUMINOUS CONCRETE PATCHING	21600.000 SYIN				
0140	403000 BITUMINOUS CONCRETE AND/OR COLD-LAID BITUMINOUS (TRM) CONCRETE	200.000 TON				
0150	503503 PATCHING CONCRETE	600.000 SYIN				
0160	602100 REPLACE DRAINAGE INLET GRATE(S)	34.000 EACH				
0170	602101 REPLACE DRAINAGE INLET FRAME(S)	34.000 EACH				
0180	602130 ADJUSTING AND REPAIRING EXISTING DRAINAGE INLET	34.000 EACH				
0190	602131 ADJUSTING AND REPAIRING EXISTING DOUBLE DRAINAGE INLET	1.000 EACH				

DELAWARE DEPARTMENT OF TRANSPORTATION
 SCHEDULE OF ITEMS

PAGE: 3
 DATE:

CONTRACT ID: T201906105.01 PROJECT(S): T201906105

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0200	602132 ADJUSTING AND REPAIRING EXISTING MANHOLE	48.000 EACH				
0210	701010 PORTLAND CEMENT CONCRETE CURB, TYPE 1-2	36.000 LF				
0220	701011 PORTLAND CEMENT CONCRETE CURB, TYPE 1-4	80.000 LF				
0230	701012 PORTLAND CEMENT CONCRETE CURB, TYPE 1-6	671.000 LF				
0240	701013 PORTLAND CEMENT CONCRETE CURB, TYPE 1-8	82.000 LF				
0250	701021 INTEGRAL PORTLAND CEMENT CONCRETE CURB AND GUTTER, TYPE 3-4	24.000 LF				
0260	701022 INTEGRAL PORTLAND CEMENT CONCRETE CURB AND GUTTER, TYPE 3-6	117.000 LF				
0270	701502 STONE CURB	402.000 LF				
0280	701503 CURVED STONE CURB	742.000 LF				
0290	705001 PORTLAND CEMENT CONCRETE SIDEWALK, 4"	8158.000 SF				

CAN NOT BE
 USED FOR
 BIDDING

DELAWARE DEPARTMENT OF TRANSPORTATION
SCHEDULE OF ITEMS

PAGE: 4
DATE:

CONTRACT ID: T201906105.01 PROJECT(S): T201906105

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0300	705002 PORTLAND CEMENT CONCRETE SIDEWALK, 6"	3913.000 SF				
0310	705007 SIDEWALK SURFACE DETECTABLE WARNING SYSTEM	1188.000 SF				
0320	705008 PEDESTRIAN CONNECTION, TYPE 1	205.000 SF				
0330	705009 PEDESTRIAN CONNECTION, TYPE 2, 3, AND/OR 4	2505.000 SF				
0340	705504 BRICK AND/OR BLOCK SIDEWALK	665.000 SF				
0350	705505 REST STONE/BRICK SIDEWALK AND/OR STONE/BRICK ROADWAY	6070.000 SF				
0360	705506 BRICK AND/OR BLOCK ROADWAY	116.000 SF				
0370	710001 ADJUST WATER SERVICES	1.000 EACH				
0380	710002 ADJUST WATER VALVE BOXES	29.000 EACH				
0390	710003 ADJUST FIRE HYDRANTS	3.000 EACH				

CONTRACT ID: T201906105.01 PROJECT(S): T201906105

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0400	760010 PAVEMENT MILLING, BITUMINOUS CONCRETE PAVEMENT	49500.000 SYIN				
0410	762000 SAW CUTTING, BITUMINOUS CONCRETE	5055.000 LF				
0420	762001 SAW CUTTING, CONCRETE, FULL DEPTH	454.000 LF				
0430	763000 INITIAL EXPENSE/DE-MOBILIZATION	LUMP	LUMP			
0440	763621 CONSTRUCTION ENGINEERING, REHABILITATION	75.000 HOUR				
0450	801500 MAINTENANCE OF TRAFFIC, ALL INCLUSIVE	LUMP	LUMP			
0460	803001 FURNISH AND MAINTAIN PORTABLE CHANGEABLE MESSAGE SIGN	60.000 EADY				
0470	806001 TRAFFIC OFFICERS	800.000 HOUR	75.00000		60000.00	
0480	808002 FURNISH AND MAINTAIN TRUCK MOUNTED ATTENUATOR, TYPE II	15.000 EADY				
0490	811001 FLAGGER, NEW CASTLE COUNTY STATE	3680.000 HOUR				

CAN NOT BE
 USED FOR
 BIDDING

CONTRACT ID: T201906105.01 PROJECT(S): T201906105

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0500	811013 FLAGGER, NEW CASTLE COUNTY, STATE, OVERTIME	368.000 HOUR				
0510	817002 PERMANENT PAVEMENT STRIPING, SYMBOL/LEGEND, ALKYD-THERMOPLASTIC	16735.000 SF				
0520	817003 TEMPORARY MARKINGS, PAINT, 4"	17280.000 LF				
0530	817004 TEMPORARY MARKINGS, PAINT, SYMBOL/LEGEND	33470.000 SF				
0540	817005 PERMANENT PAVEMENT STRIPING, ALKYD-THERMOPLASTIC, 5"	1555.000 LF				
0550	817006 PERMANENT PAVEMENT STRIPING, ALKYD-THERMOPLASTIC, 12"	150.000 LF				
0560	817012 RETROREFLECTIVE PREFORMED PATTERNED MARKINGS, SYMBOL/LEGEND	560.000 SF				
0570	817013 PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/YELLOW, 5"	8640.000 LF				
0580	817014 PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, WHITE/YELLOW, 10"	1180.000 LF				
0590	817015 PREFORMED RETROREFLECTIVE THERMOPLASTIC MARKINGS, BIKE SYMBOL	55.000 EACH				

CONTRACT ID: T201906105.01 PROJECT(S): T201906105

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0600	817018 PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 3"	515.000 LF				
0610	817019 PERMANENT PAVEMENT STRIPING, EPOXY RESIN PAINT, BLACK, 5"	35.000 LF				
0620	817022 RETROREFLECTIVE PREFORMED PATTERNED MARKINGS, 8"	10.000 LF				
0630	817031 REMOVAL OF PAVEMENT STRIPING	1120.000 SF				
0640	818002 SUPPLY OF FLAT SHEET ALUMINUM SIGN PANEL, TYPE IX, RETROREFLECTIVE SHEETING	90.000 SF				
0650	819016 INSTALLATION OF 4" DIAMETER HOLE, LESS THAN OR EQUAL TO 6" DEPTH	18.000 EACH				
0660	819018 INSTALLATION OR REMOVAL OF TRAFFIC SIGN(S) ON SINGLE SIGN POST	151.000 EACH				
0670	822001 INSTALL SIGN PANEL OVERLAY	90.000 SF				
0680	830001 CONDUIT JUNCTION WELL, TYPE 1, 20" X 20" PRECAST CONCRETE	13.000 EACH				
0690	830002 CONDUIT JUNCTION WELL, TYPE 4, 20" X 42-1/2" PRECAST CONCRETE	7.000 EACH				

CAN NOT BE USED FOR BIDDING

CONTRACT ID: T201906105.01 PROJECT(S): T201906105

All figures must be typewritten.

CONTRACTOR : _____

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0700	830008 ADJUST OR REPAIR EXISTING CONDUIT JUNCTION WELL	 25.000 EACH				
0710	830010 REMOVAL OF EXISTING JUNCTION WELL	 5.000 EACH				
0720	831503 FURNISH AND INSTALL 2-1/2" SCHEDULE 80 PVC CONDUIT (OPEN CUT)	 20.000 LF				
0730	831514 FURNISH AND INSTALL 2-1/2" SCHEDULE 80 PVC CONDUIT (TRENCH)	 140.000 LF				
0740	831515 FURNISH AND INSTALL 3" SCHEDULE 80 PVC CONDUIT (TRENCH)	 45.000 LF				
0750	831516 FURNISH AND INSTALL 4" SCHEDULE 80 PVC CONDUIT (TRENCH)	 1065.000 LF				
0760	831523 FURNISH AND INSTALL 2" GALVANIZED CONDUIT (TRENCH)	 260.000 LF				
0770	831533 FURNISH AND INSTALL 2" GALVANIZED STEEL CONDUIT (OPEN CUT)	 70.000 LF				
0780	831542 FURNISH AND INSTALL 2" HDPE SDR-13.5 CONDUIT (BORE)	 35.000 LF				
0790	831544 FURNISH AND IN STALL 3" HDPE SDR-13.5 CONDUIT (BORE)	 15.000 LF				

CAN NOT BE
 USED FOR
 BIDDING

CONTRACT ID: T201906105.01 PROJECT(S): T201906105

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0800	831545 FURNISH AND INSTALL 4" HDPE SDR-13.5 CONDUIT (BORE)	915.000 LF				
0810	831574 FURNISH AND INSTALL SECOND AND SUBSEQUENT ADDITIONAL 4" SCHEDULE 80 PVC CONDUIT IN TRENCH OR OPEN CUT	45.000 LF				
0820	831578 FURNISH AND INSTALL SECOND AND SUBSEQUENT ADDITIONAL 4" HDPE SDR-13.5 CONDUIT IN DIRECTIONAL BORE	60.000 LF				
0830	833001 BONDING AND GROUTING EXISTING JUNCTION WELL	2.000 EACH				
0840	834002 POLE BASE, TYPE 3A	5.000 EACH				
0850	834005 POLE BASE, TYPE 4A	12.000 EACH				
0860	834006 POLE BASE, TYPE 6	2.000 EACH				
0870	834007 POLE BASE EXTENSION	48.000 CF				
0880	834501 PARTIAL REMOVAL OF CONCRETE POLE BASES AND CABINET FOUNDATIONS	29.000 CY				
0890	835003 CABINET BASE TYPE P	4.000 EACH				

CONTRACT ID: T201906105.01 PROJECT(S): T201906105

All figures must be typewritten.

CONTRACTOR :

LINE NO	ITEM DESCRIPTION	APPROX. QUANTITY AND UNITS	UNIT PRICE		BID AMOUNT	
			DOLLARS	CTS	DOLLARS	CTS
0900	846001 FURNISH AND INSTALL LOOP WIRE 1-CONDUCTOR #14 AWG ENCASED IN 1/4" FLEXIBLE TUBING IN A LOOP SAWCUT	200.000 LF				
0910	851007 RELOCATED EXISTING LIGHT STANDARD	1.000 EACH				
0920	905004 INLET SEDIMENT CONTROL, DRAINAGE INLET	61.000 EACH				
0930	905005 INLET SEDIMENT CONTROL, CURB INLET	13.000 EACH				
0940	908004 TOPSOIL, 6" DEPTH	25.000 SY				
0950	908016 PERMANENT GRASS SEEDING, SUBDIVISION	15.000 SY				
	SECTION 0001 TOTAL					
	TOTAL BID					

CAN NOT BE
USED FOR
BIDDING

Contract No. T201906105.01



**AFFIDAVIT
OF
EMPLOYEE DRUG TESTING PROGRAM**

4104 Regulations for the Drug Testing of Contractor and Subcontractor Employees Working on Large Public Works Projects requires that Contractors and Subcontractors implement a program of mandatory drug testing for Employees who work on Large Public Works Contracts funded all or in part with public funds.

We hereby certify that we have in place or will implement during the entire term of the contract a Mandatory Drug Testing Program for our employees on the jobsite, including subcontractors, that complies with this regulation:

Contractor Name: _____

Contractor Address: _____

Authorized Representative (typed or printed): _____

Authorized Representative (signature): _____

Title: _____

Sworn to and Subscribed before me this _____ day of _____ 20____.

My Commission expires _____ . NOTARY PUBLIC _____ .

THIS PAGE MUST BE SIGNED, NOTARIZED, AND RETURNED WITH YOUR BID.

(This form is required from the prime contractor only, not required from subcontractors)

CERTIFICATION
Contract No. T201906105.01

The undersigned bidder, _____
whose address is _____
and telephone number is _____ hereby certifies the following:

I/We have carefully examined the location of the proposed work, the proposed plans and specifications, and will be bound, upon award of this contract by the Department of Transportation, to execute in accordance with such award, a contract with necessary surety bond, of which contract this proposal and said plans and specifications shall be a part, to provide all necessary machinery, tools, labor and other means of construction, and to do all the work and to furnish all the materials necessary to perform and complete the said contract within the time and as required in accordance with the requirements of the Department of Transportation, and at the unit prices for the various items as listed on the preceding pages.

The foregoing quantities are considered to be approximate only and are given as the basis for comparison of bids. The Department of Transportation may increase or decrease the amount of any item or portion of the work as may be deemed necessary or expedient. Any such increase or decrease in the quantity for any item will not be regarded as a sufficient ground for an increase or decrease in the unit prices, nor in the time allowed for the completion of the work, except as provided in the contract.

Accompanying this proposal is a surety bond or a security of the bidder assigned to the Department of Transportation, for at least ten (10) percentum of total amount of the proposal, which deposit is to be forfeited as liquidated damages in case this proposal is accepted, and the undersigned shall fail to execute a contract with necessary bond, when required, for the performance of said contract with the Department of Transportation, under the conditions of this proposal, within twenty (20) days after date of official notice of the award of the contract as provided in the requirement and specifications hereto attached; otherwise said deposit is to be returned to the undersigned.

I/We are licensed, or have initiated the license application as required by Section 2502, Chapter 25, Title 30, of the Delaware Code.

By submission of this proposal, each bidder and each person signing on behalf of any bidder, certifies as to its own organization, under penalty of perjury, that to the best of each signer's knowledge and belief:

1. The prices in this proposal have been arrived at independently without collusion, consultation, communication, or Agreement with any other bidder or with any competitor for the purpose of restricting competition.
2. Unless required by law, the prices which have been quoted in this proposal have not been knowingly disclosed and will not knowingly be disclosed by the bidder, directly or indirectly, to any other bidder or competitor prior to the opening of proposals.
3. No attempt has been made or will be made by the bidder to induce any other person, partnership, or corporation to submit or not to submit a proposal for the purpose of restricting competition.

=====
I/We acknowledge receipt and incorporation of addenda to this proposal as follows:

No.	Date								
_____	_____	_____	_____	_____	_____	_____	_____	_____	_____

BIDDERS MUST ACKNOWLEDGE RECEIPT OF ALL ADDENDA

MUST INSERT DATE OF FINAL QUESTIONS AND ANSWERS ON WEBSITE: _____



AFFIRMATION:

Within the past five (5) years, has your firm, any affiliate, any predecessor company or entity, owner, Director, officer, partner or proprietor been the subject of a Federal, State, Local government suspension or debarment?

YES _____ NO _____ if yes, please explain _____

Agreement to Accept Retainage

"Bidder acknowledges that if its Performance-Based Rating as defined in 29 Del.C. §6962 and section NEW 2408 of Title 2 of Delaware's Administrative Code is below the required minimum threshold, as a condition to bid, Bidder acknowledges, consents and agrees to the Department withholding retainage of up to 5% from the monies due at the time of each progress payment under the contract."

Sealed and dated this _____ day of _____ in the year of our Lord two thousand _____ (20____).

CAN NOT BE
USED FOR
BIDDING

Name of Bidder (Organization)

Corporate
Seal

By: _____
Authorized Signature

Attest _____

Title

SWORN TO AND SUBSCRIBED BEFORE ME this _____ day of _____, 20____.

Notary
Seal

Notary

BID BOND

TO ACCOMPANY PROPOSAL
(Not necessary if security is used)

KNOW ALL MEN BY THESE PRESENTS That: _____

of _____ in the County of _____ and State of _____
as **Principal**, and _____ of _____ in the County of _____
and State of _____ as **Surety**, legally authorized to do business in the
State of Delaware ("**State**"), are held and firmly bound unto the **State** in the sum of _____
Dollars (\$ _____), or _____ percent not to exceed _____

_____ Dollars (\$ _____) of amount of bid on
Contract No. T201906105.01 , to be paid to the **State** for the use and benefit of its Department of
Transportation ("**DelDOT**") for which payment well and truly to be made, we do bind ourselves, our and
each of our heirs, executors, administrators, and successors, jointly and severally for and in the whole
firmly by these presents.

NOW THE CONDITION OF THIS OBLIGATION IS SUCH That if the above bounden **Principal**
who has submitted to the **DelDOT** a certain proposal to enter into this contract for the furnishing of
certain materiel and/or services within the **State**, shall be awarded this Contract, and if said **Principal**
shall well and truly enter into and execute this Contract as may be required by the terms of this Contract
and approved by the **DelDOT**, this Contract to be entered into within twenty days after the date of official
notice of the award thereof in accordance with the terms of said proposal, then this obligation shall be
void or else to be and remain in full force and virtue.

Sealed with _____ seal and dated this _____ day of _____ in the year of our Lord
two thousand and _____ (20_____).

SEALED, AND DELIVERED IN THE
presence of

Name of Bidder (Organization)
Corporate Seal By: _____
Authorized Signature

Attest _____
Title

Name of **Surety**
Witness: _____ By: _____
Title